

**STORMWATER MANAGEMENT  
AND FUNCTIONAL SERVICING REPORT**

**FOR**

**560 WINSTON CHURCHILL  
BOULEVARD  
BLACKWOOD PARTNERS**

**TOWN OF OAKVILLE**

February 26, 2021  
November 25, 2021  
June 17, 2022  
Rev. August 17, 2023

a.m. candaras associates inc.  
8551 Weston Rd, Suite 203  
Woodbridge, Ontario  
L4L 9R4

Project No. 1870



a.m. candaras associates inc.  
consulting engineers

## TABLE OF CONTENTS

1.0	INTRODUCTION.....	1
2.0	DESIGN CRITERIA.....	2
3.0	SITE DEVELOPMENT STATISTICS .....	3
4.0	PRE-DEVELOPMENT STORMWATER FLOWS .....	5
5.0	STORMWATER MANAGEMENT .....	7
5.1	QUANTITY CONTROLS .....	7
5.2	QUALITY CONTROLS .....	10
5.3	SWM FACILITY OUTLET .....	11
6.0	UNCONTROLLED RUNOFF .....	11
6.1	UNCONTROLLED RUNOFF TO WINSTON CHURCHILL BOULEVARD .....	11
6.2	UNCONTROLLED RUNOFF TO CLEARVIEW CREEK.....	11
7.0	STORMWATER MANAGEMENT SUMMARY TABLES .....	12
8.0	STORM SEWERS .....	13
9.0	FLOODPLAIN MODIFICATION .....	14
9.1	PROPOSED GRADING.....	14
9.2	FLOOD LOSS STORAGE.....	14
9.3	CLEARVIEW CREEK FLOWS .....	17
9.4	PROPOSED CHANGE IN VELOCITIES .....	19
10.0	ROOF DRAIN .....	22
11.0	SANITARY DESIGN.....	24
11.1	SANITARY DESIGN FLOWS.....	24
11.2	PROPOSED SANITARY SERVICING .....	25
11.3	EXTERNAL SANITARY SERVICING .....	25
12.0	WATERMAIN DESIGN .....	26
12.1	DOMESTIC AND FIREFLOW DEMAND .....	26
12.2	EXTERNAL WATERMAIN SERVICING.....	28
13.0	EROSION AND SEDIMENT CONTROLS .....	29
13.1	EROSION CONTROL AND SEDIMENT CONTROL REQUIREMENTS.....	29
13.2	MONITORING PLAN .....	29

## LIST OF FIGURES

Figure 1 – Site Location Plan.....	Following Page 1
Figure 2 – Existing Land Use.....	Following Page 1
Figure 3 – SWMP Discharge Drainage Path .....	Following Page 11

## LIST OF APPENDICES

APPENDIX A – REFERENCE DOCUMENTS

APPENDIX B – SWMHYMO SIMULATION OUTPUT

APPENDIX C – SWM FACILITY CALCULATIONS

APPENDIX D – HEC-RAS MODEL TABLES

APPENDIX E – SANITARY SERVICING (ALTERNATIVE 3)

## LIST OF PLANS

G-1.....	Site Servicing and Stormwater Management Plan - North
G-2.....	Site Servicing and Stormwater Management Plan - South
G-3.....	Grading Plan -North
G-4.....	Grading Plan - South
C-1.....	Stormwater Management Plan Detials
ESC-1 .....	Sediment and Erosion Control Plan
ESC-2 .....	Sediment and Erosion Control Plan
STM-1.....	Storm Drainage Area Plan

## 1.0 INTRODUCTION

This report presents the site servicing and stormwater management analysis for the Blackwood site located at 560 Winston Churchill Boulevard, north of Deer Run Ave in the Town of Oakville as shown on Figure 1. The total site area is 12.93 ha which will be developed as three Industrial Warehouses and a stormwater management pond.


Stormwater management will be provided within a quality/quantity wet pond facility (0.87 ha), that will be constructed at the southeast portion of the site as shown on Plan G-1.

A Subwatershed Study was completed by McCormick Rankin Corporation (MRC) for the Clearview Creek in May 2007 which established pre-development flow rates. In the 2007 Clearview Creek Subwatershed Study a 4.0 ha site was identified as being part of Subcatchment 5, which had a total area of 24.2 ha. The drainage limits of Subcatchment 5, as delineated in the 2007 Clearview Creek Subwatershed Study, is referenced in Figure 2, with further details of Subcatchment 5 and the related pre-development flow rates provided in Appendix A.

The whole site area will be controlled to the balance of the allowable area of 8.93 ha (12.93 ha – 4.0 ha) and will drain to the southeast and discharge to the ditch along the west side of Winston Churchill Boulevard.





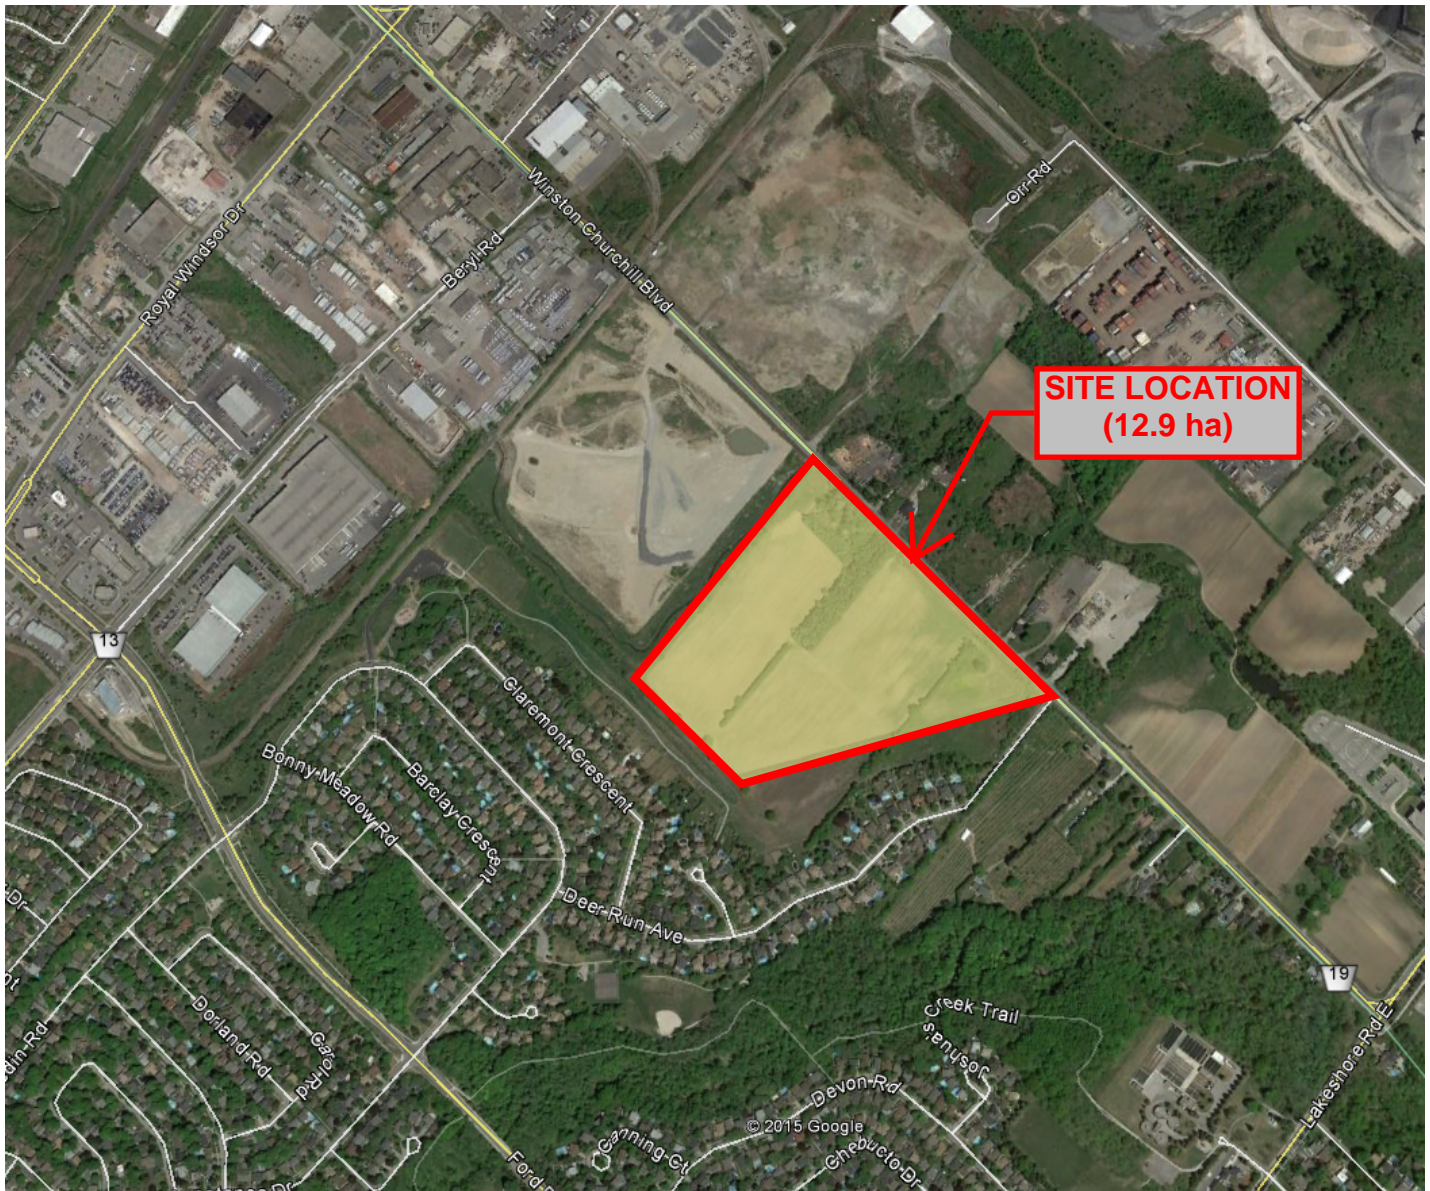

# SITE LOCATION PLAN FIGURE 1



a.m.candaras associates inc.  
consulting engineers  
8551 Weston rd., suite 203  
Woodbridge ont. L4L 9R4  
905-850-8020 Fax 905-850-8099  
Email: civil@amcai.com


560 Winston Churchill Blvd.  
Town of Oakville

Blackwood Partners

Date: July 11, 2019

Job No.: 1870



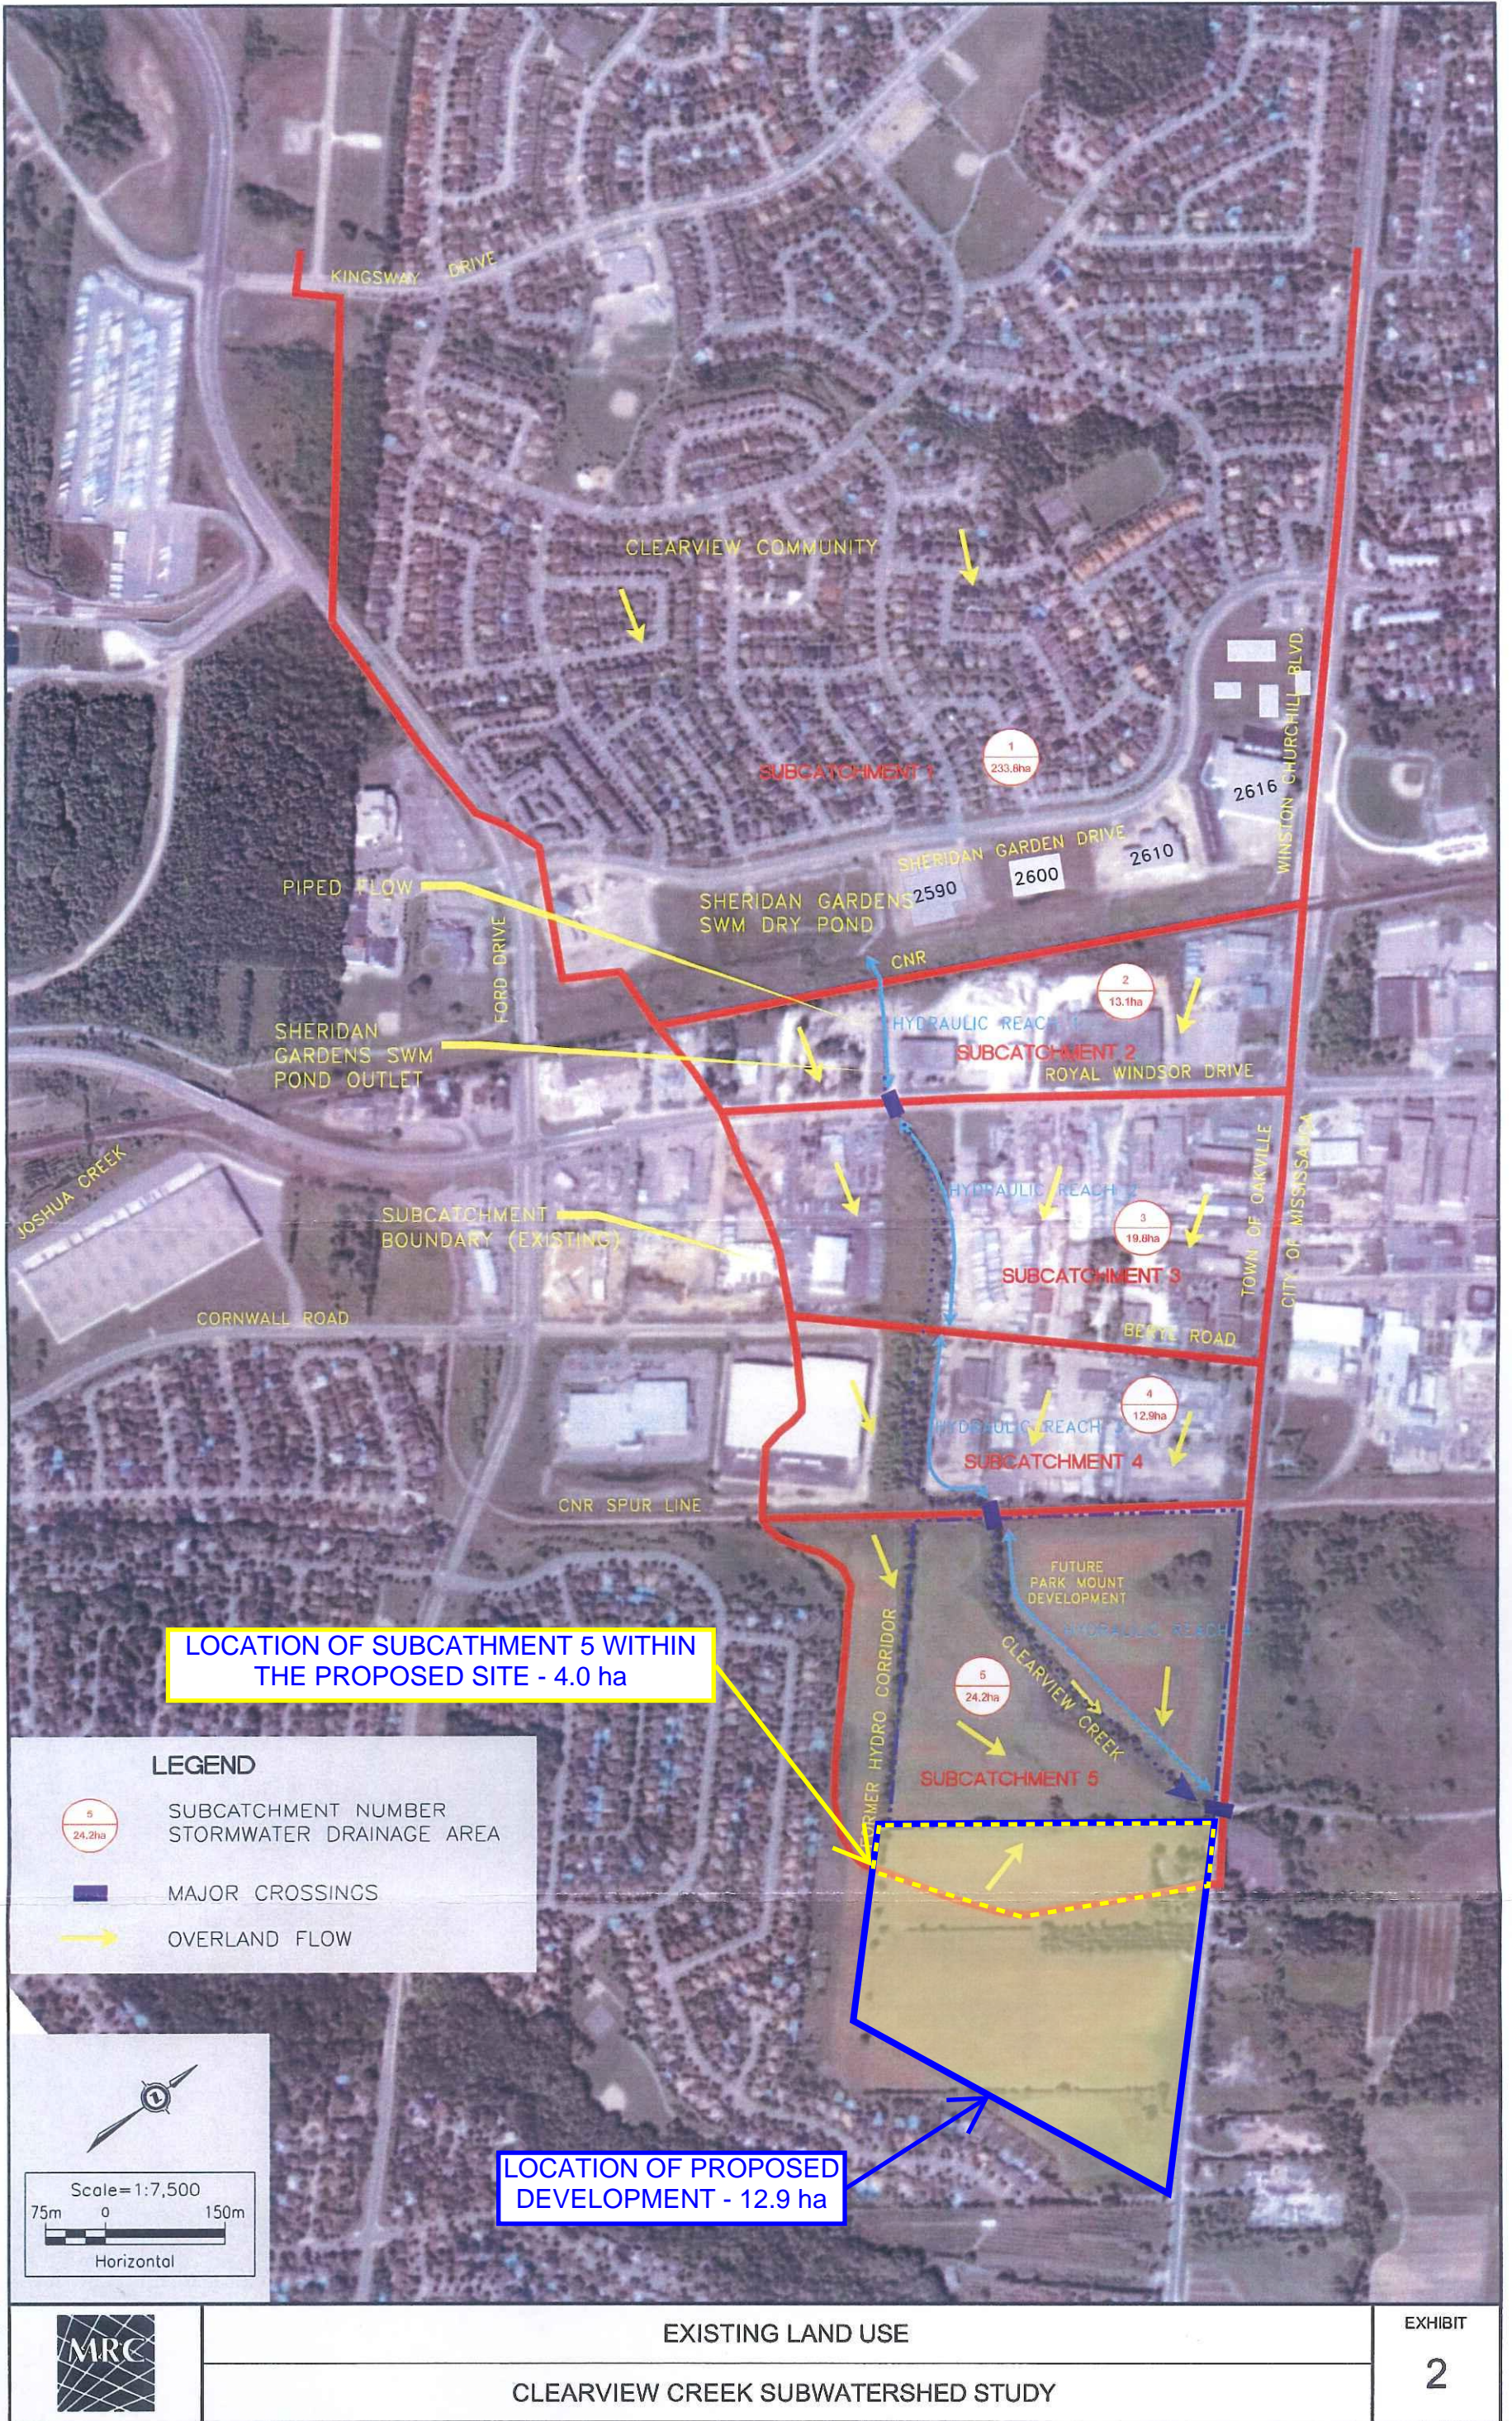

MODIFIED: 07/03/15 16:07:54 DRAWING NAME: K5470-EXISTING LANDUSE.DWG

MODIFIED BY A.M. CANDARAS & ASSOCIATES INC.  
DATE: July 16, 2019

**FIGURE 2**



## 2.0 DESIGN CRITERIA

1. Maximum allowable stormwater discharge to be limited to pre-development flows.
2. On-site detention must be provided to attenuate post development peak flows to the pre-development rates for storms up to and including the 100-year storm.
3. Stormwater quality controls to be based on Type 1 Enhanced Protection (80% TSS removal) as per the MOE Stormwater Management Planning and Design Manual (2003).



### 3.0 SITE DEVELOPMENT STATISTICS

The development site will be separated into two areas for the stormwater analysis:

- Roof area of 5.91 ha to have rooftop controls, and drain to the SWM Pond
- Building/Paved/Parking/Landscaped areas of 11.69 ha to the proposed SWM pond at southeast portion of site

The proposed site conditions consist of three industrial buildings, a stormwater management pond plus paved and landscaped areas. The site statistics are provided below:

Building A	=	16,206.0m <sup>2</sup>
Building B	=	12,791.0m <sup>2</sup>
Building C	=	30,082.0m <sup>2</sup>
Paved	=	39,454.0m <sup>2</sup>
Landscaped:	=	22,079.0m <sup>2</sup>
SWM Pond:	=	<u>8,700.0m<sup>2</sup></u>
Site Area	=	<u>129,312.0m<sup>2</sup></u>

The stormwater analysis for the site has been completed using the SWMHYMO model. The subcatchment areas used in the model calculations are summarized in Table 1.



*Table 1 - Proposed Development Land Use*

<b>Subcatchment ID</b>	<b>Post-Development Land Use Type</b>	<b>Area</b>
1	Building, Paved and Landscaped Areas	116,912 m <sup>2</sup>
2	Stormwater Management Pond	8,700 m <sup>2</sup>
3	Uncontrolled Area Discharged to Winston Churchill Boulevard	1,400 m <sup>2</sup>
4	Uncontrolled Area Discharged to the Clearview Creek Channel	2,300 m <sup>2</sup>
<b>TOTAL</b>		<b>129,312 m<sup>2</sup></b>



## 4.0 PRE-DEVELOPMENT STORMWATER FLOWS

The allowable discharge rates will be limited to the pre-development values which are indicated in Table 2, based on the Chicago Storm (Bloor St. Data). The pre-development rates listed in Table 2 below are based on the stormwater flow rates provided by the 2007 Clearview Creek Subwatershed Study (see Appendix A). The pre-development rates for the site area of 12.93 ha is the pro rata flow rate of total subcatchment area (24.2 ha) discharging to the Clearview Creek realignment.



*Table 2 – Calculated Pre-Development Flow Rates Based On Total Area*

Storm Event	Pre-Development Pro-Rated Target Rate [m <sup>3</sup> /s]		
	Area (24.2 ha) <sup>(1)</sup>	Area (4.0 ha) <sup>(1)</sup>	Area (8.93 ha)
2 Year	0.155	0.026	0.057
5 Year	0.300	0.050	0.111
10 Year	0.413	0.068	0.152
25 Year	0.540	0.089	0.199
100 Year	0.869	0.144	0.321

(1) Flow rates from Clearview Creek subwatershed study prepared by MRC



## 5.0 STORMWATER MANAGEMENT

The total drainage area to the SWM Facility is 12.55 ha, which does not include the uncontrolled areas (0.38 ha) outlined in Table 1. A 0.87 ha stormwater management wet pond will provide both quality and quantity controls, refer to Plan G-1 and G-3 for the design layout and details. Refer to Appendix C for the SWM Facility calculations.

### 5.1 QUANTITY CONTROLS

A proposed permanent pool elevation for this facility is 91.10m. The proposed stage storage relationship for this facility is shown in Table 3. A permanent pool volume of 3,045.1m<sup>3</sup> will be provided between the pond bottom of 90.00m and 91.10m elevations. An erosion control volume of 3,146.2m<sup>3</sup> will be provided between the 91.10m and 91.90m elevations.

For this facility, a 125mm orifice will be installed with an invert elevation of 91.10m. The erosion control volume will be released over a period of 61.1 hours at a peak release rate of 0.025m<sup>3</sup>/s. A 175mm weir at elevation 91.90m will provide the quantity controls as detailed on Plan G-1, G-3 and C-1. Refer to Table 4 for the SWM pond performance.





Table 3 - SWM Pond Stage Storage Discharge Relationship

	AREA (m <sup>2</sup> )		VOLUME (m <sup>3</sup> )			DISCHARGE (m <sup>3</sup> ) AND HEAD (m)								
Elevation	Pond	Forebay	Pond	Forebay	Total	Effective	Orifice <sup>(1)</sup>	Orifice Head	Weir 1 <sup>(2)</sup>	Weir 1 Head	Weir 2 <sup>(3)</sup>	Weir 2 Head	Discharge (m <sup>3</sup> /s)	Storage (ha*m)
90.00	1,231.00	826.0	0.0	0.0	0.0								0.0000	0.0000
90.20	1,342.00	948.00	257.3	177.4	434.7								0.0000	0.0000
90.40	1,453.00	1070.0	536.8	379.2	916.0								0.0000	0.0000
90.60	1,624.85	1,193.85	844.6	605.6	1,450.2								0.0000	0.0000
90.80	1,796.69	1,317.69	1,186.7	856.7	2,043.5								0.0000	0.0000
90.90	1,882.62	1,379.62	1,370.7	991.6	2,362.3								0.0000	0.0000
91.00	1,968.54	1,441.54	1,563.3	1132.7	2,695.9	0.0							0.0000	0.0000
91.10	2,054.46	1,520.00	1,764.4	1280.7	3,045.1	0.0	0.0000	0.00	0.0000	0.00			0.0000	0.0000
91.30	2,226.31	1,627.31	2,192.5	1595.5	3,788.0	742.8	0.0127	0.20	0.0000	0.00			0.0127	0.0743
91.50	2,398.15	1,751.15	2,654.9	1933.3	4,588.2	1,543.1	0.0199	0.40	0.0000	0.00			0.0199	0.1543
91.70	2,570.00	1,875.00	3,151.8	2295.9	5,447.7	2,402.5	0.0251	0.60	0.0000	0.00			0.0251	0.2403
91.90	4,867.00	0.0	3,895.5	2295.9	6,191.4	3,146.2	0.0294	0.80	0.0000	0.00			0.0294	0.3146
92.10	5,057.38	0.0	4,887.9	2295.9	7,183.8	4,138.7	0.0332	1.00	0.0267	0.20			0.0598	0.4139
92.30	5,247.75	0.0	5,918.4	2295.9	8,214.3	5,169.2	0.0365	1.20	0.0755	0.40			0.1120	0.5169
92.50	5,438.13	0.0	6,987.0	2295.9	9,282.9	6,237.8	0.0396	1.40	0.1387	0.60			0.1783	0.6238
92.70	5,628.50	0.0	8,093.7	2295.9	10,389.6	7,344.4	0.0425	1.60	0.2135	0.80			0.2560	0.7344
93.00	5,914.06	0.0	9,825.0	2295.9	12,121.0	9,075.8	0.0464	1.90	0.3442	1.10	0.000	0.00	0.3907	0.9076
93.20	6,104.44	0.0	11,026.9	2295.9	13,322.8	10,277.7	0.0489	2.10	0.4423	1.30	1.830	0.20	2.3211	1.0278
93.30	6,199.63	0.0	11,642.1	2295.9	13,938.0	10,892.9	0.0501	2.20	0.4943	1.40	3.362	0.30	3.9062	1.0893
93.40	6,294.81	0.0	12,266.8	2295.9	14,562.7	11,517.6	0.0512	2.30	0.5481	1.50	5.176	0.40	5.7754	1.1518
93.50	6,390.00	0.0	12,901.1	2295.9	15,197.0	12,151.8	0.0524	2.40	0.6039	1.60	7.234	0.50	7.8899	1.2152

1. Based on an 125mm orifice set at Permanent HWL = 91.10,  $Q=CA\sqrt{2gh}$
2. Based on a 175mm weir at Inv. 91.90,  $Q=CLH^{3/2}$
3. Based on an emergency overflow weir at Inv. 93.00, 12.00m wide,  $Q=CLH^{3/2}$

*Table 4 – Stormwater Management Pond Performance*

Storm	Inflow (m <sup>3</sup> /s)	Outflow (m <sup>3</sup> /s)	Pre-Development Flow Rates (m <sup>3</sup> /s)	Storage (m <sup>3</sup> )	Pond HWL
2 Year	2.495	0.036	0.057	3,378	91.95
5 Year	3.469	0.074	0.111	4,410	92.15
10 Year	4.175	0.106	0.152	5,041	92.28
25 Year	4.945	0.143	0.199	5,667	92.39
100 Year	6.350	0.231	0.321	6,985	92.64
100 Year 24Hr SCS	3.677	0.269	0.321	4,505	92.73
Regional	1.832	1.813		9,961	93.15



## 5.2 QUALITY CONTROLS

For the proposed development, stormwater quality controls are to be provided within the SWM facility. The Clearview Creek subwatershed study prepared by MRC has stipulated design guidelines that are in agreement with the Stormwater Management Practices Planning and Design Manual (2003) (SWMP) as published by the Ontario Ministry of the Environment. The proposed facility will provide an Enhanced Protection Level.

Based on the site coverage values the imperviousness of the site directed to the pond is calculated as follows:

*Table 5 – Impervious Calculations*

Post-Development Land Use Type	Imperviousness	Total Area	Impervious Area
Building 1	100%	16, 218 m <sup>2</sup>	16,218 m <sup>2</sup>
Building 2	100%	12,791 m <sup>2</sup>	12,791 m <sup>2</sup>
Building 3	100%	30,082 m <sup>2</sup>	30,082 m <sup>2</sup>
Paved	100%	39,442 m <sup>2</sup>	39,442 m <sup>2</sup>
Landscaped / Seeded Area	0%	18,279 m <sup>2</sup> <sup>(1)</sup>	0 m <sup>2</sup>
Stormwater Management Pond	50%	8,700 m <sup>2</sup>	4,350 m <sup>2</sup>
<b>TOTAL</b>	<b>82% (weighted)</b>	<b>125,512 m<sup>2</sup> <sup>(2)</sup></b>	<b>102,883 m<sup>2</sup></b>

(1) The landscaped area does not include the uncontrolled areas outlined in Table 1. Landscaped Area = Total Landscaped Area – Uncontrolled Areas = 22,079m<sup>2</sup> – 3,800m<sup>2</sup> = 18,279m<sup>2</sup>.

(2) Total Pond Tributary Area does not include the uncontrolled areas (3,700m<sup>2</sup>). Total Area = 129,312m<sup>2</sup> (total site area) – 3,800m<sup>2</sup> (uncontrolled area) = 125,512m<sup>2</sup>.

Based on 85% imperviousness a permanent storage volume of 250m<sup>3</sup>/ha is required to provide Enhanced Protection.

*Table 6 - SWM Facility - Stormwater Quality Requirements*

Area	Imperviousness	Permanent Pool
12.55ha	85%	210m <sup>3</sup> /ha <sup>(1)</sup>
	Required:	2,65.5m <sup>3</sup>
	Provided:	3,045.1m <sup>3</sup>
	Elevation:	91.10m

(1) MOE SWM Planning and Design Manual for a wet pond based on 85% imperviousness. (250m<sup>3</sup>/ha – 40m<sup>3</sup>/ha active storage)



### 5.3 SWM FACILITY OUTLET

The proposed SWM facility located at the southeast corner of the site will discharge into the existing ditch along the west side of Winston Churchill Boulevard. As shown on Plan G-1 and Figure 3, the existing ditch flows south through an existing 600mm culvert.

The runoff will continue downstream to a low point where the runoff is conveyed east under Winston Churchill Boulevard through two existing 20.8m long 900mm culvert with a 0.25% slope. The runoff continues northeast through a drainage path that leads to the Clearview Creek. Therefore, the site will discharge to the ditch along Winston Churchill Boulevard and continue through an existing drainage path into the Clearview Creek.

## 6.0 UNCONTROLLED RUNOFF

There are multiple landscaped areas that will discharge uncontrolled on to two different locations which include Winston Churchill Boulevard and the Clearview Creek. The combined uncontrolled discharge volumes in addition to the SWMP discharge rates are below the pre-development flow rates outlined in Table 2. Refer to Plan STM-1 for the post development storm drainage area plan.

### 6.1 UNCONTROLLED RUNOFF TO WINSTON CHURCHILL BOULEVARD

The uncontrolled runoff from a portion of the landscaped frontage facing Winston Churchill Boulevard and a portion of the two driveway entrances (0.14 ha) will discharge onto Winston Churchill Boulevard. The uncontrolled discharge is in addition to the controlled discharge from the SWMP on site. The runoff for a 2-year to 100-year rainfall event was modelled using SWMHYMO. The results are displayed in Table 7 below.

### 6.2 UNCONTROLLED RUNOFF TO CLEARVIEW CREEK

The uncontrolled runoff from the landscaped area along the north side of the site (0.24 ha) will discharge into the Clearview Creek. The uncontrolled runoff for a 2-year to 100-year rainfall event was modelled using SWMHYMO. The results are displayed in Table 7.









## 7.0 STORMWATER MANAGEMENT SUMMARY TABLES

Table 7 - Total Site Discharge Flows to the Winston Churchill Boulevard Ditch

Storm	SWMP Discharge Flows <sup>(1)</sup> (m <sup>3</sup> /s)	Uncontrolled to Winston Churchill Boulevard (m <sup>3</sup> /s)	Total Site Discharge Flows <sup>(2)</sup> (m <sup>3</sup> /s)	Pre-Development Flow Rates <sup>(3)</sup> (m <sup>3</sup> /s)
2 Year	0.036	0.009	0.037	0.057
5 Year	0.074	0.015	0.074	0.111
10 Year	0.106	0.020	0.106	0.152
25 Year	0.143	0.026	0.144	0.199
100 Year	0.231	0.038	0.233	0.321
100 Year 24Hr SCS	0.269	0.028	0.272	0.321
Regional	1.813	0.020	1.832	-

(1) Refer to Table 4 for the SWMP outflow rates for the 2-Year to 100-Year rainfall event.

(2) Refer to SWMHYMO output In Appendix B for total site discharge flows.

(3) Pre-Development Flow Rates are based on the 8.93ha pro-rated target rates from Table 2 in Section 4.0 of this report.

Table 8 - Clearview Creek Discharge Flows

Storm	Uncontrolled Discharge to Clearview Creek <sup>(1)</sup> (m <sup>3</sup> /s)	Pre-Development Flow Rates <sup>(2)</sup> (m <sup>3</sup> /s)
2 Year	0.005	0.026
5 Year	0.010	0.050
10 Year	0.013	0.068
25 Year	0.018	0.089
100 Year	0.028	0.144
100 Year SCS	0.031	0.144

(1) Refer to SWMHYMO output In Appendix B for discharge flows.

(2) Pre-Development Flow Rates are based on the 4.0ha pro-rated target rates from Table 2 in Section 4.0 of this report.

As demonstrated above the post-development flow rates are below the allowable pre-development pro-rated target rates from Table 2 in Section 4.0 of this report.



## 8.0 STORM SEWERS

All entrances to the site and a portion of the landscape frontage along Winston Churchill Boulevard will include a storm sewer network that has been sized for the 100-Year event, refer to Plan G-1, G-3 and the storm sewer design sheet in Appendix A for details. Due to the existing grades in these areas the runoff from the 100-year storm cannot be conveyed overland to the SWM pond. Instead, the runoff will be conveyed using CB's and storm sewer pipes sized to capture and convey the 100-year storm event to the SWM pond.

The storm sewer network on site, other than the network outline above, has been sized to capture and convey the 5-year storm event with an intensity based on a time of concentration (Tc) of 10 minutes. Refer to Plan G-1, G-2 and the storm sewer design sheets for details.



## 9.0 FLOODPLAIN MODIFICATION

Currently a portion of the property approximately 0.29 ha located within the northeast corner of the site is part of the Clearview Creek Floodplain limits. As part of this development, it is being proposed that this area be built up to an elevation of 94.00m while matching the existing grades along the north property line.

Using the Clearview Creek HEC-RAS model (dated May 2020) provided by the Credit Valley Conservation (CVC) and following the CVC Standard Parameters a floodplain analysis was completed. The CVC Standard Parameters have not been altered but channel elevations and sloping changes were made from Section 11915 to Section 11802. The Sections were modified to show the proposed grading that take place on the 560 Winston Churchill Boulevard only. The proposed grading would start from the existing property line elevations followed by a 3:1 slope. The output model table compares the existing and modified HEC-RAS model high water elevations, refer to Appendix D for tables. The results indicated no changes to the existing high water elevations with the proposed channel modifications.

### 9.1 PROPOSED GRADING

The proposed channel grading will take place on the 560 Winston Churchill Boulevard property only, there will be no grading within the existing 40m wide Clearview Creek channel corridor. The existing elevations along the property line will remain followed by a 3:1 slope up to a minimum grade of 94.00m. Where grading cannot be achieved by sloping a gravity retaining wall with an integrated traffic barrier will be provided as shown on Plan G-3.

### 9.2 FLOOD LOSS STORAGE

As a result of the proposed grading and filling within the 560 Winston Churchill Blvd. property there will be a loss of flood storage. Refer to **Table 9** below which summarizes the loss of flood storage from the existing to the proposed conditions for the 2-year to 100-year and Regional storm events.





Table 9 - Clearview Creek Flood Loss Storage

Station	Storm	CVC Existing HEC-RAS Model Difference in Storage (1000 m <sup>3</sup> )	CVC Future HEC-RAS Model Difference in Storage (1000 m <sup>3</sup> )
11915	2 YR	0	0.01
	5 YR	0	0.06
	10 YR	0.06	-0.01
	25YR	0	0
	50 YR	0	-0.02
	100 YR	0	0.01
	Regional	-0.05	-0.01
11902	2 YR	0.01	0.03
	5 YR	0	0.06
	10 YR	0.03	-0.03
	25YR	-0.05	-0.06
	50 YR	-0.07	-0.18
	100 YR	-0.21	-0.37
	Regional	-2.05	-2.05
11895	2 YR	0	0.02
	5 YR	0.01	0.06
	10 YR	0.03	-0.03
	25YR	-0.05	-0.06
	50 YR	-0.07	-0.18
	100 YR	-0.21	-0.36
	Regional	-1.99	-1.99
11856	2 YR	0	0.02
	5 YR	0.01	0.07
	10 YR	0.05	-0.01
	25YR	-0.01	-0.05
	50 YR	-0.07	-0.17
	100 YR	-0.19	-0.31
	Regional	-1.49	-1.48



Table 9 – Clearview Creek Flood Loss Storage Continued

Station	Storm	CVC Existing HEC-RAS Model Difference in Storage (1000 m³)	CVC Future HEC-RAS Model Difference in Storage (1000 m³)
11838	2 YR	0	0.02
	5 YR	0	0.06
	10 YR	0.06	-0.01
	25YR	-0.01	-0.06
	50 YR	-0.07	-0.16
	100 YR	-0.18	-0.26
	Regional	-1.21	-1.19
11832	2 YR	0	0.02
	5 YR	0	0.06
	10 YR	0.05	-0.01
	25YR	0	-0.06
	50 YR	-0.07	-0.15
	100 YR	-0.17	-0.24
	Regional	-1.06	-1.05
11815	2 YR	-0.01	0.01
	5 YR	-0.01	0.05
	10 YR	0.05	-0.02
	25YR	-0.01	-0.05
	50 YR	-0.06	-0.12
	100 YR	-0.11	-0.14
	Regional	-0.64	-0.62
11802	2 YR	0	0.02
	5 YR	0	0.05
	10 YR	0.05	-0.02
	25YR	0	-0.02
	50 YR	-0.02	-0.05
	100 YR	-0.03	-0.03
	Regional	-0.20	-0.19



### 9.3 CLEARVIEW CREEK FLOWS

As discussed in Section 4.0, 5.0 and 6.0 of this report the 560 Winston Churchill Boulevard site will control the post-development flows down to the pro-rated pre-development flows as outlined in **Table 2**. The site has a drainage divide where 8.93 ha currently drains towards the existing ditch along the west side of Winston Churchill Blvd. and the remaining 4.0 ha drains towards the Clearview Creek.

This site is self-contained except for a portion of paved and landscaped areas (0.14ha) along the east limits of the site which flows uncontrolled to the existing Winston Churchill Blvd. ditch and a landscaped area (0.24ha) along the north limits of the site which flows uncontrolled into the Clearview Creek. The on-site stormwater management pond is overcontrolling the flows from the site to ensure the stormwater flows leaving the site, both the controlled stormwater management pond flows and the uncontrolled flows to Winston Churchill Blvd. ditch, are below the pro-rated pre-development flow rates as outlined in **Table 10** below. In addition, the uncontrolled landscaped area (0.24 ha) along the north limits of the site will continue to drain towards the Clearview Creek. These flows draining towards the Clearview Creek will be below the pro-rated pre-development flow rate as outlined in **Table 11** below.

The total flows provided in the HEC-RAS model have already accounted for the pre-development flows from this site and therefore, will remain the same since the stormwater flows leaving the site are below the pro-rated pre-development flow rate.

Table 10 - Total Site Discharge Flows to the Winston Churchill Boulevard Ditch

Storm	SWMP Discharge Flows <sup>(1)</sup> (m <sup>3</sup> /s)	Uncontrolled to Winston Churchill Boulevard (m <sup>3</sup> /s)	Total Site Discharge Flows <sup>(2)</sup> (m <sup>3</sup> /s)	Pre-Development Flow Rates <sup>(3)</sup> (m <sup>3</sup> /s)
2 Year	0.036	0.009	0.037	0.057
5 Year	0.074	0.015	0.074	0.111
10 Year	0.106	0.020	0.106	0.152
25 Year	0.143	0.026	0.144	0.199
100 Year	0.231	0.038	0.233	0.321
100 Year 24Hr SCS	0.269	0.028	0.272	0.321
Regional	1.813	0.020	1.832	-

(1) Refer to Table 4 for the SWMP outflow rates for the 2-Year to 100-Year rainfall event.

(2) Refer to SWMHYMO output in Appendix B for total site discharge flows.

(3) Pre-Development Flow Rates are based on the 8.93ha pro-rated target rates from Table 2 in Section 4.0 of this report.



Table 11 - Clearview Creek Discharge Flows

Storm	Uncontrolled Discharge to Clearview Creek <sup>(1)</sup> (m <sup>3</sup> /s)	Pre-Development Flow Rates <sup>(2)</sup> (m <sup>3</sup> /s)
2 Year	0.005	0.026
5 Year	0.010	0.050
10 Year	0.013	0.068
25 Year	0.018	0.089
100 Year	0.028	0.144
100 Year SCS	0.031	0.144

(1) Refer to SWMHYMO output In Appendix B for discharge flows.

(2) Pre-Development Flow Rates are based on the 4.0ha pro-rated target rates from Table 2 in Section 4.0 of this report.

Table 12 - Clearview Creek Total Discharge Flows

Storm	SWMP Discharge Flows <sup>(1)</sup> (m <sup>3</sup> /s)	Uncontrolled to Winston Churchill Boulevard (m <sup>3</sup> /s)	Uncontrolled Discharge to Clearview Creek <sup>(2)</sup> (m <sup>3</sup> /s)	Total Site Discharge Flows <sup>(3)</sup> (m <sup>3</sup> /s)	Pre-Development Flow Rates <sup>(2)</sup> (m <sup>3</sup> /s)
2 Year	0.036	0.009	0.005	0.050	0.083
5 Year	0.074	0.015	0.010	0.099	0.161
10 Year	0.106	0.020	0.013	0.139	0.220
25 Year	0.143	0.026	0.018	0.187	0.288
100 Year	0.231	0.038	0.028	0.297	0.465
100 Year SCS	0.269	0.028	0.031	0.328	0.465

(1) Refer to Table 4 for the SWMP outflow rates for the 2-Year to 100-Year rainfall event.

(2) Refer to SWMHYMO output In Appendix B for total site discharge flows.

(3) Total Site Discharge = SWMP Flows + Uncontrolled to Winston Churchill Blvd. + Uncontrolled to Clearview Creek  
 Total Site Discharge (2-year) = 0.036 m<sup>3</sup>/s + 0.009 m<sup>3</sup>/s + 0.005 m<sup>3</sup>/s = 0.050 m<sup>3</sup>/s

(4) Total Site Pre-Development Flow Rate = (Pre-Development Flow Rates are based on the 8.93ha pro-rated target rates from Table 10) + (Pre-Development Flow Rates are based on the 4.0ha pro-rated target rates from Table 11)  
 Total Site Pre-Development Flow Rate = 0.057 m<sup>3</sup>/s + 0.026 m<sup>3</sup>/s = 0.083 m<sup>3</sup>/s



## 9.4 PROPOSED CHANGE IN VELOCITIES

The proposed channel grading work will result in a change of velocities which range from a decrease in velocity of 0.19 m/s, for the 25-year existing storm at Station 11815, to an increase in velocity of 0.31 m/s, for the Regional storm at Station 11802. The maximum permissible velocity based on the MTO Chart D5-13B for grass mixture channels is 1.22-1.52m/s. Therefore, while there is an increase in velocity at Station 11802 the velocity of 1.12 m/s achieves non-erosive velocity when compared to the MTO Chart. In addition, other already constructed and functioning sections upstream of the proposed works have a Regional velocity greater than 1.12m/s and show no erosive impacts. For example, Station 12053 has a Regional velocity of 1.41 m/s and Station 12316 has a Regional velocity of 2.12 m/s and show no erosive impacts. Refer to **Table 12** below which summarizes the changes in velocity from the existing to the proposed conditions for the 2-year to 100-year and Regional storm events.

Table 13 - Clearview Creek Change in Velocity

Station	Storm	CVC Existing HEC-RAS Model			CVC Future HEC-RAS Model		
		Existing Channel Velocity (m/s)	Proposed Channel Velocity (m/s)	Difference in Channel Velocity (m/s)	Existing Channel Velocity (m/s)	Proposed Channel Velocity (m/s)	Difference in Channel Velocity (m/s)
11915	2 YR	0.86	0.86	0.00	0.88	0.88	0.00
	5 YR	1.02	1.03	0.01	1.05	1.06	0.01
	10 YR	1.13	1.14	0.01	1.16	1.16	0.00
	25YR	1.21	1.21	0.00	1.23	1.23	0.00
	50 YR	1.28	1.27	-0.01	1.29	1.28	-0.01
	100 YR	1.32	1.30	-0.02	1.24	1.22	-0.02
	Regional	1.18	1.17	-0.01	1.18	1.16	-0.02
11902	2 YR	0.76	0.76	0.00	0.78	0.79	0.01
	5 YR	0.91	0.92	0.01	0.94	0.95	0.01
	10 YR	1.02	1.03	0.01	1.04	1.05	0.01
	25YR	1.09	1.10	0.01	1.12	1.13	0.01
	50 YR	1.17	1.17	0.00	1.18	1.18	0.00
	100 YR	1.21	1.21	0.00	1.13	1.14	0.01
	Regional	1.09	1.12	0.03	1.08	1.12	0.04



Table 12 – Clearview Creek Change in Velocity Continued

Station	Storm	CVC Existing HEC-RAS Model			CVC Future HEC-RAS Model		
		Existing Channel Velocity (m/s)	Proposed Channel Velocity (m/s)	Difference in Channel Velocity (m/s)	Existing Channel Velocity (m/s)	Proposed Channel Velocity (m/s)	Difference in Channel Velocity (m/s)
11895	2 YR	1.51	1.51	0.00	1.51	1.52	0.01
	5 YR	1.69	1.73	0.04	1.72	1.77	0.05
	10 YR	1.80	1.88	0.08	1.83	1.91	0.08
	25YR	1.86	1.96	0.10	1.81	1.83	0.02
	50 YR	1.82	1.84	0.02	1.65	1.66	0.01
	100 YR	1.61	1.63	0.02	1.37	1.40	0.03
	Regional	1.11	1.19	0.08	1.10	1.19	0.09
11856	2 YR	0.87	0.87	0.00	0.88	0.89	0.01
	5 YR	1.04	1.05	0.01	1.07	1.09	0.02
	10 YR	1.17	1.18	0.01	1.21	1.22	0.01
	25YR	1.25	1.29	0.04	1.23	1.20	-0.03
	50 YR	1.28	1.25	-0.03	1.19	1.16	-0.03
	100 YR	1.19	1.17	-0.02	1.05	1.04	-0.01
	Regional	0.89	1.04	0.15	0.89	1.04	0.15
11838	2 YR	0.93	0.92	-0.01	0.94	0.93	-0.01
	5 YR	1.10	1.09	-0.01	1.13	1.12	-0.01
	10 YR	1.22	1.21	-0.01	1.26	1.24	-0.02
	25YR	1.30	1.31	0.01	1.25	1.20	-0.05
	50 YR	1.31	1.25	-0.06	1.18	1.15	-0.03
	100 YR	1.17	1.16	-0.01	1.02	1.03	0.01
	Regional	0.85	1.05	0.20	0.84	1.05	0.21
11832	2 YR	1.34	1.34	0.00	1.31	1.29	-0.02
	5 YR	1.47	1.40	-0.07	1.46	1.37	-0.09
	10 YR	1.42	1.36	-0.06	1.47	1.37	-0.10
	25YR	1.45	1.41	-0.04	1.35	1.24	-0.11
	50 YR	1.40	1.28	-0.12	1.23	1.16	-0.07
	100 YR	1.19	1.16	-0.03	0.98	1.02	0.04
	Regional	0.81	1.03	0.22	0.80	1.03	0.23



Table 12 – Clearview Creek Change in Velocity Continued

Station	Storm	CVC Existing HEC-RAS Model			CVC Future HEC-RAS Model		
		Existing Channel Velocity (m/s)	Proposed Channel Velocity (m/s)	Difference in Channel Velocity (m/s)	Existing Channel Velocity (m/s)	Proposed Channel Velocity (m/s)	Difference in Channel Velocity (m/s)
11815	2 YR	1.62	1.62	0.00	1.37	1.35	-0.02
	5 YR	1.90	1.84	-0.06	1.64	1.56	-0.08
	10 YR	2.18	2.12	-0.06	1.76	1.65	-0.11
	25YR	2.18	1.99	-0.19	1.40	1.41	0.01
	50 YR	1.47	1.49	0.02	1.18	1.30	0.12
	100 YR	1.16	1.30	0.14	0.96	1.12	0.16
	Regional	0.82	1.13	0.31	0.82	1.12	0.30
11802	2 YR	0.88	0.88	0.00	0.88	0.88	0.00
	5 YR	0.93	0.94	0.01	0.91	0.94	0.03
	10 YR	0.93	0.96	0.03	0.90	0.95	0.05
	25YR	0.98	1.03	0.05	0.82	0.91	0.09
	50 YR	0.87	0.96	0.09	0.82	0.94	0.12
	100 YR	0.86	0.99	0.13	0.74	0.89	0.15
	Regional	0.80	1.10	0.30	0.81	1.12	0.31



## 10.0 ROOF DRAIN

The three proposed industrial buildings, Building A, Building B and Building C, will be equipped with roof drains as outlined below:

Building A will be equipped with of Zurn (Z-105-5-ERC) control flow drains with a total of 48 notches, as follows:

*Table 14 - Building A Rooftop Controls*

Area	No. of Notches	Notch Area	Flow per Notch <sup>(1)</sup>	Total Flows
16,218.9m <sup>2</sup>	48	337.9	1.55 l/s	74.4 l/s

**Q<sub>R</sub> = 74.4 l/s**

<sup>(1)</sup> Based on manufacturer's design tables at a 102mm depth, 1 notch/drain, 465m<sup>2</sup>/notch, 93lpm.

The resulting required total roof top 100-year volume is 595.1m<sup>3</sup>, as indicated in **Appendix A**. The available roof top storage is 809.4m<sup>3</sup>, based on a maximum ponding depth of 100mm, as indicated in the Rooftop Available Storage calculations located in **Appendix A**.

Building B will be equipped with Zurn (Z-105-5-ERC) control flow drains with a total of 39 notches, as follows:

*Table 15 - Building B Rooftop Controls*

Area	No. of Notches	Notch Area	Flow per Notch <sup>(1)</sup>	Total Flows
12,821.5m <sup>2</sup>	39	328.0	1.55 l/s	60.5

**Q<sub>R</sub> = 60.5 l/s**

<sup>(1)</sup> Based on manufacturer's design tables at a 102mm depth, 1 notch/drain, 465m<sup>2</sup>/notch, 93lpm.

The resulting required total roof top 100-year volume is 465.1m<sup>3</sup>, as indicated in **Appendix A**. The available roof top storage is 639.6m<sup>3</sup>, based on a maximum ponding depth of 100mm, as indicated in the Rooftop Available Storage calculations located in **Appendix A**.





Building C will be equipped with Zurn (Z-105-5-ERC) control flow drains with a total of 82 notches, as follows:

*Table 16 - Building C Rooftop Controls*

Area	No. of Notches	Notch Area	Flow per Notch <sup>(1)</sup>	Total Flows
30,087.4m <sup>2</sup>	82	366.9	1.55 l/s	127.1

$$Q_R = 127.1 \text{ l/s}$$

<sup>(1)</sup> Based on manufacturer's design tables at a 102mm depth, 1 notch/drain, 465m<sup>2</sup>/notch, 93lpm.

The resulting required total roof top 100-year volume is 1,131.4m<sup>3</sup>, as indicated in **Appendix A**. The available roof top storage is 1,500.6m<sup>3</sup>, based on a maximum ponding depth of 100mm, as indicated in the Rooftop Available Storage calculations located in **Appendix A**.



## 11.0 SANITARY DESIGN

### 11.1 SANITARY DESIGN FLOWS

The peak sanitary flow will discharge from the southwest side of Building A, Building B and Building C and connect to a lift station at MH 105A. At MH 105A a forcemain will be installed to convey the sanitary flows to MH 100A where it will connect to a proposed 250mm sanitary sewer which will be located in an easement to the west of the site and extended downstream through Acacia Court to the 750mm trunk sewer on Deer Run Avenue. For the external sanitary works outside of this site a separate FSR for the Industrial Developments located at 772, 560/570, 568 and 824 Winston Churchill Boulevard dated August 31, 2020 has been completed and submitted to the Town of Oakville and Halton Region for approval.

The population for Building A, Building B and Building C is based on the anticipated maximum employee population. Sanitary sewage flows were calculated below:

Site Area	=	12.93 ha
Population Density	=	125 persons/ha
Total Population	=	1,616 people
Sanitary Flow Rate	=	34.375 m <sup>3</sup> /ha/day
Peaking Factor M	=	$0.8 \cdot \left(1 + \frac{14}{4+P^{0.5}}\right)$ where P = Populations in thousands
	=	$0.8 \cdot \left(1 + \frac{14}{4+(1.616)^{0.5}}\right) = 2.93$
Peak Sewage Flow Q	=	$\frac{A \times q \times m}{86400} + IA$
	=	$\frac{12.93 \times 34.375 \text{ m}^3/\text{ha}/\text{day} \times 2.93}{86400}$
	=	15.1 l/s + IA
Infiltration	=	12.93 ha x 0.00028 m <sup>3</sup> /sec/ha
	=	0.0037 m <sup>3</sup> /sec
Total Peak Flow	=	15.1 l/s + 3.7 l/s
	=	18.8 l/s



## 11.2 PROPOSED SANITARY SERVICING

A 200mm sanitary service connection will be provided on site and connect downstream to the proposed 250mm sanitary sewer. The sanitary connection to the proposed 250mm sanitary sewer system will be a 100mm forcemain from MH 105A to MH 100A which will convey the combined sanitary flow of 18.8 l/s from Building A, B and C. The sanitary connection, from 568 Winston Churchill Boulevard, to the proposed 250mm sanitary sewer system will be a 150mm gravity sewer from MH 103A to MH 100A which will convey the sanitary flow from the residential property at 568 Winston Churchill Boulevard.

## 11.3 EXTERNAL SANITARY SERVICING

The existing single residential home at 568 Winston Churchill Boulevard will also be serviced through an 8.0m wide sanitary easement along the north and west portion of the site. A sanitary duplex grinder pump will be located on the northwest corner of the single residential lot, as shown on Plan G-1. This will convey the peak flow from this residential property through a forcemain that goes along the north and a sanitary gravity sewer along the west side of the proposed development where it connects to MH 100A. From MH 100A the sanitary sewer network connects to MH 6A on Acadia Court. This section of the sanitary network is to be completed by others. Refer to Plan G-2 for more details.

The sanitary servicing for the property west of the proposed development at 772 Winston Churchill Boulevard will be provided by a 250mm sanitary sewer from MH 4A to MH 1A. There is also an existing 400mm steel sleeve crossing the Clearview Creek channel within the 772 Winston Churchill Boulevard property limits.

As presented in the approved FSR of August 31, 2020 the preferred sanitary servicing (Alternative 4), as indicated in Figure 2 in Appendix E, for the proposed development at 560 Winston Churchill Boulevard includes the servicing of Building 'A', Building 'B', Building 'C' and the existing residential home at 568 Winston Churchill Boulevard will be through to Acadia Court and also services 772 Winston Churchill Boulevard

The Region of Halton staff reviewed the report of August 31, 2020 and had indicated that the preferred servicing option to service this site is to construct a gravity sanitary sewer through the Town of Oakville's open space block to the west of the property. The Region's servicing conditions reflect this servicing strategy. However, for the sanitary sewer servicing, the conditions are based on the assumption that a Regional easement can be obtained from the Town of Oakville over their open space block. Should the Town not allow a Regional easement over these lands then the proposed servicing of this site will have to be re-evaluated and another servicing alternative selected. A further alternative servicing option along Winston Churchill Boulevard to Beryl Road (Alternative 3) is presented in Appendix E.



## 12.0 WATERMAIN DESIGN

The proposed development will connect to a proposed 300mm watermain along Winston Churchill Boulevard. On site there will be a 150mm domestic and 200mm fire line pipe that connects to all three buildings, as shown on Plan G-1, G-1 and G-2. The watermain connection for Building A and Building C will be along the east side of the building and the connection for Building B will be along the west side of the building.

### 12.1 DOMESTIC AND FIREFLOW DEMAND

The domestic demands were based on the Water and Wastewater Linear Design Manual (October 2019) by Halton Region. The water demand for this site is outlined below:

Site Area	=	12.93 ha
Population Density	=	125 persons/ha (Light Industrial Area)
Total Population	=	1,616 people
Consumption	=	275 l/person/day
Max Day Factor	=	2.25
Peak Hour Factor	=	2.25

#### Water Demands

##### Average Daily Demand

$$\begin{aligned} &= 275 \text{ l/capita/day} \times 1,616 \text{ people} \\ &= 444,000 \text{ l/day} \\ &= 5.14 \text{ l/s} \end{aligned}$$

##### Maximum Daily Demand

$$\begin{aligned} &= 275 \text{ l/capita/day} \times 1,616 \text{ people} \times 2.25 \text{ (Max day factor)} \\ &= 999,900 \text{ l/day} \\ &= 11.57 \text{ l/s} \end{aligned}$$

##### Peak Hour Demand

$$\begin{aligned} &= 275 \text{ l/capita/day} \times 1,616 \text{ people} \times 2.25 \text{ (Peak Hour factor)} \\ &= 999,900 \text{ l/day} \\ &= 11.57 \text{ l/s} \end{aligned}$$



## Fire Flow Calculation

Fire Flow Calculation (Based on Fire Underwriters Survey 1999)

1. An estimate of the fire flow required for a given area is determined by the formula:

$$F = 220C\sqrt{A}$$

Where,  $F$  = the required fire flow in litres per minute l/m  
 $C$  = Construction type coefficient= 0.8 (Fire resistive construction)  
 $A$  = Total area (based on construction type and protected openings)

Building Area = 30,082 m<sup>2</sup> (1)

(1) Based on the largest building area on site, Building C.

$$F = 220(0.80)\sqrt{30,082 \text{ m}^2}$$

$$F = 30,525 \text{ l/m (509 l/s)}$$

Therefore use:  $F = 31,000 \text{ l/m (517 l/s)}$

### 2. Occupancy Reduction

Office Area = 0% Increase based on Commercial buildings

∴ Total Reduction = 0%

$$F_2 = 31,000 \text{ l/m} - (31,000 \text{ l/m} \times 0\%)$$

$$F_2 = 31,000 \text{ l/m (517 l/s)}$$

### 3. Sprinkler Reduction

30% Reduction for NFPA 13 System

### 4. Separation Charge

East Side (10.1 - 20m) = 15%

West Side (30.1 - 45m) = 5%

North Side (> 45m) = 0%

South Side (> 45m) = 0%

Total Separation Charge = 20%

$$F_{final} = F_2 - (F_2 \times 30\%) + (F_2 \times 20\%)$$

$$F_{final} = 31,000 \text{ l/m} - (9,300 \text{ l/min}) + (6,200 \text{ l/min})$$

$$F_{final} = 27,900 \text{ l/min (465 l/s)}$$

Therefore use:  $F_{final} = 28,000 \text{ l/min (467 l/s)}$

$$F_{final} = 7,402 \text{ US gpm}$$



The water supply system will be designed to convey the greater of the fire flow plus maximum day demand or the peak hour demand. The greater flow results from the fire flow plus max day, as calculated below.

$$\begin{aligned}\text{Fire Flow} + \text{Max Day} &= 467 \text{ l/s} + 11.57 \text{ l/s} \\ &= 478.57 \text{ l/s} \\ &= 28,714 \text{ l/min (7,596 US gpm)}\end{aligned}$$

A fire flow hydrant test will be undertaken once the proposed 300mm watermain is constructed on Winston Churchill Boulevard.

## 12.2 EXTERNAL WATERMAIN SERVICING

The existing single residential home at 568 Winston Churchill Boulevard, located north of the proposed development, will also be serviced by a 200mm watermain that will connect to the proposed 300mm watermain along Winston Churchill Boulevard.

The currently undeveloped property at 772 Winston Churchill Boulevard, adjacent to the proposed development, will also be serviced by a proposed 200mm watermain that is connected to the proposed 300mm watermain along Winston Churchill Boulevard. Since this site is currently undeveloped the proposed 200mm watermain will be split into a 200mm fire line and 100mm domestic line. Both of these lines will be plugged.



## 13.0 EROSION AND SEDIMENT CONTROLS

During construction, temporary erosion and sediment controls are to be provided in accordance with the “Erosion and Sediment Control Guidelines for Urban Construction” (2006), prepared by the Greater Golden Horseshoe Conservation Authorities. Erosion control measures will be provided through the use of silt fences, diversion swales, inlet protection devices, sediment traps, temporary sediment pond, and the proposed SWM pond.

### 13.1 EROSION CONTROL AND SEDIMENT CONTROL REQUIREMENTS

The erosion and sediment control requirements for the proposed development are as follows:

1. The Contractor will provide temporary excavated sediment traps for sediment control. The sediment traps should be located at points of discharge from the area.
2. The Contractor will monitor the quality of stormwater discharging from the SWM pond and sediment traps during the construction period.
3. The Contractor will construct temporary drainage systems, such as ditching, temporary culverts to facilitate drainage from exposed soils to the SWM pond and sediment traps.
4. Silt fences will be installed around the exposed area of the pond.
5. The exposed soils will be vegetated as soon as possible. Erosion control blankets should be placed where applicable.
6. Straw bales and/or rock protection will be placed in temporary drainage conveyance channels on steep grades.
7. Rock protection will be placed at points of concentrated discharge, which includes the outlet of the SWM pond.
8. Stockpiled excavated material, and topsoil will be protected from wind and rain erosion.
9. The SWM pond will be cleaned of sediment upon completion of construction.

### 13.2 MONITORING PLAN

The monitoring plan for the development site will be implemented for three stages of development: pre-development, construction, and post-construction. The monitoring plan will be as recommended by the Clearview Creek subwatershed study. Excerpts of the recommended monitoring plan is provided in Appendix A.

As described in the subwatershed study:

The development / activity driven monitoring should follow three stages: the pre-development phase, the construction phase, and the post-construction phase. During the pre-development phase, monitoring should be undertaken to generate any additional baseline data that may be required to compile a more detailed understanding of existing conditions.



In the construction phase, the purpose of monitoring will be to ensure that the environmental measures implemented during construction are performing as expected (i.e. sediment control by provision of silt fences and temporary sediment traps/basins). Monitoring during the post-construction phase will be conducted to confirm that the performance targets are being achieved and to ensure that no negative environmental changes are occurring because of development.

During Construction Monitoring Program:

During construction, the monitoring program of the SWM facilities, including the temporary sediment control facilities such as excavated sediment traps, should include the following:

- Weekly inspections of the facilities
- Inspections of the control facilities and the receiving water course (Clearview Creek), after rainfall events with at least 10mm of precipitation
- Measurement of suspended solids downstream of the control works

Weekly inspection reports should be submitted by the developer's engineer to the satisfaction of the Town of Oakville. The reports should summarize the state of the control works, their performance during rainfall events, any presence of downstream erosion or sediment accumulation, and any actions necessary to modify the works.


Post-Construction Monitoring Program:

A monitoring response and maintenance program (MRM Program) will be initiated upon completion of the 'During Construction Monitoring Program' and will extend for a 2-year period following substantial completion. Refer to Section 5.2 of the subwatershed study (also provided in Appendix A of this report) for details and requirements of the post-construction monitoring program.

Prepared by,  
**a.m. candaras associates inc.**



A.M. Candaras, P. Eng.  
Consulting Engineer

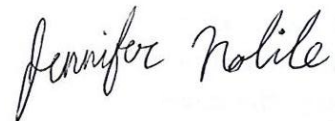

Jennifer Nobile, EIT  
August 17, 2023






## APPENDIX A

### SUPPORTING DOCUMENTATION

## ROOFTOP STORAGE AVAILABLE CALCULATIONS

Table A – Building A Roof Storage Required for 100-Year Storm Event

TIME PERIOD (min)	INTENSITY (mm/hr)	RUNOFF (l/s)	STORAGE (m <sup>3</sup> )
20-30	4.96	20.1	0.0
30-40	5.88	23.8	0.0
40-50	7.27	29.5	0.0
50-60	9.69	39.3	0.0
60-70	15	60.8	0.0
70-80	38.04	154.1	47.9
80-90	203.31	823.8	450.0
90-100	51.04	206.8	79.5
100-110	25.59	103.7	17.6
110-120	17.24	69.9	0.0
120-130	13.11	53.1	0.0
130-140	10.64	43.1	0.0
140-150	8.99	36.4	0.0
150-160	7.81	31.6	0.0
160-170	6.92	28.0	0.0
			595.1

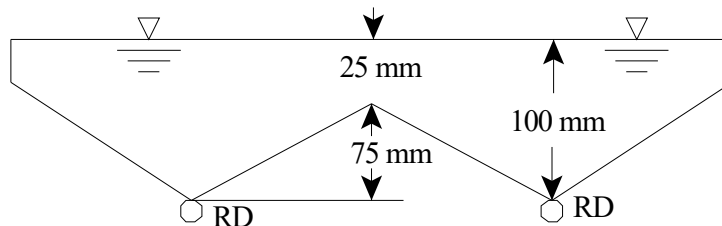

### Building A Rooftop Ponding:

Area per Drain = 16,218.9m<sup>2</sup> / 48 drain = 337.9 m<sup>2</sup>/drain

Available Ponding Volume per Drain =  $\frac{l \cdot w \cdot h}{3} + l \cdot w \cdot h$


Ponding Volume Per Drain =  $\frac{(337.9\text{m}^2) \cdot (0.075\text{m})}{3} + (337.9\text{m}^2) \cdot (0.025\text{m}) = 16.9\text{m}^3/\text{drain}$

Rooftop Volume Provided = 16.9m<sup>3</sup> · 48 drains = 811.2m<sup>3</sup>

Required Rooftop Volume = 595.1m<sup>3</sup>

Table B – Building B Roof Storage Required for 100-Year Storm Event

TIME PERIOD (min)	INTENSITY (mm/hr)	RUNOFF (l/s)	STORAGE (m³)
30-40	5.88	18.8	0.0
40-50	7.27	23.2	0.0
50-60	9.69	31.0	0.0
60-70	15	48.0	0.0
70-80	38.04	121.7	36.7
80-90	203.31	650.2	353.8
90-100	51.04	163.2	61.7
100-110	25.59	81.8	12.8
110-120	17.24	55.1	0.0
120-130	13.11	41.9	0.0
130-140	10.64	34.0	0.0
140-150	8.99	28.8	0.0
150-160	7.81	25.0	0.0
160-170	6.92	22.1	0.0
			<b>465.1</b>

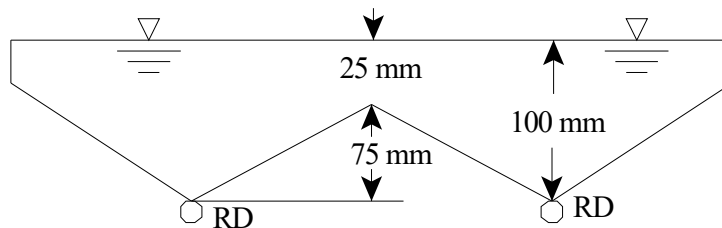

Building B Rooftop Ponding:

Area per Drain =  $12,821.5\text{m}^2 / 39 \text{ drain} = 328.7 \text{ m}^2/\text{drain}$

Available Ponding Volume per Drain =  $\frac{l \cdot w \cdot h}{3} + l \cdot w \cdot h$


Ponding Volume Per Drain =  $\frac{(328.7\text{m}^2) \cdot (0.075\text{m})}{3} + (328.7\text{m}^2) \cdot (0.025\text{m}) = 16.4\text{m}^3/\text{drain}$

Rooftop Volume Provided =  $16.4\text{m}^3 \cdot 39 \text{ drains} = 639.6\text{m}^3$

Required Rooftop Volume =  $465.1\text{m}^3$

Table C – Building C Roof Storage Required for 100-Year Storm Event

TIME PERIOD (min)	INTENSITY (mm/hr)	RUNOFF (l/s)	STORAGE (m <sup>3</sup> )
40-50	7.27	54.7	0.0
50-60	9.69	72.9	0.0
60-70	15	112.8	0.0
70-80	38.04	286.1	95.4
80-90	203.31	1529.1	841.2
90-100	51.04	383.9	154.1
100-110	25.59	192.5	39.2
110-120	17.24	129.7	1.5
120-130	13.11	98.6	0.0
130-140	10.64	80.0	0.0
140-150	8.99	67.6	0.0
150-160	7.81	58.7	0.0
160-170	6.92	52.0	0.0
			<b>1,131.4</b>

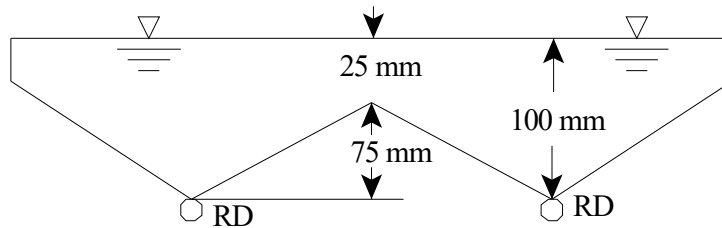

Building C Rooftop Ponding:

Area per Drain = 30,087.4m<sup>2</sup> / 82 drain = 366.9 m<sup>2</sup>/drain

Available Ponding Volume per Drain =  $\frac{l \cdot w \cdot h}{3} + l \cdot w \cdot h$

Ponding Volume Per Drain =  $\frac{(366.9\text{m}^2) \cdot (0.075\text{m})}{3} + (366.9\text{m}^2) \cdot (0.025\text{m}) = 18.3\text{m}^3/\text{drain}$

Rooftop Volume Provided = 18.3m<sup>3</sup> · 82 drains = 1,500.6m<sup>3</sup>

Required Rooftop Volume = 1,131.4m<sup>3</sup>

# **ROOF DRAIN MANUFACTURERS DESIGN TABLE**

LOCATION	SQUARE METRE (SQUARE FOOT)	ROOF LOAD FACTOR KGS (LBS.)	TOTAL ROOF SLOPE											
			DEAD-LEVEL		51mm (2'') RISE		102mm (4'') RISE		152mm (6'') RISE					
			Draindown Time Hrs.	mm (In.) Water Depth	Draindown Time Hrs.	mm (In.) Water Depth	Draindown Time Hrs.	mm (In.) Water Depth	Draindown Time Hrs.	mm (In.) Water Depth				
L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge	L.P.M. (G.P.M.) Discharge		
St. Thomas, Ontario	232 ( 2,500)	5.7 (12.5)	54.5 (12)	8	61 (2.4)	68 (15)	7	76 (3.0)	86.5 (19)	5	96.5 (3.8)	104.5 (23)	4	117 (4.6)
	465 ( 5,000)	6.6 (14.6)	63.5 (14)	19	71 (2.8)	77.5 (17)	16	86.5 (3.4)	97.5 (21.5)	11	109 (4.3)	118 (26)	9	132 (5.2)
	697 ( 7,500)	7.1 (15.6)	68 (15)	29	76 (3.0)	82 (18)	26	91.5 (3.6)	102.5 (22.5)	18	114.5 (4.5)	125 (27.5)	15	139.5 (5.5)
	929 (10,000)	7.5 (16.6)	72.5 (16)	40	81.5 (3.2)	86.5 (19)	34	96.5 (3.8)	107 (23.5)	24	119.5 (4.7)	132 (29)	20	147.5 (5.8)
Timmins, Ontario	232 ( 2,500)	4.3 (9.4)	41 (9)	7	45.5 (1.8)	57 (12.5)	6	63.5 (2.5)	72.5 (16)	4	81.5 (3.2)	86.5 (19)	3.3	96.5 (3.8)
	465 ( 5,000)	5.7 (12.5)	54.5 (12)	16	61 (2.4)	63.5 (14)	14	71 (2.8)	82 (18)	9	91.5 (3.6)	97.5 (21.5)	7.5	109 (4.3)
	697 ( 7,500)	6.4 (14)	61.5 (13.5)	27	68.5 (2.7)	70.5 (15.5)	22	78.5 (3.1)	86.5 (19)	15	96.5 (3.8)	104.5 (23)	12	117 (4.6)
	929 (10,000)	6.6 (14.6)	63.5 (14)	36	71 (2.8)	72.5 (16)	30	81.5 (3.2)	91 (20)	21	101.5 (4.0)	109 (24)	17	122 (4.8)
Toronto, Ontario	232 ( 2,500)	5.7 (12.5)	54.5 (12)	8	61 (2.4)	66 (14.5)	7	73.5 (2.9)	82 (18)	4.5	91.5 (3.6)	97.5 (21.5)	3.5	109 (4.3)
	465 ( 5,000)	6.8 (15.1)	66 (14.5)	19	73.5 (2.9)	77.5 (17)	16	86.5 (3.4)	93 (20.5)	11	104 (4.1)	111.5 (24.5)	9	124.5 (4.9)
	697 ( 7,500)	8.0 (17.7)	77.5 (17)	30	86.5 (3.4)	84 (18.5)	26	94 (3.7)	100 (22)	18	112 (4.4)	120.5 (26.5)	14	134.5 (5.3)
	929 (10,000)	8.7 (19.2)	82 (18)	42	91.5 (3.6)	86.5 (19)	34	96.5 (3.8)	104.5 (23)	24	117 (4.6)	127.5 (28)	20	142 (5.6)
Windsor, Ontario	232 ( 2,500)	6.1 (13.5)	59 (13)	8.5	66 (2.6)	70.5 (15.5)	7.5	78.5 (3.1)	84 (18.5)	4.5	94 (3.7)	107 (23.5)	4	119.5 (4.7)
	465 ( 5,000)	7.1 (15.6)	68 (15)	20	76 (3.0)	79.5 (17.5)	16	89 (3.5)	97.5 (21.5)	11	109 (4.3)	118 (26)	9	132 (5.2)
	697 ( 7,500)	8.0 (17.7)	77.5 (17)	30	86.5 (3.4)	86.5 (19)	26	96.5 (3.8)	107 (23.5)	18	119.5 (4.7)	125 (27.5)	15	139.5 (5.5)
	929 (10,000)	8.7 (19.2)	82 (18)	42	91.5 (3.6)	91 (20)	36	101.5 (4.0)	113.5 (25)	26	127 (5.0)	129.5 (28.5)	20	145 (5.7)
Charlottetown, P.E.I.	232 ( 2,500)	4.9 (10.9)	47.5 (10.5)	7.5	53.5 (2.1)	57 (12.5)	6	63.5 (2.5)	68 (15)	3.8	76 (3.0)	79.5 (17.5)	3	89 (3.5)
	465 ( 5,000)	6.6 (14.6)	63.5 (14)	19	71 (2.8)	75 (16.5)	15.5	84 (3.3)	88.5 (19.5)	10	99 (3.9)	100 (22)	7.5	112 (4.4)
	697 ( 7,500)	7.8 (17.2)	75 (16.5)	31	84 (3.3)	86.5 (19)	26	96.5 (3.8)	102.5 (22.5)	18	114.5 (4.5)	113.5 (25)	13	127 (5.0)
	929 (10,000)	8.7 (19.2)	84 (18.5)	42	94 (3.7)	97.5 (21.5)	37	106.5 (4.2)	111.5 (24.5)	26	124.5 (4.9)	125 (27.5)	20	139.5 (5.5)
Montreal, Quebec	232 ( 2,500)	5.2 (11.4)	50 (11)	7.5	56 (2.2)	61.5 (13.5)	7	68.5 (2.7)	79.5 (17.5)	4.5	89 (3.5)	97.5 (21.5)	3.5	109 (4.3)
	465 ( 5,000)	5.9 (13)	57 (12.5)	17	63.5 (2.5)	70.5 (15.5)	15	78.5 (3.1)	88.5 (19.5)	10	99 (3.9)	109 (24)	8	122 (4.8)
	697 ( 7,500)	6.1 (13.5)	59 (13)	27	66 (2.6)	72.5 (16)	23	81.5 (3.2)	93 (20.5)	16	104 (4.1)	113.5 (25)	13	127 (5.0)
	929 (10,000)	6.4 (14)	61.5 (13.5)	36	68.5 (2.7)	77.5 (17)	31	86.5 (3.4)	95.5 (21)	22	106.5 (4.2)	120.5 (26.5)	19	134.5 (5.3)
Quebec City, Quebec	232 ( 2,500)	5.4 (12)	52.5 (11.5)	8	58.5 (2.3)	63.5 (14)	7	71 (2.8)	79.5 (17.5)	4.5	89 (3.5)	97.5 (21.5)	3.5	109 (4.3)
	465 ( 5,000)	6.4 (14)	61.5 (13.5)	18	68.5 (2.7)	70.5 (15.5)	15	78.5 (3.1)	84 (18.5)	10	94 (3.7)	104.5 (23)	8	117 (4.6)
	697 ( 7,500)	6.6 (14.6)	63.5 (14)	28	71 (2.8)	72.5 (16)	23	81.5 (3.2)	86.5 (19)	15	96.5 (3.8)	107 (23.5)	12	119.5 (4.7)
	929 (10,000)	7.1 (15.6)	68 (15)	37	76 (3.0)	77.5 (17)	31	86.5 (3.4)	88.5 (19.5)	20	99 (3.9)	109 (24)	17	122 (4.8)
Regina, Saskatchewan	232 ( 2,500)	4.5 (9.9)	43 (9.5)	7	48.5 (1.9)	54.5 (12)	6	61 (2.4)	72.5 (16)	4	81.5 (3.2)	79.5 (17.5)	3	89 (3.5)
	465 ( 5,000)	6.4 (14)	61.5 (13.5)	18	68.5 (2.7)	68 (15)	14	76 (3.0)	86.5 (19)	10	96.5 (3.8)	97.5 (21.5)	7.5	109 (4.3)
	697 ( 7,500)	7.3 (16.1)	70.5 (15.5)	29	78.5 (3.1)	77.5 (17)	24	86.5 (3.4)	100 (22)	17	112 (4.4)	109 (24)	12	122 (4.8)
	929 (10,000)	8.3 (18.2)	79.5 (17.5)	40	89 (3.5)	82 (18)	32	91.5 (3.6)	104.5 (23)	24	117 (4.6)	118 (26)	18	132 (5.2)
Saskatoon, Saskatchewan	232 ( 2,500)	4.0 (8.8)	38.5 (8.5)	6	43 (1.7)	57 (12.5)	6	63.5 (2.5)	66 (14.5)	3.8	73.5 (2.9)	77.5 (17)	2.8	86.5 (3.4)
	465 ( 5,000)	5.7 (12.5)	54.5 (12)	16	61 (2.4)	68 (15)	14.5	76 (3.0)	82 (18)	9	91.5 (3.6)	95.5 (21)	7	106.5 (4.2)
	697 ( 7,500)	6.6 (14.6)	63.5 (14)	28	71 (2.8)	75 (16.5)	24	84 (3.3)	91 (20)	16	101.5 (4.0)	104.5 (23)	12	117 (4.6)
	929 (10,000)	7.1 (15.6)	68 (15)	38	76 (3.0)	82 (18)	32	91.5 (3.6)	97.5 (21.5)	22	109 (4.3)	113.5 (25)	18	127 (5.0)

### 4.3 Stormwater Management for the Park Mount Development

#### 4.3.1. Existing and Future Flows

Existing conditions and post-development flows, with and without a stormwater management pond were calculated for the study subcatchment containing the Park Mount Development. All flows were calculated using the 4-hour Chicago Storm distribution. The NASH Hydrograph method was used to calculate the existing conditions flows and the StandHyd method was used to calculate the future conditions flows.

Table 13 presents the pre-development and post-development flows and runoff volumes for Subcatchment 5 (total area 24.2 ha) that includes the Park Mount Property (approximately 14.5 ha development area not including the creek realignment corridor). Numbers in brackets show the flow contribution from the Park Mount Development area of 14.5 ha.

**Table 13 Post-development and Pre-development Flows for Park Mount Development Subcatchment**

Storm Recurrence (Years)	Pre-development Runoff		Uncontrolled Post-development Runoff		Post-development Runoff with Stormwater Management Pond in Park Mount Development	
	Flow (m <sup>3</sup> /s)	Volume (m <sup>3</sup> )	Flow (m <sup>3</sup> /s)	Volume (m)	Flow (m <sup>3</sup> /s)	Volume (m <sup>3</sup> )
2	0.15 (0.10)	1300 (780)	1.74 (1.73)	3840 (3470)	0.08 (0.04)	3840 (3470)
5	0.30 (0.19)	2390 (1430)	2.57 (2.56)	5540 (4830)	0.24 (0.17)	5540 (4830)
10	0.42 (0.27)	3250 (1950)	3.16 (3.15)	6740 (5780)	0.40 (0.31)	6740 (5780)
25	0.58 (0.37)	4460 (2680)	3.99 (3.99)	8360 (7010)	0.55 (0.37)	8360 (7010)
50	0.71 (0.45)	5350 (3200)	4.58 (4.57)	9480 (7850)	0.56 (0.45)	9480 (7850)
100	0.84 (0.54)	6320 (3790)	5.17 (5.16)	10680 (8730)	0.74 (0.54)	10680 (8730)

#### 4.3.2. Stormwater Management Pond

The proposed extended detention SWM wet pond for the Park Mount Development will provide an Enhanced (Level 1) level of treatment, which exceeds the specified Normal (Level 2) target for water quality treatment in the study watershed. The Enhanced level of treatment will provide an added benefit to upstream and downstream users by releasing cleaner post-development flows to the creek thus enhancing the overall water quality in the creek.

The estimated preliminary parameters for the required stormwater pond are summarized in Table 14. The volumes of the permanent pool, the extended detention, and flood attenuation zones were calculated using the criteria discussed in Section 4.2.1, with the exception for water quality, where a higher standard was used. As summarized in Table 14, 202 m<sup>3</sup>/ha was used for water quality control, which is based on 80 % impervious area and the Enhanced level of protection, according to criteria in MOE guidelines. The extended detention volume of 210 m<sup>3</sup>/ha was calculated based on the volume of runoff generated by 25mm of precipitation and the weighted runoff coefficient of 0.84 for the development area. The combined extended detention and flood attenuation volume is the required detention storage to reduce the 2 year to 100-year post-

## **6.0 IMPLEMENTATION AND MONITORING PLAN**

The implementation and monitoring plan encompasses two different components, specifically, the more detailed and intensive but shorter term monitoring associated with a development proposal or specific construction activity that will change the land use or landscape in one area of the watershed, and the more general long term monitoring undertaken across the watershed as a whole. The development or activity specific monitoring would be undertaken by the developer/proponent, with reporting and review requirements to the Town and CVC. The long term overall monitoring program would be undertaken by the Town and / or CVC.

### **6.1 Development / Activity Monitoring**

The development / activity driven monitoring should follow three stages: the pre-development phase, the construction phase, and the post-construction phase. During the pre-development phase, monitoring should be undertaken to generate any additional baseline data that may be required to compile a more detailed understanding of existing conditions. In the construction phase the purpose of monitoring will be to ensure that the environmental measures implemented during construction are performing as expected (i.e. sediment control by provision of silt fences and temporary sediment traps/basins). Monitoring during the post-construction phase will be conducted to confirm that the performance targets are being achieved and to ensure that no negative environmental changes are occurring because of development.

For the study watershed, the areas of critical importance include impacts of development on water quality and peak flows, potential point soil contamination (on-going issue) and monitoring of the proposed channel re-location and associated stream and riparian corridor habitat elements. Soil contamination is an issue due to the industrial nature of the existing and proposed developments within the subwatershed.

### **6.2 Stormwater Management Implementation and Monitoring Plan**

The preferred option for treatment of stormwater in the study subwatershed is based on the use of 'wet detention ponds'. Where ponds cannot be provided due to existing space/land purchase negotiations the use of flat bottom grassed swales is recommended. The approximate capital cost of construction of the three SWM extended detention wet ponds is approximately \$1,050,000. The cost of construction of grassed swales by modification of existing ditches and provision of sediment control BMPs would be in the order of \$400,000.

#### **During Construction Monitoring Program**

During construction, the monitoring program of the SWM facilities, including the temporary sediment control facilities such as excavated sediment traps, should include the following:

- Weekly inspections of the facilities.
- Inspections of the control facilities and the receiving watercourse, i.e. Clearview Creek, after rainfall events with at least 10 mm of precipitation.
- Measurement of suspended solids downstream of the control works.



Weekly inspection reports should be submitted by the developer's engineer to the satisfaction of the Town of Oakville. The reports should summarize the state of the control works, their performance during rainfall events, any presence of downstream erosion or sediment accumulation, and any actions necessary to modify the works.

### **Post-Construction Monitoring Program**

The proponent will submit a Monitoring Response and Maintenance Program (MRM Program), which will be initiated upon completion of the 'During Construction Monitoring Program', and will extend for a 2 year period following substantial completion. A typical monitoring season should extend from mid-April to end of October, with specific monitoring during the off-construction season following major runoff events to ensure long term or over-wintering measures remain stable. The substantial completion requires that for a given development all roads and open spaces be completed and 90% of lots sodded. The program should focus on compliance with watershed targets as well as ecological health immediately downstream of the development. The program should identify the following:

- **Performance Targets.** The following specifies allowable targets for flood control, allowable sediment levels, temperature and other targets relating to water quality:
  - Flood Control Target - SWM pond outflows to be controlled to pre-development levels up to the 100 year event.
  - Sediment Control Target: Background Annual Average.
  - Temperature of SWM pond discharge to Clearview Creek: Background Maximum - Conditional on Air Temperature.
  - Dissolved Oxygen: Background Annual Average.
  - Other water quality parameters: Background Annual Average Levels
    - Total Phosphorous, Nitrate, Chlorides, E.coli, Aluminum, Copper, Ttotal ammonia (unionized NH<sub>3</sub>)

The exceedance of any of the identified target levels will represent triggers, which will immediately initiate the Response Plan.

- **Mitigation Measures.** If targets are not met mitigation measures should be implemented. Possible mitigation measures will be identified in the MRM Program, along with approximate costs and expected benefits.
- **Response Plan,** which will be implemented where the monitoring identifies that Performance Targets are not being met. The Response Plan may include more comprehensive monitoring program to determine the consequence of exceedance.
- **Maintenance Requirements.** Routine and occasional maintenance requirements will be identified for the SWM facilities.
- **Monitoring Program,** which at the minimum should include the items listed below. Recommendations for remediation should be made where required.



- a. Collect water level from SWM facilities during the monitoring season.
- b. Collect water quality data (suspended solids, dissolved oxygen, phosphorous) as per Section 6.2 during the same five significant rainfall events specified in Section 6.2.1.
- c. During the spring and fall, inspect all SWM facilities shortly after a rainfall event to determine whether the outlet works operate as designed. Make recommendations
- d. Groundwater elevation and quality monitoring
- e. Twice annually inspect the health of the vegetation at existing SWM facilities
- f. Inspect annually the boundary between developed areas and natural areas/buffers.
- g. Cleanup litter and notify the Town of Oakville of illicit dumping.

The Monitoring Reports should be submitted twice per year to the Town of Oakville and CVC. The reports will present the results of monitoring of the SWM facilities, note trends, exceedance of performance targets, comment on the effectiveness of the SWM facilities and recommend mitigation measures where required.

- **Erosion Control.** Two or more erosion monitoring stations should be established on Clearview Creek downstream of the proposed development to monitor the amount of erosion during construction and in the post-construction period. The selected sites should contain a section where erosion is evident as well as a section which does not show erosion but is prone to erosion (i.e. creek bend). Each station should be inspected annually and any changes in bed or banks should be noted. A photographic inventory should be maintained at selected sites, which should be updated after each inspection.

#### **6.2.1. Water Quality Testing Frequency and Locations**

A total of eight water quality sampling runs per year will be conducted at two locations over a three-year period. Five of these sampling runs will be conducted during significant rain events and three sampling runs will be conducted during dry weather conditions (negligible precipitation in the previous five days). The sampling frequency should be evenly distributed throughout the open water season from April to October. The recommended water chemistry sampling locations are:

1. Downstream of Royal Windsor Road
2. Upstream of Winston Churchill Blvd at the property boundary at the downstream end of stream re-alignment

The recommended water sampling program is as follows:

Year 1 - Baseline monitoring, prior to site development. Eight samples are to be taken at the two locations and the samples will be tested for the above-identified parameters.

Years 2 and 3 - Post-construction monitoring, to be conducted after completion of site development. Eight samples are to be taken during each year at the two locations and the samples will be tested for the above-identified parameters.

STORM SEWER DESIGN SHEET



Project / Subdivision 560 WINSTON CHURCHILL BLVD., OAKVILLE

Consulting Engineer A.M. Candaras Associates Inc.

Project No.: #1870

Prepared by: J.M.N.

Checked by: A.M.C.

Last Revised: 4-May-22

Design Parameters				Design Equations	
A = drainage area (ha)	5 <sub>YR</sub> T <sub>init</sub> = 10	100 <sub>YR</sub> T <sub>init</sub> = 10		$I = \frac{A}{(t + B)^C}$  Q = 2.78 x A x C x I	
C = runoff coefficient	A = 1170	A = 2150			
T <sub>c</sub> = time of concentration	B = 5.800	B = 5.700			
	C = 0.843	C = 0.861			

Notes/Comments: 5 year sewers																	
Location			Drainage Area Characteristics				Rainfall / Runoff			Sewer Data							Remarks
Street	From	To	Area	C	AC	Accum.	T <sub>c</sub>	I	Flow	Diameter	Length	Slope	Cap.	Vel.	Sect.	Accum.	
	MH.	MH.	(ha)			AC	(min)	(mm/hr)	(m³/s)	(mm)	(m)	(%)	(m³/s)	(m/s)	Time	Time	
STM PIPE NETWORK TO HW 1																	
																10.00	minimum entry time
Building C - North Side	CBMH 21	MH 19	0.21	0.90	0.19	0.19	10.00	114.21	0.060	450	75.0	0.15	0.110	0.69	1.80	11.80	
Building C - North Side	CB 20	MH 19	0.07	0.90	0.06	0.06	10.00	114.21	0.020	300	1.1	1.00	0.097	1.37	0.01	10.01	
Building C - North Side	CB 18	MH 19	0.13	0.90	0.12	0.12	10.00	114.21	0.037	300	1.0	1.00	0.097	1.37	0.01	10.01	
Building C - North Side	MH 19	CBMH 17	0.00	0.90	0.00	0.37	11.80	104.28	0.107	600	75.0	0.15	0.238	0.84	1.49	13.29	
Building C - North Side	CBMH 17	CBMH 16	0.14	0.90	0.13	0.50	13.29	97.39	0.134	600	65.3	0.15	0.238	0.84	1.29	14.58	
Building B - North Side	CBMH 16	CBMH 15	0.08	0.90	0.07	0.57	14.58	92.15	0.145	600	40.9	0.15	0.238	0.84	0.81	15.39	
Building C - North Side	CB 14	CBMH 15	0.08	0.85	0.07	0.07	10.00	114.21	0.022	300	1.7	1.00	0.097	1.37	0.02	10.03	
Building B - North Side	CBMH 15	MH 13	0.11	0.85	0.09	0.73	15.39	89.17	0.180	600	61.2	0.15	0.238	0.84	1.21	15.79	
Building B - West Side	CB 12	MH 13	0.18	0.90	0.16	0.16	10.00	114.21	0.051	375	1.9	1.00	0.175	1.59	0.02	10.02	
Building B - West Side	MH 13	CBMH 11	0.00	0.90	0.00	0.89	15.79	87.77	0.217	675	83.8	0.15	0.326	0.91	1.54	17.33	
Building B - West Side	CB 10	CBMH 11	0.18	0.90	0.16	0.16	10.00	114.21	0.051	300	1.0	1.00	0.097	1.37	0.01	10.01	
Building B - West Side - Roof	ROOF 3	CBMH 11	0.07	0.90	0.07	0.07	10.00	114.21	0.021	300	10.5	1.00	0.097	1.37	0.13	10.13	*AREA EDITED TO ACHIEVE DISCHARGE (21.7 L/S)
Building B - West Side	CBMH 11	MH 9	0.18	0.90	0.16	1.28	17.33	82.83	0.295	750	102.2	0.15	0.431	0.98	1.75	19.07	
Building B - West Side	MH 9	MH 7	0.24	0.85	0.20	1.48	19.07	77.91	0.321	750	78.3	0.15	0.431	0.98	1.34	20.41	
Building B - West Side - Roof	Roof 4	MH 7	0.07	0.85	0.06	0.06	10.00	114.21	0.019	300	14.0	1.00	0.097	1.37	0.17	10.17	*AREA EDITED TO ACHIEVE DISCHARGE (21.7 L/S)
Building B - South Side	MH 7	MH 5	0.23	0.85	0.20	1.74	20.41	74.54	0.361	825	47.4	0.15	0.556	1.04	0.76	21.17	
																10.00	minimum entry time
Loading Dock	CBMH 35	CBMH 34	0.20	0.90	0.18	0.18	10.00	114.21	0.057	300	40.0	1.00	0.097	1.37	0.49	10.49	
Loading Dock	CB 33	CBMH 34	0.13	0.90	0.12	0.12	10.00	114.21	0.037	300	1.0	1.00	0.097	1.37	0.01	10.01	
Loading Dock - Building C Roof	ROOF 1	CBMH 34	0.18	0.90	0.16	0.16	10.00	114.21	0.050	300	27.1	1.00	0.097	1.37	0.33	10.33	*AREA EDITED TO ACHIEVE DISCHARGE (50.4 L/S)
Loading Dock	CBMH 34	CBMH 32	0.20	0.90	0.18	0.64	10.49	111.33	0.197	600	84.2	0.20	0.275	0.97	1.44	11.44	
Loading Dock - Building C Roof	ROOF 2	CBMH 32	0.18	0.90	0.16	0.16	10.00	114.21	0.050	300	27.1	1.00	0.097	1.37	0.33	10.33	*AREA EDITED TO ACHIEVE DISCHARGE (50.4 L/S)
Loading Dock	CBMH 32	CBMH 31	0.16	0.90	0.14	0.94	11.44	106.09	0.276	675	33.2	0.20	0.376	1.05	0.53	11.97	
Loading Dock	CBMH 31	MH 30	0.10	0.90	0.09	1.03	11.97	103.43	0.295	675	32.6	0.20	0.376	1.05	0.52	12.49	

STORM SEWER DESIGN SHEET



Project / Subdivision 560 WINSTON CHURCHILL BLVD., OAKVILLE

Consulting Engineer A.M. Candaras Associates Inc.

Project No.: #1870

Prepared by: J.M.N.

Checked by: A.M.C.

Last Revised: 4-May-22

Design Parameters				Design Equations	
A = drainage area (ha)	5 <sub>YR</sub> T <sub>init</sub> = 10	100 <sub>YR</sub> T <sub>init</sub> = 10		$I = \frac{A}{(t + B)^C}$  $Q = 2.78 \times A \times C \times I$	
C = runoff coefficient	A= 1170	A= 2150			
T <sub>c</sub> = time of concentration	B= 5.800	B= 5.700			
	C= 0.843	C= 0.861			

Notes/Comments: 5 year sewers																	
Location			Drainage Area Characteristics				Rainfall / Runoff			Sewer Data							Remarks
Street	From	To	Area	C	AC	Accum.	T <sub>c</sub>	I	Flow	Diameter	Length	Slope	Cap.	Vel.	Sect.	Accum.	
	MH.	MH.	(ha)			AC	(min)	(mm/hr)	(m³/s)	(mm)	(m)	(%)	(m³/s)	(m/s)	Time	Time	
BUILDING B - TRENCH DRAIN	TRENCH DRAIN	MH 30	0.92	0.90	0.83	0.83	10.00	114.21	0.263	750	11.3	0.15	0.431	0.98	0.19	10.19	
Loading Dock	MH 30	MH 5	0.00	0.90	0.00	1.86	12.49	100.96	0.521	900	63.7	0.20	0.810	1.27	0.83	13.32	
																10.00	minimum entry time
BUILDING A - South Side	MH 5	CBMH 4	0.00	0.90	0.00	3.60	21.17	72.77	0.727	1050	43.5	0.20	1.221	1.41	0.51	21.68	
BUILDING A - South Side	CBMH 4	MH 3	0.18	0.90	0.16	3.76	21.68	71.62	0.748	1050	47.1	0.20	1.221	1.41	0.56	22.24	
BUILDING A - South Side	MH 3	CBMH 2	0.00	0.90	0.00	3.76	22.24	70.42	0.735	1050	33.7	0.20	1.221	1.41	0.40	22.64	
BUILDING A - TRENCH DRAIN	MH 101	MH 100	0.84	0.90	0.76	0.76	10.00	114.21	0.240	600	22.3	0.25	0.307	1.09	0.34	10.34	
BUILDING A - TRENCH DRAIN	MH 100	CBMH 2	0.00	0.90	0.00	0.76	10.34	112.17	0.236	600	86.6	0.30	0.336	1.19	1.21	11.56	
																10.00	minimum entry time
Site	CB 53	MH 52	0.26	0.31	0.08	0.08	10.00	200.80	0.045	375	57.5	0.20	0.078	0.71	1.35	11.35	Sized for 100 YR Event
Site	MH 52	MH 51	0.00	0.25	0.00	0.08	11.35	187.04	0.042	375	84.6	0.20	0.078	0.71	1.99	13.34	Sized for 100 YR Event
Site	MH 51	CBMH 50	0.00	0.25	0.00	0.08	13.34	170.11	0.038	375	47.6	0.20	0.078	0.71	1.12	14.45	Sized for 100 YR Event
Site	CBMH 50	CBMH 48	0.24	0.25	0.06	0.14	14.45	161.95	0.063	375	94.9	0.20	0.078	0.71	2.23	16.68	Sized for 100 YR Event
Site	CBMH 48	CBMH 47	0.07	0.90	0.06	0.20	16.68	147.97	0.084	450	8.0	0.20	0.128	0.80	0.17	16.85	Sized for 100 YR Event
Site	CBMH 47	MH 46	0.00	0.25	0.00	0.20	16.85	147.03	0.083	525	84.7	0.15	0.167	0.77	1.83	18.68	Sized for 100 YR Event
Site	CB 45	MH 46	0.18	0.25	0.05	0.05	10.00	200.80	0.025	300	3.0	1.00	0.097	1.37	0.04	10.04	Sized for 100 YR Event
Site	MH 46	MH 43	0.00	0.25	0.00	0.25	18.68	137.46	0.095	525	32.2	0.15	0.167	0.77	0.70	19.38	Sized for 100 YR Event
Site	CB 44	MH 43	0.05	0.90	0.05	0.05	10.00	200.80	0.025	375	52.3	0.15	0.068	0.61	1.42	11.42	Sized for 100 YR Event
Site	CB 42	MH 43	0.12	0.90	0.11	0.11	10.00	200.80	0.060	300	0.8	1.00	0.097	1.37	0.01	10.01	Sized for 100 YR Event
Site	MH 43	MH 41	0.00	0.90	0.00	0.40	19.38	134.16	0.150	600	81.2	0.15	0.238	0.84	1.61	20.99	Sized for 100 YR Event
Site	CB 40	MH 41	0.11	0.90	0.10	0.10	10.00	200.80	0.055	300	1.3	1.00	0.097	1.37	0.02	10.02	Sized for 100 YR Event
Site - Building A Roof	ROOF 5	MH 41	0.19	0.90	0.17	0.17	10.00	114.21	0.054	300	10.2	1.00	0.097	1.37	0.12	10.12	*AREA EDITED TO ACHIEVE DISCHARGE (54.3 L/S)
Site	MH 41	CBMH 2	0.00	0.90	0.00	0.67	20.99	127.16	0.237	675	63.1	0.15	0.326	0.91	1.16	22.14	Sized for 100 YR Event

STORM SEWER DESIGN SHEET

Project / Subdivision 560 WINSTON CHURCHILL BLVD., OAKVILLE

Consulting Engineer A.M. Candaras Associates Inc.

Project No.: #1870



a.m. candaras associates inc.  
consulting engineers

Prepared by: J.M.N.

Checked by: A.M.C.

Last Revised: 4-May-22

Design Parameters				Design Equations	
A = drainage area (ha)	5 <sub>YR</sub> T <sub>init</sub> = 10	100 <sub>YR</sub> T <sub>init</sub> = 10		$I = \frac{A}{(t + B)^C}$  Q = 2.78 x A x C x I	
C = runoff coefficient	A = 1170	A = 2150			
T <sub>c</sub> = time of concentration	B = 5.800	B = 5.700			
	C = 0.843	C = 0.861			

Notes/Comments: 5 year sewers																	
Location			Drainage Area Characteristics				Rainfall / Runoff			Sewer Data							Remarks
Street	From	To	Area	C	AC	Accum.	T <sub>c</sub>	I	Flow	Diameter	Length	Slope	Cap.	Vel.	Sect.	Accum.	
	MH.	MH.	(ha)			AC	(min)	(mm/hr)	(m³/s)	(mm)	(m)	(%)	(m³/s)	(m/s)	Time	Time	
Site	CBMH 2	MH 1	0.00	0.90	0.00	5.19	22.64	120.76	1.740	1200	11.2	0.35	2.307	2.04	0.09	22.73	Sized for 100 YR Event
Site	MH 1	HW 1	0.00	0.90	0.00	5.19	22.73	120.43	1.735	1200	32.8	0.34	2.273	2.01	0.27	23.00	Sized for 100 YR Event

## APPENDIX B

### SWMHYMO OUTPUT

```
2      Metric units
*#*****
*# Project Name: 560 Winston Churchill Blvd., Oakville
*# Project Number: 1870
*# Date       : DECEMBER 15, 2020
*# Revised    : SEPTEMBER 22, 2020
*# Modeller   : JMN
*# Company    : a.m. candaras associates inc.
*# License #   : 3813174
*#*****
START      TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [001]
           "CHIC25MM.STM"
*
READ STORM  STORM_FILENAME= ["storm.001"]
*
*****
*SITE 560 WINSTON CHURCHILL*
*****
*
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS
CALIB STANDHYD ID=[1], NHYD=["002"], DT=[1](min), AREA=[11.68](ha),
                XIMP=[0.90], TIMP=[0.90], DWF=[0.0](cms), LOSS=[2],
                SCS curve number CN=[70.0],
                Pervious surfaces: IAPer=[5](mm), SLPP=[2.0](%),
                LGP=[40.0](m), MNP=[0.25],
                SCP=[0.0](min),
                Impervious surfaces: IAimp=[2](mm), SLPI=[1.0](%),
                LGI=[30](m), MNI=[0.013],
                SCI=[0.0](min),
                RAINFALL=[ , , , ](mm/hr) , END=-1
*
* SWM POND AREA
CALIB STANDHYD ID=[2], NHYD=["003"], DT=[1](min), AREA=[0.87](ha),
                XIMP=[0.50], TIMP=[0.50], DWF=[0.0](cms), LOSS=[2],
                SCS curve number CN=[70.0],
                Pervious surfaces: IAPer=[5](mm), SLPP=[2.0](%),
                LGP=[10.0](m), MNP=[0.25],
                SCP=[0.0](min),
                Impervious surfaces: IAimp=[2](mm), SLPI=[1.0](%),
                LGI=[22](m), MNI=[0.013],
                SCI=[0.0](min),
                RAINFALL=[ , , , ](mm/hr) , END=-1
*
* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD
CALIB STANDHYD ID=[3], NHYD=["004"], DT=[1](min), AREA=[0.14](ha),
                XIMP=[0.25], TIMP=[0.25], DWF=[0.0](cms), LOSS=[2],
                SCS curve number CN=[70.0],
                Pervious surfaces: IAPer=[5](mm), SLPP=[2.0](%),
                LGP=[10.0](m), MNP=[0.25],
                SCP=[0.0](min),
                Impervious surfaces: IAimp=[2](mm), SLPI=[1.0](%),
                LGI=[30](m), MNI=[0.013],
                SCI=[0.0](min),
                RAINFALL=[ , , , ](mm/hr) , END=-1
```

```
* UNCONTROLLED AREA TO CHANNEL
CALIB NASHYD ID=[4], NHYD=["005"], DT=[1]min, AREA=[0.24](ha),
              DWF=[0.0](cms), CN/C=[70.0], IA=[5](mm),
              N=[3], TP=[0.16]hrs,
              RAINFALL=[ , , , ](mm/hr), END=-1

*****
* Discharge rates from the SWMP, buildings and paved area
* Total Area = 12.55 ha
*****
ADD HYD      IDsum=6 NHYD=300 IDs to add=1+2

*****
*STORMWATER MANAGEMENT FACILITY
*PERMANENT WL 91.10 ORIFICE 125mm
*EROS/EXT WL 91.90 WEIR 175mm
*****

ROUTE RESERVOIR IDout= 7 , NHYD= 200 , IDin= 6 ,
                 RDT=[1](min),
                 TABLE of ( OUTFLOW-STORAGE ) values
                 (cms) - (ha-m)
                 0.0000 0.0000
                 0.0127 0.0743
                 0.0199 0.1543
                 0.0251 0.2403
                 0.0294 0.3146
                 0.0598 0.4139
                 0.1120 0.5169
                 0.1783 0.6238
                 0.2560 0.7344
                 0.3907 0.9076
                 2.3211 1.0278
                 3.9062 1.0893
                 5.7754 1.1518
                 7.8899 1.2152
                 IDovf=[ , ], NHYDovf=[ ]

*****
* Discharge rates from the SWMP, buildings, paved area and
* Uncontrolled discharge being released onto Winston Churchill
*****
ADD HYD      IDsum=8 NHYD=300 IDs to add=7+3

*****
START      TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [002]
           "CHIC2YR.STM"
START      TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [003]
           "CHIC5YR.STM"
START      TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [004]
           "CHIC10YR.STM"
           START      TZERO=[0.0], METOUT=[2], NSTORM=[1],
           NRUN= [005]
           "CHIC25YR.STM"
           START      TZERO=[0.0], METOUT=[2], NSTORM=[1],
           NRUN= [006]
           "CH100YR.STM"
```

	START	TZERO=[0.0], METOUT=[2], NSTORM=[1],
	NRUN= [007]	
	"2Y24HS.STM"	
	START	TZERO=[0.0], METOUT=[2], NSTORM=[1],
	NRUN= [008]	
	"5Y24HS.STM"	
START	TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [009]	
	"10Y24HS.STM"	
START	TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [010]	
	"25Y24HS.STM"	
	START	TZERO=[0.0], METOUT=[2], NSTORM=[1],
	NRUN= [011]	
	"100Y24HS.STM"	
	FINISH	

```

=====
SSSSS W W M M H H Y Y M M OOO 999 999 =====
S W W W MM MM H H Y Y MM MM O O 9 9 9 9
SSSSS W W W M M M HHHHH Y M M M O O ## 9 9 9 9 Ver. 4.02
S W W M M H H Y M M O O 9999 9999 July 1999
SSSSS W W M M H H Y M M OOO 9 9 9 =====
StormWater Management HYdrologic Model 999 999 =====

*****
***** SWMHYMO-99 Ver/4.02 *****
***** A single event and continuous hydrologic simulation model *****
***** based on the principles of HYMO and its successors *****
***** OTTHYMO-83 and OTTHYMO-89. *****
*****
***** Distributed by: J.F. Sabourin and Associates Inc. *****
***** Ottawa, Ontario: (613) 727-5199 *****
***** Gatineau, Quebec: (819) 243-6858 *****
***** E-Mail: swmhymo@jfsa.Com *****
*****

+++++
+++++ Licensed user: A.M. Candaras Associates Inc. +++++
+++++ Woodbridge SERIAL#:3813174 +++++
+++++

*****
***** +++++ PROGRAM ARRAY DIMENSIONS +++++ *****
***** Maximum value for ID numbers : 10 *****
***** Max. number of rainfall points: 15000 *****
***** Max. number of flow points : 15000 *****
*****

***** D E T A I L E D O U T P U T *****
*****
* DATE: 2022-06-16 TIME: 16:10:24 RUN COUNTER: 000971 *
*****
* Input filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\1870PST.dat *
* Output filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\1870PST.out *
* Summary filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\1870PST.sum *
* User comments: *
* 1: *
* 2: *
* 3: *
*****

001:0001-----
*#*****
*
*# Project Name: 560 Winston Churchill Blvd., Oakville
*# Project Number: 1870
*# Date : DECEMBER 15, 2020
*# Revised : SEPTEMBER 22, 2020
*# Modeller : JMN
*# Company : a.m. candaras associates inc.

```

```

*# License # : 3813174
*#*****
*
-----
| START | Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
----- Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 001
NSTORM= 1
# 1=CHIC25MM.STM
-----
001:0002-----
*
-----
| READ STORM | Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
| Ptotal= 25.00 mm | Comments: *BLOOR ST STAT DATA 10 MIN DISCRITIZATIO
-----

TIME RAIN TIME RAIN TIME RAIN TIME RAIN
hrs mm/hr hrs mm/hr hrs mm/hr hrs mm/hr
.08 1.624 1.08 12.284 2.08 3.786 3.08 1.940
.17 1.624 1.17 12.284 2.17 3.786 3.17 1.940
.25 1.853 1.25 58.772 2.25 3.233 3.25 1.803
.33 1.853 1.33 58.772 2.33 3.233 3.33 1.803
.42 2.170 1.42 16.185 2.42 2.838 3.42 1.688
.50 2.170 1.50 16.185 2.50 2.838 3.50 1.688
.58 2.651 1.58 8.549 2.58 2.529 3.58 1.588
.67 2.651 1.67 8.549 2.67 2.529 3.67 1.588
.75 3.470 1.75 5.927 2.75 2.292 3.75 1.501
.83 3.470 1.83 5.927 2.83 2.292 3.83 1.501
.92 5.201 1.92 4.598 2.92 2.098 3.92 1.422
1.00 5.201 2.00 4.598 3.00 2.098 4.00 1.422

001:0003-----
*
*****
*SITE 560 WINSTON CHURCHILL*
*****
*
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS
-----
| CALIB STANDHYD | Area (ha)= 11.68
| 01:002 DT= 1.00 | Total Imp(%)= 90.00 Dir. Conn.(%)= 90.00
-----

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 10.51 1.17
Dep. Storage (mm)= 2.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 30.00 40.00
Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 58.77 3.13
over (min) 2.00 30.00
Storage Coeff. (min)= 1.53 (ii) 29.74 (ii)
Unit Hyd. Tpeak (min)= 2.00 30.00
Unit Hyd. peak (cms)= .66 .04

*TOTALS*

```



PEAK FLOW (cms)=	1.71	.01	1.713 (iii)
TIME TO PEAK (hrs)=	1.33	1.92	1.333
RUNOFF VOLUME (mm)=	23.00	3.10	21.010
TOTAL RAINFALL (mm)=	25.00	25.00	25.000
RUNOFF COEFFICIENT =	.92	.12	.840

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
001:0004-----

## \* SWM POND AREA

CALIB STANDHYD	Area (ha)=	.87	
02:003 DT= 1.00	Total Imp(%)=	50.00	Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	58.77	4.71
over (min)	1.00	12.00
Storage Coeff. (min)=	1.27 (ii)	11.70 (ii)
Unit Hyd. Tpeak (min)=	1.00	12.00
Unit Hyd. peak (cms)=	.92	.10

*TOTALS*			
PEAK FLOW (cms)=	.07	.00	.072 (iii)
TIME TO PEAK (hrs)=	1.33	1.52	1.333
RUNOFF VOLUME (mm)=	23.00	3.10	13.052
TOTAL RAINFALL (mm)=	25.00	25.00	25.000
RUNOFF COEFFICIENT =	.92	.12	.522

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
001:0005-----

## \* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)=	.14	
03:004 DT= 1.00	Total Imp(%)=	25.00	Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	58.77	4.71
over (min)	2.00	12.00
Storage Coeff. (min)=	1.53 (ii)	11.96 (ii)
Unit Hyd. Tpeak (min)=	2.00	12.00
Unit Hyd. peak (cms)=	.66	.09

## \*TOTALS\*

PEAK FLOW (cms)=	.01	.00	.006 (iii)
TIME TO PEAK (hrs)=	1.33	1.52	1.333
RUNOFF VOLUME (mm)=	23.00	3.10	8.078
TOTAL RAINFALL (mm)=	25.00	25.00	25.000
RUNOFF COEFFICIENT =	.92	.12	.323

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
001:0006-----

## \* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)=	5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)=	.160	

Unit Hyd Qpeak (cms)=	.057
-----------------------	------

PEAK FLOW (cms)=	.002 (i)
TIME TO PEAK (hrs)=	1.517
RUNOFF VOLUME (mm)=	3.103
TOTAL RAINFALL (mm)=	25.000
RUNOFF COEFFICIENT =	.124

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
001:0007-----

\*\*\*\*\*

\* Discharge rates from the SWMP, buildings and paved area

\* Total Area = 12.55 ha

\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:002	11.68	1.713	1.33	21.01	.000
	+ID2 02:003	.87	.072	1.33	13.05	.000
	SUM 06:000300	12.55	1.786	1.33	20.46	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
001:0008-----

\*\*\*\*\*

\*STORMWATER MANAGEMENT FACILITY

\*PERMANENT WL 91.10 ORIFICE 125mm

\*EROS/EXT WL 91.90 WEIR 175mm

\*\*\*\*\*

```

ROUTE RESERVOIR      Requested routing time step = 1.0 min.
IN>06:(000300)
OUT<07:(000200)

===== OUTFLOW STORAGE TABLE =====
OUTFLOW      STORAGE      OUTFLOW      STORAGE
(cms)      (ha.m.)      (cms)      (ha.m.)
.000      .0000E+00      .178      .6238E+00
.013      .7430E-01      .256      .7344E+00
.020      .1543E+00      .391      .9076E+00
.025      .2403E+00      2.321      .1028E+01
.029      .3146E+00      3.906      .1089E+01
.060      .4139E+00      5.775      .1152E+01
.112      .5169E+00      7.890      .1215E+01

```

```

ROUTING RESULTS      AREA      QPEAK      TPEAK      R.V.
-----
INFLOW >06: (000300) 12.55      1.786      1.333      20.459
OUTFLOW <07: (000200) 12.55      .025      4.033      20.458

```

```

PEAK FLOW REDUCTION [Qout/Qin](%)= 1.380
TIME SHIFT OF PEAK FLOW (min)= 162.00
MAXIMUM STORAGE USED (ha.m.)=.2328E+00

```

001:0009-----

```

*****
* Discharge rates from the SWMP, buildings, paved area and
* Uncontrolled discharge being released onto Winston Churchill
*****

```

```

| ADD HYD (000300) | ID: NHYD      AREA      QPEAK      TPEAK      R.V.      DWF
-----
ID1 07:000200      12.55      .025      4.03      20.46      .000
+ID2 03:0004      .14      .006      1.33      8.08      .000
=====
SUM 08:000300      12.69      .025      4.00      20.32      .000

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0010-----

```

*****
** END OF RUN : 1

```

\*\*\*\*\*

```

| START | Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 002
NSTORM= 1

```

# 1=CHIC2YR.STM

```

002:0002-----
*****
* Project Name: 560 Winston Churchill Blvd., Oakville
* Project Number: 1870
* Date : DECEMBER 15, 2020
* Revised : SEPTEMBER 22, 2020
* Modeller : JMN
* Company : a.m. candaras associates inc.
* License # : 3813174
*****

```

002:0002-----

```

| READ STORM | Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
Ptotal= 34.80 mm | Comments: *BLOOR ST STAT DATA 10 MIN DISCRITIZATIO

```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.08	2.260	1.08	17.100	2.08	5.270	3.08	2.700
.17	2.260	1.17	17.100	2.17	5.270	3.17	2.700
.25	2.580	1.25	81.810	2.25	4.500	3.25	2.510
.33	2.580	1.33	81.810	2.33	4.500	3.33	2.510
.42	3.020	1.42	22.530	2.42	3.950	3.42	2.350
.50	3.020	1.50	22.530	2.50	3.950	3.50	2.350
.58	3.690	1.58	11.900	2.58	3.520	3.58	2.210
.67	3.690	1.67	11.900	2.67	3.520	3.67	2.210
.75	4.830	1.75	8.250	2.75	3.190	3.75	2.090
.83	4.830	1.83	8.250	2.83	3.190	3.83	2.090
.92	7.240	1.92	6.400	2.92	2.920	3.92	1.980
1.00	7.240	2.00	6.400	3.00	2.920	4.00	1.980

002:0003-----

```

*
*****
*SITE 560 WINSTON CHURCHILL*
*****

```

\* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

```

| CALIB STANDHYD | Area (ha)= 11.68
01:002 DT= 1.00 | Total Imp(%)= 90.00 Dir. Conn.(%)= 90.00

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	10.51	1.17
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	81.81	8.53
over (min)	1.00	20.00
Storage Coeff. (min)=	1.34 (ii)	20.24 (ii)

Unit Hyd. Tpeak (min)=	1.00	20.00	
Unit Hyd. peak (cms)=	.89	.06	
*TOTALS*			
PEAK FLOW (cms)=	2.39	.02	2.390 (iii)
TIME TO PEAK (hrs)=	1.33	1.65	1.333
RUNOFF VOLUME (mm)=	32.80	6.40	30.161
TOTAL RAINFALL (mm)=	34.80	34.80	34.800
RUNOFF COEFFICIENT =	.94	.18	.867

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

002:0004-----

\* SWM POND AREA

CALIB STANDHYD	Area (ha)=	.87	
02:003 DT= 1.00	Total Imp(%)=	50.00	Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	81.81	13.00
over (min)=	1.00	8.00
Storage Coeff. (min)=	1.12 (ii)	8.06 (ii)
Unit Hyd. Tpeak (min)=	1.00	8.00
Unit Hyd. peak (cms)=	1.01	.14

		*TOTALS*
PEAK FLOW (cms)=	.10	.01 .105 (iii)
TIME TO PEAK (hrs)=	1.33	1.43 1.333
RUNOFF VOLUME (mm)=	32.80	6.40 19.602
TOTAL RAINFALL (mm)=	34.80	34.80 34.800
RUNOFF COEFFICIENT =	.94	.18 .563

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

002:0005-----

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)=	.14	
03:004 DT= 1.00	Total Imp(%)=	25.00	Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00

Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	81.81	13.00
over (min)=	1.00	8.00
Storage Coeff. (min)=	1.34 (ii)	8.29 (ii)
Unit Hyd. Tpeak (min)=	1.00	8.00
Unit Hyd. peak (cms)=	.89	.14

		*TOTALS*
PEAK FLOW (cms)=	.01	.00 .009 (iii)
TIME TO PEAK (hrs)=	1.33	1.43 1.333
RUNOFF VOLUME (mm)=	32.80	6.40 13.003
TOTAL RAINFALL (mm)=	34.80	34.80 34.800
RUNOFF COEFFICIENT =	.94	.18 .374

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

002:0006-----

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)=	5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)=	.160	

Unit Hyd Qpeak (cms)=	.057
-----------------------	------

PEAK FLOW (cms)=	.005 (i)
TIME TO PEAK (hrs)=	1.500
RUNOFF VOLUME (mm)=	6.403
TOTAL RAINFALL (mm)=	34.800
RUNOFF COEFFICIENT =	.184

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

002:0007-----

\*\*\*\*\*

\* Discharge rates from the SWMP, buildings and paved area

\* Total Area = 12.55 ha

\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:002	11.68	2.390	1.33	30.16	.000
	+ID2 02:003	.87	.105	1.33	19.60	.000
=====						
	SUM 06:000300	12.55	2.495	1.33	29.43	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

002:0008-----

\*\*\*\*\*

\*STORMWATER MANAGEMENT FACILITY  
 \*PERMANENT WL 91.10 ORIFICE 125mm  
 \*EROS/EXT WL 91.90 WEIR 175mm  
 \*\*\*\*\*

ROUTE RESERVOIR  
 IN>06:(000300)  
 OUT<07:(000200)

Requested routing time step = 1.0 min.

===== OUTFLOW STORAGE TABLE =====	
OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00
.013	.7430E-01
.020	.1543E+00
.025	.2403E+00
.029	.3146E+00
.060	.4139E+00
.112	.5169E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	2.495	1.333	29.429
OUTFLOW<07: (000200)	12.55	.036	4.017	29.427

PEAK FLOW REDUCTION [Qout/Qin](%)= 1.462  
 TIME SHIFT OF PEAK FLOW (min)= 161.00  
 MAXIMUM STORAGE USED (ha.m.)=.3378E+00

002:0009-----  
 \*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings, paved area and  
 \* Uncontrolled discharge being released onto Winston Churchill  
 \*\*\*\*\*

ID	HYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1	07:000200	12.55	.036	4.02	29.43	.000
+ID2	03:004	.14	.009	1.33	13.00	.000
=====						
SUM	08:000300	12.69	.037	4.00	29.25	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

002:0010-----  
 \*\*\*\*\*

002:0002-----  
 \*\* END OF RUN : 2

\*\*\*\*\*

START | Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\

----- Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\  
 TZERO = .00 hrs on 0  
 METOUT= 2 (output = METRIC)  
 NRUN = 003  
 NSTORM= 1  
 # 1=CHIC5YR.STM

003:0002-----  
 \*  
 \*\* Project Name: 560 Winston Churchill Blvd., Oakville  
 \*\* Project Number: 1870  
 \*\* Date : DECEMBER 15, 2020  
 \*\* Revised : SEPTEMBER 22, 2020  
 \*\* Modeller : JMN  
 \*\* Company : a.m. candaras associates inc.  
 \*\* License # : 3813174  
 \*  
 \*\*\*\*\*

003:0002-----  
 \*

READ STORM		Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187	
Ptotal= 46.25 mm		Comments: *BLOOR ST STAT DATA 10 MIN DISCRITIZATIO	
TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
.08	2.820	1.08	22.680
.17	2.820	1.17	22.680
.25	3.240	1.25	113.160
.33	3.240	1.33	113.160
.42	3.810	1.42	30.090
.50	3.810	1.50	30.090
.58	4.680	1.58	15.580
.67	4.680	1.67	15.580
.75	6.160	1.75	10.690
.83	6.160	1.83	10.690
.92	9.350	1.92	8.230
1.00	9.350	2.00	8.230

003:0003-----  
 \*

\*\*\*\*\*  
 \*SITE 560 WINSTON CHURCHILL\*  
 \*\*\*\*\*

\* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

CALIB STANDHYD		Area (ha)=	11.68
01:002 DT= 1.00		Total Imp(%)=	90.00
		Dir. Conn.(%)=	90.00
		IMPERVIOUS	PERVIOUS (i)
Surface Area	(ha)=	10.51	1.17
Dep. Storage	(mm)=	2.00	5.00
Average Slope	(%)=	1.00	2.00
Length	(m)=	30.00	40.00

```

Mannings n      =      .013      .250
Max.eff.Inten.(mm/hr)= 113.16    18.45
over (min)      =      1.00      15.00
Storage Coeff. (min)= 1.18 (ii)  15.06 (ii)
Unit Hyd. Tpeak (min)= 1.00      15.00
Unit Hyd. peak (cms)= .97        .08

```

```

*TOTALS*
PEAK FLOW (cms)= 3.30      .04      3.314 (iii)
TIME TO PEAK (hrs)= 1.33      1.57      1.333
RUNOFF VOLUME (mm)= 44.25     11.34     40.959
TOTAL RAINFALL (mm)= 46.25     46.25     46.250
RUNOFF COEFFICIENT = .96        .25      .886

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
003:0004-----
* SWM POND AREA

```

```

| CALIB STANDHYD | Area (ha)= .87
| 02:003 DT= 1.00 | Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00

```

```

IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= .44      .44
Dep. Storage (mm)= 2.00      5.00
Average Slope (%)= 1.00      2.00
Length (m)= 22.00      10.00
Mannings n = .013      .250

```

```

Max.eff.Inten.(mm/hr)= 113.16    28.32
over (min)      =      1.00      6.00
Storage Coeff. (min)= .98 (ii)  6.07 (ii)
Unit Hyd. Tpeak (min)= 1.00      6.00
Unit Hyd. peak (cms)= 1.09      .19

```

```

*TOTALS*
PEAK FLOW (cms)= .14        .02      .155 (iii)
TIME TO PEAK (hrs)= 1.33      1.40      1.333
RUNOFF VOLUME (mm)= 44.25     11.34     27.793
TOTAL RAINFALL (mm)= 46.25     46.25     46.250
RUNOFF COEFFICIENT = .96        .25      .601

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
003:0005-----
* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

```

```

| CALIB STANDHYD | Area (ha)= .14
| 03:004 DT= 1.00 | Total Imp(%)= 25.00 Dir. Conn.(%)= 25.00

```

```

-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= .04      .10
Dep. Storage (mm)= 2.00      5.00
Average Slope (%)= 1.00      2.00
Length (m)= 30.00      10.00
Mannings n = .013      .250

```

```

Max.eff.Inten.(mm/hr)= 113.16    28.32
over (min)      =      1.00      6.00
Storage Coeff. (min)= 1.18 (ii)  6.27 (ii)
Unit Hyd. Tpeak (min)= 1.00      6.00
Unit Hyd. peak (cms)= .97        .18

```

```

*TOTALS*
PEAK FLOW (cms)= .01        .01      .015 (iii)
TIME TO PEAK (hrs)= 1.33      1.40      1.333
RUNOFF VOLUME (mm)= 44.25     11.34     19.564
TOTAL RAINFALL (mm)= 46.25     46.25     46.250
RUNOFF COEFFICIENT = .96        .25      .423

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
003:0006-----
* UNCONTROLLED AREA TO CHANNEL

```

```

| CALIB NASHYD | Area (ha)= .24 Curve Number (CN)=70.00
| 04:005 DT= 1.00 | Ia (mm)= 5.000 # of Linear Res.(N)= 3.00
| U.H. Tp(hrs)= .160

```

```

Unit Hyd Qpeak (cms)= .057

```

```

PEAK FLOW (cms)= .010 (i)
TIME TO PEAK (hrs)= 1.483
RUNOFF VOLUME (mm)= 11.334
TOTAL RAINFALL (mm)= 46.250
RUNOFF COEFFICIENT = .245

```

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
003:0007-----
*****
* Discharge rates from the SWMP, buildings and paved area
* Total Area = 12.55 ha
*****

```

```

| ADD HYD (000300) | ID: NHYD AREA QPEAK TPEAK R.V. DWF
| (ha) (cms) (hrs) (mm) (cms)
ID1 01:002 11.68 3.314 1.33 40.96 .000
+ID2 02:003 .87 .155 1.33 27.79 .000
=====
SUM 06:000300 12.55 3.469 1.33 40.05 .000

```



NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

003:0008-----

\*\*\*\*\*  
\*STORMWATER MANAGEMENT FACILITY  
\*PERMANENT WL 91.10 ORIFICE 125mm  
\*EROS/EXT WL 91.90 WEIR 175mm  
\*\*\*\*\*

ROUTE RESERVOIR		Requested routing time step = 1.0 min.	
IN>06:(000300)	OUT<07:(000200)	===== OUTFLOW STORAGE TABLE =====	
		OUTFLOW STORAGE	OUTFLOW STORAGE
		(cms) (ha.m.)	(cms) (ha.m.)
		.000 .0000E+00	.178 .6238E+00
		.013 .7430E-01	.256 .7344E+00
		.020 .1543E+00	.391 .9076E+00
		.025 .2403E+00	2.321 .1028E+01
		.029 .3146E+00	3.906 .1089E+01
		.060 .4139E+00	5.775 .1152E+01
		.112 .5169E+00	7.890 .1215E+01

ROUTING RESULTS	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW >06: (000300)	12.55	3.469	1.333	40.046
OUTFLOW <07: (000200)	12.55	.074	4.000	40.045

PEAK FLOW REDUCTION [Qout/Qin](%)= 2.120  
TIME SHIFT OF PEAK FLOW (min)= 160.00  
MAXIMUM STORAGE USED (ha.m.)=.4410E+00

003:0009-----

\*\*\*\*\*  
\* Discharge rates from the SWMP, buildings, paved area and  
\* Uncontrolled discharge being released onto Winston Churchill  
\*\*\*\*\*

ADD HYD (000300)	ID: NYHD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
ID1 07:000200		12.55	.074	4.00	40.04	.000
+ID2 03:004		.14	.015	1.33	19.56	.000
=====						
SUM 08:000300		12.69	.074	4.00	39.82	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

003:0010-----

\*\*\*\*\*

003:0002-----

003:0002-----

\*\* END OF RUN : 3

\*\*\*\*\*

START	Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
	Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on	0
METOUT= 2 (output = METRIC)	
NRUN = 004	
NSTORM= 1	
# 1=CHIC10YR.STM	

004:0002-----

\*\*\*\*\*  
\* Project Name: 560 Winston Churchill Blvd., Oakville  
\* Project Number: 1870  
\* Date : DECEMBER 15, 2020  
\* Revised : SEPTEMBER 22, 2020  
\* Modeller : JMN  
\* Company : a.m. candaras associates inc.  
\* License # : 3813174  
\*\*\*\*\*

004:0002-----

\*

READ STORM	Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
Ptotal= 54.14 mm	Comments: *BLOOR ST STAT DATA 10 MIN DISCRITIZATIO

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.08	3.410	1.08	25.220	2.08	7.880	3.08	4.080
.17	3.410	1.17	25.220	2.17	7.880	3.17	4.080
.25	3.890	1.25	135.630	2.25	6.750	3.25	3.800
.33	3.890	1.33	135.630	2.33	6.750	3.33	3.800
.42	4.560	1.42	33.220	2.42	5.930	3.42	3.560
.50	4.560	1.50	33.220	2.50	5.930	3.50	3.560
.58	5.550	1.58	17.550	2.58	5.300	3.58	3.350
.67	5.550	1.67	17.550	2.67	5.300	3.67	3.350
.75	7.230	1.75	12.240	2.75	4.810	3.75	3.160
.83	7.230	1.83	12.240	2.83	4.810	3.83	3.160
.92	10.770	1.92	9.540	2.92	4.410	3.92	3.000
1.00	10.770	2.00	9.540	3.00	4.410	4.00	3.000

004:0003-----

\*

\*\*\*\*\*  
\*SITE 560 WINSTON CHURCHILL\*  
\*\*\*\*\*

\*

\* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

CALIB STANDHYD	Area	(ha)=
	11.68	

01:002	DT= 1.00	Total Imp(%)= 90.00	Dir. Conn.(%)= 90.00
--------	----------	---------------------	----------------------

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	10.51	1.17
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	135.63	27.75
over (min)	1.00	13.00
Storage Coeff. (min)=	1.10 (ii)	12.88 (ii)
Unit Hyd. Tpeak (min)=	1.00	13.00
Unit Hyd. peak (cms)=	1.02	.09

*TOTALS*		
PEAK FLOW (cms)=	3.96	.06
TIME TO PEAK (hrs)=	1.33	1.52
RUNOFF VOLUME (mm)=	52.14	15.28
TOTAL RAINFALL (mm)=	54.14	54.14
RUNOFF COEFFICIENT =	.96	.28

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

004:0004-

\* SWM POND AREA

CALIB STANDHYD	Area (ha)= .87
02:003 DT= 1.00	Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	135.63	41.68
over (min)	1.00	5.00
Storage Coeff. (min)=	.91 (ii)	5.27 (ii)
Unit Hyd. Tpeak (min)=	1.00	5.00
Unit Hyd. peak (cms)=	1.13	.22

*TOTALS*		
PEAK FLOW (cms)=	.16	.03
TIME TO PEAK (hrs)=	1.33	1.38
RUNOFF VOLUME (mm)=	52.14	15.28
TOTAL RAINFALL (mm)=	54.14	54.14
RUNOFF COEFFICIENT =	.96	.28

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

004:0005-

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)= .14
03:004 DT= 1.00	Total Imp(%)= 25.00 Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	135.63	41.68
over (min)	1.00	5.00
Storage Coeff. (min)=	1.10 (ii)	5.46 (ii)
Unit Hyd. Tpeak (min)=	1.00	5.00
Unit Hyd. peak (cms)=	1.02	.21

*TOTALS*		
PEAK FLOW (cms)=	.01	.01
TIME TO PEAK (hrs)=	1.33	1.38
RUNOFF VOLUME (mm)=	52.14	15.28
TOTAL RAINFALL (mm)=	54.14	54.14
RUNOFF COEFFICIENT =	.96	.28

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

004:0006-

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)= .24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)= 5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)= .160	

Unit Hyd Qpeak (cms)=	.057
-----------------------	------

PEAK FLOW (cms)=	.013 (i)
TIME TO PEAK (hrs)=	1.467
RUNOFF VOLUME (mm)=	15.282
TOTAL RAINFALL (mm)=	54.140
RUNOFF COEFFICIENT =	.282

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

004:0007-

\*\*\*\*\*  
\* Discharge rates from the SWMP, buildings and paved area  
\* Total Area = 12.55 ha  
\*\*\*\*\*

File: N:\otthymo\1870\1870PST.out 6/16/2022, 4:10:54 PM

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:002		11.68	3.981	1.33	48.45	.000
+ID2 02:003		.87	.194	1.33	33.71	.000
=====						
SUM 06:000300		12.55	4.175	1.33	47.43	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

004:0008-----

\*\*\*\*\*

\*STORMWATER MANAGEMENT FACILITY

\*PERMANENT WL 91.10 ORIFICE 125mm

\*EROS/EXT WL 91.90 WEIR 175mm

\*\*\*\*\*

ROUTE RESERVOIR IN>06:(000300) OUT<07:(000200)	Requested routing time step = 1.0 min.
=====	=====
OUTFLOW	STORAGE
(cms)	(ha.m.)
.000	.0000E+00
.013	.7430E-01
.020	.1543E+00
.025	.2403E+00
.029	.3146E+00
.060	.4139E+00
.112	.5169E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	4.175	1.333	47.432
OUTFLOW<07: (000200)	12.55	.106	3.700	47.431

PEAK FLOW REDUCTION [Qout/Qin](%)= 2.528  
TIME SHIFT OF PEAK FLOW (min)= 142.00  
MAXIMUM STORAGE USED (ha.m.)=.5041E+00

004:0009-----

\*\*\*\*\*

\* Discharge rates from the SWMP, buildings, paved area and  
\* Uncontrolled discharge being released onto Winston Churchill  
\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 07:000200		12.55	.106	3.70	47.43	.000
+ID2 03:004		.14	.020	1.33	24.50	.000
=====						
SUM 08:000300		12.69	.106	3.67	47.18	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

004:0010-----

\*\*\*\*\*

File: N:\otthymo\1870\1870PST.out 6/16/2022, 4:10:54 PM

-----  
004:0002-----  
-----  
004:0002-----  
-----  
004:0002-----  
-----  
\*\* END OF RUN : 4

\*\*\*\*\*

START	Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on 0	Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
METOUT= 2 (output = METRIC)	
NRUN = 005	
NSTORM= 1	
# 1=CHIC25YR.STM	

005:0002-----

\*\*\*\*\*

\*  
\*# Project Name: 560 Winston Churchill Blvd., Oakville  
\*# Project Number: 1870  
\*# Date : DECEMBER 15, 2020  
\*# Revised : SEPTEMBER 22, 2020  
\*# Modeller : JMN  
\*# Company : a.m. candaras associates inc.  
\*# License # : 3813174  
\*\*\*\*\*

005:0002-----

\*

READ STORM	Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
Ptotal= 62.16 mm	Comments: *BLOOR ST STAT DATA 10 MIN DISCRITIZATIO

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.08	4.040	1.08	27.240	2.08	9.030	3.08	4.800
.17	4.040	1.17	27.240	2.17	9.030	3.17	4.800
.25	4.590	1.25	159.940	2.25	7.790	3.25	4.480
.33	4.590	1.33	159.940	2.33	7.790	3.33	4.480
.42	5.340	1.42	35.500	2.42	6.880	3.42	4.200
.50	5.340	1.50	35.500	2.50	6.880	3.50	4.200
.58	6.460	1.58	19.320	2.58	6.190	3.58	3.960
.67	6.460	1.67	19.320	2.67	6.190	3.67	3.960
.75	8.320	1.75	13.740	2.75	5.630	3.75	3.750
.83	8.320	1.83	13.740	2.83	5.630	3.83	3.750
.92	12.160	1.92	10.840	2.92	5.180	3.92	3.570
1.00	12.160	2.00	10.840	3.00	5.180	4.00	3.570

```

005:0003-----
*
*****
*SITE 560 WINSTON CHURCHILL*
*****
*
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS
-----
| CALIB STANDHYD | Area (ha)= 11.68
| 01:002 DT= 1.00 | Total Imp(%)= 90.00 Dir. Conn.(%)= 90.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 10.51 1.17
Dep. Storage (mm)= 2.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 30.00 40.00
Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 159.94 41.33
over (min)= 1.00 11.00
Storage Coeff. (min)= 1.03 (ii) 11.08 (ii)
Unit Hyd. Tpeak (min)= 1.00 11.00
Unit Hyd. peak (cms)= 1.06 .10

*TOTALS*
PEAK FLOW (cms)= 4.67 .08 4.709 (iii)
TIME TO PEAK (hrs)= 1.33 1.48 1.333
RUNOFF VOLUME (mm)= 60.16 19.68 56.110
TOTAL RAINFALL (mm)= 62.16 62.16 62.158
RUNOFF COEFFICIENT = .97 .32 .903

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 70.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

-----
005:0004-----
* SWM POND AREA
-----
| CALIB STANDHYD | Area (ha)= .87
| 02:003 DT= 1.00 | Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= .44 .44
Dep. Storage (mm)= 2.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 22.00 10.00
Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 159.94 56.01
over (min)= 1.00 5.00
Storage Coeff. (min)= .85 (ii) 4.73 (ii)
Unit Hyd. Tpeak (min)= 1.00 5.00
Unit Hyd. peak (cms)= 1.17 .23

*TOTALS*
PEAK FLOW (cms)= .19 .05 .236 (iii)
TIME TO PEAK (hrs)= 1.33 1.37 1.333

```

```

RUNOFF VOLUME (mm)= 60.16 19.68 39.919
TOTAL RAINFALL (mm)= 62.16 62.16 62.158
RUNOFF COEFFICIENT = .97 .32 .642

```

```

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 70.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

-----
005:0005-----
* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD
-----
| CALIB STANDHYD | Area (ha)= .14
| 03:004 DT= 1.00 | Total Imp(%)= 25.00 Dir. Conn.(%)= 25.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= .04 .10
Dep. Storage (mm)= 2.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 30.00 10.00
Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 159.94 56.01
over (min)= 1.00 5.00
Storage Coeff. (min)= 1.03 (ii) 4.90 (ii)
Unit Hyd. Tpeak (min)= 1.00 5.00
Unit Hyd. peak (cms)= 1.06 .23

*TOTALS*
PEAK FLOW (cms)= .02 .01 .026 (iii)
TIME TO PEAK (hrs)= 1.33 1.37 1.333
RUNOFF VOLUME (mm)= 60.16 19.68 29.799
TOTAL RAINFALL (mm)= 62.16 62.16 62.158
RUNOFF COEFFICIENT = .97 .32 .479

```

```

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 70.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

-----
005:0006-----
* UNCONTROLLED AREA TO CHANNEL
-----
| CALIB NASHYD | Area (ha)= .24 Curve Number (CN)=70.00
| 04:005 DT= 1.00 | Ia (mm)= 5.000 # of Linear Res.(N)= 3.00
-----
U.H. Tp(hrs)= .160

Unit Hyd Qpeak (cms)= .057

PEAK FLOW (cms)= .018 (i)
TIME TO PEAK (hrs)= 1.467
RUNOFF VOLUME (mm)= 19.678
TOTAL RAINFALL (mm)= 62.158
RUNOFF COEFFICIENT = .317

```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

005:0007-

\*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings and paved area  
 \* Total Area = 12.55 ha  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:002		11.68	4.709	1.33	56.11	.000
+ID2 02:003		.87	.236	1.33	39.92	.000
SUM 06:000300		12.55	4.945	1.33	54.99	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

005:0008-

\*\*\*\*\*  
 \*STORMWATER MANAGEMENT FACILITY  
 \*PERMANENT WL 91.10 ORIFICE 125mm  
 \*EROS/EXT WL 91.90 WEIR 175mm  
 \*\*\*\*\*

ROUTE RESERVOIR IN>06:(000300) OUT<07:(000200)	Requested routing time step = 1.0 min.			
	OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
	.000	.0000E+00	.178	.6238E+00
	.013	.7430E-01	.256	.7344E+00
	.020	.1543E+00	.391	.9076E+00
	.025	.2403E+00	2.321	.1028E+01
	.029	.3146E+00	3.906	.1089E+01
	.060	.4139E+00	5.775	.1152E+01
	.112	.5169E+00	7.890	.1215E+01

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	4.945	1.333	54.988
OUTFLOW <07: (000200)	12.55	.143	3.350	54.987

PEAK FLOW REDUCTION [Qout/Qin](%)= 2.889  
 TIME SHIFT OF PEAK FLOW (min)= 121.00  
 MAXIMUM STORAGE USED (ha.m.)=.5667E+00

005:0009-

\*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings, paved area and  
 \* Uncontrolled discharge being released onto Winston Churchill  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 07:000200		12.55	.143	3.35	54.99	.000

+ID2 03:004	.14	.026	1.33	29.80	.000
SUM 08:000300	12.69	.144	3.33	54.71	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

005:0010-

\*\*\*\*\*

005:0002-

005:0002-

005:0002-

005:0002-

\*\* END OF RUN : 5

\*\*\*\*\*

START	Project dir.:	C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
	Rainfall dir.:	C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO =	.00 hrs on	0
METOUT=	2 (output = METRIC)	
NRUN =	006	
NSTORM=	1	
#	1=CH100YR.STM	

006:0002-

\*\*\*\*\*

\*  
 \*# Project Name: 560 Winston Churchill Blvd., Oakville  
 \*# Project Number: 1870  
 \*# Date : DECEMBER 15, 2020  
 \*# Revised : SEPTEMBER 22, 2020  
 \*# Modeller : JMN  
 \*# Company : a.m. candaras associates inc.  
 \*# License # : 3813174  
 \*#\*\*\*\*\*

006:0002-

\*\*\*\*\*

READ STORM	Filename:	C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
Ptotal= 78.03 mm	Comments:	*BLOOR ST STAT DATA 10 MIN DISCRITIZATIO

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
.08	4.310	1.08	38.040	2.08	10.640	3.08	5.210
.17	4.310	1.17	38.040	2.17	10.640	3.17	5.210
.25	4.960	1.25	203.310	2.25	8.990	3.25	4.830

.33	4.960	1.33	203.310	2.33	8.990	3.33	4.830
.42	5.880	1.42	51.040	2.42	7.810	3.42	4.500
.50	5.880	1.50	51.040	2.50	7.810	3.50	4.500
.58	7.270	1.58	25.590	2.58	6.920	3.58	4.220
.67	7.270	1.67	25.590	2.67	6.920	3.67	4.220
.75	9.690	1.75	17.240	2.75	6.230	3.75	3.970
.83	9.690	1.83	17.240	2.83	6.230	3.83	3.970
.92	15.000	1.92	13.110	2.92	5.670	3.92	3.760
1.00	15.000	2.00	13.110	3.00	5.670	4.00	3.760

006:0003-----

\*  
 \*\*\*\*\*  
 \*SITE 560 WINSTON CHURCHILL\*  
 \*\*\*\*\*

\* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

CALIB STANDHYD	Area (ha)=	11.68
01:002 DT= 1.00	Total Imp(%)=	90.00 Dir. Conn.(%)= 90.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	10.51	1.17
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	203.31	72.73
over (min)	1.00	9.00
Storage Coeff. (min)=	.93 (ii)	8.95 (ii)
Unit Hyd. Tpeak (min)=	1.00	9.00
Unit Hyd. peak (cms)=	1.12	.13

\*TOTALS\*  
 PEAK FLOW (cms)= 5.94 .14 6.027 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.45 1.333  
 RUNOFF VOLUME (mm)= 76.03 29.32 71.361  
 TOTAL RAINFALL (mm)= 78.03 78.03 78.032  
 RUNOFF COEFFICIENT = .97 .38 .915

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

006:0004-----

\* SWM POND AREA

CALIB STANDHYD	Area (ha)=	.87
02:003 DT= 1.00	Total Imp(%)=	50.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00

Length (m)=	22.00	10.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	203.31	88.72
over (min)	1.00	4.00
Storage Coeff. (min)=	.78 (ii)	4.00 (ii)
Unit Hyd. Tpeak (min)=	1.00	4.00
Unit Hyd. peak (cms)=	1.23	.28

\*TOTALS\*  
 PEAK FLOW (cms)= .25 .08 .323 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.35 1.333  
 RUNOFF VOLUME (mm)= 76.03 29.32 52.678  
 TOTAL RAINFALL (mm)= 78.03 78.03 78.032  
 RUNOFF COEFFICIENT = .97 .38 .675

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

006:0005-----

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)=	.14
03:004 DT= 1.00	Total Imp(%)=	25.00 Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	203.31	88.72
over (min)	1.00	4.00
Storage Coeff. (min)=	.93 (ii)	4.16 (ii)
Unit Hyd. Tpeak (min)=	1.00	4.00
Unit Hyd. peak (cms)=	1.12	.28

\*TOTALS\*  
 PEAK FLOW (cms)= .02 .02 .038 (iii)  
 TIME TO PEAK (hrs)= 1.33 1.35 1.333  
 RUNOFF VOLUME (mm)= 76.03 29.32 41.000  
 TOTAL RAINFALL (mm)= 78.03 78.03 78.032  
 RUNOFF COEFFICIENT = .97 .38 .525

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

006:0006-----

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
--------------	------------	-----	-------------------------



| 04:005 DT= 1.00 | Ia (mm)= 5.000 # of Linear Res.(N)= 3.00  
 ----- U.H. Tp(hrs)= .160

Unit Hyd Qpeak (cms)= .057

PEAK FLOW (cms)= .028 (i)  
 TIME TO PEAK (hrs)= 1.467  
 RUNOFF VOLUME (mm)= 29.322  
 TOTAL RAINFALL (mm)= 78.032  
 RUNOFF COEFFICIENT = .376

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

006:0007-----

\*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings and paved area  
 \* Total Area = 12.55 ha  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:002		11.68	6.027	1.33	71.36	.000
+ID2 02:003		.87	.323	1.33	52.68	.000
=====						
SUM 06:000300		12.55	6.350	1.33	70.07	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

006:0008-----

\*\*\*\*\*  
 \*STORMWATER MANAGEMENT FACILITY  
 \*PERMANENT WL 91.10 ORIFICE 125mm  
 \*EROS/EXT WL 91.90 WEIR 175mm  
 \*\*\*\*\*

ROUTE RESERVOIR IN>06:(000300) OUT<07:(000200)		Requested routing time step = 1.0 min.			
OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)		
.000	.0000E+00	.178	.6238E+00		
.013	.7430E-01	.256	.7344E+00		
.020	.1543E+00	.391	.9076E+00		
.025	.2403E+00	2.321	.1028E+01		
.029	.3146E+00	3.906	.1089E+01		
.060	.4139E+00	5.775	.1152E+01		
.112	.5169E+00	7.890	.1215E+01		

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	6.350	1.333	70.066
OUTFLOW <07: (000200)	12.55	.231	2.667	70.063

PEAK FLOW REDUCTION [Qout/Qin](%)= 3.635  
 TIME SHIFT OF PEAK FLOW (min)= 80.00  
 MAXIMUM STORAGE USED (ha.m.)= .6985E+00

006:0009-----

\*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings, paved area and  
 \* Uncontrolled discharge being released onto Winston Churchill  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 07:000200		12.55	.231	2.67	70.06	.000
+ID2 03:004		.14	.038	1.33	41.00	.000
=====						
SUM 08:000300		12.69	.233	2.53	69.74	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

006:0010-----

\*\*\*\*\*

006:0002-----

006:0002-----

006:0002-----

006:0002-----

006:0002-----

\*\* END OF RUN : 6

\*\*\*\*\*

START	Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
	Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on 0	
METOUT= 2 (output = METRIC)	
NRUN = 007	
NSTORM= 1	
# 1=2Y24HS.STM	

007:0002-----

\*\*\*\*\*

\*  
 \*# Project Name: 560 Winston Churchill Blvd., Oakville  
 \*# Project Number: 1870  
 \*# Date : DECEMBER 15, 2020  
 \*# Revised : SEPTEMBER 22, 2020  
 \*# Modeller : JMN  
 \*# Company : a.m. candaras associates inc.  
 \*# License # : 3813174  
 \*#\*\*\*\*\*

```

*
-----
007:0002-----
*
| READ STORM |      Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
| Ptotal= 51.39 mm |      Comments: * 2YR SCS 24hr STORM, 15min TIME STEPS,M
|-----|
| TIME  RAIN | TIME  RAIN | TIME  RAIN | TIME  RAIN |
| hrs  mm/hr | hrs  mm/hr | hrs  mm/hr | hrs  mm/hr |
|-----|
|.25   .570 | 6.25  1.030 | 12.25  7.400 | 18.25  .920 |
|.50   .570 | 6.50  1.030 | 12.50  7.400 | 18.50  .920 |
|.75   .570 | 6.75  1.030 | 12.75  3.800 | 18.75  .920 |
|1.00   .570 | 7.00  1.030 | 13.00  3.800 | 19.00  .920 |
|1.25   .570 | 7.25  1.030 | 13.25  .720 | 19.25  .920 |
|1.50   .570 | 7.50  1.030 | 13.50  .720 | 19.50  .920 |
|1.75   .570 | 7.75  1.030 | 13.75  4.210 | 19.75  .920 |
|2.00   .570 | 8.00  1.030 | 14.00  4.210 | 20.00  .920 |
|2.25   .670 | 8.25  1.390 | 14.25  1.540 | 20.25  .620 |
|2.50   .670 | 8.50  1.390 | 14.50  1.540 | 20.50  .620 |
|2.75   .670 | 8.75  1.390 | 14.75  1.540 | 20.75  .620 |
|3.00   .670 | 9.00  1.390 | 15.00  1.540 | 21.00  .620 |
|3.25   .670 | 9.25  1.640 | 15.25  1.540 | 21.25  .620 |
|3.50   .670 | 9.50  1.640 | 15.50  1.540 | 21.50  .620 |
|3.75   .670 | 9.75  1.850 | 15.75  1.540 | 21.75  .620 |
|4.00   .670 | 10.00 1.850 | 16.00  1.540 | 22.00  .620 |
|4.25   .820 | 10.25 2.360 | 16.25  .920 | 22.25  .620 |
|4.50   .820 | 10.50 2.360 | 16.50  .920 | 22.50  .620 |
|4.75   .820 | 10.75 3.190 | 16.75  .920 | 22.75  .620 |
|5.00   .820 | 11.00 3.190 | 17.00  .920 | 23.00  .620 |
|5.25   .820 | 11.25 4.930 | 17.25  .920 | 23.25  .620 |
|5.50   .820 | 11.50 4.930 | 17.50  .920 | 23.50  .620 |
|5.75   .820 | 11.75 21.380 | 17.75  .920 | 23.75  .620 |
|6.00   .820 | 12.00 56.730 | 18.00  .920 | 24.00  .620 |

```

```

-----
007:0003-----
*
*****
*SITE 560 WINSTON CHURCHILL*
*****
*
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

```

```

| CALIB STANDHYD |      Area (ha)= 11.68
| 01:002  DT= 1.00 |      Total Imp(%)= 90.00  Dir. Conn.(%)= 90.00
|-----|
| IMPERVIOUS | PERVIOUS (i) |
| Surface Area (ha)= 10.51 | 1.17 |
| Dep. Storage (mm)= 2.00 | 5.00 |
| Average Slope (%)= 1.00 | 2.00 |
| Length (m)= 30.00 | 40.00 |
| Mannings n = .013 | .250 |
|
| Max.eff.Inten.(mm/hr)= 56.73 | 16.57 |
| over (min) 2.00 | 16.00 |
| Storage Coeff. (min)= 1.56 (ii) | 16.04 (ii) |
| Unit Hyd. Tpeak (min)= 2.00 | 16.00 |

```

```

Unit Hyd. peak (cms)= .65 .07
*TOTALS*
PEAK FLOW (cms)= 1.66 .03 1.679 (iii)
TIME TO PEAK (hrs)= 12.00 12.17 12.000
RUNOFF VOLUME (mm)= 49.39 13.86 45.835
TOTAL RAINFALL (mm)= 51.39 51.39 51.388
RUNOFF COEFFICIENT = .96 .27 .892

```

```

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 70.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

-----
007:0004-----
* SWM POND AREA
| CALIB STANDHYD |      Area (ha)= .87
| 02:003  DT= 1.00 |      Total Imp(%)= 50.00  Dir. Conn.(%)= 50.00
|-----|
| IMPERVIOUS | PERVIOUS (i) |
| Surface Area (ha)= .44 | .44 |
| Dep. Storage (mm)= 2.00 | 5.00 |
| Average Slope (%)= 1.00 | 2.00 |
| Length (m)= 22.00 | 10.00 |
| Mannings n = .013 | .250 |
|
| Max.eff.Inten.(mm/hr)= 56.73 | 19.62 |
| over (min) 1.00 | 7.00 |
| Storage Coeff. (min)= 1.29 (ii) | 7.19 (ii) |
| Unit Hyd. Tpeak (min)= 1.00 | 7.00 |
| Unit Hyd. peak (cms)= .92 | .16 |
*TOTALS*
PEAK FLOW (cms)= .07 .02 .086 (iii)
TIME TO PEAK (hrs)= 12.00 12.03 12.000
RUNOFF VOLUME (mm)= 49.39 13.86 31.624
TOTAL RAINFALL (mm)= 51.39 51.39 51.388
RUNOFF COEFFICIENT = .96 .27 .615

```

```

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 70.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

```

-----
007:0005-----
* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD
| CALIB STANDHYD |      Area (ha)= .14
| 03:004  DT= 1.00 |      Total Imp(%)= 25.00  Dir. Conn.(%)= 25.00
|-----|
| IMPERVIOUS | PERVIOUS (i) |
| Surface Area (ha)= .04 | .10 |
| Dep. Storage (mm)= 2.00 | 5.00 |
| Average Slope (%)= 1.00 | 2.00 |
| Length (m)= 30.00 | 10.00 |

```

Mannings n = .013 .250  
Max.eff.Inten.(mm/hr)= 56.73 19.62  
over (min) 2.00 7.00  
Storage Coeff. (min)= 1.56 (ii) 7.45 (ii)  
Unit Hyd. Tpeak (min)= 2.00 7.00  
Unit Hyd. peak (cms)= .65 .16  
  
PEAK FLOW (cms)= .01 .00 .010 (iii)  
TIME TO PEAK (hrs)= 12.00 12.03 12.000  
RUNOFF VOLUME (mm)= 49.39 13.86 22.743  
TOTAL RAINFALL (mm)= 51.39 51.39 51.388  
RUNOFF COEFFICIENT = .96 .27 .443

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

007:0006-----

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)= 5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)= .160	

Unit Hyd Qpeak (cms)= .057

PEAK FLOW (cms)= .009 (i)  
TIME TO PEAK (hrs)= 12.067  
RUNOFF VOLUME (mm)= 13.859  
TOTAL RAINFALL (mm)= 51.388  
RUNOFF COEFFICIENT = .270

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

007:0007-----

\*\*\*\*\*  
\* Discharge rates from the SWMP, buildings and paved area  
\* Total Area = 12.55 ha  
\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:002		11.68	1.679	12.00	45.83	.000
+ID2 02:003		.87	.086	12.00	31.62	.000
SUM 06:000300		12.55	1.765	12.00	44.85	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

007:0008-----

\*\*\*\*\*  
\*STORMWATER MANAGEMENT FACILITY

\*PERMANENT WL 91.10 ORIFICE 125mm  
\*EROS/EXT WL 91.90 WEIR 175mm  
\*\*\*\*\*

ROUTE RESERVOIR	Requested routing time step = 1.0 min.
IN>06:(000300)	
OUT<07:(000200)	
=====	=====
OUTFLOW (cms)	OUTFLOW STORAGE (ha.m.)
.000	.0000E+00
.013	.7430E-01
.020	.1543E+00
.025	.2403E+00
.029	.3146E+00
.060	.4139E+00
.112	.5169E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	1.765	12.000	44.850
OUTFLOW<07: (000200)	12.55	.054	14.133	44.849

PEAK FLOW REDUCTION [Qout/Qin]({})= 3.069  
TIME SHIFT OF PEAK FLOW (min)= 128.00  
MAXIMUM STORAGE USED (ha.m.)=.3955E+00

007:0009-----

\*\*\*\*\*  
\* Discharge rates from the SWMP, buildings, paved area and  
\* Uncontrolled discharge being released onto Winston Churchill  
\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 07:000200		12.55	.054	14.13	44.85	.000
+ID2 03:004		.14	.010	12.00	22.74	.000
SUM 08:000300		12.69	.055	14.02	44.60	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

007:0010-----

\*\*\*\*\*

007:0002-----

007:0002-----

007:0002-----

007:0002-----

007:0002-----

007:0002-----

\*\* END OF RUN : 7

\*\*\*\*\*

```

-----
| START | Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
-----
| Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 008
NSTORM= 1
# 1=5Y24HS.STM
-----

```

008:0002-----

```

*#*****
*# Project Name: 560 Winston Churchill Blvd., Oakville
*# Project Number: 1870
*# Date : DECEMBER 15, 2020
*# Revised : SEPTEMBER 22, 2020
*# Modeller : JMN
*# Company : a.m. candaras associates inc.
*# License # : 3813174
*#*****
*

```

008:0002-----

```

*
-----
| READ STORM | Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
| Ptotal= 63.89 mm | Comments: * 5 YEAR SCS 24hr STORM, 15 min TIME STE
-----

```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.25	.700	6.25	1.280	12.25	9.200	18.25	1.150
.50	.700	6.50	1.280	12.50	9.200	18.50	1.150
.75	.700	6.75	1.280	12.75	4.730	18.75	1.150
1.00	.700	7.00	1.280	13.00	4.730	19.00	1.150
1.25	.700	7.25	1.280	13.25	.890	19.25	1.150
1.50	.700	7.50	1.280	13.50	.890	19.50	1.150
1.75	.700	7.75	1.280	13.75	5.240	19.75	1.150
2.00	.700	8.00	1.280	14.00	5.240	20.00	1.150
2.25	.830	8.25	1.720	14.25	1.920	20.25	.770
2.50	.830	8.50	1.720	14.50	1.920	20.50	.770
2.75	.830	8.75	1.720	14.75	1.920	20.75	.770
3.00	.830	9.00	1.720	15.00	1.920	21.00	.770
3.25	.830	9.25	2.040	15.25	1.920	21.25	.770
3.50	.830	9.50	2.040	15.50	1.920	21.50	.770
3.75	.830	9.75	2.300	15.75	1.920	21.75	.770
4.00	.830	10.00	2.300	16.00	1.920	22.00	.770
4.25	1.020	10.25	2.940	16.25	1.150	22.25	.770
4.50	1.020	10.50	2.940	16.50	1.150	22.50	.770
4.75	1.020	10.75	3.960	16.75	1.150	22.75	.770
5.00	1.020	11.00	3.960	17.00	1.150	23.00	.770
5.25	1.020	11.25	6.130	17.25	1.150	23.25	.770

5.50	1.020	11.50	6.130	17.50	1.150	23.50	.770
5.75	1.020	11.75	26.580	17.75	1.150	23.75	.770
6.00	1.020	12.00	70.530	18.00	1.150	24.00	.770

008:0003-----

```

*
*****
*SITE 560 WINSTON CHURCHILL*
*****
*
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS
-----
| CALIB STANDHYD | Area (ha)= 11.68
| 01:002 DT= 1.00 | Total Imp(%)= 90.00 Dir. Conn.(%)= 90.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	10.51	1.17
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	70.53	26.86
over (min)	1.00	13.00
Storage Coeff. (min)=	1.43 (ii)	13.37 (ii)
Unit Hyd. Tpeak (min)=	1.00	13.00
Unit Hyd. peak (cms)=	.86	.09
PEAK FLOW (cms)=	2.06	.05
TIME TO PEAK (hrs)=	12.00	12.12
RUNOFF VOLUME (mm)=	61.89	20.67
TOTAL RAINFALL (mm)=	63.89	63.89
RUNOFF COEFFICIENT =	.97	.32
		.904

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

008:0004-----

```

* SWM POND AREA
-----
| CALIB STANDHYD | Area (ha)= .87
| 02:003 DT= 1.00 | Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250
Max.eff.Inten.(mm/hr)=	70.53	29.45
over (min)	1.00	6.00
Storage Coeff. (min)=	1.18 (ii)	6.19 (ii)

```

Unit Hyd. Tpeak (min)=      1.00      6.00
Unit Hyd. peak  (cms)=      .97      .18

PEAK FLOW      (cms)=      .09      .03
TIME TO PEAK   (hrs)=      12.00     12.02
RUNOFF VOLUME  (mm)=      61.89     20.67
TOTAL RAINFALL (mm)=      63.89     63.89
RUNOFF COEFFICIENT =      .97      .32

```

```

*TOTALS*
      .114 (iii)
12.000
41.284
63.892
.646

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

008:0005-

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)=	.14
03:004 DT= 1.00	Total Imp(%)=	25.00 Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	70.53	29.45
over (min)	1.00	6.00
Storage Coeff. (min)=	1.43 (ii)	6.44 (ii)
Unit Hyd. Tpeak (min)=	1.00	6.00
Unit Hyd. peak (cms)=	.86	.18

```

*TOTALS*
      .014 (iii)
12.000
30.979
63.892
.485

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

008:0006-

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)=	5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)=	.160	

Unit Hyd Qpeak (cms)=	.057
PEAK FLOW (cms)=	.014 (i)

```

TIME TO PEAK (hrs)= 12.067
RUNOFF VOLUME (mm)= 20.674
TOTAL RAINFALL (mm)= 63.892
RUNOFF COEFFICIENT = .324

```

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

008:0007-

```

*****
* Discharge rates from the SWMP, buildings and paved area
* Total Area = 12.55 ha
*****

```

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:002		11.68	2.103	12.00	57.77	.000
+ID2 02:003		.87	.114	12.00	41.28	.000
SUM 06:000300		12.55	2.217	12.00	56.63	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

008:0008-

```

*****
*STORMWATER MANAGEMENT FACILITY
*PERMANENT WL 91.10 ORIFICE 125mm
*EROS/EXT WL 91.90 WEIR 175mm
*****

```

ROUTE RESERVOIR	Requested routing time step = 1.0 min.
IN>06:(000300)	
OUT<07:(000200)	

===== OUTFLOW STORAGE TABLE =====			
OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00	.178	.6238E+00
.013	.7430E-01	.256	.7344E+00
.020	.1543E+00	.391	.9076E+00
.025	.2403E+00	2.321	.1028E+01
.029	.3146E+00	3.906	.1089E+01
.060	.4139E+00	5.775	.1152E+01
.112	.5169E+00	7.890	.1215E+01

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	2.217	12.000	56.628
OUTFLOW <07: (000200)	12.55	.094	14.033	56.625

PEAK FLOW REDUCTION [Qout/Qin](%)=	4.224
TIME SHIFT OF PEAK FLOW (min)=	122.00
MAXIMUM STORAGE USED (ha.m.)=	.4807E+00

008:0009-

```

*****
* Discharge rates from the SWMP, buildings, paved area and
* Uncontrolled discharge being released onto Winston Churchill

```

\*\*\*\*\*

	ADD HYD (000300)	ID: NYHD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1	07:000200	12.55	.094	14.03	56.63	.000
	+ID2	03:004	.14	.014	12.00	30.98	.000
=====							
	SUM	08:000300	12.69	.095	14.00	56.34	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

008:0010-----  
\*\*\*\*\*

008:0002-----

008:0002-----

008:0002-----

008:0002-----

008:0002-----

008:0002-----

008:0002-----

\*\* END OF RUN : 8

\*\*\*\*\*

	START	Project dir.:	C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
		Rainfall dir.:	C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
	TZERO =	.00 hrs on	0
	METOUT=	2 (output = METRIC)	
	NRUN =	009	
	NSTORM=	1	
	#	1=10Y24HS.STM	

009:0002-----

\*#\*\*\*\*\*

\*# Project Name: 560 Winston Churchill Blvd., Oakville

\*# Project Number: 1870

\*# Date : DECEMBER 15, 2020

\*# Revised : SEPTEMBER 22, 2020

\*# Modeller : JMN

\*# Company : a.m. candaras associates inc.

\*# License # : 3813174

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

009:0002-----

\*#\*\*\*\*\*

	READ STORM	Filename:	C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
	Ptotal= 72.94 mm	Comments:	* 10 YEAR SCS 24hr STORM, 15 min TIME ST

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.25	.800	6.25	1.460	12.25	10.500	18.25	1.310
.50	.800	6.50	1.460	12.50	10.500	18.50	1.310
.75	.800	6.75	1.460	12.75	5.400	18.75	1.310
1.00	.800	7.00	1.460	13.00	5.400	19.00	1.310
1.25	.800	7.25	1.460	13.25	1.020	19.25	1.310
1.50	.800	7.50	1.460	13.50	1.020	19.50	1.310
1.75	.800	7.75	1.460	13.75	5.980	19.75	1.310
2.00	.800	8.00	1.460	14.00	5.980	20.00	1.310
2.25	.950	8.25	1.970	14.25	2.190	20.25	.880
2.50	.950	8.50	1.970	14.50	2.190	20.50	.880
2.75	.950	8.75	1.970	14.75	2.190	20.75	.880
3.00	.950	9.00	1.970	15.00	2.190	21.00	.880
3.25	.950	9.25	2.330	15.25	2.190	21.25	.880
3.50	.950	9.50	2.330	15.50	2.190	21.50	.880
3.75	.950	9.75	2.630	15.75	2.190	21.75	.880
4.00	.950	10.00	2.630	16.00	2.190	22.00	.880
4.25	1.170	10.25	3.350	16.25	1.310	22.25	.880
4.50	1.170	10.50	3.350	16.50	1.310	22.50	.880
4.75	1.170	10.75	4.520	16.75	1.310	22.75	.880
5.00	1.170	11.00	4.520	17.00	1.310	23.00	.880
5.25	1.170	11.25	7.000	17.25	1.310	23.25	.880
5.50	1.170	11.50	7.000	17.50	1.310	23.50	.880
5.75	1.170	11.75	30.330	17.75	1.310	23.75	.880
6.00	1.170	12.00	80.500	18.00	1.310	24.00	.880

009:0003-----

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*#\*\*\*\*\*

\*TOTALS\*



PEAK FLOW (cms)=	2.35	.07	2.412 (iii)
TIME TO PEAK (hrs)=	12.00	12.10	12.000
RUNOFF VOLUME (mm)=	70.94	26.10	66.459
TOTAL RAINFALL (mm)=	72.94	72.94	72.942
RUNOFF COEFFICIENT =	.97	.36	.911

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
009:0004-----

## \* SWM POND AREA

CALIB STANDHYD	Area (ha)=	.87	
02:003 DT= 1.00	Total Imp(%)=	50.00	Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	80.50	37.03
over (min)	1.00	6.00
Storage Coeff. (min)=	1.12 (ii)	5.69 (ii)
Unit Hyd. Tpeak (min)=	1.00	6.00
Unit Hyd. peak (cms)=	1.00	.20

## \*TOTALS\*

PEAK FLOW (cms)=	.10	.04	.134 (iii)
TIME TO PEAK (hrs)=	12.00	12.02	12.000
RUNOFF VOLUME (mm)=	70.94	26.11	48.526
TOTAL RAINFALL (mm)=	72.94	72.94	72.942
RUNOFF COEFFICIENT =	.97	.36	.665

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
009:0005-----

## \* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)=	.14	
03:004 DT= 1.00	Total Imp(%)=	25.00	Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	80.50	37.03
over (min)	1.00	6.00
Storage Coeff. (min)=	1.35 (ii)	5.92 (ii)
Unit Hyd. Tpeak (min)=	1.00	6.00
Unit Hyd. peak (cms)=	.89	.19

## \*TOTALS\*

PEAK FLOW (cms)=	.01	.01	.017 (iii)
TIME TO PEAK (hrs)=	12.00	12.02	12.000
RUNOFF VOLUME (mm)=	70.94	26.11	37.317
TOTAL RAINFALL (mm)=	72.94	72.94	72.942
RUNOFF COEFFICIENT =	.97	.36	.512

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
009:0006-----

## \* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)=	5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)=	.160	

Unit Hyd Qpeak (cms)=	.057
-----------------------	------

PEAK FLOW (cms)=	.017 (i)
TIME TO PEAK (hrs)=	12.067
RUNOFF VOLUME (mm)=	26.108
TOTAL RAINFALL (mm)=	72.942
RUNOFF COEFFICIENT =	.358

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

-----  
009:0007-----

## \*\*\*\*\*

\* Discharge rates from the SWMP, buildings and paved area

\* Total Area = 12.55 ha

\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
	ID1 01:002	11.68	2.412	12.00	66.46	.000
	+ID2 02:003	.87	.134	12.00	48.53	.000
	SUM 06:000300	12.55	2.546	12.00	65.22	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

-----  
009:0008-----

## \*\*\*\*\*

\*STORMWATER MANAGEMENT FACILITY  
\*PERMANENT WL 91.10 ORIFICE 125mm  
\*EROS/EXT WL 91.90 WEIR 175mm

\*\*\*\*\*

```

ROUTE RESERVOIR
IN>06:(000300)
OUT<07:(000200)

```

Requested routing time step = 1.0 min.

===== OUTFLOW STORAGE TABLE =====	
OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00
.013	.7430E-01
.020	.1543E+00
.025	.2403E+00
.029	.3146E+00
.060	.4139E+00
.112	.5169E+00

===== OUTFLOW STORAGE TABLE =====	
OUTFLOW (cms)	STORAGE (ha.m.)
.178	.6238E+00
.256	.7344E+00
.391	.9076E+00
2.321	.1028E+01
3.906	.1089E+01
5.775	.1152E+01
7.890	.1215E+01

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	2.546	12.000	65.216
OUTFLOW<07: (000200)	12.55	.127	13.017	65.213

PEAK FLOW REDUCTION [Qout/Qin](%)= 4.992  
 TIME SHIFT OF PEAK FLOW (min)= 61.00  
 MAXIMUM STORAGE USED (ha.m.)=.5413E+00

009:0009-----

\*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings, paved area and  
 \* Uncontrolled discharge being released onto Winston Churchill  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 07:000200		12.55	.127	13.02	65.21	.000
+ID2 03:004		.14	.017	12.00	37.32	.000
SUM 08:000300		12.69	.128	13.00	64.91	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

009:0010-----

\*\*\*\*\*

009:0002-----

009:0002-----

009:0002-----

009:0002-----

009:0002-----

009:0002-----

009:0002-----

009:0002-----

009:0002-----  
 \*\* END OF RUN : 9

\*\*\*\*\*

START	Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on	0
METOUT= 2 (output = METRIC)	
NRUN = 010	
NSTORM= 1	
# 1=25Y24HS.STM	

010:0002-----

\*\*\*\*\*  
 \* Project Name: 560 Winston Churchill Blvd., Oakville  
 \* Project Number: 1870  
 \* Date : DECEMBER 15, 2020  
 \* Revised : SEPTEMBER 22, 2020  
 \* Modeller : JMN  
 \* Company : a.m. candaras associates inc.  
 \* License # : 3813174  
 \*\*\*\*\*

010:0002-----

READ STORM	Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
Ptotal= 85.25 mm	Comments: * 25 YEAR SCS 24hr STORM, 15 min TIME ST

TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr	TIME hrs	RAIN mm/hr
.25	.940	6.25	1.710	12.25	12.280	18.25	1.530
.50	.940	6.50	1.710	12.50	12.280	18.50	1.530
.75	.940	6.75	1.710	12.75	6.310	18.75	1.530
1.00	.940	7.00	1.710	13.00	6.310	19.00	1.530
1.25	.940	7.25	1.710	13.25	1.190	19.25	1.530
1.50	.940	7.50	1.710	13.50	1.190	19.50	1.530
1.75	.940	7.75	1.710	13.75	6.990	19.75	1.530
2.00	.940	8.00	1.710	14.00	6.990	20.00	1.530
2.25	1.110	8.25	2.300	14.25	2.560	20.25	1.020
2.50	1.110	8.50	2.300	14.50	2.560	20.50	1.020
2.75	1.110	8.75	2.300	14.75	2.560	20.75	1.020
3.00	1.110	9.00	2.300	15.00	2.560	21.00	1.020
3.25	1.110	9.25	2.730	15.25	2.560	21.25	1.020
3.50	1.110	9.50	2.730	15.50	2.560	21.50	1.020
3.75	1.110	9.75	3.070	15.75	2.560	21.75	1.020
4.00	1.110	10.00	3.070	16.00	2.560	22.00	1.020
4.25	1.360	10.25	3.920	16.25	1.530	22.25	1.020
4.50	1.360	10.50	3.920	16.50	1.530	22.50	1.020
4.75	1.360	10.75	5.290	16.75	1.530	22.75	1.020

5.00	1.360	11.00	5.290	17.00	1.530	23.00	1.020
5.25	1.360	11.25	8.190	17.25	1.530	23.25	1.020
5.50	1.360	11.50	8.190	17.50	1.530	23.50	1.020
5.75	1.360	11.75	35.470	17.75	1.530	23.75	1.020
6.00	1.360	12.00	94.140	18.00	1.530	24.00	1.020

010:0003-----

\*\*\*\*\*  
 \*SITE 560 WINSTON CHURCHILL\*  
 \*\*\*\*\*  
 \*

\* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

CALIB STANDHYD	Area (ha)=	11.68
01:002 DT= 1.00	Total Imp(%)=	90.00 Dir. Conn.(%)= 90.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	10.51	1.17
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	94.14	45.55
over (min)	1.00	11.00
Storage Coeff. (min)=	1.27 (ii)	10.94 (ii)
Unit Hyd. Tpeak (min)=	1.00	11.00
Unit Hyd. peak (cms)=	.93	.10

\*TOTALS\*  
 PEAK FLOW (cms)= 2.75 .10 2.838 (iii)  
 TIME TO PEAK (hrs)= 12.00 12.08 12.000  
 RUNOFF VOLUME (mm)= 83.24 34.05 78.328  
 TOTAL RAINFALL (mm)= 85.25 85.25 85.248  
 RUNOFF COEFFICIENT = .98 .40 .919

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

010:0004-----  
\* SWM POND AREA

CALIB STANDHYD	Area (ha)=	.87
02:003 DT= 1.00	Total Imp(%)=	50.00 Dir. Conn.(%)= 50.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	94.14	48.55
------------------------	-------	-------

over (min)	1.00	5.00
Storage Coeff. (min)=	1.06 (ii)	5.16 (ii)
Unit Hyd. Tpeak (min)=	1.00	5.00
Unit Hyd. peak (cms)=	1.04	.22
PEAK FLOW (cms)=	.11	.05
TIME TO PEAK (hrs)=	12.00	12.02
RUNOFF VOLUME (mm)=	83.25	34.05
TOTAL RAINFALL (mm)=	85.25	85.25
RUNOFF COEFFICIENT =	.98	.40

\*TOTALS\*  
 .164 (iii)  
 12.000  
 58.651  
 85.248  
 .688

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

010:0005-----

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD	Area (ha)=	.14
03:004 DT= 1.00	Total Imp(%)=	25.00 Dir. Conn.(%)= 25.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	94.14	48.55
over (min)	1.00	5.00
Storage Coeff. (min)=	1.27 (ii)	5.37 (ii)
Unit Hyd. Tpeak (min)=	1.00	5.00
Unit Hyd. peak (cms)=	.93	.22

\*TOTALS\*  
 PEAK FLOW (cms)= .01 .01 .021 (iii)  
 TIME TO PEAK (hrs)= 11.98 12.02 12.000  
 RUNOFF VOLUME (mm)= 83.25 34.05 46.352  
 TOTAL RAINFALL (mm)= 85.25 85.25 85.248  
 RUNOFF COEFFICIENT = .98 .40 .544

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

010:0006-----

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)=	5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)=	.160	

Unit Hyd Qpeak (cms)=	.057
-----------------------	------

PEAK FLOW (cms)= .023 (i)  
TIME TO PEAK (hrs)= 12.067  
RUNOFF VOLUME (mm)= 34.052  
TOTAL RAINFALL (mm)= 85.248  
RUNOFF COEFFICIENT = .399

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

010:0007-----

\*\*\*\*\*  
\* Discharge rates from the SWMP, buildings and paved area  
\* Total Area = 12.55 ha  
\*\*\*\*\*

	ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:002		11.68	2.838	12.00	78.33	.000
	+ID2 02:003		.87	.164	12.00	58.65	.000
	SUM 06:000300		12.55	3.002	12.00	76.96	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

010:0008-----

\*\*\*\*\*  
\*STORMWATER MANAGEMENT FACILITY  
\*PERMANENT WL 91.10 ORIFICE 125mm  
\*EROS/EXT WL 91.90 WEIR 175mm  
\*\*\*\*\*

ROUTE RESERVOIR IN>06:(000300) OUT<07:(000200)	Requested routing time step = 1.0 min.
=====	=====
OUTFLOW (cms)	OUTFLOW STORAGE TABLE (ha.m.)
.000	.0000E+00
.013	.7430E-01
.020	.1543E+00
.025	.2403E+00
.029	.3146E+00
.060	.4139E+00
.112	.5169E+00

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	3.002	12.000	76.964
OUTFLOW<07: (000200)	12.55	.181	13.000	76.962

PEAK FLOW REDUCTION [Qout/Qin](%)= 6.014  
TIME SHIFT OF PEAK FLOW (min)= 60.00  
MAXIMUM STORAGE USED (ha.m.)=.6271E+00

010:0009-----

\*\*\*\*\*

\* Discharge rates from the SWMP, buildings, paved area and  
\* Uncontrolled discharge being released onto Winston Churchill  
\*\*\*\*\*

	ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 07:000200		12.55	.181	13.00	76.96	.000
	+ID2 03:004		.14	.021	12.00	46.35	.000
	SUM 08:000300		12.69	.182	13.00	76.62	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

010:0010-----

\*\*\*\*\*

010:0002-----

010:0002-----

010:0002-----

010:0002-----

010:0002-----

010:0002-----

010:0002-----

010:0002-----

010:0002-----

\*\* END OF RUN : 10

\*\*\*\*\*

START	Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
-----	Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on	0
METOUT= 2 (output = METRIC)	
NRUN = 011	
NSTORM= 1	
# 1=100Y24HS.STM	

011:0002-----

\*\*\*\*\*

\*  
\*# Project Name: 560 Winston Churchill Blvd., Oakville  
\*# Project Number: 1870  
\*# Date : DECEMBER 15, 2020  
\*# Revised : SEPTEMBER 22, 2020

```

*# Modeller   : JMN
*# Company    : a.m. candaras associates inc.
*# License #   : 3813174
*#*****

```

011:0002-----

\*

```

-----
| READ STORM      | Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
| Ptotal= 103.37 mm | Comments: * 100 YEAR SCS 24hr STORM, 15 min TIME S
-----

```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
.25	1.140	6.25	2.070	12.25	14.890	18.25	1.860
.50	1.140	6.50	2.070	12.50	14.890	18.50	1.860
.75	1.140	6.75	2.070	12.75	7.650	18.75	1.860
1.00	1.140	7.00	2.070	13.00	7.650	19.00	1.860
1.25	1.140	7.25	2.070	13.25	1.450	19.25	1.860
1.50	1.140	7.50	2.070	13.50	1.450	19.50	1.860
1.75	1.140	7.75	2.070	13.75	8.480	19.75	1.860
2.00	1.140	8.00	2.070	14.00	8.480	20.00	1.860
2.25	1.340	8.25	2.790	14.25	3.100	20.25	1.240
2.50	1.340	8.50	2.790	14.50	3.100	20.50	1.240
2.75	1.340	8.75	2.790	14.75	3.100	20.75	1.240
3.00	1.340	9.00	2.790	15.00	3.100	21.00	1.240
3.25	1.340	9.25	3.310	15.25	3.100	21.25	1.240
3.50	1.340	9.50	3.310	15.50	3.100	21.50	1.240
3.75	1.340	9.75	3.720	15.75	3.100	21.75	1.240
4.00	1.340	10.00	3.720	16.00	3.100	22.00	1.240
4.25	1.650	10.25	4.760	16.25	1.860	22.25	1.240
4.50	1.650	10.50	4.760	16.50	1.860	22.50	1.240
4.75	1.650	10.75	6.410	16.75	1.860	22.75	1.240
5.00	1.650	11.00	6.410	17.00	1.860	23.00	1.240
5.25	1.650	11.25	9.920	17.25	1.860	23.25	1.240
5.50	1.650	11.50	9.920	17.50	1.860	23.50	1.240
5.75	1.650	11.75	43.010	17.75	1.860	23.75	1.240
6.00	1.650	12.00	114.144	18.00	1.860	24.00	1.240

011:0003-----

\*

```

*****
*SITE 560 WINSTON CHURCHILL*
*****

```

\* BUILDING, PAVED AREAS AND LANDSCAPED AREAS

```

-----
| CALIB STANDHYD | Area (ha)= 11.68
| 01:002 DT= 1.00 | Total Imp(%)= 90.00 Dir. Conn.(%)= 90.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	10.51	1.17
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250

```

Max.eff.Inten.(mm/hr)= 114.14 62.99
over (min)= 1.00 10.00
Storage Coeff. (min)= 1.18 (ii) 9.67 (ii)
Unit Hyd. Tpeak (min)= 1.00 10.00
Unit Hyd. peak (cms)= .97 .12

```

\*TOTALS\*

```

PEAK FLOW (cms)= 3.33 .15 3.468 (iii)
TIME TO PEAK (hrs)= 12.00 12.07 12.000
RUNOFF VOLUME (mm)= 101.37 46.69 95.907
TOTAL RAINFALL (mm)= 103.37 103.37 103.374
RUNOFF COEFFICIENT = .98 .45 .928

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

011:0004-----

\* SWM POND AREA

```

-----
| CALIB STANDHYD | Area (ha)= .87
| 02:003 DT= 1.00 | Total Imp(%)= 50.00 Dir. Conn.(%)= 50.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

```

Max.eff.Inten.(mm/hr)= 114.14 65.98
over (min)= 1.00 5.00
Storage Coeff. (min)= .98 (ii) 4.60 (ii)
Unit Hyd. Tpeak (min)= 1.00 5.00
Unit Hyd. peak (cms)= 1.09 .24

```

\*TOTALS\*

```

PEAK FLOW (cms)= .14 .07 .209 (iii)
TIME TO PEAK (hrs)= 11.98 12.00 12.000
RUNOFF VOLUME (mm)= 101.38 46.70 74.037
TOTAL RAINFALL (mm)= 103.37 103.37 103.374
RUNOFF COEFFICIENT = .98 .45 .716

```

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 70.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

011:0005-----

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

```

-----
| CALIB STANDHYD | Area (ha)= .14
| 03:004 DT= 1.00 | Total Imp(%)= 25.00 Dir. Conn.(%)= 25.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.14	.14
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	30.00	40.00
Mannings n =	.013	.250

Surface Area (ha)= .04 .10  
 Dep. Storage (mm)= 2.00 5.00  
 Average Slope (%)= 1.00 2.00  
 Length (m)= 30.00 10.00  
 Mannings n = .013 .250

Max.eff.Inten.(mm/hr)= 114.14 65.98  
 over (min)= 1.00 5.00  
 Storage Coeff. (min)= 1.18 (ii) 4.80 (ii)  
 Unit Hyd. Tpeak (min)= 1.00 5.00  
 Unit Hyd. peak (cms)= .97 .23

\*TOTALS\*  
 PEAK FLOW (cms)= .01 .02 .028 (iii)  
 TIME TO PEAK (hrs)= 11.98 12.00 12.000  
 RUNOFF VOLUME (mm)= 101.37 46.70 60.368  
 TOTAL RAINFALL (mm)= 103.37 103.37 103.374  
 RUNOFF COEFFICIENT = .98 .45 .584

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
 CN\* = 70.0 Ia = Dep. Storage (Above)  
 (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
 THAN THE STORAGE COEFFICIENT.  
 (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

011:0006-----  
 \* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD	Area (ha)=	.24	Curve Number (CN)=70.00
04:005 DT= 1.00	Ia (mm)=	5.000	# of Linear Res.(N)= 3.00
	U.H. Tp(hrs)=	.160	

Unit Hyd Qpeak (cms)= .057

PEAK FLOW (cms)= .031 (i)  
 TIME TO PEAK (hrs)= 12.067  
 RUNOFF VOLUME (mm)= 46.698  
 TOTAL RAINFALL (mm)= 103.374  
 RUNOFF COEFFICIENT = .452

- (i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

011:0007-----  
 \*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings and paved area  
 \* Total Area = 12.55 ha  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 01:002		11.68	3.468	12.00	95.91	.000
+ID2 02:003		.87	.209	12.00	74.04	.000
=====						
SUM 06:000300		12.55	3.677	12.00	94.39	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

011:0008-----  
 \*\*\*\*\*  
 \*STORMWATER MANAGEMENT FACILITY  
 \*PERMANENT WL 91.10 ORIFICE 125mm  
 \*EROS/EXT WL 91.90 WEIR 175mm  
 \*\*\*\*\*

ROUTE RESERVOIR		Requested routing time step = 1.0 min.	
IN>06:(000300)	OUT<07:(000200)	=====	=====
OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
.000	.0000E+00	.178	.6238E+00
.013	.7430E-01	.256	.7344E+00
.020	.1543E+00	.391	.9076E+00
.025	.2403E+00	2.321	.1028E+01
.029	.3146E+00	3.906	.1089E+01
.060	.4139E+00	5.775	.1152E+01
.112	.5169E+00	7.890	.1215E+01

ROUTING RESULTS	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW >06: (000300)	12.55	3.677	12.000	94.390
OUTFLOW <07: (000200)	12.55	.269	12.667	94.388

PEAK FLOW REDUCTION [Qout/Qin](%)= 7.303  
 TIME SHIFT OF PEAK FLOW (min)= 40.00  
 MAXIMUM STORAGE USED (ha.m.)= .7505E+00

011:0009-----  
 \*\*\*\*\*  
 \* Discharge rates from the SWMP, buildings, paved area and  
 \* Uncontrolled discharge being released onto Winston Churchill  
 \*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
ID1 07:000200		12.55	.269	12.67	94.39	.000
+ID2 03:004		.14	.028	12.00	60.37	.000
=====						
SUM 08:000300		12.69	.272	12.55	94.01	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

011:0010-----  
 \*\*\*\*\*

011:0002-----

011:0002-----

011:0002-----

011:0002-----



011:0002-----  
-----  
011:0002-----  
-----  
011:0002-----  
-----  
011:0002-----  
-----  
011:0002-----  
-----  
011:0002-----  
-----  
FINISH  
-----  
\*\*\*\*\*  
WARNINGS / ERRORS / NOTES  
-----  
Simulation ended on 2022-06-16 at 16:10:26  
=====

```
2      Metric units
*#*****
*# Project Name: 560 Winston Churchill Blvd., Oakville
*# Project Number: 1870
*# Date       : DECEMBER 15, 2020
*# Revised    : SEPTEMBER 23, 2021
*# Modeller   : JMN
*# Company    : a.m. candaras associates inc.
*# License #   : 3813174
*#*****
START      TZERO=[0.0], METOUT=[2], NSTORM=[1], NRUN= [001]
          "HAZEL.STM"
*
READ STORM      STORM_FILENAME= ["storm.001"]
*
*****
*SITE 560 WINSTON CHURCHILL*
*****
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS
CALIB STANDHYD      ID=[1], NHYD=["002"], DT=[1](min), AREA=[11.68](ha),
                    XIMP=[0.90], TIMP=[0.90], DWF=[0.0](cms), LOSS=[2],
                    SCS curve number CN=[86.0],
                    Pervious surfaces: IAPer=[5](mm), SLPP=[2.0](%),
                                         LGP=[40.0](m), MNP=[0.25],
                                         SCP=[0.0](min),
                    Impervious surfaces: IAimp=[2](mm), SLPI=[1.0](%),
                                         LGI=[196](m), MNI=[0.013],
                                         SCI=[0.0](min),
                    RAINFALL=[ , , , ](mm/hr) , END=-1

* SWM POND AREA
CALIB STANDHYD      ID=[2], NHYD=["003"], DT=[1](min), AREA=[0.87](ha),
                    XIMP=[0.50], TIMP=[0.50], DWF=[0.0](cms), LOSS=[2],
                    SCS curve number CN=[86.0],
                    Pervious surfaces: IAPer=[5](mm), SLPP=[2.0](%),
                                         LGP=[10.0](m), MNP=[0.25],
                                         SCP=[0.0](min),
                    Impervious surfaces: IAimp=[2](mm), SLPI=[1.0](%),
                                         LGI=[22.0](m), MNI=[0.013],
                                         SCI=[0.0](min),
                    RAINFALL=[ , , , ](mm/hr) , END=-1

* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD
CALIB STANDHYD      ID=[3], NHYD=["005"], DT=[1](min), AREA=[0.14](ha),
                    XIMP=[0.25], TIMP=[0.25], DWF=[0.0](cms), LOSS=[2],
                    SCS curve number CN=[86.0],
                    Pervious surfaces: IAPer=[5](mm), SLPP=[2.0](%),
                                         LGP=[10.0](m), MNP=[0.25],
                                         SCP=[0.0](min),
                    Impervious surfaces: IAimp=[2](mm), SLPI=[1.0](%),
                                         LGI=[300](m), MNI=[0.013],
                                         SCI=[0.0](min),
                    RAINFALL=[ , , , ](mm/hr) , END=-1
```

```
* UNCONTROLLED AREA TO CHANNEL
CALIB NASHYD      ID=[4], NHYD=["004"], DT=[1]min, AREA=[0.24](ha),
                  DWF=[0.0](cms), CN/C=[86], IA=[5](mm),
                  N=[3], TP=[0.16]hrs,
                  RAINFALL=[ , , , ](mm/hr), END=-1

*****
* Discharge rates from the SWMP, buildings and paved area
* Total Area = 12.55 ha
*****
ADD HYD          IDsum=6 NHYD=300 IDs to add=1+2

*****
*STORMWATER MANAGEMENT FACILITY
*PERMANENT WL 91.10 ORIFICE 125mm
*EROS/EXT WL 91.90 WEIR 175mm
*****

ROUTE RESERVOIR      IDout= 7 , NHYD= 200 , IDin= 6 ,
                    RDT=[1](min),
                    TABLE of ( OUTFLOW-STORAGE ) values
                    (cms) - (ha-m)
                    0.0000 0.0000
                    0.0127 0.0743
                    0.0199 0.1543
                    0.0251 0.2403
                    0.0294 0.3146
                    0.0598 0.4139
                    0.1120 0.5169
                    0.1783 0.6238
                    0.2560 0.7344
                    0.3907 0.9076
                    2.3211 1.0278
                    3.9062 1.0893
                    5.7754 1.1518
                    7.8899 1.2152
                    IDovf=[ , ], NHYDovf=[ ]

*****
* Discharge rates from the SWMP, buildings, paved area and
* Uncontrolled discharge being released onto Winston Churchill
*****
ADD HYD          IDsum=8 NHYD=300 IDs to add=7+3

*****
FINISH
```

```

=====
SSSSS W W M M H H Y Y M M OOO 999 999 =====
S W W W MM MM H H Y Y MM MM O O 9 9 9 9
SSSSS W W W M M M HHHHH Y M M M O O ## 9 9 9 9 Ver. 4.02
S W W M M H H Y M M O O 9999 9999 July 1999
SSSSS W W M M H H Y M M OOO 9 9 9 =====
StormWater Management HYdrologic Model 999 999 =====

*****
***** SWMHYMO-99 Ver/4.02 *****
***** A single event and continuous hydrologic simulation model *****
***** based on the principles of HYMO and its successors *****
***** OTTHYMO-83 and OTTHYMO-89. *****
*****
***** Distributed by: J.F. Sabourin and Associates Inc. *****
***** Ottawa, Ontario: (613) 727-5199 *****
***** Gatineau, Quebec: (819) 243-6858 *****
***** E-Mail: swmhymo@jfsa.Com *****
*****

+++++
+++++ Licensed user: A.M. Candaras Associates Inc. +++++
+++++ Woodbridge SERIAL#:3813174 +++++
+++++

*****
***** +++++ PROGRAM ARRAY DIMENSIONS +++++ *****
***** Maximum value for ID numbers : 10 *****
***** Max. number of rainfall points: 15000 *****
***** Max. number of flow points : 15000 *****
*****

***** D E T A I L E D O U T P U T *****
*****
* DATE: 2022-06-16 TIME: 16:10:33 RUN COUNTER: 000972 *
*****
* Input filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\1870Reg.dat *
* Output filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\1870Reg.out *
* Summary filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\1870Reg.sum *
* User comments:
* 1:
* 2:
* 3:
*****

001:0001-----
*#*****
*
*# Project Name: 560 Winston Churchill Blvd., Oakville
*# Project Number: 1870
*# Date : DECEMBER 15, 2020
*# Revised : SEPTEMBER 23, 2021
*# Modeller : JMN
*# Company : a.m. candaras associates inc.

```

```

*# License # : 3813174
*#*****
*
-----
| START | Project dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
----- Rainfall dir.: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\1870\
TZERO = .00 hrs on 0
METOUT= 2 (output = METRIC)
NRUN = 001
NSTORM= 1
# 1=HAZEL.STM
-----
001:0002-----
*
-----
| READ STORM | Filename: C:\DOCUME~1\ADMINI~1\DESKTOP\SWMHYMO\187
| Ptotal= 212.00 mm | Comments: HURRICANE HAZEL STORM
-----
TIME RAIN | TIME RAIN | TIME RAIN | TIME RAIN
hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs mm/hr
1.00 6.000 | 4.00 13.000 | 7.00 23.000 | 10.00 53.000
2.00 4.000 | 5.00 17.000 | 8.00 13.000 | 11.00 38.000
3.00 6.000 | 6.00 13.000 | 9.00 13.000 | 12.00 13.000
-----
001:0003-----
*
*****
*SITE 560 WINSTON CHURCHILL*
*****
*
* BUILDING, PAVED AREAS AND LANDSCAPED AREAS
-----
| CALIB STANDHYD | Area (ha)= 11.68
| 01:002 DT= 1.00 | Total Imp(%)= 90.00 Dir. Conn.(%)= 90.00
-----
IMPERVIOUS PERVIOUS (i)
Surface Area (ha)= 10.51 1.17
Dep. Storage (mm)= 2.00 5.00
Average Slope (%)= 1.00 2.00
Length (m)= 196.00 40.00
Mannings n = .013 .250
Max.eff.Inten.(mm/hr)= 53.00 50.52
over (min) 5.00 14.00
Storage Coeff. (min)= 4.93 (ii) 14.21 (ii)
Unit Hyd. Tpeak (min)= 5.00 14.00
Unit Hyd. peak (cms)= .23 .08
*TOTALS*
PEAK FLOW (cms)= 1.55 .16 1.707 (iii)
TIME TO PEAK (hrs)= 10.00 10.02 10.000
RUNOFF VOLUME (mm)= 209.99 172.52 206.253
TOTAL RAINFALL (mm)= 212.00 212.00 212.000
RUNOFF COEFFICIENT = .99 .81 .973
(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 86.0 Ia = Dep. Storage (Above)
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL

```

THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0004-----

\* SWM POND AREA

CALIB STANDHYD 02:003 DT= 1.00	Area (ha)= .87 Total Imp(%)= 50.00	Dir. Conn.(%)= 50.00
-----------------------------------	---------------------------------------	----------------------

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.44	.44
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	22.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	53.00	50.62
over (min)	1.00	5.00
Storage Coeff. (min)=	1.33 (ii)	5.36 (ii)
Unit Hyd. Tpeak (min)=	1.00	5.00
Unit Hyd. peak (cms)=	.90	.22

			*TOTALS*
PEAK FLOW (cms)=	.06	.06	.125 (iii)
TIME TO PEAK (hrs)=	9.33	10.00	10.000
RUNOFF VOLUME (mm)=	210.00	172.53	191.267
TOTAL RAINFALL (mm)=	212.00	212.00	212.000
RUNOFF COEFFICIENT =	.99	.81	.902

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 86.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0005-----

\* UNCONTROLLED AREA TO WINSTON CHURCHILL BLVD

CALIB STANDHYD 03:005 DT= 1.00	Area (ha)= .14 Total Imp(%)= 25.00	Dir. Conn.(%)= 25.00
-----------------------------------	---------------------------------------	----------------------

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	.04	.10
Dep. Storage (mm)=	2.00	5.00
Average Slope (%)=	1.00	2.00
Length (m)=	300.00	10.00
Mannings n =	.013	.250

Max.eff.Inten.(mm/hr)=	53.00	50.56
over (min)	6.00	10.00
Storage Coeff. (min)=	6.37 (ii)	10.40 (ii)
Unit Hyd. Tpeak (min)=	6.00	10.00
Unit Hyd. peak (cms)=	.18	.11

			*TOTALS*
PEAK FLOW (cms)=	.01	.01	.020 (iii)
TIME TO PEAK (hrs)=	10.00	10.00	10.000
RUNOFF VOLUME (mm)=	209.99	172.53	181.901

TOTAL RAINFALL (mm)=	212.00	212.00	212.000
RUNOFF COEFFICIENT =	.99	.81	.858

(i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:  
CN\* = 86.0 Ia = Dep. Storage (Above)  
(ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL  
THAN THE STORAGE COEFFICIENT.  
(iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0006-----

\* UNCONTROLLED AREA TO CHANNEL

CALIB NASHYD 04:004 DT= 1.00	Area (ha)= .24 Ia (mm)= 5.000	Curve Number (CN)=86.00 # of Linear Res.(N)= 3.00
---------------------------------	----------------------------------	--

Unit Hyd Qpeak (cms)=	.057
-----------------------	------

PEAK FLOW (cms)=	.034 (i)
TIME TO PEAK (hrs)=	10.000
RUNOFF VOLUME (mm)=	172.535
TOTAL RAINFALL (mm)=	212.000
RUNOFF COEFFICIENT =	.814

(i) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

001:0007-----

\*\*\*\*\*  
\* Discharge rates from the SWMP, buildings and paved area  
\* Total Area = 12.55 ha  
\*\*\*\*\*

ADD HYD (000300)	ID: NHYD	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)	DWF (cms)
	ID1 01:002	11.68	1.707	10.00	206.25	.000
	+ID2 02:003	.87	.125	10.00	191.27	.000
	SUM 06:000300	12.55	1.832	10.00	205.21	.000

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

001:0008-----

\*\*\*\*\*  
\*STORMWATER MANAGEMENT FACILITY  
\*PERMANENT WL 91.10 ORIFICE 125mm  
\*EROS/EXT WL 91.90 WEIR 175mm  
\*\*\*\*\*

ROUTE RESERVOIR IN>06:(000300) OUT<07:(000200)	Requested routing time step = 1.0 min.  ===== OUTFLOW STORAGE TABLE ===== OUTFLOW STORAGE OUTFLOW STORAGE (cms) (ha.m.) (cms) (ha.m.) .000 .0000E+00 .178 .6238E+00 .013 .7430E-01 .256 .7344E+00
--	---

	.020	.1543E+00		.391	.9076E+00	
	.025	.2403E+00		2.321	.1028E+01	
	.029	.3146E+00		3.906	.1089E+01	
	.060	.4139E+00		5.775	.1152E+01	
	.112	.5169E+00		7.890	.1215E+01	
ROUTING RESULTS						
-----	AREA	QPEAK	TPEAK	R.V.		
	(ha)	(cms)	(hrs)	(mm)		
INFLOW >06: (000300)	12.55	1.832	10.000	205.214		
OUTFLOW<07: (000200)	12.55	1.813	10.017	205.210		
PEAK FLOW REDUCTION [Qout/Qin](%)=				98.927		
TIME SHIFT OF PEAK FLOW				(min)=	1.00	
MAXIMUM STORAGE USED				(ha.m.)=	.9961E+00	
-----						
001:0009-----						
*****						
* Discharge rates from the SWMP, buildings, paved area and						
* Uncontrolled discharge being released onto Winston Churchill						
*****						
-----						
ADD HYD (000300)	ID: NHYD	AREA	QPEAK	TPEAK	R.V.	DWF
		(ha)	(cms)	(hrs)	(mm)	(cms)
ID1 07:000200		12.55	1.813	10.02	205.21	.000
+ID2 03:005		.14	.020	10.00	181.90	.000
=====						
SUM 08:000300		12.69	1.832	10.02	204.95	.000
=====						
NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.						
-----						
001:0010-----						
*****						
FINISH						
-----						
*****						
WARNINGS / ERRORS / NOTES						
-----						
Simulation ended on 2022-06-16 at 16:10:33						
=====						

## APPENDIX C

### SWM FACILITY CALCULATIONS



## SWM Facility Calculations

### Drawdown Time

The drawdown time for this facility was determined using the falling head equation as per the MOE manual 2003 which is represented below.

$$t = \frac{2A_p}{(CA_o)\sqrt{2g}}(\sqrt{h_1} - \sqrt{h_2})$$

t = draw down time in seconds  
A<sub>p</sub> = surface area of the pond (m<sup>2</sup>)  
C = discharge coefficient (0.63)  
A<sub>o</sub> = cross-sectional area of the orifice  
g = gravitational acceleration constant (9.81m/s<sup>2</sup>)  
h<sub>1</sub> = starting water elevation above the orifice  
h<sub>2</sub> = ending water elevation above the orifice

The calculation has been completed based on a 125mm orifice at an invert of 91.10m. This orifice will be a vertical orifice located within the outlet control structure as shown on Plan C-1. Since this orifice is greater than 100mm, protection of the orifice is not required in accordance to the M.O.E. SWMP manual. The proposed orifice will provide a 61 hr 6 min drain time for erosion control volume as calculated below.

$$t = \frac{2 \times 4,220.7}{(0.63 \times 0.0123)\sqrt{2 \times 9.81}}(\sqrt{0.80})$$

t = 219,970.4 sec  
t = 61.1 hr

t = draw down time in seconds  
A<sub>p</sub> = 4,220.7m<sup>2</sup> (average area at elevations 91.10m and 91.90m)  
C = discharge coefficient (0.63)  
A<sub>o</sub> = (πx(0.125 m)<sup>2</sup>) ÷ 4 = 0.0123m<sup>2</sup>  
g = gravitational acceleration constant (9.81m/s<sup>2</sup>)  
h<sub>1</sub> = 91.10m  
h<sub>2</sub> = 91.90m

### Emergency Overflow

The emergency overflow for this facility has been sized to convey the uncontrolled 100-Year (CHIC) post-development flow, which yields the largest flow rate of the storms, of 6.350m<sup>3</sup>/s, refer to SWMHYMO Output. The emergency overflow will operate between the 93.00m elevation and the 93.50m elevation which is the top of the facility. The emergency overflow will be a weir configuration as calculated below:

$$\begin{aligned}
 Q &= 1.7 \times L \times h^{3/2} \\
 \text{where:} \quad Q &= 6.350 \text{ m}^3/\text{s} \\
 h &= 93.00\text{m} - 93.50\text{m} = 0.50\text{m} \\
 \text{therefore:} \quad L &= \frac{Q}{1.7 \times h^{3/2}} = \frac{6.350}{1.7 \times (0.50)^{3/2}} \\
 L &= 10.6\text{m} \\
 \text{set:} \quad L &= 12.0\text{m}
 \end{aligned}$$

A 12.0m emergency overflow at elevation 93.00 will be constructed to direct the uncontrolled 100-Year post-development inflow in a safe manner if the outlet control structure becomes inoperable. The resulting depth of flow based on a 12.0m emergency overflow weir is 0.46m, as calculated below:

$$\begin{aligned}
 Q &= 1.7 \times L \times h^{3/2} \\
 H &= (Q / 1.7 \times L)^{2/3} \\
 &= (6.350 / (1.7 \times 12.0))^{2/3} \\
 &= 0.46 \text{ m}
 \end{aligned}$$

Erosion control for the emergency overflow will be provided by the Terrafix Terraweb liner, which may accommodate velocities up to 6.0m/s. Based on the peak flow, the maximum velocity is 1.18m/s, as calculated below:

$$\begin{aligned}
 Q &= V \times A \\
 V &= 6.350\text{m}^3/\text{s} / (12.0\text{m} \times 0.46\text{m}) \\
 &= 1.15\text{m/s}
 \end{aligned}$$

### **Sediment Forebay Sizing**

An additional requirement for this stormwater quality facility is a sediment forebay. The sediment forebay is required to provide a localized area for the majority of the sediments within the stormwater facility to settle out. This sediment forebay makes maintenance of the stormwater quality facility easier and minimizes total wetland disruption. As per the MOE Stormwater Management Planning and Design Manual (March 2003), there are two equations for the design of a sediment forebay as listed below:

*Equation 4.5: Forebay Settling Length*

$$Dist = \sqrt{\frac{rQ_p}{V_s}} \quad \text{where: } Dist = \text{sediment forebay length (m)}$$

$Q_p$  = peak flow rate from the pond during design quality storm (0.025m<sup>3</sup>/s @ 91.10)  
 $V_s$  = settling velocity (0.0003m/s)  
 $r$  = length-to-width ratio of forebay (2:1 min)

$$Dist = \sqrt{\frac{2(0.025)}{0.0003}}$$

$$= 12.9m$$

*Equation 4.6: Dispersion Length*

$$Dist = \frac{8Q}{dV_f} \quad \text{where: } Dist = \text{sediment forebay length (m)}$$

$Q$  = inlet flow rate (4.175m<sup>3</sup>/s, SWMHYMO output)  
 $V_f$  = desired velocity in the forebay (0.5m/s)  
 $d$  = depth of permanent pool in the forebay (1.10m)

$$Dist = \frac{8 \times 4.175}{1.10 \times 0.5}$$

$$= 60.7m$$

*Equation 4.7: Minimum Forebay Deep Zone Bottom Width*

$$Width = \frac{Dist}{8}$$

$$= \frac{60.7m}{8}$$

$$= 7.6m$$

The sediment forebay will have a length of 62m and a minimum width of 7.6. Therefore, the sediment forebay will accommodate the proposed development and will promote localized settling of particulate matter.

Average Forebay Velocity:

$$V = \frac{Q}{A} = \frac{4.175 \text{ m}^3/s}{62m \times 1.10m} = 0.0631m/s$$

Therefore, the average velocity through the forebay will be 0.061 m/s. This velocity is acceptable as it is less than the 0.15 m/s permissible velocity to prevent erosion.

## APPENDIX D

### HEC-RAS MODEL TABLES

### Clearview Creak Surface Water Elevation

The following table summarizes the change in surface water elevation from the existing to proposed condition for the 2-year

Station	Storm	CVC Existing HEC-RAS Model			CVC Future HEC-RAS Model		
		Existing Channel Water Level (m)	Proposed Channel Water Level (m)	Difference in Water Level (m)	Existing Channel Water Level (m)	Proposed Channel Water Level (m)	Difference in Water Level (m)
11915	2 YR	92.40	92.40	0.00	92.43	92.43	0.00
	5 YR	92.57	92.56	0.01	92.60	92.59	0.01
	10 YR	92.68	92.67	0.01	92.70	92.70	0.00
	25YR	92.75	92.75	0.00	92.78	92.78	0.00
	50 YR	92.80	92.80	0.00	92.83	92.83	0.00
	100 YR	92.86	92.87	-0.01	92.94	92.95	-0.01
	Regional	93.69	93.72	-0.03	93.70	93.73	-0.03
11902	2 YR	92.39	92.39	0.00	92.42	92.42	0.00
	5 YR	92.56	92.55	0.01	92.59	92.58	0.01
	10 YR	92.67	92.66	0.01	92.69	92.69	0.00
	25YR	92.74	92.74	0.00	92.76	92.76	0.00
	50 YR	92.79	92.79	0.00	92.82	92.82	0.00
	100 YR	92.85	92.86	-0.01	92.93	92.94	-0.01
	Regional	93.69	93.71	-0.02	93.70	93.72	-0.02
11895	2 YR	92.28	92.27	0.01	92.31	92.31	0.00
	5 YR	92.43	92.41	0.02	92.46	92.44	0.02
	10 YR	92.53	92.51	0.02	92.56	92.54	0.02
	25YR	92.61	92.58	0.03	92.65	92.65	0.00
	50 YR	92.68	92.68	0.00	92.75	92.75	0.00
	100 YR	92.80	92.80	0.00	92.91	92.91	0.00
	Regional	93.68	93.70	-0.02	93.70	93.71	-0.01
11856	2 YR	92.23	92.23	0.00	92.27	92.26	0.01
	5 YR	92.38	92.36	0.02	92.41	92.39	0.02
	10 YR	92.48	92.46	0.02	92.50	92.48	0.02
	25YR	92.55	92.53	0.02	92.60	92.60	0.00
	50 YR	92.62	92.63	-0.01	92.70	92.71	-0.01
	100 YR	92.75	92.75	0.00	92.87	92.88	-0.01
	Regional	93.67	93.68	-0.01	93.68	93.70	-0.02

11838	2 YR	92.20	92.20	0.00	92.24	92.23	0.01
	5 YR	92.35	92.33	0.02	92.38	92.36	0.02
	10 YR	92.45	92.43	0.02	92.47	92.45	0.02
	25YR	92.52	92.49	0.03	92.57	92.58	-0.01
	50 YR	92.59	92.60	-0.01	92.68	92.69	-0.01
	100 YR	92.73	92.73	0.00	92.86	92.86	0.00
	Regional	93.67	93.68	-0.01	93.68	93.69	-0.01
11832	2 YR	92.13	92.13	0.00	92.18	92.18	0.00
	5 YR	92.28	92.28	0.00	92.32	92.32	0.00
	10 YR	92.41	92.40	0.01	92.43	92.43	0.00
	25YR	92.49	92.47	0.02	92.55	92.57	-0.02
	50 YR	92.57	92.59	-0.02	92.67	92.68	-0.01
	100 YR	92.72	92.73	-0.01	92.86	92.86	0.00
	Regional	93.67	93.67	0.00	93.68	93.69	-0.01
11815	2 YR	91.97	91.97	0.00	92.09	92.09	0.00
	5 YR	92.09	92.10	-0.01	92.20	92.21	-0.01
	10 YR	92.16	92.16	0.00	92.30	92.32	-0.02
	25YR	92.25	92.29	-0.04	92.50	92.51	-0.01
	50 YR	92.52	92.52	0.00	92.65	92.64	0.01
	100 YR	92.70	92.69	0.01	92.84	92.83	0.01
	Regional	93.66	93.66	0.00	93.68	93.67	0.01
11802	2 YR	91.99	91.99	0.00	92.10	92.10	0.00
	5 YR	92.14	92.14	0.00	92.23	92.23	0.00
	10 YR	92.23	92.23	0.00	92.35	92.34	0.01
	25YR	92.34	92.34	0.00	92.52	92.52	0.00
	50 YR	92.54	92.53	0.01	92.65	92.64	0.01
	100 YR	92.70	92.69	0.01	92.84	92.83	0.01
	Regional	93.66	93.65	0.01	93.67	93.66	0.01

### Grading Tables

As part of a discussion with the CVC regarding the modifications being made to the floodplain the CVC requested a table summarizing the distance between the left bank of the low flow channel to the toe of the proposed grading for the modified Stations 11915 to 11802.

Station	Left Channel Limit (m)	Left Limit of Low Flow Channel (m)	Right Limit of Low Flow Channel (m)	Existing Right Channel Limit (m)	Existing Property Line Limit (m)	Proposed Right Channel Limit (m)	Total Proposed Grading on 560 WCH (m) (1)	Total Proposed Channel Width (m) (2)
11915	0	27.4	33.56	74.76	40.00	42.50	32.26	42.50
11902	0	27.53	34.16	76.58	40.00	43.50	33.08	43.50
11895	0	27.50	33.38	76.77	40.00	43.50	33.27	43.50
11856	0	22.14	28.16	92.24	40.00	45.00	47.24	45.00
11838	0	20.65	26.3	98.51	40.00	42.35	56.16	42.35
11832	0	20.82	26.78	98.71	40.00	43.00	55.71	43.00
11815	0	24.50	29.99	103.38	40.00	45.00	58.38	45.00
11802	0	27.06	33.07	101.28	40.00	45.50	55.78	45.50

(1) Grading distance from the existing right channel limit to the property line of 560 Winston Churchill Blvd.

[NOTE: this grading will take place on private property 560 Winston Churchill Blvd.]

(2) The total proposed channel width is measured from the left channel limit to the proposed right channel limit.

The left channel is the north portion of the channel, and the right channel refers to the south portion of the channel. There will be no grading within the Clearview Creek 40.0m wide channel. All grading work will take place on the 560 Winston Churchill Boulevard property, as outlined on Plan G-3.

HEC-RAS River: Clearview Creek Reach: 2101

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	13211	2yr_ Ex	CVC	2.10	99.00	99.62	99.61	99.80	0.017315	1.87	1.12	2.82	0.95	18.81
2101	13211	2yr_ Ex	AMCAI	2.10	99.00	99.62	99.61	99.80	0.017315	1.87	1.12	2.82	0.95	18.81
2101	13211	5yr_ Ex	CVC	3.20	99.00	99.76	99.76	99.98	0.018534	2.07	1.54	3.54	1.00	25.04
2101	13211	5yr_ Ex	AMCAI	3.20	99.00	99.76	99.76	99.98	0.018534	2.07	1.54	3.54	1.00	25.03
2101	13211	10yr_ Ex	CVC	4.70	99.00	99.92	99.92	100.15	0.017242	2.16	2.18	4.51	0.99	30.72
2101	13211	10yr_ Ex	AMCAI	4.70	99.00	99.92	99.92	100.15	0.017242	2.16	2.18	4.51	0.99	30.77
2101	13211	25yr_ Ex	CVC	5.90	99.00	100.01	100.01	100.27	0.016920	2.24	2.63	5.09	1.00	35.66
2101	13211	25yr_ Ex	AMCAI	5.90	99.00	100.01	100.01	100.27	0.016920	2.24	2.63	5.09	1.00	35.66
2101	13211	50yr_ Ex	CVC	7.70	99.00	100.13	100.13	100.41	0.016450	2.35	3.28	5.82	1.00	40.94
2101	13211	50yr_ Ex	AMCAI	7.70	99.00	100.13	100.13	100.41	0.016450	2.35	3.28	5.82	1.00	40.91
2101	13211	100yr_ Ex	CVC	10.00	99.00	100.25	100.25	100.57	0.015624	2.51	3.99	6.42	1.00	47.19
2101	13211	100yr_ Ex	AMCAI	10.00	99.00	100.25	100.25	100.57	0.015624	2.51	3.99	6.42	1.00	47.09
2101	13211	Reg_ Ex	CVC	27.90	99.00	100.78	100.92	101.45	0.015004	3.68	8.18	9.68	1.08	109.07
2101	13211	Reg_ Ex	AMCAI	27.90	99.00	100.78	100.92	101.45	0.015004	3.68	8.18	9.68	1.08	107.56
2101	13211	2yr_ Fut	CVC	2.10	99.00	99.62	99.61	99.80	0.017315	1.87	1.12	2.82	0.95	22.65
2101	13211	2yr_ Fut	AMCAI	2.10	99.00	99.62	99.61	99.80	0.017315	1.87	1.12	2.82	0.95	22.66
2101	13211	5yr_ Fut	CVC	3.20	99.00	99.76	99.76	99.98	0.018534	2.07	1.54	3.54	1.00	30.29
2101	13211	5yr_ Fut	AMCAI	3.20	99.00	99.76	99.76	99.98	0.018534	2.07	1.54	3.54	1.00	30.34
2101	13211	10yr_ Fut	CVC	4.70	99.00	99.92	99.92	100.15	0.017242	2.16	2.18	4.51	0.99	37.71
2101	13211	10yr_ Fut	AMCAI	4.70	99.00	99.92	99.92	100.15	0.017242	2.16	2.18	4.51	0.99	37.71
2101	13211	25yr_ Fut	CVC	6.00	99.00	100.02	100.02	100.28	0.017021	2.26	2.66	5.13	1.00	43.91
2101	13211	25yr_ Fut	AMCAI	6.00	99.00	100.02	100.02	100.28	0.017021	2.26	2.66	5.13	1.00	43.89
2101	13211	50yr_ Fut	CVC	7.70	99.00	100.13	100.13	100.41	0.016450	2.35	3.28	5.82	1.00	50.61
2101	13211	50yr_ Fut	AMCAI	7.70	99.00	100.13	100.13	100.41	0.016450	2.35	3.28	5.82	1.00	50.51
2101	13211	100yr_ Fut	CVC	10.00	99.00	100.25	100.25	100.57	0.015624	2.51	3.99	6.42	1.00	58.23
2101	13211	100yr_ Fut	AMCAI	10.00	99.00	100.25	100.25	100.57	0.015624	2.51	3.99	6.42	1.00	58.04
2101	13211	Reg_ Fut	CVC	27.90	99.00	100.78	100.92	101.45	0.015004	3.68	8.18	9.68	1.08	111.47
2101	13211	Reg_ Fut	AMCAI	27.90	99.00	100.78	100.92	101.45	0.015004	3.68	8.18	9.68	1.08	109.94
2101	13179	2yr_ Ex	CVC	2.10	98.55	99.18	99.13	99.30	0.012626	1.55	1.36	3.82	0.83	18.77
2101	13179	2yr_ Ex	AMCAI	2.10	98.55	99.18	99.13	99.30	0.012626	1.55	1.36	3.82	0.83	18.77
2101	13179	5yr_ Ex	CVC	3.20	98.55	99.31	99.25	99.45	0.012477	1.69	1.90	4.66	0.84	24.98
2101	13179	5yr_ Ex	AMCAI	3.20	98.55	99.31	99.25	99.45	0.012477	1.69	1.90	4.66	0.84	24.98
2101	13179	10yr_ Ex	CVC	4.70	98.55	99.44	99.38	99.61	0.012086	1.84	2.58	6.25	0.85	30.64
2101	13179	10yr_ Ex	AMCAI	4.70	98.55	99.44	99.38	99.61	0.012086	1.84	2.58	6.25	0.85	30.69
2101	13179	25yr_ Ex	CVC	5.90	98.55	99.51	99.47	99.71	0.011610	1.97	3.07	6.57	0.85	35.57
2101	13179	25yr_ Ex	AMCAI	5.90	98.55	99.51	99.47	99.71	0.011610	1.97	3.07	6.57	0.85	35.57
2101	13179	50yr_ Ex	CVC	7.70	98.55	99.61	99.57	99.85	0.010996	2.15	3.76	6.98	0.85	40.83
2101	13179	50yr_ Ex	AMCAI	7.70	98.55	99.61	99.57	99.85	0.010996	2.15	3.76	6.98	0.85	40.80
2101	13179	100yr_ Ex	CVC	10.00	98.55	99.73	99.68	100.00	0.010207	2.32	4.62	7.46	0.85	47.05
2101	13179	100yr_ Ex	AMCAI	10.00	98.55	99.73	99.68	100.00	0.010207	2.32	4.62	7.46	0.85	46.95
2101	13179	Reg_ Ex	CVC	27.90	98.55	100.50	100.33	100.89	0.006463	2.93	11.71	11.05	0.76	108.75
2101	13179	Reg_ Ex	AMCAI	27.90	98.55	100.50	100.33	100.89	0.006463	2.93	11.71	11.05	0.76	107.24
2101	13179	2yr_ Fut	CVC	2.10	98.55	99.18	99.13	99.30	0.012626	1.55	1.36	3.82	0.83	22.61
2101	13179	2yr_ Fut	AMCAI	2.10	98.55	99.18	99.13	99.30	0.012626	1.55	1.36	3.82	0.83	22.62
2101	13179	5yr_ Fut	CVC	3.20	98.55	99.31	99.25	99.45	0.012477	1.69	1.90	4.66	0.84	30.23
2101	13179	5yr_ Fut	AMCAI	3.20	98.55	99.31	99.25	99.45	0.012477	1.69	1.90	4.66	0.84	30.29
2101	13179	10yr_ Fut	CVC	4.70	98.55	99.44	99.38	99.61	0.012086	1.84	2.58	6.25	0.85	37.63
2101	13179	10yr_ Fut	AMCAI	4.70	98.55	99.44	99.38	99.61	0.012086	1.84	2.58	6.25	0.85	37.63
2101	13179	25yr_ Fut	CVC	6.00	98.55	99.52	99.47	99.72	0.011523	1.98	3.12	6.60	0.85	43.82
2101	13179	25yr_ Fut	AMCAI	6.00	98.55	99.52	99.47	99.72	0.011523	1.98	3.12	6.60	0.85	43.80
2101	13179	50yr_ Fut	CVC	7.70	98.55	99.61	99.57	99.85	0.010996	2.15	3.76	6.98	0.85	50.49
2101	13179	50yr_ Fut	AMCAI	7.70	98.55	99.61	99.57	99.85	0.010996	2.15	3.76	6.98	0.85	50.40
2101	13179	100yr_ Fut	CVC	10.00	98.55	99.73	99.68	100.00	0.010207	2.32	4.62	7.46	0.85	58.09
2101	13179	100yr_ Fut	AMCAI	10.00	98.55	99.73	99.68	100.00	0.010207	2.32	4.62	7.46	0.85	57.90
2101	13179	Reg_ Fut	CVC	27.90	98.55	100.50	100.33	100.89	0.006463	2.93	11.71	11.05	0.76	111.15
2101	13179	Reg_ Fut	AMCAI	27.90	98.55	100.50	100.33	100.89	0.006463	2.93	11.71	11.05	0.76	109.62
2101	13136	2yr_ Ex	CVC	2.10	97.96	98.47	98.47	98.65	0.018816	1.86	1.13	3.22	1.00	18.72
2101	13136	2yr_ Ex	AMCAI	2.10	97.96	98.47	98.47	98.65	0.018816	1.86	1.13	3.22	1.00	18.72
2101	13136	5yr_ Ex	CVC	3.20	97.96	98.59	98.59	98.81	0.018162	2.07	1.55	3.60	1.01	24.91
2101	13136	5yr_ Ex	AMCAI	3.20	97.96	98.59	98.59	98.81	0.018162	2.07	1.55	3.60	1.01	24.91
2101	13136	10yr_ Ex	CVC	4.70	97.96	98.74	98.74	98.99	0.016962	2.25	2.09	4.01	1.00	30.54
2101	13136	10yr_ Ex	AMCAI	4.70	97.96	98.74	98.74	98.99	0.016962	2.25	2.09	4.01	1.00	30.60
2101	13136	25yr_ Ex	CVC	5.90	97.96	98.83	98.83	99.12	0.016534	2.39	2.47	4.28	1.00	35.45
2101	13136	25yr_ Ex	AMCAI	5.90	97.96	98.83	98.83	99.12	0.016534	2.39	2.47	4.28	1.00	35.45
2101	13136	50yr_ Ex	CVC	7.70	97.96	98.95	98.95	99.29	0.015551	2.57	3.02	4.64	0.99	40.68
2101	13136	50yr_ Ex	AMCAI	7.70	97.96	98.95	98.95	99.29	0.015551	2.57	3.02	4.64	0.99	40.65
2101	13136	100yr_ Ex	CVC	10.00	97.96	99.08	99.08	99.47	0.014671	2.77	3.67	5.06	0.99	46.87
2101	13136	100yr_ Ex	AMCAI	10.00	97.96	99.08	99.08	99.47	0.014671	2.77	3.67	5.06	0.99	46.77
2101	13136	Reg_ Ex	CVC	27.90	97.96	99.88	99.88	100.53	0.010298	3.67	8.78	7.95	0.93	108.32
2101	13136	Reg_ Ex	AMCAI	27.90	97.96	99.88	99.88	100.53	0.010298	3.67	8.78	7.95	0.93	106.81
2101	13136	2yr_ Fut	CVC	2.10	97.96	98.47	98.47	98.65	0.018816	1.86	1.13	3.22	1.00	22.56
2101	13136	2yr_ Fut	AMCAI	2.10	97.96	98.47	98.47	98.65	0.018816	1.86	1.13	3.22	1.00	22.57
2101	13136	5yr_ Fut	CVC	3.20	97.96	98.59	98.59	98.81	0.018162	2.07	1.55	3.60	1.01	30.16
2101	13136	5yr_ Fut	AMCAI	3.20	97.96	98.59	98.59	98.81	0.018162	2.07	1.55	3.60	1.01	30.21
2101	13136	10yr_ Fut	CVC	4.70	97.96	98.74	98.74	98.99	0.016962	2.25	2.09	4.01	1.00	37.54
2101	13136	10yr_ Fut	AMCAI	4.70	97.96	98.74	98.74	98.99	0.016962	2.25	2.09	4.01	1.00	37.53
2101	13136	25yr_ Fut	CVC	6.00	97.96	98.83	98.83	99.13	0.016564	2.40	2.50	4.30	1.00	43.70
2101	13136	25yr_ Fut	AMCAI	6.00	97.96	98.83	98.83	99.13	0.016564	2.40	2.50	4.30	1.00	43.68
2101	13136	50yr_ Fut	CVC	7.70	97.96	98.95	98.95	99.29	0.015551	2.57	3.02	4.64	0.99	50.35
2101	13136	50yr_ Fut	AMCAI	7.70	97.96	98.95	98.95	99.29	0.015551	2.57	3.02	4.64	0.99	50.26
2101	13136	100yr_ Fut	CVC	10.00	97.96	99.08	99.08	99.47	0.014671	2.77	3.67	5.06	0.99	57.92



HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	13107	25yr_Ex	AMCAI	5.90	97.68	98.68	98.37	98.78	0.003131	1.42	4.58	7.02	0.49	35.35
2101	13107	50yr_Ex	CVC	7.70	97.68	98.80	98.48	98.92	0.003387	1.61	5.49	8.39	0.52	40.56
2101	13107	50yr_Ex	AMCAI	7.70	97.68	98.80	98.48	98.92	0.003387	1.61	5.49	8.39	0.52	40.53
2101	13107	100yr_Ex	CVC	10.00	97.68	98.83	98.61	99.03	0.004994	2.00	5.80	8.72	0.63	46.73
2101	13107	100yr_Ex	AMCAI	10.00	97.68	98.83	98.61	99.03	0.004994	2.00	5.80	8.72	0.63	46.63
2101	13107	Reg_Ex	CVC	27.90	97.68	98.98	99.33	100.04	0.023416	4.74	7.20	10.34	1.40	108.08
2101	13107	Reg_Ex	AMCAI	27.90	97.68	98.98	99.33	100.04	0.023333	4.73	7.22	10.36	1.40	106.57
2101	13107	2yr_Fut	CVC	2.10	97.68	98.27	98.09	98.32	0.003718	1.00	2.12	5.09	0.48	22.51
2101	13107	2yr_Fut	AMCAI	2.10	97.68	98.27	98.09	98.32	0.003718	1.00	2.12	5.09	0.48	22.52
2101	13107	5yr_Fut	CVC	3.20	97.68	98.41	98.18	98.48	0.003410	1.15	2.88	5.61	0.48	30.09
2101	13107	5yr_Fut	AMCAI	3.20	97.68	98.41	98.18	98.48	0.003410	1.15	2.88	5.61	0.48	30.15
2101	13107	10yr_Fut	CVC	4.70	97.68	98.57	98.29	98.66	0.003161	1.30	3.86	6.46	0.48	37.45
2101	13107	10yr_Fut	AMCAI	4.70	97.68	98.57	98.29	98.66	0.003161	1.30	3.86	6.46	0.48	37.44
2101	13107	25yr_Fut	CVC	6.00	97.68	98.69	98.38	98.79	0.003137	1.43	4.63	7.06	0.49	43.59
2101	13107	25yr_Fut	AMCAI	6.00	97.68	98.69	98.38	98.79	0.003137	1.43	4.63	7.06	0.49	43.57
2101	13107	50yr_Fut	CVC	7.70	97.68	98.80	98.48	98.92	0.003387	1.61	5.49	8.39	0.52	50.22
2101	13107	50yr_Fut	AMCAI	7.70	97.68	98.80	98.48	98.92	0.003387	1.61	5.49	8.39	0.52	50.13
2101	13107	100yr_Fut	CVC	10.00	97.68	98.83	98.61	99.03	0.004994	2.00	5.80	8.72	0.63	57.78
2101	13107	100yr_Fut	AMCAI	10.00	97.68	98.83	98.61	99.03	0.004994	2.00	5.80	8.72	0.63	57.58
2101	13107	Reg_Fut	CVC	27.90	97.68	98.98	99.33	100.04	0.023416	4.74	7.20	10.34	1.40	110.48
2101	13107	Reg_Fut	AMCAI	27.90	97.68	98.98	99.33	100.04	0.023333	4.73	7.22	10.36	1.40	108.95
2101	13045	2yr_Ex	CVC	2.10	97.21	97.92	97.78	98.00	0.007019	1.31	1.60	3.63	0.63	18.55
2101	13045	2yr_Ex	AMCAI	2.10	97.21	97.92	97.78	98.00	0.007019	1.31	1.60	3.63	0.63	18.55
2101	13045	5yr_Ex	CVC	3.20	97.21	98.06	97.90	98.17	0.007149	1.48	2.17	4.14	0.65	24.68
2101	13045	5yr_Ex	AMCAI	3.20	97.21	98.06	97.90	98.17	0.007149	1.48	2.17	4.14	0.65	24.68
2101	13045	10yr_Ex	CVC	4.70	97.21	98.15	98.04	98.32	0.010105	1.85	2.54	4.44	0.78	30.25
2101	13045	10yr_Ex	AMCAI	4.70	97.21	98.15	98.04	98.32	0.010105	1.85	2.54	4.44	0.78	30.31
2101	13045	25yr_Ex	CVC	5.90	97.21	98.22	98.14	98.43	0.011282	2.04	3.08	10.58	0.84	35.11
2101	13045	25yr_Ex	AMCAI	5.90	97.21	98.22	98.14	98.43	0.011282	2.04	3.08	10.58	0.84	35.11
2101	13045	50yr_Ex	CVC	7.70	97.21	98.31	98.31	98.55	0.012267	2.25	4.07	13.12	0.88	40.27
2101	13045	50yr_Ex	AMCAI	7.70	97.21	98.31	98.31	98.55	0.012267	2.25	4.07	13.12	0.88	40.24
2101	13045	100yr_Ex	CVC	10.00	97.21	98.47	98.47	98.65	0.007503	2.04	7.23	32.84	0.72	46.34
2101	13045	100yr_Ex	AMCAI	10.00	97.21	98.47	98.47	98.65	0.007503	2.04	7.23	32.84	0.72	46.24
2101	13045	Reg_Ex	CVC	27.90	97.21	98.73	98.78	98.95	0.009162	2.71	19.64	110.87	0.83	107.20
2101	13045	Reg_Ex	AMCAI	27.90	97.21	98.73	98.78	98.95	0.009168	2.71	19.63	110.86	0.83	105.70
2101	13045	2yr_Fut	CVC	2.10	97.21	97.92	97.78	98.00	0.007009	1.31	1.60	3.63	0.63	22.39
2101	13045	2yr_Fut	AMCAI	2.10	97.21	97.92	97.78	98.00	0.007009	1.31	1.60	3.63	0.63	22.41
2101	13045	5yr_Fut	CVC	3.20	97.21	98.06	97.90	98.17	0.007072	1.47	2.18	4.15	0.65	29.93
2101	13045	5yr_Fut	AMCAI	3.20	97.21	98.06	97.90	98.17	0.007072	1.47	2.18	4.15	0.65	29.99
2101	13045	10yr_Fut	CVC	4.70	97.21	98.14	98.04	98.32	0.010466	1.88	2.50	4.42	0.80	37.25
2101	13045	10yr_Fut	AMCAI	4.70	97.21	98.14	98.04	98.32	0.010466	1.88	2.50	4.42	0.80	37.24
2101	13045	25yr_Fut	CVC	6.00	97.21	98.22	98.15	98.44	0.011407	2.06	3.12	10.68	0.84	43.36
2101	13045	25yr_Fut	AMCAI	6.00	97.21	98.22	98.15	98.44	0.011407	2.06	3.12	10.68	0.84	43.33
2101	13045	50yr_Fut	CVC	7.70	97.21	98.31	98.31	98.55	0.012267	2.25	4.07	13.12	0.88	49.93
2101	13045	50yr_Fut	AMCAI	7.70	97.21	98.31	98.31	98.55	0.012267	2.25	4.07	13.12	0.88	49.84
2101	13045	100yr_Fut	CVC	10.00	97.21	98.47	98.47	98.65	0.007503	2.04	7.23	32.84	0.72	57.38
2101	13045	100yr_Fut	AMCAI	10.00	97.21	98.47	98.47	98.65	0.007503	2.04	7.23	32.84	0.72	57.19
2101	13045	Reg_Fut	CVC	27.90	97.21	98.73	98.78	98.95	0.009162	2.71	19.64	110.87	0.83	109.61
2101	13045	Reg_Fut	AMCAI	27.90	97.21	98.73	98.78	98.95	0.009168	2.71	19.63	110.86	0.83	108.08
2101	12995	2yr_Ex	CVC	2.10	96.92	97.70	97.46	97.75	0.003703	0.97	2.16	5.65	0.47	18.46
2101	12995	2yr_Ex	AMCAI	2.10	96.92	97.70	97.46	97.75	0.003703	0.97	2.16	5.65	0.47	18.46
2101	12995	5yr_Ex	CVC	3.20	96.92	97.85	97.58	97.91	0.003680	1.08	2.98	17.10	0.48	24.54
2101	12995	5yr_Ex	AMCAI	3.20	96.92	97.85	97.58	97.91	0.003680	1.08	2.98	17.10	0.48	24.53
2101	12995	10yr_Ex	CVC	4.70	96.92	97.98	97.72	98.03	0.003216	1.03	6.43	24.08	0.45	30.04
2101	12995	10yr_Ex	AMCAI	4.70	96.92	97.98	97.72	98.03	0.003216	1.03	6.43	24.08	0.45	30.09
2101	12995	25yr_Ex	CVC	5.90	96.92	98.00	97.80	98.07	0.004251	1.22	7.01	25.76	0.52	34.87
2101	12995	25yr_Ex	AMCAI	5.90	96.92	98.00	97.80	98.07	0.004251	1.22	7.01	25.76	0.52	34.87
2101	12995	50yr_Ex	CVC	7.70	96.92	98.05	97.95	98.13	0.005058	1.40	8.31	29.59	0.58	39.97
2101	12995	50yr_Ex	AMCAI	7.70	96.92	98.05	97.95	98.13	0.005058	1.40	8.31	29.59	0.58	39.94
2101	12995	100yr_Ex	CVC	10.00	96.92	98.10	98.02	98.20	0.005938	1.60	9.83	37.41	0.63	45.91
2101	12995	100yr_Ex	AMCAI	10.00	96.92	98.10	98.02	98.20	0.005938	1.60	9.83	37.41	0.63	45.81
2101	12995	Reg_Ex	CVC	27.90	96.92	98.31	98.36	98.49	0.009683	2.46	22.34	101.75	0.85	106.07
2101	12995	Reg_Ex	AMCAI	27.90	96.92	98.31	98.36	98.49	0.009677	2.46	22.35	101.75	0.85	104.56
2101	12995	2yr_Fut	CVC	2.10	96.92	97.71	97.46	97.76	0.003410	0.94	2.23	6.46	0.45	22.30
2101	12995	2yr_Fut	AMCAI	2.10	96.92	97.71	97.46	97.76	0.003410	0.94	2.23	6.46	0.45	22.31
2101	12995	5yr_Fut	CVC	3.20	96.92	97.87	97.58	97.93	0.003313	1.03	3.10	17.82	0.45	29.78
2101	12995	5yr_Fut	AMCAI	3.20	96.92	97.87	97.58	97.93	0.003313	1.03	3.10	17.82	0.45	29.83
2101	12995	10yr_Fut	CVC	4.70	96.92	98.00	97.72	98.04	0.002821	0.99	6.86	25.33	0.42	37.02
2101	12995	10yr_Fut	AMCAI	4.70	96.92	98.00	97.72	98.04	0.002821	0.99	6.86	25.33	0.42	37.01
2101	12995	25yr_Fut	CVC	6.00	96.92	98.01	97.81	98.07	0.004273	1.22	7.11	26.03	0.52	43.11
2101	12995	25yr_Fut	AMCAI	6.00	96.92	98.01	97.81	98.07	0.004273	1.22	7.11	26.03	0.52	43.08
2101	12995	50yr_Fut	CVC	7.70	96.92	98.06	97.95	98.13	0.004759	1.37	8.55	30.18	0.56	49.63
2101	12995	50yr_Fut	AMCAI	7.70	96.92	98.06	97.95	98.13	0.004759	1.37	8.55	30.18	0.56	49.53
2101	12995	100yr_Fut	CVC	10.00	96.92	98.12	98.02	98.21	0.005194	1.52	10.48	41.39	0.59	56.94
2101	12995	100yr_Fut	AMCAI	10.00	96.92	98.12	98.02	98.21	0.005194	1.52	10.48	41.39	0.59	56.75
2101	12995	Reg_Fut	CVC	27.90	96.92	98.31	98.36	98.49	0.009683	2.46	22.34	101.75	0.85	108.47
2101	12995	Reg_Fut	AMCAI	27.90	96.92	98.31	98.36	98.49	0.009677	2.46	22.35	101.75	0.85	106.95
2101	12949	2yr_Ex	CVC	3.70	96.46	97.12	97.12	97.33	0.017278	2.05	1.80	4.20	1.00	18.37
2101	12949	2yr_Ex	AMCAI	3.70	96.46	97.12	97.12	97.33	0.017278	2.05	1.80	4.20	1.00	18.37
2101	12949	5yr_Ex	CVC	5.40	96.46	97.25	97.25	97.51	0.016601	2.25	2.40	4.65	1.00	24.39
2101	12949	5yr_Ex	AMCAI	5.40	96.46	97.25	97.25	97.51	0.016601	2.25	2.40	4.65	1.00	24.39

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	12949	2yr_Fut	CVC	3.90	96.46	97.13	97.13	97.35	0.017069	2.07	1.88	4.26	1.00	22.20
2101	12949	2yr_Fut	AMCAI	3.90	96.46	97.13	97.13	97.35	0.017069	2.07	1.88	4.26	1.00	22.22
2101	12949	5yr_Fut	CVC	5.70	96.46	97.27	97.27	97.54	0.016503	2.28	2.50	4.72	1.00	29.62
2101	12949	5yr_Fut	AMCAI	5.70	96.46	97.27	97.27	97.54	0.016503	2.28	2.50	4.72	1.00	29.68
2101	12949	10yr_Fut	CVC	7.60	96.46	97.40	97.40	97.70	0.015836	2.42	3.14	10.14	1.00	36.79
2101	12949	10yr_Fut	AMCAI	7.60	96.46	97.40	97.40	97.70	0.015836	2.42	3.14	10.14	1.00	36.78
2101	12949	25yr_Fut	CVC	9.10	96.46	97.56	97.56	97.76	0.009139	2.06	5.80	18.87	0.78	42.81
2101	12949	25yr_Fut	AMCAI	9.10	96.46	97.56	97.56	97.76	0.009139	2.06	5.80	18.87	0.78	42.79
2101	12949	50yr_Fut	CVC	10.60	96.46	97.61	97.61	97.82	0.008724	2.12	6.94	23.67	0.77	49.27
2101	12949	50yr_Fut	AMCAI	10.60	96.46	97.61	97.61	97.82	0.008724	2.12	6.94	23.67	0.77	49.18
2101	12949	100yr_Fut	CVC	12.10	96.46	97.65	97.65	97.87	0.009339	2.26	7.65	30.80	0.81	56.52
2101	12949	100yr_Fut	AMCAI	12.10	96.46	97.65	97.65	97.87	0.009339	2.26	7.65	30.80	0.81	56.32
2101	12949	Reg_Fut	CVC	30.70	96.46	97.86	97.92	98.05	0.009207	2.62	24.78	129.99	0.83	107.34
2101	12949	Reg_Fut	AMCAI	30.70	96.46	97.86	97.92	98.05	0.009313	2.63	24.41	128.74	0.84	105.82
2101	12922	2yr_Ex	CVC	3.70	95.49	96.68	96.18	96.69	0.000405	0.46	8.70	32.00	0.17	18.17
2101	12922	2yr_Ex	AMCAI	3.70	95.49	96.68	96.18	96.69	0.000405	0.46	8.70	32.00	0.17	18.17
2101	12922	5yr_Ex	CVC	5.40	95.49	96.80	96.27	96.82	0.000481	0.55	10.46	33.16	0.19	24.13
2101	12922	5yr_Ex	AMCAI	5.40	95.49	96.80	96.27	96.82	0.000481	0.55	10.46	33.16	0.19	24.13
2101	12922	10yr_Ex	CVC	7.20	95.49	96.91	96.34	96.93	0.000553	0.64	11.98	34.36	0.21	29.49
2101	12922	10yr_Ex	AMCAI	7.20	95.49	96.91	96.34	96.93	0.000553	0.64	11.98	34.36	0.21	29.55
2101	12922	25yr_Ex	CVC	8.70	95.49	96.99	96.39	97.02	0.000604	0.71	13.11	42.87	0.22	34.19
2101	12922	25yr_Ex	AMCAI	8.70	95.49	96.99	96.39	97.02	0.000604	0.71	13.11	42.87	0.22	34.19
2101	12922	50yr_Ex	CVC	10.20	95.49	97.06	96.43	97.09	0.000658	0.77	14.09	46.63	0.23	39.17
2101	12922	50yr_Ex	AMCAI	10.20	95.49	97.06	96.43	97.09	0.000658	0.77	14.09	46.63	0.23	39.14
2101	12922	100yr_Ex	CVC	11.60	95.49	97.12	96.47	97.16	0.000708	0.83	14.91	49.51	0.25	45.01
2101	12922	100yr_Ex	AMCAI	11.60	95.49	97.12	96.47	97.16	0.000708	0.83	14.91	49.51	0.25	44.90
2101	12922	Reg_Ex	CVC	30.60	95.49	97.66	96.86	97.67	0.000268	0.66	69.16	144.21	0.16	103.56
2101	12922	Reg_Ex	AMCAI	30.60	95.49	97.66	96.86	97.67	0.000268	0.66	69.16	144.21	0.16	102.05
2101	12922	2yr_Fut	CVC	3.90	95.49	96.69	96.20	96.70	0.000413	0.47	8.94	32.16	0.17	21.99
2101	12922	2yr_Fut	AMCAI	3.90	95.49	96.69	96.20	96.70	0.000413	0.47	8.94	32.16	0.17	22.01
2101	12922	5yr_Fut	CVC	5.70	95.49	96.82	96.28	96.84	0.000493	0.57	10.74	33.34	0.19	29.35
2101	12922	5yr_Fut	AMCAI	5.70	95.49	96.82	96.28	96.84	0.000493	0.57	10.74	33.34	0.19	29.40
2101	12922	10yr_Fut	CVC	7.60	95.49	96.93	96.35	96.96	0.000568	0.66	12.29	36.76	0.21	36.45
2101	12922	10yr_Fut	AMCAI	7.60	95.49	96.93	96.35	96.96	0.000568	0.66	12.29	36.76	0.21	36.44
2101	12922	25yr_Fut	CVC	9.10	95.49	97.01	96.40	97.04	0.000617	0.73	13.39	43.98	0.23	42.40
2101	12922	25yr_Fut	AMCAI	9.10	95.49	97.01	96.40	97.04	0.000616	0.73	13.40	44.01	0.23	42.38
2101	12922	50yr_Fut	CVC	10.60	95.49	97.08	96.45	97.11	0.000672	0.79	14.33	47.48	0.24	48.81
2101	12922	50yr_Fut	AMCAI	10.60	95.49	97.08	96.45	97.11	0.000672	0.79	14.33	47.48	0.24	48.71
2101	12922	100yr_Fut	CVC	12.10	95.49	97.14	96.49	97.18	0.000730	0.85	15.16	50.40	0.25	56.00
2101	12922	100yr_Fut	AMCAI	12.10	95.49	97.14	96.49	97.18	0.000730	0.85	15.16	50.40	0.25	55.81
2101	12922	Reg_Fut	CVC	30.70	95.49	97.66	96.87	97.67	0.000267	0.66	69.47	144.54	0.16	105.94
2101	12922	Reg_Fut	AMCAI	30.70	95.49	97.66	96.87	97.67	0.000267	0.66	69.47	144.54	0.16	104.43
2101	12906	7-Beryl		Bridge										
2101	12887	2yr_Ex	CVC	3.70	95.40	96.62	96.12	96.65	0.001440	0.72	5.19	12.26	0.30	17.94
2101	12887	2yr_Ex	AMCAI	3.70	95.40	96.62	96.12	96.65	0.001440	0.72	5.19	12.26	0.30	17.94
2101	12887	5yr_Ex	CVC	5.40	95.40	96.74	96.24	96.77	0.001559	0.85	6.91	17.38	0.32	23.85
2101	12887	5yr_Ex	AMCAI	5.40	95.40	96.74	96.24	96.77	0.001559	0.85	6.91	17.38	0.32	23.85
2101	12887	10yr_Ex	CVC	7.20	95.40	96.84	96.35	96.88	0.001582	0.93	8.67	41.36	0.33	29.18
2101	12887	10yr_Ex	AMCAI	7.20	95.40	96.84	96.35	96.88	0.001582	0.93	8.67	41.36	0.33	29.24
2101	12887	25yr_Ex	CVC	8.70	95.40	96.91	96.46	96.96	0.001592	0.99	9.95	66.10	0.34	33.85
2101	12887	25yr_Ex	AMCAI	8.70	95.40	96.91	96.46	96.96	0.001592	0.99	9.95	66.10	0.34	33.85
2101	12887	50yr_Ex	CVC	10.20	95.40	96.97	96.55	97.02	0.001661	1.06	10.98	75.88	0.35	38.80
2101	12887	50yr_Ex	AMCAI	10.20	95.40	96.97	96.55	97.02	0.001661	1.06	10.98	75.88	0.35	38.77
2101	12887	100yr_Ex	CVC	11.60	95.40	97.01	96.62	97.07	0.001746	1.12	11.80	82.79	0.36	44.61
2101	12887	100yr_Ex	AMCAI	11.60	95.40	97.01	96.62	97.07	0.001746	1.12	11.80	82.79	0.36	44.51
2101	12887	Reg_Ex	CVC	30.60	95.40	97.37	97.06	97.40	0.000698	0.87	52.07	133.64	0.24	102.62
2101	12887	Reg_Ex	AMCAI	30.60	95.40	97.37	97.06	97.40	0.000698	0.87	52.07	133.64	0.24	101.11
2101	12887	2yr_Fut	CVC	3.90	95.40	96.64	96.13	96.67	0.001460	0.74	5.39	13.47	0.31	21.76
2101	12887	2yr_Fut	AMCAI	3.90	95.40	96.64	96.13	96.67	0.001460	0.74	5.39	13.47	0.31	21.77
2101	12887	5yr_Fut	CVC	5.70	95.40	96.76	96.26	96.79	0.001569	0.86	7.21	18.66	0.33	29.07
2101	12887	5yr_Fut	AMCAI	5.70	95.40	96.76	96.26	96.79	0.001569	0.86	7.21	18.66	0.33	29.13
2101	12887	10yr_Fut	CVC	7.60	95.40	96.86	96.38	96.90	0.001582	0.95	9.03	49.06	0.34	36.13
2101	12887	10yr_Fut	AMCAI	7.60	95.40	96.86	96.38	96.90	0.001582	0.95	9.03	49.06	0.34	36.12
2101	12887	25yr_Fut	CVC	9.10	95.40	96.93	96.49	96.98	0.001605	1.01	10.25	69.57	0.34	42.05
2101	12887	25yr_Fut	AMCAI	9.10	95.40	96.93	96.49	96.98	0.001599	1.01	10.27	69.73	0.34	42.02
2101	12887	50yr_Fut	CVC	10.60	95.40	96.98	96.57	97.04	0.001684	1.07	11.23	77.95	0.35	48.43
2101	12887	50yr_Fut	AMCAI	10.60	95.40	96.98	96.57	97.04	0.001684	1.07	11.23	77.95	0.35	48.33
2101	12887	100yr_Fut	CVC	12.10	95.40	97.03	96.67	97.09	0.001803	1.15	12.01	84.60	0.37	55.60
2101	12887	100yr_Fut	AMCAI	12.10	95.40	97.03	96.67	97.09	0.001803	1.15	12.01	84.60	0.37	55.40
2101	12887	Reg_Fut	CVC	30.70	95.40	97.38	97.06	97.40	0.000699	0.87	52.25	135.75	0.24	105.00
2101	12887	Reg_Fut	AMCAI	30.70	95.40	97.38	97.06	97.40	0.000699	0.87	52.25	135.75	0.24	103.48
2101	12854	2yr_Ex	CVC	3.70	95.58	96.50	96.22	96.56	0.003843	1.19	3.57	12.46	0.49	17.79
2101	12854	2yr_Ex	AMCAI	3.70	95.58	96.50	96.22	96.56	0.003843	1.19	3.57	12.46	0.49	17.79
2101	12854	5yr_Ex	CVC	5.40	95.58	96.56	96.37	96.66	0.005689	1.50	4.41	14.13	0.60	23.67
2101	12854	5yr_Ex	AMCAI	5.40	95.58	96.56	96.37	96.66	0.005689	1.50	4.41	14.13	0.60	23.66
2101	12854	10yr_Ex	CVC	7.20	95.58	96.60	96.57	96.75	0.007844	1.79	5.07	15.29	0.71	28.94
2101	12854	10yr_Ex	AMCAI	7.20	95.58	96.60	96.57	96.75	0.007844	1.79	5.07	15.29	0.71	28.99
2101	12854	25yr_Ex	CVC	8.70	95.58	96.64	96.63	96.81	0.009359	1.98	5.62	16.01	0.78	33.53
2101	12854	25yr_Ex	AMCAI	8.70	95.58	96.64	96.63	96.81	0.009359	1.98	5.62	16.01	0.78	33.53
2101	12854	50yr_Ex	CVC	10.20	95.58	96.69	96.69	96.87	0.009827	2.07	6.40	16.98	0.80	38.40
2101	12854	50yr_Ex	AMCAI	10.20	95.58	96.69	96.69	96.87	0.009827	2.07	6.40	16.98	0.80	38.37
2101	12854	100yr_Ex	CVC											

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12854	10yr_Fut	AMCAI	7.60	95.58	96.61	96.58	96.77	0.008314	1.85	5.20	15.46	0.73	35.86
2101	12854	25yr_Fut	CVC	9.10	95.58	96.65	96.65	96.83	0.009570	2.02	5.81	16.25	0.79	41.71
2101	12854	25yr_Fut	AMCAI	9.10	95.58	96.65	96.65	96.83	0.009672	2.02	5.78	16.21	0.79	41.68
2101	12854	50yr_Fut	CVC	10.60	95.58	96.70	96.70	96.88	0.009879	2.09	6.62	17.25	0.80	48.00
2101	12854	50yr_Fut	AMCAI	10.60	95.58	96.70	96.70	96.88	0.009879	2.09	6.62	17.25	0.80	47.91
2101	12854	100yr_Fut	CVC	12.10	95.58	96.75	96.75	96.93	0.009667	2.11	7.58	20.02	0.80	55.10
2101	12854	100yr_Fut	AMCAI	12.10	95.58	96.75	96.75	96.93	0.009667	2.11	7.58	20.02	0.80	54.90
2101	12854	Reg_Fut	CVC	30.70	95.58	97.13	97.04	97.30	0.007288	2.20	19.10	63.08	0.73	103.67
2101	12854	Reg_Fut	AMCAI	30.70	95.58	97.13	97.04	97.30	0.007288	2.20	19.10	63.08	0.73	102.16
2101	12802	2yr_Ex	CVC	3.70	95.47	96.29	96.11	96.36	0.004089	1.20	4.01	31.64	0.51	17.58
2101	12802	2yr_Ex	AMCAI	3.70	95.47	96.29	96.11	96.36	0.004089	1.20	4.01	31.64	0.51	17.58
2101	12802	5yr_Ex	CVC	5.40	95.47	96.41	96.33	96.45	0.002634	1.09	7.26	44.66	0.42	23.32
2101	12802	5yr_Ex	AMCAI	5.40	95.47	96.41	96.33	96.45	0.002634	1.09	7.26	44.66	0.42	23.32
2101	12802	10yr_Ex	CVC	7.20	95.47	96.49	96.38	96.53	0.002067	1.05	10.03	56.23	0.38	28.47
2101	12802	10yr_Ex	AMCAI	7.20	95.47	96.49	96.38	96.53	0.002067	1.05	10.03	56.23	0.38	28.52
2101	12802	25yr_Ex	CVC	8.70	95.47	96.55	96.42	96.58	0.001929	1.06	11.78	62.41	0.37	32.97
2101	12802	25yr_Ex	AMCAI	8.70	95.47	96.55	96.42	96.58	0.001929	1.06	11.78	62.41	0.37	32.97
2101	12802	50yr_Ex	CVC	10.20	95.47	96.60	96.44	96.63	0.001791	1.06	13.50	65.48	0.36	37.73
2101	12802	50yr_Ex	AMCAI	10.20	95.47	96.60	96.44	96.63	0.001791	1.06	13.50	65.48	0.36	37.70
2101	12802	100yr_Ex	CVC	11.60	95.47	96.64	96.46	96.68	0.001702	1.07	14.98	66.11	0.36	43.36
2101	12802	100yr_Ex	AMCAI	11.60	95.47	96.64	96.46	96.68	0.001702	1.07	14.98	66.11	0.36	43.26
2101	12802	Reg_Ex	CVC	30.60	95.47	96.70	96.68	96.89	0.008343	2.46	16.82	66.54	0.80	100.02
2101	12802	Reg_Ex	AMCAI	30.60	95.47	96.70	96.68	96.89	0.008343	2.46	16.82	66.54	0.80	98.51
2101	12802	2yr_Fut	CVC	3.90	95.47	96.31	96.13	96.37	0.003844	1.19	4.38	33.28	0.50	21.38
2101	12802	2yr_Fut	AMCAI	3.90	95.47	96.31	96.13	96.37	0.003844	1.19	4.38	33.28	0.50	21.40
2101	12802	5yr_Fut	CVC	5.70	95.47	96.43	96.34	96.47	0.002434	1.07	7.85	46.00	0.41	28.51
2101	12802	5yr_Fut	AMCAI	5.70	95.47	96.43	96.34	96.47	0.002434	1.07	7.85	46.00	0.41	28.56
2101	12802	10yr_Fut	CVC	7.60	95.47	96.51	96.38	96.55	0.001967	1.04	10.63	57.81	0.37	35.37
2101	12802	10yr_Fut	AMCAI	7.60	95.47	96.51	96.38	96.55	0.001967	1.04	10.63	57.81	0.37	35.36
2101	12802	25yr_Fut	CVC	9.10	95.47	96.56	96.43	96.60	0.001888	1.06	12.25	63.45	0.37	41.11
2101	12802	25yr_Fut	AMCAI	9.10	95.47	96.56	96.43	96.60	0.001888	1.06	12.25	63.45	0.37	41.09
2101	12802	50yr_Fut	CVC	10.60	95.47	96.61	96.45	96.65	0.001771	1.06	13.91	65.85	0.36	47.30
2101	12802	50yr_Fut	AMCAI	10.60	95.47	96.61	96.45	96.65	0.001771	1.06	13.91	65.85	0.36	47.21
2101	12802	100yr_Fut	CVC	12.10	95.47	96.66	96.47	96.69	0.001678	1.07	15.48	66.23	0.35	54.29
2101	12802	100yr_Fut	AMCAI	12.10	95.47	96.66	96.47	96.69	0.001678	1.07	15.48	66.23	0.35	54.10
2101	12802	Reg_Fut	CVC	30.70	95.47	96.70	96.68	96.89	0.008394	2.47	16.82	66.54	0.80	102.39
2101	12802	Reg_Fut	AMCAI	30.70	95.47	96.70	96.68	96.89	0.008394	2.47	16.82	66.54	0.80	100.88
2101	12756	2yr_Ex	CVC	3.70	95.24	96.03	95.89	96.12	0.006279	1.35	2.85	14.57	0.62	17.41
2101	12756	2yr_Ex	AMCAI	3.70	95.24	96.03	95.89	96.12	0.006279	1.35	2.85	14.57	0.62	17.41
2101	12756	5yr_Ex	CVC	5.40	95.24	96.09	96.03	96.24	0.009063	1.74	3.41	20.26	0.76	23.03
2101	12756	5yr_Ex	AMCAI	5.40	95.24	96.09	96.03	96.24	0.009063	1.74	3.41	20.26	0.76	23.03
2101	12756	10yr_Ex	CVC	7.20	95.24	96.16	96.16	96.34	0.009378	1.93	4.45	39.00	0.79	28.03
2101	12756	10yr_Ex	AMCAI	7.20	95.24	96.16	96.16	96.34	0.009378	1.93	4.45	39.00	0.79	28.08
2101	12756	25yr_Ex	CVC	8.70	95.24	96.23	96.23	96.41	0.008270	1.96	5.69	54.47	0.76	32.37
2101	12756	25yr_Ex	AMCAI	8.70	95.24	96.23	96.23	96.41	0.008270	1.96	5.69	54.47	0.76	32.37
2101	12756	50yr_Ex	CVC	10.20	95.24	96.28	96.28	96.46	0.008523	2.07	6.43	55.86	0.78	37.00
2101	12756	50yr_Ex	AMCAI	10.20	95.24	96.28	96.28	96.46	0.008523	2.07	6.43	55.86	0.78	36.97
2101	12756	100yr_Ex	CVC	11.60	95.24	96.32	96.32	96.51	0.008616	2.15	7.10	60.84	0.79	42.52
2101	12756	100yr_Ex	AMCAI	11.60	95.24	96.32	96.32	96.51	0.008616	2.15	7.10	60.84	0.79	42.42
2101	12756	Reg_Ex	CVC	30.60	95.24	96.47	96.42	96.57	0.005092	1.87	23.86	67.47	0.62	98.87
2101	12756	Reg_Ex	AMCAI	30.60	95.24	96.47	96.42	96.57	0.005092	1.87	23.86	67.47	0.62	97.37
2101	12756	2yr_Fut	CVC	3.90	95.24	96.04	95.91	96.14	0.006489	1.39	2.94	14.99	0.64	21.19
2101	12756	2yr_Fut	AMCAI	3.90	95.24	96.04	95.91	96.14	0.006489	1.39	2.94	14.99	0.64	21.21
2101	12756	5yr_Fut	CVC	5.70	95.24	96.09	96.05	96.25	0.010079	1.84	3.41	20.28	0.80	28.19
2101	12756	5yr_Fut	AMCAI	5.70	95.24	96.09	96.05	96.25	0.010079	1.84	3.41	20.28	0.80	28.25
2101	12756	10yr_Fut	CVC	7.60	95.24	96.17	96.17	96.36	0.009783	1.99	4.59	40.49	0.81	34.90
2101	12756	10yr_Fut	AMCAI	7.60	95.24	96.17	96.17	96.36	0.009783	1.99	4.59	40.49	0.81	34.89
2101	12756	25yr_Fut	CVC	9.10	95.24	96.25	96.25	96.42	0.008334	1.99	5.89	54.80	0.76	40.49
2101	12756	25yr_Fut	AMCAI	9.10	95.24	96.25	96.25	96.42	0.008334	1.99	5.89	54.80	0.76	40.46
2101	12756	50yr_Fut	CVC	10.60	95.24	96.29	96.29	96.48	0.008414	2.08	6.67	57.72	0.77	46.54
2101	12756	50yr_Fut	AMCAI	10.60	95.24	96.29	96.29	96.48	0.008414	2.08	6.67	57.72	0.77	46.45
2101	12756	100yr_Fut	CVC	12.10	95.24	96.33	96.33	96.53	0.008598	2.18	7.35	61.13	0.79	53.41
2101	12756	100yr_Fut	AMCAI	12.10	95.24	96.33	96.33	96.53	0.008598	2.18	7.35	61.13	0.79	53.21
2101	12756	Reg_Fut	CVC	30.70	95.24	96.47	96.42	96.57	0.005057	1.87	23.96	67.50	0.62	101.24
2101	12756	Reg_Fut	AMCAI	30.70	95.24	96.47	96.42	96.57	0.005057	1.87	23.96	67.50	0.62	99.73
2101	12717	2yr_Ex	CVC	3.70	95.07	95.85	95.64	95.92	0.004173	1.21	3.46	19.65	0.51	17.28
2101	12717	2yr_Ex	AMCAI	3.70	95.07	95.85	95.64	95.92	0.004173	1.21	3.46	19.65	0.51	17.28
2101	12717	5yr_Ex	CVC	5.40	95.07	95.94	95.76	96.01	0.003473	1.22	6.25	39.07	0.48	22.83
2101	12717	5yr_Ex	AMCAI	5.40	95.07	95.94	95.76	96.01	0.003473	1.22	6.25	39.07	0.48	22.83
2101	12717	10yr_Ex	CVC	7.20	95.07	96.01	95.98	96.06	0.002824	1.17	9.14	50.50	0.44	27.73
2101	12717	10yr_Ex	AMCAI	7.20	95.07	96.01	95.98	96.06	0.002824	1.17	9.14	50.50	0.44	27.79
2101	12717	25yr_Ex	CVC	8.70	95.07	96.06	96.00	96.10	0.002299	1.11	12.00	57.49	0.40	31.95
2101	12717	25yr_Ex	AMCAI	8.70	95.07	96.06	96.00	96.10	0.002299	1.11	12.00	57.49	0.40	31.95
2101	12717	50yr_Ex	CVC	10.20	95.07	96.11	96.02	96.14	0.001905	1.05	14.65	60.50	0.37	36.48
2101	12717	50yr_Ex	AMCAI	10.20	95.07	96.11	96.02	96.14	0.001905	1.05	14.65	60.50	0.37	36.45
2101	12717	100yr_Ex	CVC	11.60	95.07	96.15	96.04	96.18	0.001571	0.98	17.33	62.81	0.34	41.91
2101	12717	100yr_Ex	AMCAI	11.60	95.07	96.15	96.04	96.18	0.001571	0.98	17.33	62.81	0.34	41.81
2101	12717	Reg_Ex	CVC	30.60	95.07	96.20	96.20	96.33	0.006977	2.15	20.33	63.70	0.72	98.02
2101	12717	Reg_Ex	AMCAI	30.60	95.07	96.20	96.20	96.33	0.006977	2.15	20.33	63.70	0.72	96.51
2101	12717	2yr_Fut	CVC	3.90	95.07	95.87	95.65	95.94	0.004026	1.21	3.79	22.24	0.51	21.06
2101	12717	2yr_Fut	AMCAI	3.90	95.07	95.87	95.65	95.94	0.004026	1.21	3.79	22.24	0	

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	12717	Reg_Fut	CVC	30.70	95.07	96.20	96.20	96.33	0.007041	2.16	20.31	63.70	0.72	100.38
2101	12717	Reg_Fut	AMCAI	30.70	95.07	96.20	96.20	96.33	0.007041	2.16	20.31	63.70	0.72	98.87
2101	12622	2yr_Ex	CVC	4.40	94.15	94.90	94.90	95.15	0.017175	2.23	1.98	3.91	1.00	17.04
2101	12622	2yr_Ex	AMCAI	4.40	94.15	94.90	94.90	95.15	0.017175	2.23	1.98	3.91	1.00	17.04
2101	12622	5yr_Ex	CVC	6.50	94.15	95.07	95.07	95.37	0.016489	2.40	2.71	4.64	1.00	22.50
2101	12622	5yr_Ex	AMCAI	6.50	94.15	95.07	95.07	95.37	0.016489	2.40	2.71	4.64	1.00	22.50
2101	12622	10yr_Ex	CVC	8.50	94.15	95.21	95.21	95.53	0.015975	2.52	3.38	5.40	1.00	27.33
2101	12622	10yr_Ex	AMCAI	8.50	94.15	95.21	95.21	95.53	0.015975	2.52	3.38	5.40	1.00	27.38
2101	12622	25yr_Ex	CVC	10.30	94.15	95.31	95.31	95.66	0.014943	2.64	3.92	7.49	0.99	31.48
2101	12622	25yr_Ex	AMCAI	10.30	94.15	95.31	95.31	95.66	0.014943	2.64	3.92	7.49	0.99	31.48
2101	12622	50yr_Ex	CVC	11.90	94.15	95.39	95.39	95.77	0.014016	2.74	4.42	10.35	0.97	35.95
2101	12622	50yr_Ex	AMCAI	11.90	94.15	95.39	95.39	95.77	0.014016	2.74	4.42	10.35	0.97	35.92
2101	12622	100yr_Ex	CVC	13.60	94.15	95.49	95.49	95.87	0.012001	2.75	5.27	21.71	0.92	41.29
2101	12622	100yr_Ex	AMCAI	13.60	94.15	95.49	95.49	95.87	0.012001	2.75	5.27	21.71	0.92	41.19
2101	12622	Reg_Ex	CVC	32.00	94.15	96.10	95.85	96.14	0.001553	1.39	63.83	154.32	0.36	96.54
2101	12622	Reg_Ex	AMCAI	32.00	94.15	96.10	95.85	96.14	0.001553	1.39	63.83	154.32	0.36	95.04
2101	12622	2yr_Fut	CVC	4.70	94.15	94.93	94.93	95.19	0.017086	2.26	2.08	3.99	1.00	20.80
2101	12622	2yr_Fut	AMCAI	4.70	94.15	94.93	94.93	95.19	0.017086	2.26	2.08	3.99	1.00	20.82
2101	12622	5yr_Fut	CVC	7.00	94.15	95.11	95.11	95.41	0.016294	2.43	2.88	4.80	1.00	27.63
2101	12622	5yr_Fut	AMCAI	7.00	94.15	95.11	95.11	95.41	0.016294	2.43	2.88	4.80	1.00	27.69
2101	12622	10yr_Fut	CVC	9.10	94.15	95.25	95.25	95.58	0.015539	2.54	3.58	5.92	0.99	34.15
2101	12622	10yr_Fut	AMCAI	9.10	94.15	95.25	95.25	95.58	0.015539	2.54	3.58	5.92	0.99	34.15
2101	12622	25yr_Fut	CVC	11.00	94.15	95.34	95.34	95.71	0.014644	2.70	4.12	8.62	0.99	39.53
2101	12622	25yr_Fut	AMCAI	11.00	94.15	95.34	95.34	95.71	0.014644	2.70	4.12	8.62	0.99	39.51
2101	12622	50yr_Fut	CVC	12.60	94.15	95.42	95.42	95.81	0.013442	2.77	4.69	12.46	0.96	45.42
2101	12622	50yr_Fut	AMCAI	12.60	94.15	95.42	95.42	95.81	0.013442	2.77	4.69	12.46	0.96	45.33
2101	12622	100yr_Fut	CVC	14.40	94.15	95.52	95.52	95.92	0.012009	2.81	5.54	32.05	0.93	52.10
2101	12622	100yr_Fut	AMCAI	14.40	94.15	95.52	95.52	95.92	0.012009	2.81	5.54	32.05	0.93	51.90
2101	12622	Reg_Fut	CVC	32.10	94.15	96.10	95.85	96.14	0.001534	1.39	64.29	154.40	0.36	98.90
2101	12622	Reg_Fut	AMCAI	32.10	94.15	96.10	95.85	96.14	0.001534	1.39	64.29	154.40	0.36	97.39
2101	12604	2yr_Ex	CVC	4.40	93.87	94.63	94.21	94.64	0.000728	0.59	7.96	14.94	0.23	16.94
2101	12604	2yr_Ex	AMCAI	4.40	93.87	94.63	94.21	94.64	0.000728	0.59	7.96	14.94	0.23	16.94
2101	12604	5yr_Ex	CVC	6.50	93.87	94.80	94.29	94.82	0.000731	0.69	10.10	16.73	0.24	22.36
2101	12604	5yr_Ex	AMCAI	6.50	93.87	94.80	94.29	94.82	0.000731	0.69	10.10	16.73	0.24	22.36
2101	12604	10yr_Ex	CVC	8.50	93.87	94.91	94.35	94.94	0.000824	0.79	11.47	17.90	0.26	27.16
2101	12604	10yr_Ex	AMCAI	8.50	93.87	94.91	94.35	94.94	0.000824	0.79	11.47	17.90	0.26	27.21
2101	12604	25yr_Ex	CVC	10.30	93.87	94.99	94.41	95.03	0.000917	0.88	12.49	21.15	0.28	31.28
2101	12604	25yr_Ex	AMCAI	10.30	93.87	94.99	94.41	95.03	0.000917	0.88	12.48	21.14	0.28	31.28
2101	12604	50yr_Ex	CVC	11.90	93.87	95.05	94.45	95.10	0.000990	0.95	13.32	30.28	0.29	35.71
2101	12604	50yr_Ex	AMCAI	11.90	93.87	95.05	94.45	95.10	0.000990	0.95	13.32	30.28	0.29	35.68
2101	12604	100yr_Ex	CVC	13.60	93.87	95.13	94.50	95.18	0.001037	1.02	14.25	30.76	0.30	40.99
2101	12604	100yr_Ex	AMCAI	13.60	93.87	95.13	94.50	95.18	0.001037	1.02	14.25	30.76	0.30	40.89
2101	12604	Reg_Ex	CVC	32.00	93.87	96.08	94.89	96.11	0.000411	0.96	52.62	42.48	0.21	94.31
2101	12604	Reg_Ex	AMCAI	32.00	93.87	96.08	94.89	96.11	0.000411	0.96	52.62	42.48	0.21	92.81
2101	12604	2yr_Fut	CVC	4.70	93.87	94.66	94.23	94.67	0.000720	0.60	8.32	15.20	0.23	20.69
2101	12604	2yr_Fut	AMCAI	4.70	93.87	94.66	94.23	94.67	0.000720	0.60	8.32	15.20	0.23	20.71
2101	12604	5yr_Fut	CVC	7.00	93.87	94.83	94.31	94.85	0.000753	0.71	10.48	17.05	0.24	27.48
2101	12604	5yr_Fut	AMCAI	7.00	93.87	94.83	94.31	94.85	0.000753	0.71	10.47	17.05	0.24	27.54
2101	12604	10yr_Fut	CVC	9.10	93.87	94.94	94.37	94.97	0.000855	0.82	11.83	18.76	0.27	33.97
2101	12604	10yr_Fut	AMCAI	9.10	93.87	94.93	94.37	94.97	0.000856	0.82	11.82	18.74	0.27	33.97
2101	12604	25yr_Fut	CVC	11.00	93.87	95.03	94.43	95.07	0.000924	0.91	12.97	24.73	0.28	39.32
2101	12604	25yr_Fut	AMCAI	11.00	93.87	95.03	94.43	95.07	0.000924	0.91	12.97	24.73	0.28	39.29
2101	12604	50yr_Fut	CVC	12.60	93.87	95.08	94.47	95.13	0.001013	0.98	13.69	30.48	0.30	45.16
2101	12604	50yr_Fut	AMCAI	12.60	93.87	95.08	94.47	95.13	0.001013	0.98	13.69	30.48	0.30	45.07
2101	12604	100yr_Fut	CVC	14.40	93.87	95.17	94.52	95.22	0.001039	1.04	14.74	31.02	0.30	51.76
2101	12604	100yr_Fut	AMCAI	14.40	93.87	95.17	94.52	95.22	0.001039	1.04	14.74	31.02	0.30	51.56
2101	12604	Reg_Fut	CVC	32.10	93.87	96.08	94.89	96.12	0.000411	0.96	52.74	42.49	0.21	96.66
2101	12604	Reg_Fut	AMCAI	32.10	93.87	96.08	94.89	96.12	0.000411	0.96	52.74	42.49	0.21	95.15
2101	12596 6-CNR Spur			Culvert										
2101	12589	2yr_Ex	CVC	4.40	93.73	94.61	94.12	94.63	0.000547	0.56	8.53	13.56	0.20	16.89
2101	12589	2yr_Ex	AMCAI	4.40	93.73	94.61	94.12	94.63	0.000547	0.56	8.53	13.56	0.20	16.88
2101	12589	5yr_Ex	CVC	6.50	93.73	94.77	94.20	94.80	0.000621	0.68	10.53	16.94	0.22	22.29
2101	12589	5yr_Ex	AMCAI	6.50	93.73	94.77	94.20	94.80	0.000621	0.68	10.53	16.94	0.22	22.29
2101	12589	10yr_Ex	CVC	8.50	93.73	94.87	94.27	94.90	0.000749	0.80	11.76	22.21	0.25	27.08
2101	12589	10yr_Ex	AMCAI	8.50	93.73	94.87	94.27	94.90	0.000749	0.80	11.76	22.21	0.25	27.14
2101	12589	25yr_Ex	CVC	10.30	93.73	94.94	94.32	94.98	0.000877	0.90	12.63	27.95	0.27	31.20
2101	12589	25yr_Ex	AMCAI	10.30	93.73	94.94	94.32	94.98	0.000877	0.90	12.63	27.94	0.27	31.20
2101	12589	50yr_Ex	CVC	11.90	93.73	94.99	94.37	95.04	0.000992	0.99	13.30	32.36	0.29	35.62
2101	12589	50yr_Ex	AMCAI	11.90	93.73	94.99	94.37	95.04	0.000992	0.99	13.30	32.36	0.29	35.59
2101	12589	100yr_Ex	CVC	13.60	93.73	95.05	94.42	95.10	0.001107	1.08	13.97	39.76	0.31	40.89
2101	12589	100yr_Ex	AMCAI	13.60	93.73	95.05	94.42	95.10	0.001107	1.08	13.97	39.76	0.31	40.79
2101	12589	Reg_Ex	CVC	32.00	93.73	95.51	94.84	95.57	0.001159	1.37	39.58	48.67	0.34	94.12
2101	12589	Reg_Ex	AMCAI	32.00	93.73	95.51	94.84	95.57	0.001159	1.37	39.58	48.67	0.34	92.62
2101	12589	2yr_Fut	CVC	4.70	93.73	94.64	94.13	94.65	0.000554	0.58	8.86	13.76	0.21	20.64
2101	12589	2yr_Fut	AMCAI	4.70	93.73	94.64	94.13	94.65	0.000554	0.58	8.86	13.76	0.21	20.65
2101	12589	5yr_Fut	CVC	7.00	93.73	94.80	94.22	94.82	0.000651	0.71	10.87	17.72	0.23	27.41
2101	12589	5yr_Fut	AMCAI	7.00	93.73	94.80	94.22	94.82	0.000651	0.71	10.87	17.72	0.23	27.47
2101	12589	10yr_Fut	CVC	9.10	93.73	94.90	94.29	94.93	0.000790	0.83	12.07	24.90	0.26	33.89
2101	12589	10yr_Fut	AMCAI	9.10	93.73	94.90	94.29	94.93	0.000792	0.83	12.07	24.87	0.26	33.89
2101	12589	25yr_Fut	CVC	11.00	93.73	94.96	94.35	95.01	0.000927	0.94	12.93	29.60	0.28	39.23
2101	12589	25yr_Fut	AMCAI	11.00	93.73	94.96	94.35	95.01	0.000927	0.94	12.93	29.60	0.28	39.21
2101	12589	50yr_Fut	CVC	12.60										

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12567	5yr_ Ex	CVC	6.50	93.70	94.72		94.77	0.001676	1.04	8.88	23.04	0.36	22.06
2101	12567	5yr_ Ex	AMCAI	6.50	93.70	94.72		94.77	0.001676	1.04	8.88	23.04	0.36	22.06
2101	12567	10yr_ Ex	CVC	8.50	93.70	94.81		94.87	0.001785	1.15	11.27	27.03	0.37	26.79
2101	12567	10yr_ Ex	AMCAI	8.50	93.70	94.81		94.87	0.001786	1.15	11.27	27.02	0.37	26.84
2101	12567	25yr_ Ex	CVC	10.30	93.70	94.88		94.94	0.001864	1.23	13.21	28.61	0.39	30.85
2101	12567	25yr_ Ex	AMCAI	10.30	93.70	94.88		94.94	0.001865	1.23	13.20	28.61	0.39	30.85
2101	12567	50yr_ Ex	CVC	11.90	93.70	94.94		95.00	0.001923	1.29	14.83	29.86	0.40	35.24
2101	12567	50yr_ Ex	AMCAI	11.90	93.70	94.94		95.00	0.001923	1.29	14.83	29.86	0.40	35.21
2101	12567	100yr_ Ex	CVC	13.60	93.70	94.99		95.06	0.001998	1.36	16.65	38.47	0.41	40.46
2101	12567	100yr_ Ex	AMCAI	13.60	93.70	94.99		95.06	0.001998	1.36	16.65	38.47	0.41	40.36
2101	12567	Reg_ Ex	CVC	32.00	93.70	95.47		95.54	0.001623	1.55	38.80	48.55	0.39	93.13
2101	12567	Reg_ Ex	AMCAI	32.00	93.70	95.47		95.54	0.001623	1.55	38.80	48.55	0.39	91.62
2101	12567	2yr_ Fut	CVC	4.70	93.70	94.58		94.63	0.001821	0.96	6.11	17.49	0.36	20.46
2101	12567	2yr_ Fut	AMCAI	4.70	93.70	94.58		94.63	0.001821	0.96	6.11	17.49	0.36	20.48
2101	12567	5yr_ Fut	CVC	7.00	93.70	94.74		94.79	0.001701	1.06	9.50	24.17	0.36	27.16
2101	12567	5yr_ Fut	AMCAI	7.00	93.70	94.74		94.79	0.001702	1.06	9.50	24.16	0.36	27.22
2101	12567	10yr_ Fut	CVC	9.10	93.70	94.84		94.90	0.001809	1.17	11.94	27.59	0.38	33.59
2101	12567	10yr_ Fut	AMCAI	9.10	93.70	94.84		94.89	0.001815	1.17	11.92	27.58	0.38	33.58
2101	12567	25yr_ Fut	CVC	11.00	93.70	94.91		94.97	0.001892	1.26	13.92	29.17	0.39	38.87
2101	12567	25yr_ Fut	AMCAI	11.00	93.70	94.91		94.97	0.001892	1.26	13.92	29.17	0.39	38.84
2101	12567	50yr_ Fut	CVC	12.60	93.70	94.96		95.03	0.001944	1.32	15.55	32.28	0.40	44.67
2101	12567	50yr_ Fut	AMCAI	12.60	93.70	94.96		95.03	0.001944	1.32	15.55	32.28	0.40	44.57
2101	12567	100yr_ Fut	CVC	14.40	93.70	95.01		95.09	0.002170	1.43	17.49	44.33	0.43	51.20
2101	12567	100yr_ Fut	AMCAI	14.40	93.70	95.01		95.09	0.002170	1.43	17.49	44.33	0.43	51.00
2101	12567	Reg_ Fut	CVC	32.10	93.70	95.47		95.54	0.001622	1.55	38.90	48.57	0.39	95.47
2101	12567	Reg_ Fut	AMCAI	32.10	93.70	95.47		95.54	0.001622	1.55	38.90	48.57	0.39	93.96
2101	12565	2yr_ Ex	CVC	4.40	92.97	94.57		94.59	0.000393	0.58	8.95	17.33	0.17	16.70
2101	12565	2yr_ Ex	AMCAI	4.40	92.97	94.57		94.59	0.000393	0.58	8.95	17.33	0.17	16.70
2101	12565	5yr_ Ex	CVC	6.50	92.97	94.73		94.76	0.000498	0.72	12.24	23.25	0.20	22.03
2101	12565	5yr_ Ex	AMCAI	6.50	92.97	94.73		94.76	0.000498	0.72	12.24	23.25	0.20	22.03
2101	12565	10yr_ Ex	CVC	8.50	92.97	94.83		94.86	0.000616	0.83	14.57	25.27	0.22	26.75
2101	12565	10yr_ Ex	AMCAI	8.50	92.97	94.83		94.86	0.000616	0.83	14.57	25.27	0.22	26.81
2101	12565	25yr_ Ex	CVC	10.30	92.97	94.90		94.93	0.000719	0.93	16.35	27.33	0.24	30.81
2101	12565	25yr_ Ex	AMCAI	10.30	92.97	94.90		94.93	0.000719	0.93	16.34	27.32	0.24	30.81
2101	12565	50yr_ Ex	CVC	11.90	92.97	94.95		94.99	0.000805	1.01	17.96	32.51	0.26	35.19
2101	12565	50yr_ Ex	AMCAI	11.90	92.97	94.95		94.99	0.000805	1.01	17.96	32.51	0.26	35.16
2101	12565	100yr_ Ex	CVC	13.60	92.97	95.00		95.05	0.000905	1.09	20.05	45.46	0.27	40.40
2101	12565	100yr_ Ex	AMCAI	13.60	92.97	95.00		95.05	0.000905	1.09	20.05	45.46	0.27	40.30
2101	12565	Reg_ Ex	CVC	32.00	92.97	95.47		95.54	0.001088	1.42	42.59	50.23	0.31	93.01
2101	12565	Reg_ Ex	AMCAI	32.00	92.97	95.47		95.54	0.001088	1.42	42.59	50.23	0.31	91.50
2101	12565	2yr_ Fut	CVC	4.70	92.97	94.60		94.62	0.000409	0.61	9.44	18.33	0.18	20.44
2101	12565	2yr_ Fut	AMCAI	4.70	92.97	94.60		94.62	0.000409	0.61	9.44	18.33	0.18	20.46
2101	12565	5yr_ Fut	CVC	7.00	92.97	94.76		94.78	0.000529	0.75	12.86	24.21	0.20	27.13
2101	12565	5yr_ Fut	AMCAI	7.00	92.97	94.76		94.78	0.000529	0.75	12.86	24.21	0.20	27.19
2101	12565	10yr_ Fut	CVC	9.10	92.97	94.85		94.88	0.000650	0.87	15.19	25.55	0.23	33.55
2101	12565	10yr_ Fut	AMCAI	9.10	92.97	94.85		94.88	0.000652	0.87	15.18	25.54	0.23	33.54
2101	12565	25yr_ Fut	CVC	11.00	92.97	94.92		94.96	0.000757	0.96	17.04	29.05	0.25	38.82
2101	12565	25yr_ Fut	AMCAI	11.00	92.97	94.92		94.96	0.000757	0.96	17.04	29.05	0.25	38.80
2101	12565	50yr_ Fut	CVC	12.60	92.97	94.97		95.02	0.000842	1.04	18.73	35.98	0.26	44.62
2101	12565	50yr_ Fut	AMCAI	12.60	92.97	94.97		95.02	0.000842	1.04	18.73	35.98	0.26	44.52
2101	12565	100yr_ Fut	CVC	14.40	92.97	95.03		95.08	0.000960	1.13	21.11	46.30	0.28	51.14
2101	12565	100yr_ Fut	AMCAI	14.40	92.97	95.03		95.08	0.000960	1.13	21.11	46.30	0.28	50.94
2101	12565	Reg_ Fut	CVC	32.10	92.97	95.48		95.54	0.001089	1.42	42.70	50.25	0.31	95.35
2101	12565	Reg_ Fut	AMCAI	32.10	92.97	95.48		95.54	0.001089	1.42	42.70	50.25	0.31	93.84
2101	12553	2yr_ Ex	CVC	4.40	92.94	94.56		94.58	0.000619	0.70	7.97	18.90	0.21	16.60
2101	12553	2yr_ Ex	AMCAI	4.40	92.94	94.56		94.58	0.000619	0.70	7.97	18.90	0.21	16.60
2101	12553	5yr_ Ex	CVC	6.50	92.94	94.72		94.75	0.000729	0.83	11.60	26.36	0.23	21.89
2101	12553	5yr_ Ex	AMCAI	6.50	92.94	94.72		94.75	0.000729	0.83	11.60	26.36	0.23	21.89
2101	12553	10yr_ Ex	CVC	8.50	92.94	94.81		94.85	0.000860	0.94	14.21	28.89	0.26	26.58
2101	12553	10yr_ Ex	AMCAI	8.50	92.94	94.81		94.85	0.000860	0.94	14.21	28.88	0.26	26.64
2101	12553	25yr_ Ex	CVC	10.30	92.94	94.88		94.92	0.000974	1.04	16.23	30.55	0.28	30.62
2101	12553	25yr_ Ex	AMCAI	10.30	92.94	94.88		94.92	0.000974	1.04	16.23	30.54	0.28	30.62
2101	12553	50yr_ Ex	CVC	11.90	92.94	94.93		94.98	0.001062	1.11	17.92	31.87	0.29	34.98
2101	12553	50yr_ Ex	AMCAI	11.90	92.94	94.93		94.98	0.001062	1.11	17.92	31.87	0.29	34.95
2101	12553	100yr_ Ex	CVC	13.60	92.94	94.99		95.04	0.001136	1.18	19.73	33.23	0.30	40.17
2101	12553	100yr_ Ex	AMCAI	13.60	92.94	94.99		95.04	0.001136	1.18	19.73	33.23	0.30	40.07
2101	12553	Reg_ Ex	CVC	32.00	92.94	95.46		95.52	0.001308	1.50	41.89	52.24	0.34	92.55
2101	12553	Reg_ Ex	AMCAI	32.00	92.94	95.46		95.52	0.001308	1.50	41.89	52.24	0.34	91.04
2101	12553	2yr_ Fut	CVC	4.70	92.94	94.58		94.61	0.000637	0.72	8.50	20.13	0.21	20.34
2101	12553	2yr_ Fut	AMCAI	4.70	92.94	94.58		94.61	0.000637	0.72	8.50	20.13	0.21	20.35
2101	12553	5yr_ Fut	CVC	7.00	92.94	94.74		94.78	0.000763	0.86	12.30	27.24	0.24	26.98
2101	12553	5yr_ Fut	AMCAI	7.00	92.94	94.74		94.78	0.000764	0.86	12.30	27.24	0.24	27.04
2101	12553	10yr_ Fut	CVC	9.10	92.94	94.84		94.88	0.000898	0.98	14.92	29.48	0.26	33.37
2101	12553	10yr_ Fut	AMCAI	9.10	92.94	94.84		94.88	0.000900	0.98	14.90	29.46	0.26	33.37
2101	12553	25yr_ Fut	CVC	11.00	92.94	94.90		94.95	0.001014	1.07	16.97	31.14	0.28	38.63
2101	12553	25yr_ Fut	AMCAI	11.00	92.94	94.90		94.95	0.001014	1.07	16.97	31.14	0.28	38.60
2101	12553	50yr_ Fut	CVC	12.60	92.94	94.96		95.01	0.001096	1.14	18.65	32.43	0.29	44.40
2101	12553	50yr_ Fut	AMCAI	12.60	92.94	94.96		95.01	0.001096	1.14	18.65	32.43	0.29	44.30
2101	12553	100yr_ Fut	CVC	14.40	92.94	95.01		95.07	0.001165	1.20	20.57	36.97	0.31	50.90
2101	12553	100yr_ Fut	AMCAI	14.40	92.94	95.01		95.07	0.001165	1.20	20.57	36.97	0.31	50.70
2101	12553	Reg_ Fut	CVC	32.10	92.94	95.46		95.52	0.001308	1.50	42.00	52.25	0.34	94.89
2101	12553	Reg_ Fut	AMCAI	32.10	92.94	95.46		95.52	0.001308	1.50	42.00	52.25	0.34	93.38
2101	12550	2yr_ Ex	CVC	4.40	93.56	94.52		94.57	0.002234	1.06	5.58	18.12	0.40	16.58
2101	12550	2yr_ Ex	AMCAI	4.40	93.56	94.52		94.57	0.002234	1.06				

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	12550	50yr_ Ex	AMCAI	11.90	93.56	94.91		94.98	0.002002	1.34	15.78	32.56	0.40	34.89
2101	12550	100yr_ Ex	CVC	13.60	93.56	94.97		95.03	0.002074	1.41	17.64	36.07	0.41	40.10
2101	12550	100yr_ Ex	AMCAI	13.60	93.56	94.97		95.03	0.002074	1.41	17.64	36.07	0.41	40.00
2101	12550	Reg_ Ex	CVC	32.00	93.56	95.46		95.51	0.001536	1.52	42.20	53.89	0.38	92.39
2101	12550	Reg_ Ex	AMCAI	32.00	93.56	95.46		95.51	0.001536	1.52	42.20	53.89	0.38	90.88
2101	12550	2yr_ Fut	CVC	4.70	93.56	94.55		94.60	0.002156	1.07	6.12	19.55	0.39	20.31
2101	12550	2yr_ Fut	AMCAI	4.70	93.56	94.55		94.60	0.002156	1.07	6.12	19.55	0.39	20.33
2101	12550	5yr_ Fut	CVC	7.00	93.56	94.72		94.77	0.001855	1.13	10.02	26.52	0.38	26.94
2101	12550	5yr_ Fut	AMCAI	7.00	93.56	94.72		94.77	0.001857	1.14	10.01	26.51	0.38	27.00
2101	12550	10yr_ Fut	CVC	9.10	93.56	94.81		94.87	0.001913	1.23	12.68	29.74	0.39	33.32
2101	12550	10yr_ Fut	AMCAI	9.10	93.56	94.81		94.87	0.001921	1.23	12.65	29.72	0.39	33.31
2101	12550	25yr_ Fut	CVC	11.00	93.56	94.88		94.94	0.001964	1.30	14.82	31.30	0.40	38.57
2101	12550	25yr_ Fut	AMCAI	11.00	93.56	94.88		94.94	0.001964	1.30	14.82	31.30	0.40	38.54
2101	12550	50yr_ Fut	CVC	12.60	93.56	94.94		95.00	0.002024	1.36	16.54	33.53	0.41	44.33
2101	12550	50yr_ Fut	AMCAI	12.60	93.56	94.94		95.00	0.002024	1.36	16.54	33.53	0.41	44.24
2101	12550	100yr_ Fut	CVC	14.40	93.56	94.99		95.06	0.002096	1.43	18.57	38.66	0.42	50.83
2101	12550	100yr_ Fut	AMCAI	14.40	93.56	94.99		95.06	0.002096	1.43	18.57	38.66	0.42	50.63
2101	12550	Reg_ Fut	CVC	32.10	93.56	95.46		95.52	0.001534	1.52	42.32	53.91	0.38	94.73
2101	12550	Reg_ Fut	AMCAI	32.10	93.56	95.46		95.52	0.001534	1.52	42.32	53.91	0.38	93.22
2101	12504	2yr_ Ex	CVC	4.40	93.13	94.46		94.50	0.001159	0.84	5.98	20.03	0.28	16.32
2101	12504	2yr_ Ex	AMCAI	4.40	93.13	94.46		94.50	0.001159	0.84	5.98	20.03	0.28	16.31
2101	12504	5yr_ Ex	CVC	6.50	93.13	94.64		94.67	0.001114	0.93	9.94	25.43	0.29	21.41
2101	12504	5yr_ Ex	AMCAI	6.50	93.13	94.64		94.67	0.001114	0.93	9.94	25.43	0.29	21.41
2101	12504	10yr_ Ex	CVC	8.50	93.13	94.72		94.77	0.001280	1.05	12.27	27.89	0.31	25.98
2101	12504	10yr_ Ex	AMCAI	8.50	93.13	94.72		94.77	0.001281	1.05	12.26	27.88	0.31	26.04
2101	12504	25yr_ Ex	CVC	10.30	93.13	94.79		94.84	0.001440	1.15	14.06	30.26	0.33	29.92
2101	12504	25yr_ Ex	AMCAI	10.30	93.13	94.79		94.84	0.001441	1.15	14.05	30.26	0.33	29.92
2101	12504	50yr_ Ex	CVC	11.90	93.13	94.83		94.89	0.001565	1.23	15.59	32.17	0.35	34.20
2101	12504	50yr_ Ex	AMCAI	11.90	93.13	94.83		94.89	0.001565	1.23	15.59	32.17	0.35	34.17
2101	12504	100yr_ Ex	CVC	13.60	93.13	94.89		94.95	0.001660	1.30	17.26	33.84	0.36	39.30
2101	12504	100yr_ Ex	AMCAI	13.60	93.13	94.89		94.95	0.001660	1.30	17.26	33.84	0.36	39.20
2101	12504	Reg_ Ex	CVC	32.00	93.13	95.36		95.44	0.001705	1.62	37.18	49.24	0.39	90.51
2101	12504	Reg_ Ex	AMCAI	32.00	93.13	95.36		95.44	0.001705	1.62	37.18	49.24	0.39	89.01
2101	12504	2yr_ Fut	CVC	4.70	93.13	94.49		94.53	0.001154	0.85	6.57	20.95	0.29	20.02
2101	12504	2yr_ Fut	AMCAI	4.70	93.13	94.49		94.53	0.001154	0.85	6.57	20.95	0.29	20.04
2101	12504	5yr_ Fut	CVC	7.00	93.13	94.66		94.70	0.001153	0.96	10.57	26.12	0.29	26.48
2101	12504	5yr_ Fut	AMCAI	7.00	93.13	94.66		94.70	0.001155	0.96	10.57	26.11	0.29	26.53
2101	12504	10yr_ Fut	CVC	9.10	93.13	94.75		94.80	0.001329	1.08	12.90	28.52	0.32	32.74
2101	12504	10yr_ Fut	AMCAI	9.10	93.13	94.75		94.79	0.001336	1.08	12.87	28.48	0.32	32.73
2101	12504	25yr_ Fut	CVC	11.00	93.13	94.81		94.86	0.001499	1.19	14.73	31.27	0.34	37.89
2101	12504	25yr_ Fut	AMCAI	11.00	93.13	94.81		94.86	0.001499	1.19	14.73	31.27	0.34	37.87
2101	12504	50yr_ Fut	CVC	12.60	93.13	94.86		94.92	0.001608	1.26	16.27	32.86	0.36	43.58
2101	12504	50yr_ Fut	AMCAI	12.60	93.13	94.86		94.92	0.001608	1.26	16.27	32.86	0.36	43.49
2101	12504	100yr_ Fut	CVC	14.40	93.13	94.91		94.98	0.001695	1.33	18.05	34.61	0.37	49.99
2101	12504	100yr_ Fut	AMCAI	14.40	93.13	94.91		94.98	0.001695	1.33	18.05	34.61	0.37	49.79
2101	12504	Reg_ Fut	CVC	32.10	93.13	95.36		95.44	0.001704	1.62	37.28	49.30	0.39	92.85
2101	12504	Reg_ Fut	AMCAI	32.10	93.13	95.36		95.44	0.001704	1.62	37.28	49.30	0.39	91.34
2101	12485	2yr_ Ex	CVC	4.40	92.94	94.46		94.48	0.000662	0.67	7.27	16.99	0.22	16.19
2101	12485	2yr_ Ex	AMCAI	4.40	92.94	94.46		94.48	0.000662	0.67	7.27	16.99	0.22	16.19
2101	12485	5yr_ Ex	CVC	6.50	92.94	94.63		94.66	0.000710	0.77	11.42	26.51	0.23	21.21
2101	12485	5yr_ Ex	AMCAI	6.50	92.94	94.63		94.66	0.000710	0.77	11.42	26.51	0.23	21.21
2101	12485	10yr_ Ex	CVC	8.50	92.94	94.71		94.75	0.000860	0.89	13.71	27.54	0.26	25.74
2101	12485	10yr_ Ex	AMCAI	8.50	92.94	94.71		94.75	0.000860	0.89	13.70	27.54	0.26	25.80
2101	12485	25yr_ Ex	CVC	10.30	92.94	94.77		94.81	0.001000	0.99	15.37	28.26	0.28	29.65
2101	12485	25yr_ Ex	AMCAI	10.30	92.94	94.77		94.81	0.001001	0.99	15.37	28.26	0.28	29.65
2101	12485	50yr_ Ex	CVC	11.90	92.94	94.82		94.87	0.001120	1.08	16.70	28.83	0.30	33.90
2101	12485	50yr_ Ex	AMCAI	11.90	92.94	94.82		94.87	0.001120	1.08	16.70	28.83	0.30	33.87
2101	12485	100yr_ Ex	CVC	13.60	92.94	94.87		94.92	0.001228	1.15	18.09	29.41	0.31	38.97
2101	12485	100yr_ Ex	AMCAI	13.60	92.94	94.87		94.92	0.001228	1.15	18.09	29.41	0.31	38.87
2101	12485	Reg_ Ex	CVC	32.00	92.94	95.31		95.40	0.001726	1.65	32.48	37.92	0.39	89.83
2101	12485	Reg_ Ex	AMCAI	32.00	92.94	95.31		95.40	0.001726	1.65	32.48	37.92	0.39	88.32
2101	12485	2yr_ Fut	CVC	4.70	92.94	94.48		94.51	0.000674	0.69	7.81	20.63	0.22	19.89
2101	12485	2yr_ Fut	AMCAI	4.70	92.94	94.48		94.51	0.000674	0.69	7.81	20.63	0.22	19.90
2101	12485	5yr_ Fut	CVC	7.00	92.94	94.65		94.68	0.000746	0.80	12.06	26.80	0.24	26.26
2101	12485	5yr_ Fut	AMCAI	7.00	92.94	94.65		94.68	0.000747	0.80	12.05	26.79	0.24	26.32
2101	12485	10yr_ Fut	CVC	9.10	92.94	94.73		94.77	0.000904	0.93	14.31	27.80	0.26	32.48
2101	12485	10yr_ Fut	AMCAI	9.10	92.94	94.73		94.77	0.000909	0.93	14.28	27.79	0.26	32.48
2101	12485	25yr_ Fut	CVC	11.00	92.94	94.79		94.84	0.001054	1.03	15.96	28.52	0.29	37.60
2101	12485	25yr_ Fut	AMCAI	11.00	92.94	94.79		94.84	0.001054	1.03	15.96	28.52	0.29	37.58
2101	12485	50yr_ Fut	CVC	12.60	92.94	94.84		94.89	0.001167	1.11	17.27	29.07	0.30	43.27
2101	12485	50yr_ Fut	AMCAI	12.60	92.94	94.84		94.89	0.001167	1.11	17.27	29.07	0.30	43.17
2101	12485	100yr_ Fut	CVC	14.40	92.94	94.89		94.95	0.001272	1.19	18.74	29.68	0.32	49.64
2101	12485	100yr_ Fut	AMCAI	14.40	92.94	94.89		94.95	0.001272	1.19	18.74	29.68	0.32	49.44
2101	12485	Reg_ Fut	CVC	32.10	92.94	95.31		95.41	0.001728	1.65	32.55	38.05	0.39	92.16
2101	12485	Reg_ Fut	AMCAI	32.10	92.94	95.31		95.41	0.001728	1.65	32.55	38.05	0.39	90.65
2101	12474	2yr_ Ex	CVC	4.40	92.93	94.44		94.47	0.000843	0.73	6.25	12.95	0.24	16.12
2101	12474	2yr_ Ex	AMCAI	4.40	92.93	94.44		94.47	0.000843	0.73	6.25	12.95	0.24	16.12
2101	12474	5yr_ Ex	CVC	6.50	92.93	94.61		94.65	0.000900	0.84	9.99	23.19	0.26	21.10
2101	12474	5yr_ Ex	AMCAI	6.50	92.93	94.61		94.65	0.000900	0.84	9.99	23.19	0.26	21.10
2101	12474	10yr_ Ex	CVC	8.50	92.93	94.69		94.74	0.001102	0.98	11.87	23.60	0.29	25.60
2101	12474	10yr_ Ex	AMCAI	8.50	92.93	94.69		94.74	0.001103	0.98	11.86	23.60	0.29	25.66
2101	12474	25yr_ Ex	CVC	10.30	92.93	94.75		94.80	0.001301	1.09	13.17	23.88	0.32	29.49
2101	12474	25yr_ Ex	AMCAI	10.30	92.93	94.75		94.80	0.001302	1.09	13.17	23.87	0.32	29.49
2101	12474	50yr_ Ex	CVC	11.90	92.93	94.79		94.85	0.001477	1.19</				

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12474	5yr_Fut	CVC	7.00	92.93	94.64		94.67	0.000948	0.87	10.52	23.31	0.27	26.14
2101	12474	5yr_Fut	AMCAI	7.00	92.93	94.64		94.67	0.000949	0.88	10.51	23.31	0.27	26.20
2101	12474	10yr_Fut	CVC	9.10	92.93	94.71		94.76	0.001165	1.01	12.35	23.70	0.30	32.34
2101	12474	10yr_Fut	AMCAI	9.10	92.93	94.71		94.76	0.001171	1.02	12.32	23.69	0.30	32.34
2101	12474	25yr_Fut	CVC	11.00	92.93	94.77		94.82	0.001380	1.14	13.62	23.97	0.33	37.45
2101	12474	25yr_Fut	AMCAI	11.00	92.93	94.77		94.82	0.001380	1.14	13.62	23.97	0.33	37.42
2101	12474	50yr_Fut	CVC	12.60	92.93	94.81		94.87	0.001546	1.23	14.63	24.18	0.35	43.10
2101	12474	50yr_Fut	AMCAI	12.60	92.93	94.81		94.87	0.001546	1.23	14.63	24.18	0.35	43.00
2101	12474	100yr_Fut	CVC	14.40	92.93	94.85		94.93	0.001705	1.32	15.75	24.41	0.37	49.45
2101	12474	100yr_Fut	AMCAI	14.40	92.93	94.85		94.93	0.001705	1.32	15.75	24.41	0.37	49.26
2101	12474	Reg_Fut	CVC	32.10	92.93	95.24		95.38	0.002576	1.93	25.70	27.55	0.47	91.85
2101	12474	Reg_Fut	AMCAI	32.10	92.93	95.24		95.38	0.002576	1.93	25.70	27.55	0.47	90.33
2101	12464	2yr_Ex	CVC	4.40	93.52	94.27		94.43	0.011954	1.78	2.47	5.47	0.85	16.07
2101	12464	2yr_Ex	AMCAI	4.40	93.52	94.27		94.43	0.011954	1.78	2.47	5.47	0.85	16.07
2101	12464	5yr_Ex	CVC	6.50	93.52	94.41	94.35	94.61	0.011280	1.99	3.52	15.34	0.85	21.03
2101	12464	5yr_Ex	AMCAI	6.50	93.52	94.41	94.36	94.61	0.011280	1.99	3.52	15.34	0.85	21.03
2101	12464	10yr_Ex	CVC	8.50	93.52	94.53	94.53	94.70	0.007845	1.90	6.28	24.45	0.74	25.51
2101	12464	10yr_Ex	AMCAI	8.50	93.52	94.54	94.54	94.70	0.007780	1.89	6.30	24.49	0.73	25.57
2101	12464	25yr_Ex	CVC	10.30	93.52	94.60	94.59	94.76	0.007444	1.96	7.85	25.35	0.73	29.39
2101	12464	25yr_Ex	AMCAI	10.30	93.52	94.60	94.60	94.76	0.007402	1.96	7.87	25.36	0.72	29.39
2101	12464	50yr_Ex	CVC	11.90	93.52	94.66	94.63	94.81	0.006657	1.96	9.42	25.81	0.70	33.61
2101	12464	50yr_Ex	AMCAI	11.90	93.52	94.66	94.63	94.81	0.006657	1.96	9.42	25.81	0.70	33.58
2101	12464	100yr_Ex	CVC	13.60	93.52	94.72		94.87	0.006049	1.96	10.99	26.26	0.67	38.66
2101	12464	100yr_Ex	AMCAI	13.60	93.52	94.72		94.87	0.006049	1.96	10.99	26.26	0.67	38.56
2101	12464	Reg_Ex	CVC	32.00	93.52	95.19		95.34	0.004308	2.21	24.63	32.98	0.61	89.26
2101	12464	Reg_Ex	AMCAI	32.00	93.52	95.19		95.34	0.004308	2.21	24.63	32.98	0.61	87.76
2101	12464	2yr_Fut	CVC	4.70	93.52	94.30		94.46	0.011638	1.80	2.62	5.62	0.84	19.76
2101	12464	2yr_Fut	AMCAI	4.70	93.52	94.30		94.46	0.011638	1.80	2.62	5.62	0.84	19.77
2101	12464	5yr_Fut	CVC	7.00	93.52	94.46	94.46	94.64	0.008747	1.87	4.66	22.01	0.76	26.06
2101	12464	5yr_Fut	AMCAI	7.00	93.52	94.47	94.47	94.64	0.008635	1.86	4.70	22.07	0.76	26.12
2101	12464	10yr_Fut	CVC	9.10	93.52	94.55	94.55	94.72	0.007804	1.93	6.78	25.03	0.74	32.24
2101	12464	10yr_Fut	AMCAI	9.10	93.52	94.56	94.56	94.72	0.007452	1.90	6.94	25.08	0.72	32.24
2101	12464	25yr_Fut	CVC	11.00	93.52	94.62	94.61	94.78	0.007160	1.97	8.50	25.54	0.72	37.33
2101	12464	25yr_Fut	AMCAI	11.00	93.52	94.62	94.61	94.78	0.007160	1.97	8.50	25.54	0.72	37.31
2101	12464	50yr_Fut	CVC	12.60	93.52	94.68	94.65	94.84	0.006377	1.96	10.08	26.00	0.69	42.97
2101	12464	50yr_Fut	AMCAI	12.60	93.52	94.68	94.65	94.84	0.006377	1.96	10.08	26.00	0.69	42.88
2101	12464	100yr_Fut	CVC	14.40	93.52	94.75		94.89	0.005835	1.96	11.69	26.46	0.66	49.32
2101	12464	100yr_Fut	AMCAI	14.40	93.52	94.75		94.89	0.005835	1.96	11.69	26.46	0.66	49.12
2101	12464	Reg_Fut	CVC	32.10	93.52	95.19		95.34	0.004303	2.21	24.70	33.01	0.61	91.60
2101	12464	Reg_Fut	AMCAI	32.10	93.52	95.19		95.34	0.004303	2.21	24.70	33.01	0.61	90.08
2101	12419	2yr_Ex	CVC	4.40	92.93	94.18		94.23	0.001779	0.95	4.85	13.46	0.35	15.91
2101	12419	2yr_Ex	AMCAI	4.40	92.93	94.18		94.23	0.001779	0.95	4.85	13.46	0.35	15.90
2101	12419	5yr_Ex	CVC	6.50	92.93	94.35		94.40	0.001746	1.07	8.06	22.41	0.35	20.77
2101	12419	5yr_Ex	AMCAI	6.50	92.93	94.35		94.40	0.001746	1.07	8.06	22.41	0.35	20.77
2101	12419	10yr_Ex	CVC	8.50	92.93	94.43	93.98	94.50	0.001960	1.20	10.00	23.01	0.38	25.15
2101	12419	10yr_Ex	AMCAI	8.50	92.93	94.43	93.98	94.50	0.001960	1.20	10.00	23.01	0.38	25.21
2101	12419	25yr_Ex	CVC	10.30	92.93	94.50		94.57	0.002129	1.31	11.51	23.47	0.40	28.96
2101	12419	25yr_Ex	AMCAI	10.30	92.93	94.50	94.08	94.57	0.002129	1.31	11.51	23.47	0.40	28.96
2101	12419	50yr_Ex	CVC	11.90	92.93	94.55		94.63	0.002255	1.39	12.76	23.84	0.42	33.12
2101	12419	50yr_Ex	AMCAI	11.90	92.93	94.55		94.63	0.002255	1.39	12.76	23.84	0.42	33.09
2101	12419	100yr_Ex	CVC	13.60	92.93	94.60		94.69	0.002367	1.47	14.01	24.21	0.43	38.11
2101	12419	100yr_Ex	AMCAI	13.60	92.93	94.60		94.69	0.002367	1.47	14.01	24.21	0.43	38.01
2101	12419	Reg_Ex	CVC	32.00	92.93	95.04		95.18	0.002894	2.00	25.43	27.32	0.50	88.17
2101	12419	Reg_Ex	AMCAI	32.00	92.93	95.04		95.18	0.002894	2.00	25.43	27.32	0.50	86.66
2101	12419	2yr_Fut	CVC	4.70	92.93	94.21		94.26	0.001763	0.97	5.30	16.58	0.35	19.58
2101	12419	2yr_Fut	AMCAI	4.70	92.93	94.21		94.26	0.001763	0.97	5.30	16.58	0.35	19.60
2101	12419	5yr_Fut	CVC	7.00	92.93	94.37	93.88	94.43	0.001800	1.11	8.59	22.58	0.36	25.77
2101	12419	5yr_Fut	AMCAI	7.00	92.93	94.37	93.89	94.43	0.001800	1.11	8.59	22.58	0.36	25.83
2101	12419	10yr_Fut	CVC	9.10	92.93	94.45	94.02	94.52	0.002020	1.24	10.52	23.17	0.39	31.86
2101	12419	10yr_Fut	AMCAI	9.10	92.93	94.45	94.02	94.52	0.002021	1.24	10.52	23.17	0.39	31.85
2101	12419	25yr_Fut	CVC	11.00	92.93	94.52		94.60	0.002187	1.34	12.07	23.64	0.41	36.88
2101	12419	25yr_Fut	AMCAI	11.00	92.93	94.52		94.60	0.002187	1.34	12.07	23.64	0.41	36.86
2101	12419	50yr_Fut	CVC	12.60	92.93	94.57		94.65	0.002304	1.42	13.28	23.99	0.42	42.46
2101	12419	50yr_Fut	AMCAI	12.60	92.93	94.57		94.65	0.002304	1.42	13.28	23.99	0.42	42.36
2101	12419	100yr_Fut	CVC	14.40	92.93	94.62		94.71	0.002413	1.50	14.58	24.37	0.44	48.74
2101	12419	100yr_Fut	AMCAI	14.40	92.93	94.62		94.71	0.002413	1.50	14.58	24.37	0.44	48.54
2101	12419	Reg_Fut	CVC	32.10	92.93	95.05		95.18	0.002895	2.01	25.49	27.34	0.50	90.49
2101	12419	Reg_Fut	AMCAI	32.10	92.93	95.05		95.18	0.002895	2.01	25.49	27.34	0.50	88.98
2101	12413	2yr_Ex	CVC	4.40	93.23	94.08		94.21	0.007617	1.55	2.84	5.46	0.69	15.89
2101	12413	2yr_Ex	AMCAI	4.40	93.23	94.08		94.21	0.007617	1.55	2.84	5.46	0.69	15.88
2101	12413	5yr_Ex	CVC	6.50	93.23	94.25	94.08	94.38	0.006031	1.64	5.10	22.13	0.64	20.74
2101	12413	5yr_Ex	AMCAI	6.50	93.23	94.25	94.09	94.38	0.006031	1.64	5.10	22.13	0.64	20.73
2101	12413	10yr_Ex	CVC	8.50	93.23	94.36		94.48	0.004901	1.64	7.62	22.95	0.59	25.10
2101	12413	10yr_Ex	AMCAI	8.50	93.23	94.36		94.47	0.004908	1.64	7.61	22.95	0.59	25.16
2101	12413	25yr_Ex	CVC	10.30	93.23	94.44		94.55	0.004542	1.68	9.39	23.52	0.58	28.91
2101	12413	25yr_Ex	AMCAI	10.30	93.23	94.44		94.55	0.004542	1.68	9.39	23.52	0.58	28.90
2101	12413	50yr_Ex	CVC	11.90	93.23	94.49		94.61	0.004366	1.72	10.79	23.96	0.57	33.06
2101	12413	50yr_Ex	AMCAI	11.90	93.23	94.49		94.61	0.004366	1.72	10.79	23.96	0.57	33.03
2101	12413	100yr_Ex	CVC	13.60	93.23	94.55		94.67	0.004237	1.76	12.18	24.38	0.57	38.04
2101	12413	100yr_Ex	AMCAI	13.60	93.23	94.55		94.67	0.004237	1.76	12.18	24.38	0.57	37.94
2101	12413	Reg_Ex	CVC	32.00	93.23	95.02		95.16	0.003738	2.15	24.39	27.85	0.57	88.03
2101	12413	Reg_Ex	AMCAI	32.00	93.23	95.02		95.16	0.003738	2.15	24.39	27.85	0.57	86.52
2101	12413	2yr_Fut	CVC	4.70	93.23	94.11		94.24	0.007380	1.57	3.02	7.57	0.68	19.56
2101	12413	2yr												

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12413	50yr_Fut	AMCAI	12.60	93.23	94.52		94.63	0.004308	1.74	11.38	24.14	0.57	42.30
2101	12413	100yr_Fut	CVC	14.40	93.23	94.58		94.69	0.004189	1.78	12.81	24.57	0.57	48.66
2101	12413	100yr_Fut	AMCAI	14.40	93.23	94.58		94.69	0.004189	1.78	12.81	24.57	0.57	48.47
2101	12413	Reg_Fut	CVC	32.10	93.23	95.02		95.17	0.003737	2.15	24.45	27.87	0.57	90.36
2101	12413	Reg_Fut	AMCAI	32.10	93.23	95.02		95.17	0.003737	2.15	24.45	27.87	0.57	88.85
2101	12371	2yr_Ex	CVC	4.40	92.70	93.98		94.04	0.002013	1.03	4.32	7.65	0.36	15.73
2101	12371	2yr_Ex	AMCAI	4.40	92.70	93.98		94.04	0.002013	1.03	4.32	7.65	0.36	15.73
2101	12371	5yr_Ex	CVC	6.50	92.70	94.16		94.22	0.002008	1.16	7.46	22.20	0.37	20.47
2101	12371	5yr_Ex	AMCAI	6.50	92.70	94.16		94.22	0.002008	1.16	7.46	22.20	0.37	20.47
2101	12371	10yr_Ex	CVC	8.50	92.70	94.26		94.33	0.002049	1.26	9.90	23.12	0.38	24.74
2101	12371	10yr_Ex	AMCAI	8.50	92.70	94.26		94.33	0.002053	1.26	9.89	23.12	0.38	24.79
2101	12371	25yr_Ex	CVC	10.30	92.70	94.33		94.41	0.002219	1.36	11.47	23.65	0.40	28.47
2101	12371	25yr_Ex	AMCAI	10.30	92.70	94.33		94.41	0.002219	1.36	11.47	23.65	0.40	28.47
2101	12371	50yr_Ex	CVC	11.90	92.70	94.38		94.47	0.002362	1.45	12.72	23.98	0.42	32.57
2101	12371	50yr_Ex	AMCAI	11.90	92.70	94.38		94.47	0.002362	1.45	12.72	23.98	0.42	32.53
2101	12371	100yr_Ex	CVC	13.60	92.70	94.44		94.53	0.002490	1.53	13.96	24.31	0.43	37.49
2101	12371	100yr_Ex	AMCAI	13.60	92.70	94.44		94.53	0.002490	1.53	13.96	24.31	0.43	37.39
2101	12371	Reg_Ex	CVC	32.00	92.70	94.88		95.02	0.003037	2.06	25.47	27.14	0.50	86.98
2101	12371	Reg_Ex	AMCAI	32.00	92.70	94.88		95.02	0.003037	2.06	25.47	27.14	0.50	85.48
2101	12371	2yr_Fut	CVC	4.70	92.70	94.01		94.07	0.002060	1.06	4.57	11.97	0.37	19.40
2101	12371	2yr_Fut	AMCAI	4.70	92.70	94.01		94.07	0.002060	1.06	4.57	11.97	0.37	19.41
2101	12371	5yr_Fut	CVC	7.00	92.70	94.19		94.25	0.001984	1.18	8.19	22.48	0.37	25.44
2101	12371	5yr_Fut	AMCAI	7.00	92.70	94.19		94.25	0.001984	1.18	8.19	22.48	0.37	25.49
2101	12371	10yr_Fut	CVC	9.10	92.70	94.29		94.36	0.002108	1.29	10.45	23.32	0.39	31.42
2101	12371	10yr_Fut	AMCAI	9.10	92.70	94.29		94.36	0.002111	1.29	10.44	23.32	0.39	31.41
2101	12371	25yr_Fut	CVC	11.00	92.70	94.35		94.44	0.002284	1.40	12.03	23.80	0.41	36.36
2101	12371	25yr_Fut	AMCAI	11.00	92.70	94.35		94.44	0.002284	1.40	12.03	23.80	0.41	36.33
2101	12371	50yr_Fut	CVC	12.60	92.70	94.41		94.49	0.002418	1.48	13.23	24.12	0.42	41.87
2101	12371	50yr_Fut	AMCAI	12.60	92.70	94.41		94.49	0.002418	1.48	13.23	24.12	0.42	41.78
2101	12371	100yr_Fut	CVC	14.40	92.70	94.46		94.55	0.002542	1.56	14.53	24.45	0.44	48.09
2101	12371	100yr_Fut	AMCAI	14.40	92.70	94.46		94.55	0.002542	1.56	14.53	24.45	0.44	47.89
2101	12371	Reg_Fut	CVC	32.10	92.70	94.88		95.02	0.003038	2.06	25.52	27.15	0.50	89.31
2101	12371	Reg_Fut	AMCAI	32.10	92.70	94.88		95.02	0.003038	2.06	25.52	27.15	0.50	87.80
2101	12353	2yr_Ex	CVC	4.40	92.67	93.95		94.00	0.001892	0.98	4.69	10.88	0.36	15.65
2101	12353	2yr_Ex	AMCAI	4.40	92.67	93.95		94.00	0.001892	0.98	4.69	10.88	0.36	15.65
2101	12353	5yr_Ex	CVC	6.50	92.67	94.13		94.18	0.001723	1.07	8.08	21.44	0.35	20.33
2101	12353	5yr_Ex	AMCAI	6.50	92.67	94.13		94.18	0.001723	1.07	8.08	21.44	0.35	20.33
2101	12353	10yr_Ex	CVC	8.50	92.67	94.24		94.30	0.001769	1.17	10.41	22.14	0.36	24.55
2101	12353	10yr_Ex	AMCAI	8.50	92.67	94.24		94.30	0.001773	1.17	10.40	22.14	0.36	24.61
2101	12353	25yr_Ex	CVC	10.30	92.67	94.30		94.37	0.001960	1.28	11.82	22.56	0.39	28.26
2101	12353	25yr_Ex	AMCAI	10.30	92.67	94.30		94.37	0.001960	1.28	11.82	22.56	0.39	28.26
2101	12353	50yr_Ex	CVC	11.90	92.67	94.35		94.43	0.002131	1.37	12.92	22.87	0.40	32.34
2101	12353	50yr_Ex	AMCAI	11.90	92.67	94.35		94.43	0.002131	1.37	12.92	22.87	0.40	32.31
2101	12353	100yr_Ex	CVC	13.60	92.67	94.40		94.48	0.002291	1.46	14.03	23.19	0.42	37.24
2101	12353	100yr_Ex	AMCAI	13.60	92.67	94.40		94.48	0.002291	1.46	14.03	23.19	0.42	37.14
2101	12353	Reg_Ex	CVC	32.00	92.67	94.81		94.96	0.003147	2.08	24.29	25.93	0.52	86.54
2101	12353	Reg_Ex	AMCAI	32.00	92.67	94.81		94.96	0.003147	2.08	24.29	25.93	0.52	85.03
2101	12353	2yr_Fut	CVC	4.70	92.67	93.98		94.03	0.001894	1.00	5.05	15.08	0.36	19.31
2101	12353	2yr_Fut	AMCAI	4.70	92.67	93.98		94.03	0.001894	1.00	5.05	15.08	0.36	19.33
2101	12353	5yr_Fut	CVC	7.00	92.67	94.16		94.22	0.001697	1.09	8.80	21.66	0.35	25.28
2101	12353	5yr_Fut	AMCAI	7.00	92.67	94.16		94.22	0.001697	1.09	8.80	21.66	0.35	25.34
2101	12353	10yr_Fut	CVC	9.10	92.67	94.26		94.32	0.001833	1.20	10.90	22.29	0.37	31.23
2101	12353	10yr_Fut	AMCAI	9.10	92.67	94.26		94.32	0.001837	1.20	10.89	22.28	0.37	31.22
2101	12353	25yr_Fut	CVC	11.00	92.67	94.32		94.39	0.002037	1.32	12.31	22.70	0.39	36.14
2101	12353	25yr_Fut	AMCAI	11.00	92.67	94.32		94.39	0.002037	1.32	12.31	22.70	0.39	36.12
2101	12353	50yr_Fut	CVC	12.60	92.67	94.37		94.45	0.002200	1.41	13.38	23.01	0.41	41.64
2101	12353	50yr_Fut	AMCAI	12.60	92.67	94.37		94.45	0.002200	1.41	13.38	23.01	0.41	41.54
2101	12353	100yr_Fut	CVC	14.40	92.67	94.42		94.51	0.002358	1.50	14.54	23.33	0.43	47.83
2101	12353	100yr_Fut	AMCAI	14.40	92.67	94.42		94.51	0.002358	1.50	14.54	23.33	0.43	47.63
2101	12353	Reg_Fut	CVC	32.10	92.67	94.82		94.97	0.003149	2.08	24.34	25.94	0.52	88.87
2101	12353	Reg_Fut	AMCAI	32.10	92.67	94.82		94.97	0.003149	2.08	24.34	25.94	0.52	87.35
2101	12345	2yr_Ex	CVC	4.40	93.03	93.83		93.96	0.008749	1.63	2.70	5.33	0.73	15.62
2101	12345	2yr_Ex	AMCAI	4.40	93.03	93.83		93.96	0.008749	1.63	2.70	5.33	0.73	15.62
2101	12345	5yr_Ex	CVC	6.50	93.03	93.97	93.86	94.15	0.009037	1.85	3.62	11.82	0.77	20.29
2101	12345	5yr_Ex	AMCAI	6.50	93.03	93.97	93.86	94.15	0.009037	1.85	3.62	11.82	0.77	20.28
2101	12345	10yr_Ex	CVC	8.50	93.03	94.07	94.07	94.26	0.008418	1.98	5.41	21.02	0.76	24.49
2101	12345	10yr_Ex	AMCAI	8.50	93.03	94.07	94.07	94.26	0.008267	1.97	5.47	21.04	0.75	24.55
2101	12345	25yr_Ex	CVC	10.30	93.03	94.14	94.14	94.33	0.007832	2.04	6.94	21.50	0.74	28.18
2101	12345	25yr_Ex	AMCAI	10.30	93.03	94.14	94.14	94.33	0.007832	2.04	6.94	21.50	0.74	28.18
2101	12345	50yr_Ex	CVC	11.90	93.03	94.20	94.18	94.39	0.007313	2.07	8.24	21.89	0.73	32.25
2101	12345	50yr_Ex	AMCAI	11.90	93.03	94.20	94.18	94.39	0.007313	2.07	8.24	21.89	0.73	32.22
2101	12345	100yr_Ex	CVC	13.60	93.03	94.26	94.23	94.44	0.006838	2.10	9.56	22.29	0.71	37.15
2101	12345	100yr_Ex	AMCAI	13.60	93.03	94.26	94.23	94.44	0.006838	2.10	9.56	22.29	0.71	37.04
2101	12345	Reg_Ex	CVC	32.00	93.03	94.72		94.93	0.005487	2.48	20.42	25.32	0.68	86.36
2101	12345	Reg_Ex	AMCAI	32.00	93.03	94.72		94.93	0.005487	2.48	20.41	25.32	0.68	84.86
2101	12345	2yr_Fut	CVC	4.70	93.03	93.85		93.99	0.008693	1.66	2.84	5.46	0.73	19.28
2101	12345	2yr_Fut	AMCAI	4.70	93.03	93.85		93.99	0.008693	1.66	2.84	5.46	0.73	19.30
2101	12345	5yr_Fut	CVC	7.00	93.03	93.99	93.89	94.18	0.009079	1.91	3.96	16.09	0.77	25.23
2101	12345	5yr_Fut	AMCAI	7.00	93.03	93.99	93.89	94.18	0.009079	1.91	3.96	16.09	0.77	25.29
2101	12345	10yr_Fut	CVC	9.10	93.03	94.09	94.09	94.28	0.008111	1.99	5.98	21.20	0.75	31.16
2101	12345	10yr_Fut	AMCAI	9.10	93.03	94.10	94.10	94.28	0.007986	1.98	6.03	21.21	0.74	31.15
2101	12345	25yr_Fut	CVC	11.00	93.03	94.17	94.16	94.35	0.007590	2.05	7.52	21.67	0.74	36.06
2101	12345	25yr_Fut	AMCAI	11.00	93.03	94.17	94.16	94.35	0.007591	2.05	7.52	21.67	0.74	36.04
2101	12345	50yr_Fut	CVC	12.60	93.03	94.23	94.20</							



HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12316	2yr_ Ex	AMCAI	4.40	92.52	93.80		93.84	0.001581	0.92	5.02	12.33	0.33	15.51
2101	12316	5yr_ Ex	CVC	6.50	92.52	93.96		94.01	0.001640	1.06	7.94	21.35	0.35	20.11
2101	12316	5yr_ Ex	AMCAI	6.50	92.52	93.96		94.01	0.001640	1.06	7.94	21.35	0.35	20.11
2101	12316	10yr_ Ex	CVC	8.50	92.52	94.05	93.58	94.12	0.001794	1.18	10.01	21.95	0.37	24.26
2101	12316	10yr_ Ex	AMCAI	8.50	92.52	94.05	93.58	94.12	0.001794	1.18	10.01	21.95	0.37	24.32
2101	12316	25yr_ Ex	CVC	10.30	92.52	94.12		94.19	0.002012	1.30	11.35	22.33	0.40	27.91
2101	12316	25yr_ Ex	AMCAI	10.30	92.52	94.12		94.19	0.002012	1.30	11.35	22.33	0.40	27.91
2101	12316	50yr_ Ex	CVC	11.90	92.52	94.16		94.25	0.002187	1.40	12.45	22.64	0.41	31.95
2101	12316	50yr_ Ex	AMCAI	11.90	92.52	94.16		94.25	0.002188	1.40	12.45	22.64	0.41	31.92
2101	12316	100yr_ Ex	CVC	13.60	92.52	94.21		94.31	0.002329	1.48	13.60	22.95	0.43	36.80
2101	12316	100yr_ Ex	AMCAI	13.60	92.52	94.21		94.31	0.002329	1.48	13.60	22.95	0.43	36.70
2101	12316	Reg_ Ex	CVC	32.00	92.52	94.63		94.79	0.003207	2.12	23.66	25.55	0.53	85.72
2101	12316	Reg_ Ex	AMCAI	32.00	92.52	94.63		94.79	0.003207	2.12	23.65	25.55	0.53	84.21
2101	12316	2yr_ Fut	CVC	4.70	92.52	93.83		93.87	0.001596	0.95	5.39	14.68	0.33	19.16
2101	12316	2yr_ Fut	AMCAI	4.70	92.52	93.83		93.87	0.001596	0.95	5.39	14.68	0.33	19.17
2101	12316	5yr_ Fut	CVC	7.00	92.52	93.99		94.04	0.001658	1.09	8.55	21.53	0.35	25.05
2101	12316	5yr_ Fut	AMCAI	7.00	92.52	93.99		94.04	0.001658	1.09	8.55	21.53	0.35	25.11
2101	12316	10yr_ Fut	CVC	9.10	92.52	94.08		94.14	0.001867	1.22	10.48	22.09	0.38	30.92
2101	12316	10yr_ Fut	AMCAI	9.10	92.52	94.08	93.62	94.14	0.001867	1.22	10.48	22.09	0.38	30.91
2101	12316	25yr_ Fut	CVC	11.00	92.52	94.14		94.21	0.002092	1.35	11.84	22.47	0.40	35.78
2101	12316	25yr_ Fut	AMCAI	11.00	92.52	94.14		94.21	0.002092	1.35	11.84	22.47	0.40	35.75
2101	12316	50yr_ Fut	CVC	12.60	92.52	94.19		94.27	0.002242	1.43	12.94	22.77	0.42	41.23
2101	12316	50yr_ Fut	AMCAI	12.60	92.52	94.19		94.27	0.002242	1.43	12.94	22.77	0.42	41.13
2101	12316	100yr_ Fut	CVC	14.40	92.52	94.24		94.33	0.002394	1.52	14.10	23.09	0.44	47.38
2101	12316	100yr_ Fut	AMCAI	14.40	92.52	94.24		94.33	0.002395	1.52	14.10	23.09	0.44	47.18
2101	12316	Reg_ Fut	CVC	32.10	92.52	94.63		94.79	0.003210	2.12	23.70	25.56	0.53	88.04
2101	12316	Reg_ Fut	AMCAI	32.10	92.52	94.63		94.79	0.003210	2.12	23.70	25.56	0.53	86.53
2101	12302	2yr_ Ex	CVC	4.40	92.56	93.76		93.82	0.002426	1.07	4.17	8.29	0.40	15.45
2101	12302	2yr_ Ex	AMCAI	4.40	92.56	93.76		93.82	0.002426	1.07	4.17	8.29	0.40	15.45
2101	12302	5yr_ Ex	CVC	6.50	92.56	93.91		93.98	0.002490	1.23	6.73	21.80	0.42	20.02
2101	12302	5yr_ Ex	AMCAI	6.50	92.56	93.91		93.98	0.002490	1.23	6.73	21.80	0.42	20.02
2101	12302	10yr_ Ex	CVC	8.50	92.56	94.00	93.63	94.09	0.002631	1.35	8.79	22.42	0.44	24.14
2101	12302	10yr_ Ex	AMCAI	8.50	92.56	94.00	93.63	94.09	0.002631	1.35	8.79	22.42	0.44	24.20
2101	12302	25yr_ Ex	CVC	10.30	92.56	94.06		94.15	0.002976	1.49	9.99	22.77	0.47	27.78
2101	12302	25yr_ Ex	AMCAI	10.30	92.56	94.06		94.15	0.002976	1.49	9.99	22.77	0.47	27.78
2101	12302	50yr_ Ex	CVC	11.90	92.56	94.10		94.21	0.003220	1.59	11.01	23.07	0.49	31.80
2101	12302	50yr_ Ex	AMCAI	11.90	92.56	94.10		94.21	0.003220	1.59	11.01	23.07	0.49	31.77
2101	12302	100yr_ Ex	CVC	13.60	92.56	94.15		94.27	0.003390	1.68	12.12	23.39	0.51	36.64
2101	12302	100yr_ Ex	AMCAI	13.60	92.56	94.15		94.27	0.003390	1.68	12.12	23.39	0.51	36.54
2101	12302	Reg_ Ex	CVC	32.00	92.56	94.56		94.74	0.004153	2.29	22.25	28.30	0.59	85.44
2101	12302	Reg_ Ex	AMCAI	32.00	92.56	94.56		94.74	0.004154	2.29	22.25	28.30	0.59	83.93
2101	12302	2yr_ Fut	CVC	4.70	92.56	93.78		93.84	0.002455	1.10	4.42	11.27	0.41	19.09
2101	12302	2yr_ Fut	AMCAI	4.70	92.56	93.78		93.84	0.002455	1.10	4.42	11.27	0.41	19.11
2101	12302	5yr_ Fut	CVC	7.00	92.56	93.94		94.01	0.002478	1.25	7.37	21.99	0.42	24.95
2101	12302	5yr_ Fut	AMCAI	7.00	92.56	93.94		94.01	0.002478	1.25	7.37	21.99	0.42	25.00
2101	12302	10yr_ Fut	CVC	9.10	92.56	94.02		94.11	0.002753	1.40	9.20	22.54	0.45	30.79
2101	12302	10yr_ Fut	AMCAI	9.10	92.56	94.02		94.11	0.002753	1.40	9.20	22.54	0.45	30.78
2101	12302	25yr_ Fut	CVC	11.00	92.56	94.08		94.18	0.003090	1.54	10.44	22.90	0.48	35.64
2101	12302	25yr_ Fut	AMCAI	11.00	92.56	94.08		94.18	0.003090	1.54	10.44	22.90	0.48	35.61
2101	12302	50yr_ Fut	CVC	12.60	92.56	94.12		94.23	0.003273	1.63	11.51	23.21	0.50	41.07
2101	12302	50yr_ Fut	AMCAI	12.60	92.56	94.12		94.23	0.003273	1.63	11.51	23.21	0.50	40.98
2101	12302	100yr_ Fut	CVC	14.40	92.56	94.17		94.29	0.003470	1.72	12.61	23.53	0.52	47.21
2101	12302	100yr_ Fut	AMCAI	14.40	92.56	94.17		94.29	0.003471	1.72	12.61	23.53	0.52	47.01
2101	12302	Reg_ Fut	CVC	32.10	92.56	94.56		94.74	0.004155	2.30	22.30	28.42	0.59	87.76
2101	12302	Reg_ Fut	AMCAI	32.10	92.56	94.56		94.74	0.004155	2.30	22.30	28.42	0.59	86.25
2101	12297	2yr_ Ex	CVC	4.40	92.91	93.64		93.78	0.010489	1.68	2.61	5.75	0.80	15.43
2101	12297	2yr_ Ex	AMCAI	4.40	92.91	93.64		93.78	0.010489	1.68	2.61	5.75	0.80	15.43
2101	12297	5yr_ Ex	CVC	6.50	92.91	93.78	93.70	93.95	0.009113	1.83	3.92	14.85	0.77	19.99
2101	12297	5yr_ Ex	AMCAI	6.50	92.91	93.78	93.71	93.95	0.009113	1.83	3.92	14.85	0.77	19.99
2101	12297	10yr_ Ex	CVC	8.50	92.91	93.88	93.88	94.06	0.008175	1.93	5.79	22.26	0.75	24.11
2101	12297	10yr_ Ex	AMCAI	8.50	92.91	93.88	93.88	94.06	0.008174	1.93	5.79	22.26	0.75	24.16
2101	12297	25yr_ Ex	CVC	10.30	92.91	93.96	93.95	94.13	0.007008	1.93	7.63	22.81	0.71	27.74
2101	12297	25yr_ Ex	AMCAI	10.30	92.91	93.96	93.94	94.13	0.007019	1.93	7.62	22.81	0.71	27.74
2101	12297	50yr_ Ex	CVC	11.90	92.91	94.03	93.99	94.18	0.006410	1.94	9.06	23.23	0.69	31.75
2101	12297	50yr_ Ex	AMCAI	11.90	92.91	94.02	93.99	94.18	0.006419	1.94	9.05	23.23	0.69	31.72
2101	12297	100yr_ Ex	CVC	13.60	92.91	94.09		94.24	0.005963	1.96	10.46	23.64	0.67	36.59
2101	12297	100yr_ Ex	AMCAI	13.60	92.91	94.09		94.24	0.005964	1.96	10.46	23.64	0.67	36.49
2101	12297	Reg_ Ex	CVC	32.00	92.91	94.54		94.72	0.004839	2.33	21.82	26.70	0.65	85.33
2101	12297	Reg_ Ex	AMCAI	32.00	92.91	94.54		94.72	0.004840	2.33	21.82	26.70	0.65	83.82
2101	12297	2yr_ Fut	CVC	4.70	92.91	93.67		93.81	0.010209	1.70	2.77	6.17	0.79	19.07
2101	12297	2yr_ Fut	AMCAI	4.70	92.91	93.67		93.81	0.010209	1.70	2.77	6.17	0.79	19.09
2101	12297	5yr_ Fut	CVC	7.00	92.91	93.81	93.75	93.98	0.008947	1.87	4.33	17.29	0.77	24.92
2101	12297	5yr_ Fut	AMCAI	7.00	92.91	93.81	93.75	93.98	0.008947	1.87	4.33	17.29	0.77	24.97
2101	12297	10yr_ Fut	CVC	9.10	92.91	93.91	93.90	94.08	0.007706	1.92	6.44	22.45	0.73	30.75
2101	12297	10yr_ Fut	AMCAI	9.10	92.91	93.91	93.90	94.08	0.007706	1.92	6.44	22.45	0.73	30.75
2101	12297	25yr_ Fut	CVC	11.00	92.91	93.99	93.96	94.15	0.006707	1.93	8.28	23.00	0.70	35.59
2101	12297	25yr_ Fut	AMCAI	11.00	92.91	93.99	93.96	94.15	0.006727	1.93	8.26	23.00	0.70	35.57
2101	12297	50yr_ Fut	CVC	12.60	92.91	94.05	94.00	94.21	0.006188	1.95	9.66	23.41	0.68	41.02
2101	12297	50yr_ Fut	AMCAI	12.60	92.91	94.05	94.00	94.21	0.006182	1.95	9.66	23.41	0.68	40.93
2101	12297	100yr_ Fut	CVC	14.40	92.91	94.11		94.27	0.005816	1.98	11.08	23.82	0.67	47.15
2101	12297	100yr_ Fut	AMCAI	14.40	92.91	94.11		94.27	0.005821	1.98	11.08	23.81	0.67	46.96
2101	12297	Reg_ Fut	CVC	32.10	92.91	94.54		94.72	0.004838	2.34	21.87	26.71	0.65	87.66
2101	12297	Reg_ Fut	AMCAI	32.10	92.91	94.54		94.72	0.004839	2.34	21.87	26.71	0.65	86.14

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12266	50yr_Ex	CVC	11.90	92.36	93.96		94.05	0.002492	1.43	12.12	23.10	0.44	31.43
2101	12266	50yr_Ex	AMCAI	11.90	92.36	93.96		94.05	0.002496	1.43	12.12	23.10	0.44	31.40
2101	12266	100yr_Ex	CVC	13.60	92.36	94.01		94.11	0.002595	1.51	13.36	23.45	0.45	36.23
2101	12266	100yr_Ex	AMCAI	13.60	92.36	94.01		94.11	0.002595	1.51	13.36	23.45	0.45	36.13
2101	12266	Reg_Ex	CVC	32.00	92.36	94.44		94.59	0.003324	2.10	23.82	26.25	0.54	84.65
2101	12266	Reg_Ex	AMCAI	32.00	92.36	94.43		94.59	0.003325	2.10	23.82	26.25	0.54	83.14
2101	12266	2yr_Fut	CVC	4.70	92.36	93.61		93.66	0.002220	1.04	4.69	12.93	0.39	18.96
2101	12266	2yr_Fut	AMCAI	4.70	92.36	93.61		93.66	0.002220	1.04	4.69	12.93	0.39	18.98
2101	12266	5yr_Fut	CVC	7.00	92.36	93.77		93.83	0.002172	1.17	7.78	21.81	0.40	24.74
2101	12266	5yr_Fut	AMCAI	7.00	92.36	93.77		93.83	0.002172	1.17	7.78	21.81	0.40	24.79
2101	12266	10yr_Fut	CVC	9.10	92.36	93.86		93.93	0.002306	1.29	9.85	22.43	0.41	30.51
2101	12266	10yr_Fut	AMCAI	9.10	92.36	93.86		93.93	0.002306	1.29	9.85	22.43	0.41	30.50
2101	12266	25yr_Fut	CVC	11.00	92.36	93.93		94.01	0.002429	1.39	11.44	22.90	0.43	35.29
2101	12266	25yr_Fut	AMCAI	11.00	92.36	93.93		94.01	0.002437	1.39	11.43	22.90	0.43	35.27
2101	12266	50yr_Fut	CVC	12.60	92.36	93.98		94.07	0.002539	1.46	12.64	23.25	0.44	40.69
2101	12266	50yr_Fut	AMCAI	12.60	92.36	93.98		94.07	0.002536	1.46	12.64	23.25	0.44	40.59
2101	12266	100yr_Fut	CVC	14.40	92.36	94.04		94.13	0.002638	1.54	13.92	23.61	0.46	46.78
2101	12266	100yr_Fut	AMCAI	14.40	92.36	94.04		94.13	0.002640	1.54	13.91	23.61	0.46	46.58
2101	12266	Reg_Fut	CVC	32.10	92.36	94.44		94.59	0.003328	2.10	23.87	26.26	0.54	86.97
2101	12266	Reg_Fut	AMCAI	32.10	92.36	94.44		94.59	0.003329	2.10	23.87	26.26	0.54	85.45
2101	12233	2yr_Ex	CVC	4.40	92.31	93.48		93.55	0.002854	1.09	4.03	6.62	0.43	15.18
2101	12233	2yr_Ex	AMCAI	4.40	92.31	93.48		93.55	0.002854	1.09	4.03	6.62	0.43	15.18
2101	12233	5yr_Ex	CVC	6.50	92.31	93.65		93.72	0.002629	1.21	6.80	22.54	0.43	19.59
2101	12233	5yr_Ex	AMCAI	6.50	92.31	93.65		93.72	0.002629	1.21	6.80	22.54	0.43	19.59
2101	12233	10yr_Ex	CVC	8.50	92.31	93.75		93.82	0.002705	1.32	8.93	23.13	0.44	23.58
2101	12233	10yr_Ex	AMCAI	8.50	92.31	93.75		93.82	0.002705	1.32	8.93	23.13	0.44	23.64
2101	12233	25yr_Ex	CVC	10.30	92.31	93.81		93.90	0.002811	1.41	10.51	23.56	0.46	27.11
2101	12233	25yr_Ex	AMCAI	10.30	92.31	93.81		93.90	0.002822	1.41	10.49	23.55	0.46	27.11
2101	12233	50yr_Ex	CVC	11.90	92.31	93.86		93.96	0.002961	1.49	11.68	23.87	0.47	31.04
2101	12233	50yr_Ex	AMCAI	11.90	92.31	93.86		93.96	0.002972	1.50	11.66	23.86	0.47	31.01
2101	12233	100yr_Ex	CVC	13.60	92.31	93.91		94.01	0.003100	1.58	12.83	24.17	0.49	35.80
2101	12233	100yr_Ex	AMCAI	13.60	92.31	93.91		94.01	0.003101	1.58	12.83	24.17	0.49	35.70
2101	12233	Reg_Ex	CVC	32.00	92.31	94.30		94.47	0.004054	2.21	22.61	26.60	0.59	83.88
2101	12233	Reg_Ex	AMCAI	32.00	92.31	94.30		94.47	0.004057	2.21	22.60	26.60	0.59	82.38
2101	12233	2yr_Fut	CVC	4.70	92.31	93.51		93.58	0.002878	1.12	4.24	9.49	0.44	18.81
2101	12233	2yr_Fut	AMCAI	4.70	92.31	93.51		93.58	0.002878	1.12	4.24	9.49	0.44	18.83
2101	12233	5yr_Fut	CVC	7.00	92.31	93.68		93.75	0.002604	1.23	7.45	22.72	0.43	24.48
2101	12233	5yr_Fut	AMCAI	7.00	92.31	93.68		93.75	0.002604	1.23	7.45	22.72	0.43	24.54
2101	12233	10yr_Fut	CVC	9.10	92.31	93.77		93.85	0.002726	1.34	9.51	23.29	0.45	30.19
2101	12233	10yr_Fut	AMCAI	9.10	92.31	93.77		93.85	0.002726	1.34	9.51	23.29	0.45	30.18
2101	12233	25yr_Fut	CVC	11.00	92.31	93.84		93.93	0.002871	1.44	11.05	23.70	0.46	34.92
2101	12233	25yr_Fut	AMCAI	11.00	92.31	93.84		93.92	0.002892	1.45	11.01	23.69	0.46	34.90
2101	12233	50yr_Fut	CVC	12.60	92.31	93.88		93.98	0.003030	1.53	12.14	23.99	0.48	40.28
2101	12233	50yr_Fut	AMCAI	12.60	92.31	93.88		93.98	0.003022	1.53	12.16	23.99	0.48	40.18
2101	12233	100yr_Fut	CVC	14.40	92.31	93.93		94.04	0.003155	1.61	13.36	24.31	0.49	46.33
2101	12233	100yr_Fut	AMCAI	14.40	92.31	93.93		94.04	0.003163	1.61	13.35	24.31	0.49	46.13
2101	12233	Reg_Fut	CVC	32.10	92.31	94.30		94.47	0.004060	2.22	22.65	26.61	0.59	86.20
2101	12233	Reg_Fut	AMCAI	32.10	92.31	94.30		94.47	0.004062	2.22	22.64	26.61	0.59	84.69
2101	12230	2yr_Ex	CVC	4.40	92.64	93.38		93.52	0.010013	1.68	2.63	5.60	0.78	15.17
2101	12230	2yr_Ex	AMCAI	4.40	92.64	93.38		93.52	0.010013	1.68	2.63	5.60	0.78	15.17
2101	12230	5yr_Ex	CVC	6.50	92.64	93.53	93.43	93.70	0.008756	1.81	3.93	16.29	0.76	19.57
2101	12230	5yr_Ex	AMCAI	6.50	92.64	93.53	93.43	93.70	0.008756	1.81	3.93	16.29	0.76	19.57
2101	12230	10yr_Ex	CVC	8.50	92.64	93.67	93.62	93.80	0.006120	1.73	6.71	22.55	0.65	23.55
2101	12230	10yr_Ex	AMCAI	8.50	92.64	93.67	93.62	93.80	0.006119	1.73	6.71	22.55	0.65	23.61
2101	12230	25yr_Ex	CVC	10.30	92.64	93.76		93.88	0.005032	1.70	8.83	23.14	0.61	27.07
2101	12230	25yr_Ex	AMCAI	10.30	92.64	93.76		93.88	0.005085	1.71	8.78	23.13	0.61	27.07
2101	12230	50yr_Ex	CVC	11.90	92.64	93.81		93.94	0.004960	1.77	10.06	23.48	0.61	31.00
2101	12230	50yr_Ex	AMCAI	11.90	92.64	93.81		93.94	0.005004	1.77	10.02	23.47	0.61	30.97
2101	12230	100yr_Ex	CVC	13.60	92.64	93.86		94.00	0.004919	1.83	11.27	23.81	0.61	35.76
2101	12230	100yr_Ex	AMCAI	13.60	92.64	93.86		93.99	0.004923	1.83	11.27	23.81	0.61	35.65
2101	12230	Reg_Ex	CVC	32.00	92.64	94.25		94.45	0.005269	2.40	21.07	26.32	0.67	83.80
2101	12230	Reg_Ex	AMCAI	32.00	92.64	94.25		94.45	0.005275	2.40	21.06	26.32	0.67	82.30
2101	12230	2yr_Fut	CVC	4.70	92.64	93.40		93.55	0.009710	1.69	2.79	5.75	0.77	18.80
2101	12230	2yr_Fut	AMCAI	4.70	92.64	93.40		93.55	0.009710	1.69	2.79	5.75	0.77	18.81
2101	12230	5yr_Fut	CVC	7.00	92.64	93.56	93.46	93.73	0.008424	1.83	4.43	19.19	0.75	24.46
2101	12230	5yr_Fut	AMCAI	7.00	92.64	93.56	93.46	93.73	0.008424	1.83	4.43	19.19	0.75	24.52
2101	12230	10yr_Fut	CVC	9.10	92.64	93.71	93.64	93.83	0.005410	1.69	7.62	22.81	0.62	30.16
2101	12230	10yr_Fut	AMCAI	9.10	92.64	93.71	93.64	93.83	0.005410	1.69	7.62	22.81	0.62	30.15
2101	12230	25yr_Fut	CVC	11.00	92.64	93.78		93.91	0.004955	1.73	9.41	23.30	0.60	34.89
2101	12230	25yr_Fut	AMCAI	11.00	92.64	93.78		93.91	0.005055	1.74	9.33	23.28	0.61	34.86
2101	12230	50yr_Fut	CVC	12.60	92.64	93.83		93.96	0.004974	1.80	10.54	23.61	0.61	40.24
2101	12230	50yr_Fut	AMCAI	12.60	92.64	93.83		93.96	0.004944	1.79	10.56	23.62	0.61	40.14
2101	12230	100yr_Fut	CVC	14.40	92.64	93.89		94.02	0.004899	1.85	11.82	23.96	0.61	46.28
2101	12230	100yr_Fut	AMCAI	14.40	92.64	93.89		94.02	0.004922	1.86	11.80	23.95	0.61	46.08
2101	12230	Reg_Fut	CVC	32.10	92.64	94.26		94.45	0.005276	2.40	21.11	26.33	0.67	86.12
2101	12230	Reg_Fut	AMCAI	32.10	92.64	94.26		94.45	0.005280	2.40	21.10	26.33	0.67	84.61
2101	12215	2yr_Ex	CVC	4.40	92.40	93.29		93.40	0.006163	1.46	3.01	5.32	0.62	15.13
2101	12215	2yr_Ex	AMCAI	4.40	92.40	93.29		93.40	0.006163	1.46	3.01	5.32	0.62	15.13
2101	12215	5yr_Ex	CVC	6.50	92.40	93.44	93.25	93.58	0.006517	1.68	4.01	10.44	0.66	19.52
2101	12215	5yr_Ex	AMCAI	6.50	92.40	93.44	93.25	93.58	0.006517	1.68	4.01	10.44	0.66	19.52
2101	12215	10yr_Ex	CVC	8.50	92.40	93.51	93.37	93.70	0.007713	1.95	5.01	18.37	0.73	23.47
2101	12215	10yr_Ex	AMCAI	8.50	92.40	93.51	93.38	93.70	0.007714	1.95	5.01	18.37	0.73	23.52
2101	12215	25yr_Ex	CVC	10.30	92.40	93.58	93.58	93.78	0.007819	2.08	6.40	22.15	0.74	26.96
2101	12215	25yr_Ex	AMCAI	10.30	92.40									

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12215	2yr_Fut	AMCAI	4.70	92.40	93.32		93.43	0.006148	1.49	3.16	5.46	0.62	18.77
2101	12215	5yr_Fut	CVC	7.00	92.40	93.46	93.28	93.62	0.006741	1.74	4.26	12.92	0.67	24.40
2101	12215	5yr_Fut	AMCAI	7.00	92.40	93.46	93.28	93.62	0.006740	1.74	4.26	12.93	0.67	24.46
2101	12215	10yr_Fut	CVC	9.10	92.40	93.52	93.41	93.73	0.008144	2.03	5.30	20.10	0.75	30.06
2101	12215	10yr_Fut	AMCAI	9.10	92.40	93.52	93.42	93.73	0.008144	2.03	5.30	20.10	0.75	30.06
2101	12215	25yr_Fut	CVC	11.00	92.40	93.60	93.60	93.81	0.007767	2.11	6.93	22.30	0.74	34.77
2101	12215	25yr_Fut	AMCAI	11.00	92.40	93.61	93.61	93.81	0.007454	2.08	7.09	22.34	0.73	34.74
2101	12215	50yr_Fut	CVC	12.60	92.40	93.66	93.66	93.87	0.007389	2.16	8.22	22.66	0.73	40.10
2101	12215	50yr_Fut	AMCAI	12.60	92.40	93.65	93.65	93.87	0.007492	2.17	8.16	22.64	0.74	40.01
2101	12215	100yr_Fut	CVC	14.40	92.40	93.70	93.70	93.92	0.007573	2.26	9.24	22.94	0.75	46.13
2101	12215	100yr_Fut	AMCAI	14.40	92.40	93.70	93.70	93.92	0.007491	2.25	9.29	22.95	0.74	45.93
2101	12215	Reg_Fut	CVC	32.10	92.40	94.07	94.02	94.35	0.007454	2.80	18.13	25.23	0.79	85.84
2101	12215	Reg_Fut	AMCAI	32.10	92.40	94.07	94.03	94.35	0.007363	2.79	18.21	25.26	0.78	84.33
2101	12185	2yr_Ex	CVC	4.40	91.79	93.26		93.30	0.001340	0.86	5.18	10.23	0.30	15.01
2101	12185	2yr_Ex	AMCAI	4.40	91.79	93.26		93.30	0.001340	0.86	5.18	10.23	0.30	15.01
2101	12185	5yr_Ex	CVC	6.50	91.79	93.43		93.48	0.001460	1.01	8.39	29.45	0.32	19.34
2101	12185	5yr_Ex	AMCAI	6.50	91.79	93.43		93.48	0.001460	1.01	8.39	29.45	0.32	19.34
2101	12185	10yr_Ex	CVC	8.50	91.79	93.51		93.57	0.001668	1.14	11.07	34.28	0.35	23.24
2101	12185	10yr_Ex	AMCAI	8.50	91.79	93.51		93.57	0.001668	1.14	11.07	34.28	0.35	23.30
2101	12185	25yr_Ex	CVC	10.30	91.79	93.57	93.05	93.63	0.001842	1.24	13.02	34.67	0.37	26.69
2101	12185	25yr_Ex	AMCAI	10.30	91.79	93.57	93.05	93.63	0.001842	1.24	13.02	34.67	0.37	26.69
2101	12185	50yr_Ex	CVC	11.90	91.79	93.61	93.13	93.68	0.001965	1.32	14.62	34.96	0.39	30.57
2101	12185	50yr_Ex	AMCAI	11.90	91.79	93.61	93.14	93.68	0.001966	1.32	14.62	34.96	0.39	30.54
2101	12185	100yr_Ex	CVC	13.60	91.79	93.66	93.21	93.73	0.002068	1.39	16.22	35.25	0.40	35.27
2101	12185	100yr_Ex	AMCAI	13.60	91.79	93.66	93.23	93.73	0.002068	1.39	16.22	35.25	0.40	35.17
2101	12185	Reg_Ex	CVC	32.00	91.79	94.10		94.19	0.002093	1.71	32.53	38.06	0.42	82.87
2101	12185	Reg_Ex	AMCAI	32.00	91.79	94.11		94.20	0.002074	1.71	32.64	38.08	0.42	81.36
2101	12185	2yr_Fut	CVC	4.70	91.79	93.29		93.33	0.001356	0.89	5.53	13.69	0.30	18.63
2101	12185	2yr_Fut	AMCAI	4.70	91.79	93.29		93.33	0.001356	0.89	5.53	13.69	0.30	18.64
2101	12185	5yr_Fut	CVC	7.00	91.79	93.45		93.50	0.001498	1.04	9.18	31.13	0.33	24.21
2101	12185	5yr_Fut	AMCAI	7.00	91.79	93.45		93.50	0.001497	1.04	9.18	31.13	0.33	24.26
2101	12185	10yr_Fut	CVC	9.10	91.79	93.53		93.59	0.001729	1.18	11.75	34.43	0.36	29.83
2101	12185	10yr_Fut	AMCAI	9.10	91.79	93.53		93.59	0.001729	1.18	11.75	34.43	0.36	29.82
2101	12185	25yr_Fut	CVC	11.00	91.79	93.59	93.09	93.66	0.001899	1.28	13.73	34.80	0.38	34.49
2101	12185	25yr_Fut	AMCAI	11.00	91.79	93.59	93.09	93.66	0.001900	1.28	13.73	34.80	0.38	34.46
2101	12185	50yr_Fut	CVC	12.60	91.79	93.63	93.17	93.70	0.002009	1.35	15.30	35.08	0.39	39.78
2101	12185	50yr_Fut	AMCAI	12.60	91.79	93.63	93.18	93.70	0.002009	1.35	15.29	35.08	0.39	39.69
2101	12185	100yr_Fut	CVC	14.40	91.79	93.68	93.39	93.76	0.002109	1.42	16.95	35.38	0.40	45.78
2101	12185	100yr_Fut	AMCAI	14.40	91.79	93.68	93.38	93.76	0.002109	1.42	16.95	35.38	0.40	45.58
2101	12185	Reg_Fut	CVC	32.10	91.79	94.11		94.20	0.002079	1.71	32.68	38.08	0.42	85.18
2101	12185	Reg_Fut	AMCAI	32.10	91.79	94.11		94.20	0.002060	1.70	32.80	38.10	0.42	83.67
2101	12171	2yr_Ex	CVC	4.40	91.80	93.25		93.28	0.001195	0.82	5.36	7.42	0.28	14.94
2101	12171	2yr_Ex	AMCAI	4.40	91.80	93.25		93.28	0.001195	0.82	5.36	7.42	0.28	14.93
2101	12171	5yr_Ex	CVC	6.50	91.80	93.41		93.45	0.001359	0.97	8.53	32.26	0.31	19.22
2101	12171	5yr_Ex	AMCAI	6.50	91.80	93.41		93.45	0.001359	0.97	8.53	32.26	0.31	19.22
2101	12171	10yr_Ex	CVC	8.50	91.80	93.49		93.54	0.001550	1.10	11.44	37.02	0.34	23.07
2101	12171	10yr_Ex	AMCAI	8.50	91.80	93.49		93.54	0.001550	1.10	11.44	37.02	0.34	23.13
2101	12171	25yr_Ex	CVC	10.30	91.80	93.54		93.61	0.001735	1.20	13.43	37.35	0.36	26.49
2101	12171	25yr_Ex	AMCAI	10.30	91.80	93.54		93.61	0.001735	1.20	13.43	37.35	0.36	26.49
2101	12171	50yr_Ex	CVC	11.90	91.80	93.59		93.65	0.001867	1.27	15.06	37.61	0.37	30.34
2101	12171	50yr_Ex	AMCAI	11.90	91.80	93.59		93.65	0.001868	1.27	15.06	37.61	0.37	30.30
2101	12171	100yr_Ex	CVC	13.60	91.80	93.63		93.70	0.001976	1.34	16.71	37.87	0.39	35.01
2101	12171	100yr_Ex	AMCAI	13.60	91.80	93.63		93.70	0.001976	1.34	16.71	37.87	0.39	34.91
2101	12171	Reg_Ex	CVC	32.00	91.80	94.08		94.16	0.001933	1.63	34.16	40.54	0.40	82.29
2101	12171	Reg_Ex	AMCAI	32.00	91.80	94.08		94.16	0.001913	1.63	34.29	40.56	0.40	80.78
2101	12171	2yr_Fut	CVC	4.70	91.80	93.28		93.31	0.001229	0.85	5.63	11.15	0.29	18.55
2101	12171	2yr_Fut	AMCAI	4.70	91.80	93.28		93.31	0.001229	0.85	5.63	11.15	0.29	18.56
2101	12171	5yr_Fut	CVC	7.00	91.80	93.43		93.48	0.001395	1.00	9.38	35.00	0.32	24.07
2101	12171	5yr_Fut	AMCAI	7.00	91.80	93.43		93.48	0.001395	1.00	9.39	35.01	0.32	24.13
2101	12171	10yr_Fut	CVC	9.10	91.80	93.51		93.57	0.001615	1.13	12.13	37.14	0.34	29.64
2101	12171	10yr_Fut	AMCAI	9.10	91.80	93.51		93.57	0.001615	1.13	12.13	37.14	0.34	29.64
2101	12171	25yr_Fut	CVC	11.00	91.80	93.56		93.63	0.001796	1.23	14.16	37.46	0.37	34.27
2101	12171	25yr_Fut	AMCAI	11.00	91.80	93.56		93.63	0.001797	1.23	14.15	37.46	0.37	34.24
2101	12171	50yr_Fut	CVC	12.60	91.80	93.61		93.67	0.001914	1.30	15.76	37.72	0.38	39.54
2101	12171	50yr_Fut	AMCAI	12.60	91.80	93.61		93.67	0.001914	1.30	15.76	37.72	0.38	39.44
2101	12171	100yr_Fut	CVC	14.40	91.80	93.65		93.72	0.002019	1.37	17.46	37.99	0.39	45.50
2101	12171	100yr_Fut	AMCAI	14.40	91.80	93.65		93.72	0.002019	1.37	17.46	37.99	0.39	45.30
2101	12171	Reg_Fut	CVC	32.10	91.80	94.08		94.16	0.001918	1.63	34.33	40.56	0.40	84.80
2101	12171	Reg_Fut	AMCAI	32.10	91.80	94.08		94.17	0.001898	1.62	34.47	40.58	0.40	83.08
2101	12159	2yr_Ex	CVC	4.40	92.35	93.13		93.24	0.007259	1.48	2.97	5.97	0.67	14.88
2101	12159	2yr_Ex	AMCAI	4.40	92.35	93.13		93.24	0.007259	1.48	2.97	5.97	0.67	14.88
2101	12159	5yr_Ex	CVC	6.50	92.35	93.29	93.13	93.41	0.006429	1.60	4.80	22.53	0.65	19.14
2101	12159	5yr_Ex	AMCAI	6.50	92.35	93.29	93.13	93.41	0.006429	1.60	4.80	22.53	0.65	19.14
2101	12159	10yr_Ex	CVC	8.50	92.35	93.38	93.34	93.50	0.005899	1.68	7.25	31.24	0.64	22.97
2101	12159	10yr_Ex	AMCAI	8.50	92.35	93.38	93.34	93.50	0.005899	1.68	7.26	31.25	0.64	23.02
2101	12159	25yr_Ex	CVC	10.30	92.35	93.45	93.41	93.57	0.005284	1.69	9.46	31.96	0.62	26.36
2101	12159	25yr_Ex	AMCAI	10.30	92.35	93.45	93.41	93.57	0.005281	1.69	9.46	31.96	0.62	26.36
2101	12159	50yr_Ex	CVC	11.90	92.35	93.50		93.62	0.004924	1.71	11.19	32.30	0.60	30.19
2101	12159	50yr_Ex	AMCAI	11.90	92.35	93.50		93.62	0.004938	1.71	11.18	32.29	0.60	30.16
2101	12159	100yr_Ex	CVC	13.60	92.35	93.55		93.66	0.004687	1.74	12.84	32.61	0.59	34.84
2101	12159	100yr_Ex	AMCAI	13.60	92.35	93.55		93.66	0.004688	1.74	12.84	32.61	0.59	34.74
2101	12159	Reg_Ex	CVC	32.00	92.35	94.03		94.13	0.002985	1.85	29.09	35.59	0.51	81.93
2101	12159	Reg_Ex	AMCAI	32.00	92.35	94.03		94.13	0.002944	1.84	29.23	35.62	0.51</	

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12159	50yr_Fut	CVC	12.60	92.35	93.52		93.64	0.004794	1.72	11.91	32.44	0.60	39.38
2101	12159	50yr_Fut	AMCAI	12.60	92.35	93.52		93.64	0.004798	1.72	11.91	32.43	0.60	39.29
2101	12159	100yr_Fut	CVC	14.40	92.35	93.57		93.69	0.004613	1.75	13.56	32.75	0.59	45.32
2101	12159	100yr_Fut	AMCAI	14.40	92.35	93.57		93.69	0.004613	1.75	13.56	32.75	0.59	45.13
2101	12159	Reg_Fut	CVC	32.10	92.35	94.03		94.13	0.002953	1.85	29.26	35.62	0.51	84.25
2101	12159	Reg_Fut	AMCAI	32.10	92.35	94.03		94.14	0.002913	1.84	29.40	35.65	0.50	82.73
2101	12120	2yr_Ex	CVC	4.40	91.59	93.09		93.12	0.001275	0.85	5.38	12.69	0.29	14.72
2101	12120	2yr_Ex	AMCAI	4.40	91.59	93.09		93.12	0.001275	0.85	5.38	12.69	0.29	14.72
2101	12120	5yr_Ex	CVC	6.50	91.59	93.26		93.30	0.001238	0.94	9.91	30.82	0.30	18.86
2101	12120	5yr_Ex	AMCAI	6.50	91.59	93.26		93.30	0.001238	0.94	9.91	30.82	0.30	18.86
2101	12120	10yr_Ex	CVC	8.50	91.59	93.33		93.38	0.001431	1.06	12.31	31.33	0.32	22.60
2101	12120	10yr_Ex	AMCAI	8.50	91.59	93.33		93.38	0.001429	1.06	12.32	31.33	0.32	22.65
2101	12120	25yr_Ex	CVC	10.30	91.59	93.39		93.44	0.001599	1.16	14.08	31.70	0.35	25.92
2101	12120	25yr_Ex	AMCAI	10.30	91.59	93.39		93.45	0.001598	1.16	14.08	31.70	0.35	25.92
2101	12120	50yr_Ex	CVC	11.90	91.59	93.43		93.50	0.001734	1.24	15.50	31.99	0.36	29.69
2101	12120	50yr_Ex	AMCAI	11.90	91.59	93.43		93.49	0.001739	1.24	15.48	31.99	0.36	29.66
2101	12120	100yr_Ex	CVC	13.60	91.59	93.48		93.54	0.001877	1.32	16.84	32.27	0.38	34.29
2101	12120	100yr_Ex	AMCAI	13.60	91.59	93.48		93.54	0.001878	1.32	16.84	32.27	0.38	34.19
2101	12120	Reg_Ex	CVC	32.00	91.59	93.95		94.04	0.001898	1.65	32.93	35.41	0.40	80.79
2101	12120	Reg_Ex	AMCAI	32.00	91.59	93.96		94.04	0.001870	1.64	33.11	35.44	0.40	79.27
2101	12120	2yr_Fut	CVC	4.70	91.59	93.12		93.15	0.001303	0.88	5.80	19.70	0.30	18.32
2101	12120	2yr_Fut	AMCAI	4.70	91.59	93.12		93.15	0.001303	0.88	5.80	19.70	0.30	18.34
2101	12120	5yr_Fut	CVC	7.00	91.59	93.28		93.32	0.001251	0.96	10.74	30.99	0.30	23.68
2101	12120	5yr_Fut	AMCAI	7.00	91.59	93.28		93.33	0.001247	0.96	10.76	31.00	0.30	23.74
2101	12120	10yr_Fut	CVC	9.10	91.59	93.35		93.40	0.001488	1.10	12.93	31.46	0.33	29.14
2101	12120	10yr_Fut	AMCAI	9.10	91.59	93.35		93.40	0.001489	1.10	12.92	31.46	0.33	29.13
2101	12120	25yr_Fut	CVC	11.00	91.59	93.41		93.47	0.001656	1.20	14.73	31.83	0.35	33.66
2101	12120	25yr_Fut	AMCAI	11.00	91.59	93.41		93.47	0.001664	1.20	14.69	31.83	0.35	33.64
2101	12120	50yr_Fut	CVC	12.60	91.59	93.45		93.52	0.001792	1.28	16.07	32.11	0.37	38.86
2101	12120	50yr_Fut	AMCAI	12.60	91.59	93.45		93.52	0.001794	1.28	16.07	32.11	0.37	38.77
2101	12120	100yr_Fut	CVC	14.40	91.59	93.49		93.56	0.001941	1.36	17.44	32.39	0.39	44.75
2101	12120	100yr_Fut	AMCAI	14.40	91.59	93.49		93.56	0.001941	1.36	17.44	32.39	0.39	44.55
2101	12120	Reg_Fut	CVC	32.10	91.59	93.96		94.04	0.001878	1.64	33.13	35.45	0.40	83.10
2101	12120	Reg_Fut	AMCAI	32.10	91.59	93.96		94.05	0.001850	1.64	33.32	35.48	0.40	81.57
2101	12094	2yr_Ex	CVC	4.40	91.57	93.05		93.09	0.001523	0.90	5.04	14.50	0.32	14.59
2101	12094	2yr_Ex	AMCAI	4.40	91.57	93.05		93.09	0.001523	0.90	5.04	14.50	0.32	14.58
2101	12094	5yr_Ex	CVC	6.50	91.57	93.22		93.26	0.001383	0.98	9.75	31.34	0.31	18.60
2101	12094	5yr_Ex	AMCAI	6.50	91.57	93.22		93.26	0.001383	0.98	9.75	31.34	0.31	18.60
2101	12094	10yr_Ex	CVC	8.50	91.57	93.29		93.34	0.001627	1.11	11.96	31.76	0.34	22.28
2101	12094	10yr_Ex	AMCAI	8.50	91.57	93.29		93.34	0.001624	1.11	11.97	31.76	0.34	22.33
2101	12094	25yr_Ex	CVC	10.30	91.57	93.34		93.40	0.001859	1.22	13.52	32.05	0.37	25.56
2101	12094	25yr_Ex	AMCAI	10.30	91.57	93.34		93.40	0.001857	1.22	13.53	32.06	0.37	25.55
2101	12094	50yr_Ex	CVC	11.90	91.57	93.38		93.44	0.002052	1.31	14.76	32.29	0.39	29.29
2101	12094	50yr_Ex	AMCAI	11.90	91.57	93.38		93.44	0.002062	1.32	14.73	32.28	0.39	29.26
2101	12094	100yr_Ex	CVC	13.60	91.57	93.41		93.49	0.002273	1.41	15.89	32.49	0.41	33.86
2101	12094	100yr_Ex	AMCAI	13.60	91.57	93.41		93.49	0.002273	1.41	15.89	32.49	0.41	33.76
2101	12094	Reg_Ex	CVC	32.00	91.57	93.90		93.98	0.002048	1.68	32.36	35.40	0.42	79.93
2101	12094	Reg_Ex	AMCAI	32.00	91.57	93.90		93.99	0.002009	1.67	32.59	35.44	0.41	78.40
2101	12094	2yr_Fut	CVC	4.70	91.57	93.07		93.12	0.001545	0.93	5.50	20.13	0.32	18.17
2101	12094	2yr_Fut	AMCAI	4.70	91.57	93.07		93.12	0.001545	0.93	5.50	20.13	0.32	18.19
2101	12094	5yr_Fut	CVC	7.00	91.57	93.25		93.29	0.001388	1.00	10.59	31.50	0.32	23.40
2101	12094	5yr_Fut	AMCAI	7.00	91.57	93.25		93.29	0.001382	0.99	10.61	31.51	0.31	23.46
2101	12094	10yr_Fut	CVC	9.10	91.57	93.31		93.36	0.001704	1.15	12.51	31.86	0.35	28.80
2101	12094	10yr_Fut	AMCAI	9.10	91.57	93.31		93.36	0.001706	1.15	12.50	31.86	0.35	28.80
2101	12094	25yr_Fut	CVC	11.00	91.57	93.36		93.42	0.001939	1.26	14.10	32.16	0.38	33.28
2101	12094	25yr_Fut	AMCAI	11.00	91.57	93.35		93.42	0.001953	1.26	14.05	32.15	0.38	33.26
2101	12094	50yr_Fut	CVC	12.60	91.57	93.39		93.46	0.002139	1.35	15.26	32.38	0.40	38.45
2101	12094	50yr_Fut	AMCAI	12.60	91.57	93.39		93.46	0.002142	1.35	15.25	32.38	0.40	38.35
2101	12094	100yr_Fut	CVC	14.40	91.57	93.43		93.51	0.002373	1.45	16.39	32.59	0.42	44.30
2101	12094	100yr_Fut	AMCAI	14.40	91.57	93.43		93.51	0.002373	1.45	16.39	32.59	0.42	44.10
2101	12094	Reg_Fut	CVC	32.10	91.57	93.90		93.99	0.002020	1.68	32.60	35.44	0.41	82.23
2101	12094	Reg_Fut	AMCAI	32.10	91.57	93.91		93.99	0.001982	1.66	32.83	35.48	0.41	80.69
2101	12085	2yr_Ex	CVC	4.40	92.11	92.88	92.83	93.04	0.012347	1.80	2.45	5.51	0.86	14.55
2101	12085	2yr_Ex	AMCAI	4.40	92.11	92.88	92.83	93.04	0.012347	1.80	2.45	5.51	0.86	14.55
2101	12085	5yr_Ex	CVC	6.50	92.11	93.01	92.96	93.22	0.012322	2.03	3.33	12.74	0.89	18.54
2101	12085	5yr_Ex	AMCAI	6.50	92.11	93.01	92.97	93.22	0.012322	2.03	3.33	12.74	0.89	18.54
2101	12085	10yr_Ex	CVC	8.50	92.11	93.17	93.17	93.31	0.006494	1.76	7.39	31.72	0.67	22.19
2101	12085	10yr_Ex	AMCAI	8.50	92.11	93.17	93.17	93.31	0.006584	1.77	7.33	31.71	0.68	22.25
2101	12085	25yr_Ex	CVC	10.30	92.11	93.21	93.21	93.36	0.006840	1.88	8.79	31.97	0.70	25.45
2101	12085	25yr_Ex	AMCAI	10.30	92.11	93.21	93.21	93.36	0.006872	1.88	8.77	31.96	0.70	25.45
2101	12085	50yr_Ex	CVC	11.90	92.11	93.25	93.25	93.40	0.007151	1.98	9.87	32.16	0.72	29.18
2101	12085	50yr_Ex	AMCAI	11.90	92.11	93.25	93.25	93.40	0.006943	1.96	10.00	32.18	0.71	29.15
2101	12085	100yr_Ex	CVC	13.60	92.11	93.29	93.28	93.45	0.006885	2.02	11.30	32.41	0.71	33.73
2101	12085	100yr_Ex	AMCAI	13.60	92.11	93.29	93.28	93.45	0.006883	2.02	11.30	32.41	0.71	33.63
2101	12085	Reg_Ex	CVC	32.00	92.11	93.88		93.96	0.002528	1.75	31.20	35.69	0.47	79.64
2101	12085	Reg_Ex	AMCAI	32.00	92.11	93.88		93.97	0.002471	1.73	31.45	35.73	0.47	78.11
2101	12085	2yr_Fut	CVC	4.70	92.11	92.90	92.85	93.07	0.012106	1.82	2.59	5.64	0.86	18.14
2101	12085	2yr_Fut	AMCAI	4.70	92.11	92.90	92.85	93.07	0.012106	1.82	2.59	5.64	0.86	18.15
2101	12085	5yr_Fut	CVC	7.00	92.11	93.07	93.07	93.25	0.009584	1.92	4.37	22.67	0.79	23.33
2101	12085	5yr_Fut	AMCAI	7.00	92.11	93.06	93.06	93.25	0.009884	1.94	4.27	21.92	0.81	23.39
2101	12085	10yr_Fut	CVC	9.10	92.11	93.18	93.18	93.33	0.006648	1.81	7.86	31.80	0.68	28.71
2101	12085	10yr_Fut	AMCAI	9.10	92.11	93.19	93.19	93.33	0.006592	1.80	7.89	31.81	0.68	28.70
2101	12085	25yr_Fut	CVC	11.00	92.11	93.23	93.23	93.38	0.007109	1.94	9.19	32.04	0.71	33.18
2101	12085	25yr_Fut	AMCAI	11.00</										

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	12053	2yr_ Ex	CVC	4.40	91.58	92.85		92.89	0.001780	0.94	5.12	17.37	0.35	14.43
2101	12053	2yr_ Ex	AMCAI	4.40	91.58	92.85		92.89	0.001780	0.94	5.12	17.37	0.35	14.43
2101	12053	5yr_ Ex	CVC	6.50	91.58	93.02		93.06	0.001470	0.98	9.83	31.14	0.33	18.34
2101	12053	5yr_ Ex	AMCAI	6.50	91.58	93.02		93.06	0.001470	0.98	9.83	31.14	0.33	18.34
2101	12053	10yr_ Ex	CVC	8.50	91.58	93.11	92.65	93.16	0.001498	1.06	12.74	31.64	0.34	21.88
2101	12053	10yr_ Ex	AMCAI	8.50	91.58	93.11	92.66	93.16	0.001499	1.06	12.74	31.64	0.34	21.93
2101	12053	25yr_ Ex	CVC	10.30	91.58	93.17	92.75	93.22	0.001664	1.15	14.45	31.94	0.36	25.09
2101	12053	25yr_ Ex	AMCAI	10.30	91.58	93.17	92.75	93.22	0.001667	1.16	14.44	31.94	0.36	25.09
2101	12053	50yr_ Ex	CVC	11.90	91.58	93.21	92.97	93.27	0.001810	1.23	15.78	32.17	0.38	28.78
2101	12053	50yr_ Ex	AMCAI	11.90	91.58	93.21	92.97	93.27	0.001810	1.23	15.78	32.17	0.38	28.75
2101	12053	100yr_ Ex	CVC	13.60	91.58	93.25		93.31	0.001927	1.31	17.17	32.40	0.39	33.29
2101	12053	100yr_ Ex	AMCAI	13.60	91.58	93.25		93.31	0.001927	1.31	17.17	32.40	0.39	33.19
2101	12053	Reg_ Ex	CVC	32.00	91.58	93.84		93.90	0.001359	1.44	37.05	35.61	0.35	78.58
2101	12053	Reg_ Ex	AMCAI	32.00	91.58	93.84		93.91	0.001330	1.43	37.33	35.65	0.35	77.04
2101	12053	2yr_ Fut	CVC	4.70	91.58	92.87		92.92	0.001753	0.95	5.67	21.05	0.35	18.01
2101	12053	2yr_ Fut	AMCAI	4.70	91.58	92.87		92.92	0.001753	0.95	5.67	21.05	0.35	18.02
2101	12053	5yr_ Fut	CVC	7.00	91.58	93.06	92.56	93.10	0.001401	0.98	10.90	31.32	0.32	23.09
2101	12053	5yr_ Fut	AMCAI	7.00	91.58	93.06	92.57	93.10	0.001401	0.98	10.90	31.32	0.32	23.15
2101	12053	10yr_ Fut	CVC	9.10	91.58	93.13	92.69	93.18	0.001555	1.09	13.34	31.75	0.34	28.38
2101	12053	10yr_ Fut	AMCAI	9.10	91.58	93.13	92.69	93.18	0.001552	1.09	13.35	31.75	0.34	28.37
2101	12053	25yr_ Fut	CVC	11.00	91.58	93.19	92.84	93.24	0.001725	1.19	15.06	32.04	0.37	32.80
2101	12053	25yr_ Fut	AMCAI	11.00	91.58	93.19	92.83	93.24	0.001724	1.19	15.06	32.04	0.37	32.77
2101	12053	50yr_ Fut	CVC	12.60	91.58	93.23	92.99	93.29	0.001866	1.27	16.34	32.26	0.38	37.91
2101	12053	50yr_ Fut	AMCAI	12.60	91.58	93.23	92.99	93.29	0.001866	1.27	16.34	32.26	0.38	37.82
2101	12053	100yr_ Fut	CVC	14.40	91.58	93.28		93.34	0.001939	1.33	17.94	32.53	0.39	43.70
2101	12053	100yr_ Fut	AMCAI	14.40	91.58	93.28		93.34	0.001939	1.33	17.94	32.53	0.39	43.50
2101	12053	Reg_ Fut	CVC	32.10	91.58	93.84		93.91	0.001339	1.44	37.32	35.65	0.35	80.87
2101	12053	Reg_ Fut	AMCAI	32.10	91.58	93.85		93.91	0.001310	1.43	37.61	35.69	0.34	79.32
2101	12039	2yr_ Ex	CVC	4.40	91.61	92.80		92.86	0.002680	1.07	4.11	6.41	0.42	14.37
2101	12039	2yr_ Ex	AMCAI	4.40	91.61	92.80		92.86	0.002680	1.07	4.11	6.41	0.42	14.37
2101	12039	5yr_ Ex	CVC	6.50	91.61	92.98		93.04	0.002194	1.14	8.11	31.72	0.40	18.23
2101	12039	5yr_ Ex	AMCAI	6.50	91.61	92.98		93.04	0.002194	1.14	8.11	31.72	0.40	18.23
2101	12039	10yr_ Ex	CVC	8.50	91.61	93.08		93.14	0.002087	1.19	11.22	32.25	0.39	21.74
2101	12039	10yr_ Ex	AMCAI	8.50	91.61	93.08		93.14	0.002089	1.19	11.21	32.25	0.39	21.80
2101	12039	25yr_ Ex	CVC	10.30	91.61	93.13		93.19	0.002306	1.30	12.84	32.53	0.42	24.94
2101	12039	25yr_ Ex	AMCAI	10.30	91.61	93.13		93.19	0.002313	1.30	12.82	32.53	0.42	24.94
2101	12039	50yr_ Ex	CVC	11.90	91.61	93.16		93.24	0.002518	1.39	14.05	32.73	0.44	28.61
2101	12039	50yr_ Ex	AMCAI	11.90	91.61	93.16		93.24	0.002518	1.39	14.05	32.73	0.44	28.58
2101	12039	100yr_ Ex	CVC	13.60	91.61	93.20		93.28	0.002656	1.47	15.41	32.96	0.45	33.11
2101	12039	100yr_ Ex	AMCAI	13.60	91.61	93.20		93.28	0.002655	1.47	15.41	32.96	0.45	33.01
2101	12039	Reg_ Ex	CVC	32.00	91.61	93.82		93.88	0.001464	1.47	36.71	36.35	0.36	78.19
2101	12039	Reg_ Ex	AMCAI	32.00	91.61	93.83		93.89	0.001430	1.46	37.01	36.40	0.36	76.65
2101	12039	2yr_ Fut	CVC	4.70	91.61	92.83		92.89	0.002674	1.10	4.35	11.43	0.42	17.94
2101	12039	2yr_ Fut	AMCAI	4.70	91.61	92.83		92.89	0.002674	1.10	4.35	11.43	0.42	17.95
2101	12039	5yr_ Fut	CVC	7.00	91.61	93.02	92.61	93.07	0.001996	1.12	9.36	31.93	0.38	22.98
2101	12039	5yr_ Fut	AMCAI	7.00	91.61	93.02	92.61	93.07	0.001996	1.12	9.36	31.93	0.38	23.03
2101	12039	10yr_ Fut	CVC	9.10	91.61	93.09		93.16	0.002161	1.23	11.78	32.35	0.40	28.24
2101	12039	10yr_ Fut	AMCAI	9.10	91.61	93.09		93.16	0.002157	1.23	11.80	32.35	0.40	28.23
2101	12039	25yr_ Fut	CVC	11.00	91.61	93.14		93.21	0.002400	1.34	13.39	32.62	0.43	32.64
2101	12039	25yr_ Fut	AMCAI	11.00	91.61	93.14		93.21	0.002399	1.34	13.39	32.62	0.43	32.61
2101	12039	50yr_ Fut	CVC	12.60	91.61	93.18		93.26	0.002588	1.42	14.59	32.83	0.45	37.74
2101	12039	50yr_ Fut	AMCAI	12.60	91.61	93.18		93.26	0.002588	1.42	14.59	32.83	0.45	37.65
2101	12039	100yr_ Fut	CVC	14.40	91.61	93.23		93.31	0.002621	1.48	16.25	33.10	0.45	43.51
2101	12039	100yr_ Fut	AMCAI	14.40	91.61	93.23		93.31	0.002620	1.48	16.25	33.10	0.45	43.32
2101	12039	Reg_ Fut	CVC	32.10	91.61	93.83		93.89	0.001440	1.47	37.00	36.40	0.36	80.48
2101	12039	Reg_ Fut	AMCAI	32.10	91.61	93.84		93.90	0.001407	1.45	37.31	36.44	0.36	78.93
2101	12033	2yr_ Ex	CVC	4.40	91.95	92.64	92.59	92.81	0.012994	1.86	2.37	5.23	0.88	14.35
2101	12033	2yr_ Ex	AMCAI	4.40	91.95	92.64	92.60	92.81	0.012994	1.86	2.37	5.23	0.88	14.35
2101	12033	5yr_ Ex	CVC	6.50	91.95	92.80	92.74	93.00	0.011071	1.96	3.42	8.63	0.84	18.19
2101	12033	5yr_ Ex	AMCAI	6.50	91.95	92.80	92.74	93.00	0.011071	1.96	3.42	8.63	0.84	18.19
2101	12033	10yr_ Ex	CVC	8.50	91.95	92.96	92.96	93.10	0.006716	1.80	6.89	31.52	0.68	21.68
2101	12033	10yr_ Ex	AMCAI	8.50	91.95	92.96	92.96	93.10	0.006684	1.79	6.91	31.52	0.68	21.73
2101	12033	25yr_ Ex	CVC	10.30	91.95	93.01	93.01	93.16	0.006702	1.88	8.56	31.81	0.69	24.86
2101	12033	25yr_ Ex	AMCAI	10.30	91.95	93.01	93.01	93.16	0.006572	1.87	8.65	31.82	0.68	24.86
2101	12033	50yr_ Ex	CVC	11.90	91.95	93.06	93.05	93.21	0.006099	1.88	10.33	32.11	0.67	28.53
2101	12033	50yr_ Ex	AMCAI	11.90	91.95	93.06	93.05	93.21	0.006099	1.88	10.33	32.11	0.67	28.50
2101	12033	100yr_ Ex	CVC	13.60	91.95	93.13		93.26	0.005253	1.84	12.42	32.46	0.63	33.01
2101	12033	100yr_ Ex	AMCAI	13.60	91.95	93.13		93.26	0.005249	1.84	12.42	32.46	0.63	32.91
2101	12033	Reg_ Ex	CVC	32.00	91.95	93.81		93.87	0.001693	1.53	35.66	36.41	0.39	77.94
2101	12033	Reg_ Ex	AMCAI	32.00	91.95	93.81		93.88	0.001650	1.51	35.98	36.47	0.39	76.40
2101	12033	2yr_ Fut	CVC	4.70	91.95	92.67	92.61	92.84	0.012209	1.85	2.54	5.41	0.86	17.92
2101	12033	2yr_ Fut	AMCAI	4.70	91.95	92.67	92.62	92.84	0.012209	1.85	2.54	5.41	0.86	17.93
2101	12033	5yr_ Fut	CVC	7.00	91.95	92.83	92.78	93.03	0.011074	2.02	3.67	12.91	0.85	22.93
2101	12033	5yr_ Fut	AMCAI	7.00	91.95	92.83	92.78	93.03	0.011074	2.02	3.67	12.91	0.85	22.99
2101	12033	10yr_ Fut	CVC	9.10	91.95	92.98	92.98	93.12	0.006658	1.82	7.51	31.63	0.68	28.17
2101	12033	10yr_ Fut	AMCAI	9.10	91.95	92.97	92.97	93.12	0.006742	1.83	7.46	31.62	0.69	28.16
2101	12033	25yr_ Fut	CVC	11.00	91.95	93.03	93.03	93.18	0.006551	1.90	9.26	31.93	0.69	32.56
2101	12033	25yr_ Fut	AMCAI	11.00	91.95	93.03	93.03	93.18	0.006570	1.90	9.25	31.92	0.69	32.53
2101	12033	50yr_ Fut	CVC	12.60	91.95	93.09	93.06	93.23	0.005683	1.86	11.23	32.26	0.65	37.65
2101	12033	50yr_ Fut	AMCAI	12.60	91.95	93.09	93.06	93.23	0.005682	1.86	11.23	32.26	0.65	37.56
2101	12033	100yr_ Fut	CVC	14.40	91.95	93.17		93.28	0.004664	1.78	13.68	32.67	0.59	43.41
2101	12033	100yr_ Fut	AMCAI	14.40	91.95	93.17		93.28	0.004658	1.78	13.69	32.67	0.59	43.21
2101	12033	Reg_ Fut	CVC	32.10	91.									

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11998	25yr_Ex	AMCAI	10.30	91.19	92.99		93.04	0.001268	1.06	14.80	29.38	0.31	24.46
2101	11998	50yr_Ex	CVC	11.90	91.19	93.04	92.39	93.09	0.001361	1.13	16.31	29.70	0.33	28.07
2101	11998	50yr_Ex	AMCAI	11.90	91.19	93.04		93.09	0.001361	1.13	16.31	29.70	0.33	28.04
2101	11998	100yr_Ex	CVC	13.60	91.19	93.09		93.15	0.001433	1.19	17.89	30.03	0.34	32.49
2101	11998	100yr_Ex	AMCAI	13.60	91.19	93.09		93.15	0.001432	1.19	17.89	30.03	0.34	32.39
2101	11998	Reg_Ex	CVC	32.00	91.19	93.77		93.82	0.001003	1.32	39.59	34.22	0.30	76.64
2101	11998	Reg_Ex	AMCAI	32.00	91.19	93.78		93.83	0.000980	1.31	39.92	34.28	0.30	75.09
2101	11998	2yr_Fut	CVC	4.70	91.19	92.67		92.71	0.001181	0.83	6.01	21.81	0.29	17.77
2101	11998	2yr_Fut	AMCAI	4.70	91.19	92.67		92.71	0.001181	0.83	6.01	21.81	0.29	17.78
2101	11998	5yr_Fut	CVC	7.00	91.19	92.86		92.89	0.001076	0.90	10.98	28.46	0.28	22.68
2101	11998	5yr_Fut	AMCAI	7.00	91.19	92.86		92.89	0.001076	0.90	10.98	28.46	0.28	22.74
2101	11998	10yr_Fut	CVC	9.10	91.19	92.95	92.33	92.99	0.001193	1.00	13.57	29.12	0.30	27.81
2101	11998	10yr_Fut	AMCAI	9.10	91.19	92.95	92.33	92.99	0.001193	1.00	13.57	29.12	0.30	27.80
2101	11998	25yr_Fut	CVC	11.00	91.19	93.01		93.06	0.001309	1.09	15.48	29.53	0.32	32.13
2101	11998	25yr_Fut	AMCAI	11.00	91.19	93.01		93.06	0.001309	1.09	15.48	29.53	0.32	32.11
2101	11998	50yr_Fut	CVC	12.60	91.19	93.06		93.12	0.001390	1.15	16.98	29.84	0.33	37.16
2101	11998	50yr_Fut	AMCAI	12.60	91.19	93.06		93.12	0.001390	1.15	16.98	29.84	0.33	37.07
2101	11998	100yr_Fut	CVC	14.40	91.19	93.13		93.18	0.001394	1.19	18.97	30.25	0.33	42.85
2101	11998	100yr_Fut	AMCAI	14.40	91.19	93.13		93.18	0.001393	1.19	18.98	30.25	0.33	42.65
2101	11998	Reg_Fut	CVC	32.10	91.19	93.78		93.83	0.000988	1.31	39.90	34.28	0.30	78.91
2101	11998	Reg_Fut	AMCAI	32.10	91.19	93.79		93.84	0.000966	1.30	40.23	34.34	0.30	77.35
2101	11981	2yr_Ex	CVC	4.40	91.21	92.61		92.65	0.001398	0.88	5.00	7.24	0.31	14.12
2101	11981	2yr_Ex	AMCAI	4.40	91.21	92.61		92.65	0.001398	0.88	5.00	7.24	0.31	14.12
2101	11981	5yr_Ex	CVC	6.50	91.21	92.79		92.84	0.001406	1.00	8.64	27.07	0.32	17.80
2101	11981	5yr_Ex	AMCAI	6.50	91.21	92.79		92.84	0.001406	1.00	8.64	27.07	0.32	17.80
2101	11981	10yr_Ex	CVC	8.50	91.21	92.89		92.94	0.001531	1.11	11.24	27.67	0.33	21.13
2101	11981	10yr_Ex	AMCAI	8.50	91.21	92.89		92.94	0.001531	1.11	11.24	27.67	0.33	21.19
2101	11981	25yr_Ex	CVC	10.30	91.21	92.95		93.01	0.001718	1.21	12.88	28.05	0.36	24.23
2101	11981	25yr_Ex	AMCAI	10.30	91.21	92.95		93.01	0.001718	1.21	12.88	28.05	0.36	24.22
2101	11981	50yr_Ex	CVC	11.90	91.21	92.99		93.06	0.001862	1.30	14.21	28.36	0.37	27.81
2101	11981	50yr_Ex	AMCAI	11.90	91.21	92.99		93.06	0.001862	1.30	14.21	28.36	0.37	27.78
2101	11981	100yr_Ex	CVC	13.60	91.21	93.04		93.12	0.001966	1.37	15.65	28.68	0.39	32.21
2101	11981	100yr_Ex	AMCAI	13.60	91.21	93.04		93.12	0.001964	1.37	15.65	28.68	0.39	32.11
2101	11981	Reg_Ex	CVC	32.00	91.21	93.74		93.81	0.001200	1.43	37.22	33.15	0.33	76.00
2101	11981	Reg_Ex	AMCAI	32.00	91.21	93.75		93.81	0.001171	1.42	37.57	33.21	0.32	74.45
2101	11981	2yr_Fut	CVC	4.70	91.21	92.64		92.68	0.001428	0.91	5.25	9.38	0.31	17.67
2101	11981	2yr_Fut	AMCAI	4.70	91.21	92.64		92.68	0.001428	0.91	5.25	9.38	0.31	17.68
2101	11981	5yr_Fut	CVC	7.00	91.21	92.82		92.87	0.001406	1.02	9.48	27.26	0.32	22.50
2101	11981	5yr_Fut	AMCAI	7.00	91.21	92.82		92.87	0.001406	1.02	9.48	27.27	0.32	22.56
2101	11981	10yr_Fut	CVC	9.10	91.21	92.91		92.96	0.001598	1.15	11.80	27.80	0.34	27.59
2101	11981	10yr_Fut	AMCAI	9.10	91.21	92.91		92.96	0.001598	1.15	11.80	27.80	0.34	27.58
2101	11981	25yr_Fut	CVC	11.00	91.21	92.97		93.03	0.001781	1.25	13.48	28.19	0.36	31.89
2101	11981	25yr_Fut	AMCAI	11.00	91.21	92.97		93.03	0.001781	1.25	13.48	28.19	0.36	31.86
2101	11981	50yr_Fut	CVC	12.60	91.21	93.02		93.09	0.001904	1.33	14.82	28.49	0.38	36.90
2101	11981	50yr_Fut	AMCAI	12.60	91.21	93.02		93.09	0.001904	1.33	14.82	28.49	0.38	36.80
2101	11981	100yr_Fut	CVC	14.40	91.21	93.08		93.16	0.001883	1.37	16.76	28.93	0.38	42.55
2101	11981	100yr_Fut	AMCAI	14.40	91.21	93.08		93.16	0.001880	1.37	16.77	28.93	0.38	42.35
2101	11981	Reg_Fut	CVC	32.10	91.21	93.75		93.81	0.001181	1.42	37.54	33.21	0.32	78.27
2101	11981	Reg_Fut	AMCAI	32.10	91.21	93.76		93.82	0.001152	1.41	37.88	33.27	0.32	76.71
2101	11970	2yr_Ex	CVC	4.40	91.70	92.48		92.61	0.008321	1.60	2.75	5.40	0.72	14.08
2101	11970	2yr_Ex	AMCAI	4.40	91.70	92.48		92.61	0.008321	1.60	2.75	5.40	0.72	14.08
2101	11970	5yr_Ex	CVC	6.50	91.70	92.65	92.50	92.80	0.007261	1.72	4.17	18.27	0.69	17.73
2101	11970	5yr_Ex	AMCAI	6.50	91.70	92.65	92.50	92.80	0.007261	1.72	4.17	18.27	0.69	17.73
2101	11970	10yr_Ex	CVC	8.50	91.70	92.77	92.74	92.91	0.005571	1.70	7.21	28.22	0.62	21.03
2101	11970	10yr_Ex	AMCAI	8.50	91.70	92.77	92.72	92.91	0.005570	1.70	7.22	28.22	0.62	21.09
2101	11970	25yr_Ex	CVC	10.30	91.70	92.86		92.97	0.004757	1.68	9.55	28.74	0.59	24.11
2101	11970	25yr_Ex	AMCAI	10.30	91.70	92.86		92.97	0.004758	1.68	9.55	28.74	0.59	24.11
2101	11970	50yr_Ex	CVC	11.90	91.70	92.91		93.03	0.004465	1.70	11.22	29.11	0.58	27.68
2101	11970	50yr_Ex	AMCAI	11.90	91.70	92.91		93.03	0.004463	1.70	11.22	29.11	0.58	27.64
2101	11970	100yr_Ex	CVC	13.60	91.70	92.98		93.09	0.004095	1.70	13.05	29.51	0.56	32.06
2101	11970	100yr_Ex	AMCAI	13.60	91.70	92.98		93.09	0.004086	1.70	13.06	29.51	0.56	31.96
2101	11970	Reg_Ex	CVC	32.00	91.70	93.73		93.79	0.001358	1.45	37.11	34.33	0.35	75.61
2101	11970	Reg_Ex	AMCAI	32.00	91.70	93.74		93.80	0.001320	1.43	37.47	34.39	0.35	74.05
2101	11970	2yr_Fut	CVC	4.70	91.70	92.51		92.64	0.008012	1.61	2.93	5.55	0.71	17.63
2101	11970	2yr_Fut	AMCAI	4.70	91.70	92.51		92.64	0.008012	1.61	2.93	5.55	0.71	17.64
2101	11970	5yr_Fut	CVC	7.00	91.70	92.69	92.53	92.83	0.006855	1.73	4.85	22.79	0.68	22.43
2101	11970	5yr_Fut	AMCAI	7.00	91.70	92.69	92.54	92.83	0.006855	1.73	4.85	22.79	0.68	22.49
2101	11970	10yr_Fut	CVC	9.10	91.70	92.80	92.76	92.93	0.005219	1.69	8.06	28.41	0.61	27.49
2101	11970	10yr_Fut	AMCAI	9.10	91.70	92.80	92.76	92.93	0.005219	1.69	8.06	28.41	0.61	27.48
2101	11970	25yr_Fut	CVC	11.00	91.70	92.88		93.00	0.004580	1.68	10.34	28.92	0.58	31.76
2101	11970	25yr_Fut	AMCAI	11.00	91.70	92.88		93.00	0.004579	1.68	10.34	28.92	0.58	31.74
2101	11970	50yr_Fut	CVC	12.60	91.70	92.94		93.05	0.004261	1.70	12.03	29.29	0.56	36.76
2101	11970	50yr_Fut	AMCAI	12.60	91.70	92.94		93.05	0.004258	1.70	12.04	29.29	0.56	36.66
2101	11970	100yr_Fut	CVC	14.40	91.70	93.03		93.13	0.003434	1.62	14.68	29.86	0.51	42.38
2101	11970	100yr_Fut	AMCAI	14.40	91.70	93.03		93.13	0.003425	1.62	14.70	29.86	0.51	42.18
2101	11970	Reg_Fut	CVC	32.10	91.70	93.74		93.80	0.001332	1.44	37.44	34.39	0.35	77.87
2101	11970	Reg_Fut	AMCAI	32.10	91.70	93.75		93.81	0.001296	1.42	37.81	34.45	0.35	76.30
2101	11915	2yr_Ex	CVC	4.40	91.06	92.40		92.43	0.001343	0.86	5.12	6.69	0.30	13.86
2101	11915	2yr_Ex	AMCAI	4.40	91.06	92.40		92.43	0.001343	0.86	5.12	6.69	0.30	13.86
2101	11915	5yr_Ex	CVC	6.50	91.06	92.57		92.62	0.001479	1.02	7.57	22.04	0.33	17.41
2101	11915	5yr_Ex	AMCAI	6.50	91.06	92.57		92.62	0.001479	1.02	7.57	22.05	0.33	17.41
2101	11915	10yr_Ex	CVC	8.50	91.06	92.68		92.74	0.001577	1.13	10.55	31.41	0.34	20.55
2101	11915	10yr_Ex	AMCAI	8.50	91.06	92.68		92.74	0.001577	1.13	10.56	31.41	0.34	20.60
2101	11915	25yr_Ex	CVC	10.30	91.06									

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11915	2yr_Fut	CVC	4.70	91.06	92.43		92.47	0.001341	0.88	5.39	9.69	0.30	17.40
2101	11915	2yr_Fut	AMCAI	4.70	91.06	92.43		92.47	0.001341	0.88	5.39	9.69	0.30	17.41
2101	11915	5yr_Fut	CVC	7.00	91.06	92.60		92.65	0.001502	1.05	8.31	24.91	0.33	22.07
2101	11915	5yr_Fut	AMCAI	7.00	91.06	92.60		92.65	0.001502	1.05	8.31	24.91	0.33	22.13
2101	11915	10yr_Fut	CVC	9.10	91.06	92.70		92.76	0.001599	1.16	11.38	31.68	0.35	26.95
2101	11915	10yr_Fut	AMCAI	9.10	91.06	92.70		92.76	0.001599	1.16	11.38	31.68	0.35	26.95
2101	11915	25yr_Fut	CVC	11.00	91.06	92.78		92.84	0.001680	1.24	13.69	32.46	0.36	31.10
2101	11915	25yr_Fut	AMCAI	11.00	91.06	92.78		92.84	0.001680	1.24	13.69	32.46	0.36	31.08
2101	11915	50yr_Fut	CVC	12.60	91.06	92.83		92.90	0.001735	1.29	15.46	33.11	0.37	36.00
2101	11915	50yr_Fut	AMCAI	12.60	91.06	92.83		92.90	0.001733	1.29	15.47	33.11	0.37	35.90
2101	11915	100yr_Fut	CVC	14.40	91.06	92.94		93.00	0.001417	1.24	19.25	34.38	0.34	41.45
2101	11915	100yr_Fut	AMCAI	14.40	91.06	92.94		93.00	0.001412	1.24	19.28	34.39	0.34	41.25
2101	11915	Reg_Fut	CVC	32.10	91.06	93.70		93.74	0.000711	1.18	49.69	54.10	0.26	75.47
2101	11915	Reg_Fut	AMCAI	32.10	91.06	93.72		93.75	0.000668	1.14	48.49	40.50	0.25	73.92
2101	11902	2yr_Ex	CVC	4.40	90.96	92.39		92.42	0.000980	0.76	5.79	8.62	0.26	13.79
2101	11902	2yr_Ex	AMCAI	4.40	90.96	92.39		92.42	0.000980	0.76	5.79	8.62	0.26	13.79
2101	11902	5yr_Ex	CVC	6.50	90.96	92.56		92.60	0.001114	0.91	8.51	23.78	0.29	17.31
2101	11902	5yr_Ex	AMCAI	6.50	90.96	92.56		92.60	0.001114	0.91	8.51	23.76	0.29	17.31
2101	11902	10yr_Ex	CVC	8.50	90.96	92.67		92.72	0.001206	1.02	11.70	32.68	0.30	20.41
2101	11902	10yr_Ex	AMCAI	8.50	90.96	92.67		92.72	0.001206	1.02	11.70	32.67	0.30	20.47
2101	11902	25yr_Ex	CVC	10.30	90.96	92.74		92.79	0.001282	1.09	14.11	33.47	0.32	23.33
2101	11902	25yr_Ex	AMCAI	10.30	90.96	92.74		92.79	0.001283	1.09	14.10	33.46	0.32	23.33
2101	11902	50yr_Ex	CVC	11.90	90.96	92.79		92.85	0.001399	1.17	15.71	34.31	0.33	26.79
2101	11902	50yr_Ex	AMCAI	11.90	90.96	92.79		92.85	0.001399	1.17	15.71	34.32	0.33	26.76
2101	11902	100yr_Ex	CVC	13.60	90.96	92.85		92.91	0.001404	1.21	17.92	35.46	0.33	31.04
2101	11902	100yr_Ex	AMCAI	13.60	90.96	92.85		92.91	0.001399	1.21	17.95	35.47	0.33	30.94
2101	11902	Reg_Ex	CVC	32.00	90.96	93.69		93.72	0.000590	1.09	53.33	52.63	0.24	72.64
2101	11902	Reg_Ex	AMCAI	32.00	90.96	93.70		93.73	0.000579	1.08	50.81	41.47	0.23	71.12
2101	11902	2yr_Fut	CVC	4.70	90.96	92.42		92.45	0.000991	0.78	6.12	11.30	0.26	17.32
2101	11902	2yr_Fut	AMCAI	4.70	90.96	92.42		92.45	0.000991	0.78	6.12	11.30	0.26	17.34
2101	11902	5yr_Fut	CVC	7.00	90.96	92.59		92.63	0.001137	0.94	9.31	26.83	0.29	21.96
2101	11902	5yr_Fut	AMCAI	7.00	90.96	92.59		92.63	0.001137	0.94	9.31	26.81	0.29	22.02
2101	11902	10yr_Fut	CVC	9.10	90.96	92.69		92.74	0.001232	1.04	12.55	32.96	0.31	26.81
2101	11902	10yr_Fut	AMCAI	9.10	90.96	92.69		92.74	0.001232	1.04	12.55	32.95	0.31	26.80
2101	11902	25yr_Fut	CVC	11.00	90.96	92.76		92.82	0.001320	1.12	14.91	33.90	0.32	30.93
2101	11902	25yr_Fut	AMCAI	11.00	90.96	92.76		92.82	0.001320	1.12	14.91	33.90	0.32	30.91
2101	11902	50yr_Fut	CVC	12.60	90.96	92.82		92.88	0.001383	1.18	16.74	34.85	0.33	35.81
2101	11902	50yr_Fut	AMCAI	12.60	90.96	92.82		92.88	0.001382	1.18	16.75	34.86	0.33	35.71
2101	11902	100yr_Fut	CVC	14.40	90.96	92.93		92.98	0.001141	1.13	20.84	36.60	0.30	41.21
2101	11902	100yr_Fut	AMCAI	14.40	90.96	92.93		92.98	0.001137	1.13	20.86	36.56	0.30	41.01
2101	11902	Reg_Fut	CVC	32.10	90.96	93.70		93.73	0.000578	1.08	53.89	52.82	0.23	74.87
2101	11902	Reg_Fut	AMCAI	32.10	90.96	93.71		93.74	0.000569	1.07	51.24	41.54	0.23	73.35
2101	11895	2yr_Ex	CVC	4.40	91.46	92.28		92.39	0.007352	1.51	2.91	5.70	0.68	13.76
2101	11895	2yr_Ex	AMCAI	4.40	91.46	92.28		92.39	0.007352	1.51	2.91	5.70	0.68	13.76
2101	11895	5yr_Ex	CVC	6.50	91.46	92.43	92.27	92.57	0.006700	1.69	4.21	14.21	0.67	17.26
2101	11895	5yr_Ex	AMCAI	6.50	91.46	92.43	92.27	92.57	0.006700	1.69	4.21	14.21	0.67	17.26
2101	11895	10yr_Ex	CVC	8.50	91.46	92.53	92.42	92.69	0.006191	1.80	6.21	23.62	0.66	20.35
2101	11895	10yr_Ex	AMCAI	8.50	91.46	92.53	92.42	92.69	0.006184	1.80	6.22	23.64	0.66	20.40
2101	11895	25yr_Ex	CVC	10.30	91.46	92.61	92.55	92.77	0.005831	1.86	8.26	30.56	0.65	23.25
2101	11895	25yr_Ex	AMCAI	10.30	91.46	92.61	92.55	92.77	0.005858	1.86	8.23	30.49	0.65	23.24
2101	11895	50yr_Ex	CVC	11.90	91.46	92.68	92.65	92.82	0.005042	1.82	10.59	34.12	0.61	26.69
2101	11895	50yr_Ex	AMCAI	11.90	91.46	92.68	92.61	92.82	0.004996	1.82	10.64	34.14	0.61	26.66
2101	11895	100yr_Ex	CVC	13.60	91.46	92.80		92.89	0.003328	1.61	14.66	35.93	0.51	30.92
2101	11895	100yr_Ex	AMCAI	13.60	91.46	92.80		92.89	0.003300	1.60	14.71	35.94	0.51	30.81
2101	11895	Reg_Ex	CVC	32.00	91.46	93.68		93.72	0.000686	1.11	54.18	55.21	0.26	72.23
2101	11895	Reg_Ex	AMCAI	32.00	91.46	93.70		93.73	0.000700	1.13	49.66	41.68	0.26	70.74
2101	11895	2yr_Fut	CVC	4.70	91.46	92.31		92.43	0.006820	1.51	3.12	6.07	0.66	17.29
2101	11895	2yr_Fut	AMCAI	4.70	91.46	92.31		92.43	0.006820	1.51	3.12	6.07	0.66	17.31
2101	11895	5yr_Fut	CVC	7.00	91.46	92.46	92.30	92.61	0.006549	1.72	4.67	16.84	0.67	21.91
2101	11895	5yr_Fut	AMCAI	7.00	91.46	92.46	92.30	92.61	0.006549	1.72	4.67	16.84	0.67	21.96
2101	11895	10yr_Fut	CVC	9.10	91.46	92.56	92.48	92.72	0.006185	1.83	6.79	25.73	0.66	26.74
2101	11895	10yr_Fut	AMCAI	9.10	91.46	92.56	92.48	92.72	0.006184	1.83	6.79	25.73	0.66	26.73
2101	11895	25yr_Fut	CVC	11.00	91.46	92.65	92.58	92.79	0.005156	1.81	9.63	33.57	0.62	30.84
2101	11895	25yr_Fut	AMCAI	11.00	91.46	92.65	92.59	92.79	0.005144	1.80	9.64	33.58	0.62	30.81
2101	11895	50yr_Fut	CVC	12.60	91.46	92.75		92.86	0.003729	1.65	13.00	35.43	0.54	35.70
2101	11895	50yr_Fut	AMCAI	12.60	91.46	92.75		92.86	0.003712	1.65	13.03	35.44	0.53	35.60
2101	11895	100yr_Fut	CVC	14.40	91.46	92.91		92.97	0.002099	1.37	18.65	36.86	0.41	41.06
2101	11895	100yr_Fut	AMCAI	14.40	91.46	92.91		92.97	0.002086	1.36	18.69	36.81	0.41	40.86
2101	11895	Reg_Fut	CVC	32.10	91.46	93.70		93.73	0.000670	1.10	54.78	55.39	0.25	74.45
2101	11895	Reg_Fut	AMCAI	32.10	91.46	93.71		93.74	0.000687	1.12	50.10	41.75	0.26	72.97
2101	11856	2yr_Ex	CVC	4.40	90.94	92.23		92.27	0.001339	0.87	5.18	10.34	0.30	13.60
2101	11856	2yr_Ex	AMCAI	4.40	90.94	92.23		92.27	0.001339	0.87	5.18	10.34	0.30	13.60
2101	11856	5yr_Ex	CVC	6.50	90.94	92.38		92.43	0.001539	1.04	7.67	22.09	0.33	17.03
2101	11856	5yr_Ex	AMCAI	6.50	90.94	92.38		92.43	0.001539	1.04	7.67	22.09	0.33	17.03
2101	11856	10yr_Ex	CVC	8.50	90.94	92.48		92.55	0.001690	1.17	10.38	30.91	0.36	20.02
2101	11856	10yr_Ex	AMCAI	8.50	90.94	92.48		92.55	0.001688	1.17	10.39	30.93	0.36	20.07
2101	11856	25yr_Ex	CVC	10.30	90.94	92.55		92.62	0.001791	1.25	12.73	34.24	0.37	22.83
2101	11856	25yr_Ex	AMCAI	10.30	90.94	92.55		92.62	0.001801	1.25	12.68	34.22	0.37	22.83
2101	11856	50yr_Ex	CVC	11.90	90.94	92.62		92.69	0.001746	1.28	15.09	35.59	0.37	26.19
2101	11856	50yr_Ex	AMCAI	11.90	90.94	92.62		92.69	0.001730	1.28	15.16	35.64	0.37	26.15
2101	11856	100yr_Ex	CVC	13.60	90.94	92.75		92.80	0.001313	1.19	19.76	38.10	0.32	30.24
2101	11856	100yr_Ex	AMCAI	13.60	90.94	92.75		92.80	0.001284	1.18	19.80	36.74	0.32	30.13
2101	11856	Reg_Ex	CVC	32.00	90.94	93.67		93.69	0.000372	0.89	69.42	61.63	0.19	69.79
2101	11856	Reg_Ex	AMCAI	32.00	90.94	93.68		93.71						

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11856	25yr_Fut	AMCAI	11.00	90.94	92.60		92.66	0.001641	1.23	14.35	35.18	0.36	30.34
2101	11856	50yr_Fut	CVC	12.60	90.94	92.70		92.76	0.001375	1.19	17.99	37.17	0.33	35.09
2101	11856	50yr_Fut	AMCAI	12.60	90.94	92.70		92.76	0.001356	1.18	18.04	36.41	0.33	34.99
2101	11856	100yr_Fut	CVC	14.40	90.94	92.87		92.91	0.000921	1.05	25.28	47.80	0.28	40.20
2101	11856	100yr_Fut	AMCAI	14.40	90.94	92.87		92.91	0.000881	1.03	24.38	37.60	0.27	40.01
2101	11856	Reg_Fut	CVC	32.10	90.94	93.68		93.70	0.000364	0.89	70.11	61.79	0.19	71.99
2101	11856	Reg_Fut	AMCAI	32.10	90.94	93.69		93.72	0.000448	0.98	57.34	43.27	0.21	70.85
2101	11838	2yr_Ex	CVC	4.40	90.95	92.20		92.24	0.001536	0.93	4.95	11.28	0.32	13.51
2101	11838	2yr_Ex	AMCAI	4.40	90.95	92.20	91.64	92.24	0.001536	0.93	4.95	11.28	0.32	13.51
2101	11838	5yr_Ex	CVC	6.50	90.95	92.35		92.40	0.001746	1.10	7.60	24.07	0.35	16.90
2101	11838	5yr_Ex	AMCAI	6.50	90.95	92.35	91.80	92.40	0.001746	1.10	7.60	24.07	0.35	16.90
2101	11838	10yr_Ex	CVC	8.50	90.95	92.45		92.51	0.001869	1.22	10.45	31.73	0.37	19.84
2101	11838	10yr_Ex	AMCAI	8.50	90.95	92.45	91.94	92.51	0.001866	1.22	10.46	31.75	0.37	19.90
2101	11838	25yr_Ex	CVC	10.30	90.95	92.52		92.59	0.001957	1.30	12.76	34.32	0.38	22.62
2101	11838	25yr_Ex	AMCAI	10.30	90.95	92.52	92.04	92.59	0.001972	1.30	12.70	34.26	0.39	22.62
2101	11838	50yr_Ex	CVC	11.90	90.95	92.59		92.66	0.001843	1.31	15.28	35.37	0.38	25.93
2101	11838	50yr_Ex	AMCAI	11.90	90.95	92.59	92.13	92.66	0.001822	1.30	15.37	35.50	0.38	25.90
2101	11838	100yr_Ex	CVC	13.60	90.95	92.73		92.78	0.001274	1.17	21.05	46.92	0.32	29.90
2101	11838	100yr_Ex	AMCAI	13.60	90.95	92.73	92.32	92.78	0.001274	1.17	20.38	36.52	0.32	29.80
2101	11838	Reg_Ex	CVC	32.00	90.95	93.67		93.69	0.000331	0.85	74.44	64.54	0.18	68.64
2101	11838	Reg_Ex	AMCAI	32.00	90.95	93.67	92.74	93.70	0.000439	0.97	57.57	41.67	0.20	67.70
2101	11838	2yr_Fut	CVC	4.70	90.95	92.24		92.28	0.001472	0.94	5.49	14.76	0.32	17.02
2101	11838	2yr_Fut	AMCAI	4.70	90.95	92.24	91.67	92.28	0.001472	0.94	5.49	14.76	0.32	17.04
2101	11838	5yr_Fut	CVC	7.00	90.95	92.38		92.44	0.001772	1.13	8.34	26.42	0.36	21.51
2101	11838	5yr_Fut	AMCAI	7.00	90.95	92.38	91.84	92.44	0.001772	1.13	8.34	26.42	0.36	21.57
2101	11838	10yr_Fut	CVC	9.10	90.95	92.47		92.54	0.001968	1.26	11.01	32.44	0.38	26.20
2101	11838	10yr_Fut	AMCAI	9.10	90.95	92.47	91.97	92.54	0.001967	1.26	11.01	32.44	0.38	26.19
2101	11838	25yr_Fut	CVC	11.00	90.95	92.57		92.63	0.001725	1.25	14.61	35.17	0.36	30.13
2101	11838	25yr_Fut	AMCAI	11.00	90.95	92.57	92.08	92.64	0.001721	1.25	14.63	35.25	0.36	30.10
2101	11838	50yr_Fut	CVC	12.60	90.95	92.68		92.73	0.001361	1.18	18.84	42.54	0.33	34.78
2101	11838	50yr_Fut	AMCAI	12.60	90.95	92.68	92.19	92.73	0.001356	1.18	18.57	36.17	0.33	34.69
2101	11838	100yr_Fut	CVC	14.40	90.95	92.86		92.89	0.000850	1.02	27.46	50.70	0.26	39.76
2101	11838	100yr_Fut	AMCAI	14.40	90.95	92.86	92.37	92.90	0.000851	1.02	25.20	37.45	0.26	39.61
2101	11838	Reg_Fut	CVC	32.10	90.95	93.68		93.70	0.000324	0.84	75.17	64.73	0.18	70.83
2101	11838	Reg_Fut	AMCAI	32.10	90.95	93.68	92.75	93.71	0.000432	0.97	58.03	41.71	0.20	69.91
2101	11832	2yr_Ex	CVC	4.40	91.28	92.13		92.22	0.005282	1.34	3.33	8.05	0.58	13.49
2101	11832	2yr_Ex	AMCAI	4.40	91.28	92.13	91.92	92.22	0.005282	1.34	3.33	8.05	0.58	13.49
2101	11832	5yr_Ex	CVC	6.50	91.28	92.28		92.38	0.004517	1.47	5.68	22.78	0.56	16.86
2101	11832	5yr_Ex	AMCAI	6.50	91.28	92.28	92.07	92.38	0.004517	1.47	5.68	22.78	0.56	16.85
2101	11832	10yr_Ex	CVC	8.50	91.28	92.41		92.50	0.003368	1.42	9.29	30.18	0.50	19.78
2101	11832	10yr_Ex	AMCAI	8.50	91.28	92.41	92.23	92.50	0.003358	1.42	9.31	30.20	0.50	19.83
2101	11832	25yr_Ex	CVC	10.30	91.28	92.49		92.57	0.003115	1.45	11.75	34.19	0.48	22.54
2101	11832	25yr_Ex	AMCAI	10.30	91.28	92.49	92.35	92.57	0.003152	1.46	11.68	33.21	0.49	22.54
2101	11832	50yr_Ex	CVC	11.90	91.28	92.57		92.64	0.002601	1.40	14.89	41.44	0.45	25.84
2101	11832	50yr_Ex	AMCAI	11.90	91.28	92.58	92.40	92.65	0.002528	1.39	14.74	35.00	0.44	25.80
2101	11832	100yr_Ex	CVC	13.60	91.28	92.72		92.77	0.001559	1.19	21.55	47.70	0.36	29.77
2101	11832	100yr_Ex	AMCAI	13.60	91.28	92.72	92.44	92.77	0.001560	1.19	20.00	36.19	0.36	29.68
2101	11832	Reg_Ex	CVC	32.00	91.28	93.67		93.68	0.000320	0.81	76.58	65.71	0.18	68.17
2101	11832	Reg_Ex	AMCAI	32.00	91.28	93.67	92.74	93.69	0.000455	0.96	57.52	42.27	0.21	67.35
2101	11832	2yr_Fut	CVC	4.70	91.28	92.18		92.26	0.004461	1.31	3.84	12.64	0.54	16.99
2101	11832	2yr_Fut	AMCAI	4.70	91.28	92.18	91.94	92.26	0.004461	1.31	3.84	12.64	0.54	17.01
2101	11832	5yr_Fut	CVC	7.00	91.28	92.32		92.42	0.004216	1.46	6.55	26.43	0.54	21.46
2101	11832	5yr_Fut	AMCAI	7.00	91.28	92.32	92.10	92.42	0.004216	1.46	6.55	26.43	0.54	21.52
2101	11832	10yr_Fut	CVC	9.10	91.28	92.43		92.52	0.003503	1.47	9.77	30.79	0.51	26.14
2101	11832	10yr_Fut	AMCAI	9.10	91.28	92.43	92.28	92.52	0.003501	1.47	9.78	30.79	0.51	26.13
2101	11832	25yr_Fut	CVC	11.00	91.28	92.55		92.62	0.002459	1.35	14.15	39.84	0.44	30.04
2101	11832	25yr_Fut	AMCAI	11.00	91.28	92.56	92.38	92.62	0.002429	1.34	14.01	34.83	0.43	30.01
2101	11832	50yr_Fut	CVC	12.60	91.28	92.67		92.72	0.001749	1.23	19.14	46.19	0.37	34.66
2101	11832	50yr_Fut	AMCAI	12.60	91.28	92.67	92.42	92.72	0.001707	1.21	18.17	35.78	0.37	34.57
2101	11832	100yr_Fut	CVC	14.40	91.28	92.86		92.89	0.000915	0.98	28.24	50.85	0.28	39.59
2101	11832	100yr_Fut	AMCAI	14.40	91.28	92.86	92.46	92.89	0.000982	1.02	24.90	37.27	0.29	39.45
2101	11832	Reg_Fut	CVC	32.10	91.28	93.68		93.69	0.000313	0.80	77.32	65.94	0.18	70.36
2101	11832	Reg_Fut	AMCAI	32.10	91.28	93.68	92.74	93.71	0.000447	0.96	57.99	42.31	0.21	69.55
2101	11815	2yr_Ex	CVC	4.40	91.19	91.97		92.10	0.008695	1.62	2.72	5.60	0.73	13.44
2101	11815	2yr_Ex	AMCAI	4.40	91.19	91.97		92.10	0.008695	1.62	2.72	5.60	0.73	13.43
2101	11815	5yr_Ex	CVC	6.50	91.19	92.09		92.27	0.009019	1.90	3.69	11.31	0.77	16.78
2101	11815	5yr_Ex	AMCAI	6.50	91.19	92.09	92.00	92.27	0.009018	1.90	3.69	11.31	0.77	16.77
2101	11815	10yr_Ex	CVC	8.50	91.19	92.16		92.39	0.010342	2.18	4.60	15.31	0.84	19.66
2101	11815	10yr_Ex	AMCAI	8.50	91.19	92.16	92.16	92.39	0.010423	2.19	4.58	15.23	0.84	19.72
2101	11815	25yr_Ex	CVC	10.30	91.19	92.25		92.48	0.008666	2.18	6.38	21.05	0.79	22.39
2101	11815	25yr_Ex	AMCAI	10.30	91.19	92.26	92.26	92.48	0.008393	2.16	6.50	21.38	0.78	22.39
2101	11815	50yr_Ex	CVC	11.90	91.19	92.52		92.60	0.002648	1.47	14.93	41.75	0.46	25.59
2101	11815	50yr_Ex	AMCAI	11.90	91.19	92.52		92.60	0.002695	1.48	13.76	32.04	0.46	25.57
2101	11815	100yr_Ex	CVC	13.60	91.19	92.70		92.74	0.001339	1.16	22.75	45.76	0.33	29.40
2101	11815	100yr_Ex	AMCAI	13.60	91.19	92.69		92.74	0.001517	1.23	19.52	33.71	0.35	29.35
2101	11815	Reg_Ex	CVC	32.00	91.19	93.66		93.68	0.000311	0.82	79.73	71.71	0.18	66.89
2101	11815	Reg_Ex	AMCAI	32.00	91.19	93.66		93.69	0.000479	1.02	56.39	42.66	0.22	66.40
2101	11815	2yr_Fut	CVC	4.70	91.19	92.09		92.18	0.004727	1.37	3.69	11.28	0.56	16.93
2101	11815	2yr_Fut	AMCAI	4.70	91.19	92.09		92.18	0.004727	1.37	3.69	11.28	0.56	16.94
2101	11815	5yr_Fut	CVC	7.00	91.19	92.20		92.33	0.005349	1.64	5.39	18.06	0.61	21.36
2101	11815	5yr_Fut	AMCAI	7.00	91.19	92.20	92.04	92.33	0.005350	1.64	5.39	18.06	0.61	21.42
2101	11815	10yr_Fut	CVC	9.10	91.19	92.30		92.44	0.005198	1.76	7.45	24.20	0.62	25.99
2101	11815	10yr_Fut	AMCAI	9.10	91.19	92.30	92.20	92.44	0.005210	1.76	7.45</			



HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11802	2yr_ Ex	CVC	3.80	90.84	91.99		92.03	0.001682	0.88	4.30	6.25	0.33	13.39
2101	11802	2yr_ Ex	AMCAI	3.80	90.84	91.99		92.03	0.001682	0.88	4.30	6.25	0.33	13.39
2101	11802	5yr_ Ex	CVC	5.00	90.84	92.14		92.19	0.001448	0.93	6.10	15.88	0.32	16.71
2101	11802	5yr_ Ex	AMCAI	5.00	90.84	92.14		92.19	0.001448	0.93	6.10	15.81	0.32	16.71
2101	11802	10yr_ Ex	CVC	5.70	90.84	92.23	91.64	92.27	0.001266	0.93	7.75	21.62	0.30	19.59
2101	11802	10yr_ Ex	AMCAI	5.70	90.84	92.23	91.64	92.27	0.001264	0.93	7.73	21.02	0.30	19.64
2101	11802	25yr_ Ex	CVC	7.10	90.84	92.34		92.38	0.001221	0.96	10.50	29.92	0.30	22.28
2101	11802	25yr_ Ex	AMCAI	7.10	90.84	92.34	91.74	92.38	0.001213	0.96	10.30	27.05	0.30	22.28
2101	11802	50yr_ Ex	CVC	8.90	90.84	92.54		92.57	0.000763	0.87	18.03	42.12	0.25	25.38
2101	11802	50yr_ Ex	AMCAI	8.90	90.84	92.54		92.57	0.000782	0.88	16.84	35.46	0.25	25.37
2101	11802	100yr_ Ex	CVC	11.50	90.84	92.70		92.73	0.000628	0.86	25.31	47.60	0.23	29.09
2101	11802	100yr_ Ex	AMCAI	11.50	90.84	92.70		92.73	0.000668	0.88	22.63	36.64	0.24	29.08
2101	11802	Reg_ Ex	CVC	33.50	90.84	93.66		93.67	0.000277	0.80	86.02	77.84	0.17	65.81
2101	11802	Reg_ Ex	AMCAI	33.50	90.84	93.66		93.68	0.000407	0.97	61.06	43.79	0.20	65.65
2101	11802	2yr_ Fut	CVC	4.40	90.84	92.10		92.14	0.001378	0.88	5.43	13.50	0.31	16.87
2101	11802	2yr_ Fut	AMCAI	4.40	90.84	92.10		92.14	0.001379	0.88	5.42	13.46	0.31	16.89
2101	11802	5yr_ Fut	CVC	5.60	90.84	92.23		92.27	0.001211	0.91	7.80	21.78	0.30	21.28
2101	11802	5yr_ Fut	AMCAI	5.60	90.84	92.23		92.27	0.001208	0.91	7.78	21.14	0.30	21.34
2101	11802	10yr_ Fut	CVC	6.60	90.84	92.35		92.38	0.001027	0.90	10.68	30.38	0.28	25.88
2101	11802	10yr_ Fut	AMCAI	6.60	90.84	92.35		92.38	0.001021	0.90	10.46	27.38	0.28	25.87
2101	11802	25yr_ Fut	CVC	8.20	90.84	92.52		92.55	0.000698	0.82	17.36	41.74	0.24	29.60
2101	11802	25yr_ Fut	AMCAI	8.20	90.84	92.52		92.55	0.000713	0.83	16.27	35.34	0.24	29.59
2101	11802	50yr_ Fut	CVC	10.20	90.84	92.65		92.67	0.000609	0.82	22.94	45.54	0.22	34.06
2101	11802	50yr_ Fut	AMCAI	10.20	90.84	92.65		92.67	0.000642	0.84	20.79	36.27	0.23	34.03
2101	11802	100yr_ Fut	CVC	12.50	90.84	92.84		92.86	0.000418	0.74	32.37	50.68	0.19	38.71
2101	11802	100yr_ Fut	AMCAI	12.50	90.84	92.84		92.86	0.000469	0.79	27.93	37.68	0.20	38.70
2101	11802	Reg_ Fut	CVC	34.30	90.84	93.67		93.69	0.000283	0.81	86.86	77.98	0.17	67.98
2101	11802	Reg_ Fut	AMCAI	34.30	90.84	93.67		93.69	0.000418	0.98	61.52	43.88	0.20	67.83
2101	11793	2yr_ Ex	CVC	3.80	91.09	91.99	91.46	92.01	0.000497	0.54	7.03	13.03	0.19	13.33
2101	11793	2yr_ Ex	AMCAI	3.80	91.09	91.99	91.46	92.01	0.000497	0.54	7.03	13.03	0.19	13.33
2101	11793	5yr_ Ex	CVC	5.00	91.09	92.15	91.52	92.17	0.000472	0.59	8.42	13.41	0.20	16.63
2101	11793	5yr_ Ex	AMCAI	5.00	91.09	92.15	91.52	92.17	0.000472	0.59	8.42	13.41	0.20	16.63
2101	11793	10yr_ Ex	CVC	5.70	91.09	92.24	91.55	92.26	0.000455	0.62	9.21	14.23	0.19	19.49
2101	11793	10yr_ Ex	AMCAI	5.70	91.09	92.24	91.55	92.26	0.000455	0.62	9.21	14.23	0.19	19.54
2101	11793	25yr_ Ex	CVC	7.10	91.09	92.34	91.61	92.37	0.000511	0.70	10.15	15.54	0.21	22.17
2101	11793	25yr_ Ex	AMCAI	7.10	91.09	92.34	91.61	92.37	0.000511	0.70	10.15	15.54	0.21	22.17
2101	11793	50yr_ Ex	CVC	8.90	91.09	92.53	91.67	92.56	0.000479	0.75	11.85	47.17	0.21	25.19
2101	11793	50yr_ Ex	AMCAI	8.90	91.09	92.53	91.67	92.56	0.000479	0.75	11.85	47.17	0.21	25.19
2101	11793	100yr_ Ex	CVC	11.50	91.09	92.68	91.76	92.72	0.000565	0.87	13.15	84.14	0.23	28.82
2101	11793	100yr_ Ex	AMCAI	11.50	91.09	92.68	91.76	92.72	0.000565	0.87	13.15	84.14	0.23	28.82
2101	11793	Reg_ Ex	CVC	33.50	91.09	93.66	92.33	93.67	0.000121	0.55	109.02	178.57	0.12	64.53
2101	11793	Reg_ Ex	AMCAI	33.50	91.09	93.66	92.33	93.67	0.000121	0.55	109.03	178.57	0.12	64.49
2101	11793	2yr_ Fut	CVC	4.40	91.09	92.10	91.48	92.12	0.000433	0.55	8.00	13.29	0.19	16.80
2101	11793	2yr_ Fut	AMCAI	4.40	91.09	92.10	91.48	92.12	0.000433	0.55	8.00	13.29	0.19	16.81
2101	11793	5yr_ Fut	CVC	5.60	91.09	92.24	91.54	92.26	0.000436	0.61	9.23	14.25	0.19	21.18
2101	11793	5yr_ Fut	AMCAI	5.60	91.09	92.24	91.54	92.26	0.000436	0.61	9.23	14.25	0.19	21.24
2101	11793	10yr_ Fut	CVC	6.60	91.09	92.35	91.59	92.37	0.000435	0.65	10.19	15.61	0.19	25.76
2101	11793	10yr_ Fut	AMCAI	6.60	91.09	92.35	91.59	92.37	0.000435	0.65	10.19	15.61	0.19	25.75
2101	11793	25yr_ Fut	CVC	8.20	91.09	92.52	91.65	92.54	0.000422	0.70	11.72	46.26	0.20	29.42
2101	11793	25yr_ Fut	AMCAI	8.20	91.09	92.52	91.65	92.54	0.000422	0.70	11.72	46.26	0.20	29.42
2101	11793	50yr_ Fut	CVC	10.20	91.09	92.63	91.72	92.67	0.000491	0.80	12.76	77.84	0.21	33.81
2101	11793	50yr_ Fut	AMCAI	10.20	91.09	92.63	91.72	92.67	0.000492	0.80	12.76	77.75	0.21	33.79
2101	11793	100yr_ Fut	CVC	12.50	91.09	92.81	91.79	92.85	0.000499	0.87	14.35	113.27	0.22	38.34
2101	11793	100yr_ Fut	AMCAI	12.50	91.09	92.81	91.79	92.85	0.000498	0.87	14.35	113.38	0.22	38.35
2101	11793	Reg_ Fut	CVC	34.30	91.09	93.67	92.35	93.68	0.000124	0.56	109.92	178.59	0.12	66.68
2101	11793	Reg_ Fut	AMCAI	34.30	91.09	93.67	92.35	93.68	0.000124	0.56	109.91	178.59	0.12	66.67
2101	11783	5-WCB		Bridge										
2101	11773	2yr_ Ex	CVC	3.80	91.07	91.97	91.50	91.98	0.000592	0.53	7.17	11.58	0.21	13.22
2101	11773	2yr_ Ex	AMCAI	3.80	91.07	91.97	91.50	91.98	0.000592	0.53	7.17	11.58	0.21	13.22
2101	11773	5yr_ Ex	CVC	5.00	91.07	92.12	91.55	92.13	0.000535	0.57	8.75	14.26	0.20	16.51
2101	11773	5yr_ Ex	AMCAI	5.00	91.07	92.12	91.55	92.13	0.000535	0.57	8.75	14.26	0.20	16.51
2101	11773	10yr_ Ex	CVC	5.70	91.07	92.20	91.57	92.22	0.000506	0.59	9.64	16.74	0.20	19.36
2101	11773	10yr_ Ex	AMCAI	5.70	91.07	92.20	91.57	92.22	0.000506	0.59	9.64	16.74	0.20	19.41
2101	11773	25yr_ Ex	CVC	7.10	91.07	92.28	91.63	92.31	0.000580	0.68	10.57	18.87	0.22	22.03
2101	11773	25yr_ Ex	AMCAI	7.10	91.07	92.28	91.63	92.31	0.000580	0.68	10.57	18.87	0.22	22.03
2101	11773	50yr_ Ex	CVC	8.90	91.07	92.38	91.69	92.41	0.000672	0.77	11.60	21.46	0.24	25.04
2101	11773	50yr_ Ex	AMCAI	8.90	91.07	92.38	91.69	92.41	0.000672	0.77	11.60	21.46	0.24	25.04
2101	11773	100yr_ Ex	CVC	11.50	91.07	92.49	91.77	92.54	0.000799	0.90	12.85	25.37	0.26	28.66
2101	11773	100yr_ Ex	AMCAI	11.50	91.07	92.49	91.77	92.54	0.000799	0.90	12.85	25.37	0.26	28.66
2101	11773	Reg_ Ex	CVC	33.50	91.07	93.22	92.30	93.27	0.000624	1.06	62.44	128.03	0.25	63.84
2101	11773	Reg_ Ex	AMCAI	33.50	91.07	93.22	92.30	93.27	0.000624	1.06	62.45	128.04	0.25	63.79
2101	11773	2yr_ Fut	CVC	4.40	91.07	92.07	91.52	92.09	0.000490	0.53	8.31	13.15	0.19	16.68
2101	11773	2yr_ Fut	AMCAI	4.40	91.07	92.07	91.52	92.09	0.000490	0.53	8.31	13.15	0.19	16.69
2101	11773	5yr_ Fut	CVC	5.60	91.07	92.20	91.57	92.22	0.000482	0.58	9.68	16.82	0.19	21.05
2101	11773	5yr_ Fut	AMCAI	5.60	91.07	92.20	91.57	92.22	0.000482	0.58	9.68	16.82	0.19	21.11
2101	11773	10yr_ Fut	CVC	6.60	91.07	92.30	91.61	92.32	0.000478	0.62	10.72	19.22	0.20	25.62
2101	11773	10yr_ Fut	AMCAI	6.60	91.07	92.30	91.61	92.32	0.000478	0.62	10.72	19.22	0.20	25.61
2101	11773	25yr_ Fut	CVC	8.20	91.07	92.39	91.67	92.41	0.000554	0.71	11.70	21.72	0.21	29.27
2101	11773	25yr_ Fut	AMCAI	8.20	91.07	92.39	91.67	92.41	0.000554	0.71	11.70	21.72	0.21	29.27
2101	11773	50yr_ Fut	CVC	10.20	91.07	92.49	91.73	92.52	0.000633	0.80	12.83	25.28	0.23	33.66
2101	11773	50yr_ Fut	AMCAI	10.20	91.07	92.49	91.73	92.52	0.000634	0.80	12.82	25.26	0.23	33.64
2101	11773	100yr_ Fut	CVC	12.50	91.07	92.59	91.80	92.63	0.000736	0.91	13.86	28.71	0.25	38.18

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11750	10yr_Ex	CVC	5.70	90.96	92.16		92.20	0.000899	0.81	7.27	9.47	0.26	19.15
2101	11750	10yr_Ex	AMCAI	5.70	90.96	92.16		92.20	0.000899	0.81	7.27	9.47	0.26	19.20
2101	11750	25yr_Ex	CVC	7.10	90.96	92.24		92.28	0.001085	0.94	8.01	10.24	0.29	21.79
2101	11750	25yr_Ex	AMCAI	7.10	90.96	92.24		92.28	0.001085	0.94	8.01	10.24	0.29	21.79
2101	11750	50yr_Ex	CVC	8.90	90.96	92.32		92.38	0.001320	1.09	8.88	10.99	0.32	24.78
2101	11750	50yr_Ex	AMCAI	8.90	90.96	92.32		92.38	0.001320	1.09	8.88	10.99	0.32	24.77
2101	11750	100yr_Ex	CVC	11.50	90.96	92.41		92.50	0.001669	1.29	9.99	12.36	0.37	28.35
2101	11750	100yr_Ex	AMCAI	11.50	90.96	92.41		92.50	0.001669	1.29	9.99	12.36	0.37	28.35
2101	11750	Reg_Ex	CVC	33.50	90.96	92.88	92.54	93.16	0.004059	2.49	23.49	67.31	0.61	62.81
2101	11750	Reg_Ex	AMCAI	33.50	90.96	92.88	92.54	93.16	0.004067	2.49	23.44	67.26	0.61	62.77
2101	11750	2yr_Fut	CVC	4.40	90.96	92.04		92.07	0.000819	0.72	6.23	8.24	0.24	16.50
2101	11750	2yr_Fut	AMCAI	4.40	90.96	92.04		92.07	0.000819	0.72	6.23	8.24	0.24	16.52
2101	11750	5yr_Fut	CVC	5.60	90.96	92.17		92.20	0.000853	0.80	7.32	9.53	0.25	20.84
2101	11750	5yr_Fut	AMCAI	5.60	90.96	92.17		92.20	0.000853	0.80	7.32	9.53	0.25	20.90
2101	11750	10yr_Fut	CVC	6.60	90.96	92.26		92.30	0.000871	0.85	8.25	10.45	0.26	25.38
2101	11750	10yr_Fut	AMCAI	6.60	90.96	92.26		92.30	0.000871	0.85	8.25	10.45	0.26	25.37
2101	11750	25yr_Fut	CVC	8.20	90.96	92.34		92.39	0.001050	0.98	9.12	11.19	0.29	29.00
2101	11750	25yr_Fut	AMCAI	8.20	90.96	92.34		92.39	0.001050	0.98	9.12	11.19	0.29	29.00
2101	11750	50yr_Fut	CVC	10.20	90.96	92.43		92.49	0.001247	1.13	10.22	12.53	0.32	33.34
2101	11750	50yr_Fut	AMCAI	10.20	90.96	92.43		92.49	0.001249	1.13	10.21	12.53	0.32	33.32
2101	11750	100yr_Fut	CVC	12.50	90.96	92.51		92.59	0.001503	1.29	11.24	13.26	0.35	37.82
2101	11750	100yr_Fut	AMCAI	12.50	90.96	92.51		92.59	0.001500	1.29	11.25	13.26	0.35	37.83
2101	11750	Reg_Fut	CVC	34.30	90.96	92.89	92.55	93.18	0.004166	2.53	23.95	67.77	0.61	64.91
2101	11750	Reg_Fut	AMCAI	34.30	90.96	92.89	92.56	93.18	0.004154	2.52	24.02	67.84	0.61	64.89
2101	11701	2yr_Ex	CVC	3.80	90.74	91.90	91.27	91.92	0.000636	0.60	7.15	21.45	0.21	12.76
2101	11701	2yr_Ex	AMCAI	3.80	90.74	91.90	91.27	91.92	0.000636	0.60	7.15	21.45	0.21	12.75
2101	11701	5yr_Ex	CVC	5.00	90.74	92.05	91.35	92.07	0.000590	0.62	11.30	32.77	0.21	15.84
2101	11701	5yr_Ex	AMCAI	5.00	90.74	92.05	91.35	92.07	0.000590	0.62	11.30	32.77	0.21	15.84
2101	11701	10yr_Ex	CVC	5.70	90.74	92.14	91.39	92.16	0.000519	0.62	14.20	34.27	0.20	18.55
2101	11701	10yr_Ex	AMCAI	5.70	90.74	92.14	91.39	92.16	0.000519	0.62	14.20	34.27	0.20	18.60
2101	11701	25yr_Ex	CVC	7.10	90.74	92.22	91.47	92.24	0.000580	0.68	16.84	35.58	0.21	21.08
2101	11701	25yr_Ex	AMCAI	7.10	90.74	92.22	91.47	92.24	0.000580	0.68	16.84	35.58	0.21	21.08
2101	11701	50yr_Ex	CVC	8.90	90.74	92.30	91.56	92.32	0.000659	0.77	19.98	45.05	0.23	23.94
2101	11701	50yr_Ex	AMCAI	8.90	90.74	92.30	91.56	92.32	0.000659	0.77	19.98	45.05	0.23	23.93
2101	11701	100yr_Ex	CVC	11.50	90.74	92.39	91.67	92.42	0.000778	0.88	24.66	52.88	0.25	27.32
2101	11701	100yr_Ex	AMCAI	11.50	90.74	92.39	91.67	92.42	0.000778	0.88	24.66	52.88	0.25	27.31
2101	11701	Reg_Ex	CVC	33.50	90.74	92.96	92.31	93.00	0.000833	1.17	75.22	121.39	0.28	59.55
2101	11701	Reg_Ex	AMCAI	33.50	90.74	92.96	92.31	93.00	0.000834	1.17	75.16	121.35	0.28	59.51
2101	11701	2yr_Fut	CVC	4.40	90.74	92.02	91.31	92.04	0.000529	0.58	10.22	31.47	0.20	16.06
2101	11701	2yr_Fut	AMCAI	4.40	90.74	92.02	91.31	92.04	0.000529	0.58	10.22	31.47	0.20	16.08
2101	11701	5yr_Fut	CVC	5.60	90.74	92.15	91.38	92.16	0.000486	0.60	14.43	34.39	0.19	20.23
2101	11701	5yr_Fut	AMCAI	5.60	90.74	92.15	91.38	92.16	0.000486	0.60	14.43	34.39	0.19	20.29
2101	11701	10yr_Fut	CVC	6.60	90.74	92.24	91.44	92.26	0.000444	0.61	17.88	36.41	0.18	24.63
2101	11701	10yr_Fut	AMCAI	6.60	90.74	92.24	91.44	92.26	0.000444	0.61	17.88	36.41	0.18	24.62
2101	11701	25yr_Fut	CVC	8.20	90.74	92.32	91.52	92.34	0.000529	0.70	21.21	48.20	0.20	28.11
2101	11701	25yr_Fut	AMCAI	8.20	90.74	92.32	91.52	92.34	0.000529	0.70	21.21	48.20	0.20	28.11
2101	11701	50yr_Fut	CVC	10.20	90.74	92.42	91.62	92.44	0.000552	0.75	25.97	54.59	0.21	32.26
2101	11701	50yr_Fut	AMCAI	10.20	90.74	92.42	91.62	92.44	0.000553	0.75	25.93	54.54	0.21	32.24
2101	11701	100yr_Fut	CVC	12.50	90.74	92.50	91.71	92.53	0.000599	0.81	30.30	64.73	0.22	36.53
2101	11701	100yr_Fut	AMCAI	12.50	90.74	92.50	91.71	92.53	0.000597	0.81	30.33	64.81	0.22	36.54
2101	11701	Reg_Fut	CVC	34.30	90.74	92.98	92.31	93.02	0.000832	1.17	76.87	122.46	0.28	61.56
2101	11701	Reg_Fut	AMCAI	34.30	90.74	92.98	92.31	93.02	0.000830	1.17	76.96	122.52	0.28	61.54
2101	11662	2yr_Ex	CVC	3.80	90.56	91.86		91.89	0.001033	0.79	7.72	22.82	0.26	12.35
2101	11662	2yr_Ex	AMCAI	3.80	90.56	91.86		91.89	0.001033	0.79	7.72	22.82	0.26	12.35
2101	11662	5yr_Ex	CVC	5.00	90.56	92.01		92.04	0.000851	0.80	11.38	24.68	0.24	15.12
2101	11662	5yr_Ex	AMCAI	5.00	90.56	92.01		92.04	0.000851	0.80	11.38	24.68	0.24	15.12
2101	11662	10yr_Ex	CVC	5.70	90.56	92.10		92.13	0.000753	0.79	13.64	25.91	0.23	17.62
2101	11662	10yr_Ex	AMCAI	5.70	90.56	92.10		92.13	0.000753	0.79	13.64	25.91	0.23	17.67
2101	11662	25yr_Ex	CVC	7.10	90.56	92.17		92.20	0.000896	0.89	15.42	27.96	0.25	19.97
2101	11662	25yr_Ex	AMCAI	7.10	90.56	92.17		92.20	0.000896	0.89	15.42	27.96	0.25	19.97
2101	11662	50yr_Ex	CVC	8.90	90.56	92.24		92.28	0.001096	1.02	17.46	29.49	0.28	22.62
2101	11662	50yr_Ex	AMCAI	8.90	90.56	92.24		92.28	0.001096	1.02	17.46	29.49	0.28	22.61
2101	11662	100yr_Ex	CVC	11.50	90.56	92.32		92.37	0.001352	1.18	19.89	30.31	0.32	25.69
2101	11662	100yr_Ex	AMCAI	11.50	90.56	92.32		92.37	0.001352	1.18	19.89	30.31	0.32	25.69
2101	11662	Reg_Ex	CVC	33.50	90.56	92.79		92.90	0.002789	2.06	39.72	54.70	0.48	54.87
2101	11662	Reg_Ex	AMCAI	33.50	90.56	92.79		92.90	0.002800	2.06	39.65	54.67	0.48	54.83
2101	11662	2yr_Fut	CVC	4.40	90.56	91.98		92.01	0.000749	0.73	10.69	24.31	0.23	15.41
2101	11662	2yr_Fut	AMCAI	4.40	90.56	91.98		92.01	0.000749	0.73	10.69	24.31	0.23	15.43
2101	11662	5yr_Fut	CVC	5.60	90.56	92.11		92.13	0.000700	0.76	13.88	26.07	0.22	19.28
2101	11662	5yr_Fut	AMCAI	5.60	90.56	92.11		92.13	0.000700	0.76	13.88	26.07	0.22	19.34
2101	11662	10yr_Fut	CVC	6.60	90.56	92.21		92.23	0.000679	0.79	16.56	29.18	0.22	23.43
2101	11662	10yr_Fut	AMCAI	6.60	90.56	92.21		92.23	0.000679	0.79	16.56	29.18	0.22	23.42
2101	11662	25yr_Fut	CVC	8.20	90.56	92.28		92.31	0.000793	0.89	18.71	29.92	0.24	26.68
2101	11662	25yr_Fut	AMCAI	8.20	90.56	92.28		92.31	0.000793	0.89	18.71	29.92	0.24	26.68
2101	11662	50yr_Fut	CVC	10.20	90.56	92.37		92.40	0.000911	0.99	21.39	31.74	0.26	30.51
2101	11662	50yr_Fut	AMCAI	10.20	90.56	92.37		92.40	0.000913	0.99	21.36	31.70	0.26	30.49
2101	11662	100yr_Fut	CVC	12.50	90.56	92.44		92.48	0.001155	1.15	23.83	37.29	0.30	34.48
2101	11662	100yr_Fut	AMCAI	12.50	90.56	92.44		92.48	0.001151	1.15	23.86	37.30	0.30	34.48
2101	11662	Reg_Fut	CVC	34.30	90.56	92.80		92.92	0.002820	2.08	40.33	55.04	0.48	56.79
2101	11662	Reg_Fut	AMCAI	34.30	90.56	92.80		92.92	0.002807	2.07	40.41	55.08	0.48	56.75
2101	11635	2yr_Ex	CVC	3.80	90.43	91.84		91.86	0.000640	0.72	7.91	22.90	0.21	12.15
2101	11635	2yr_Ex	AMCAI	3.80	90.43	91.84		91.86	0.000640	0.72	7.91	22.90	0.21	12.15
2101	11635	5yr_Ex	CVC	5.00	90.43	92.00		92.02						

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11635	100yr_ Ex	AMCAI	11.50	90.43	92.29		92.34	0.001039	1.14	23.46	44.78	0.29	25.16
2101	11635	Reg_ Ex	CVC	33.50	90.43	92.74		92.84	0.002004	1.88	46.10	54.66	0.42	53.83
2101	11635	Reg_ Ex	AMCAI	33.50	90.43	92.74		92.84	0.002011	1.88	46.03	54.63	0.42	53.80
2101	11635	2yr_ Fut	CVC	4.40	90.43	91.97		91.99	0.000512	0.69	11.42	31.46	0.20	15.14
2101	11635	2yr_ Fut	AMCAI	4.40	90.43	91.97		91.99	0.000512	0.69	11.42	31.46	0.20	15.15
2101	11635	5yr_ Fut	CVC	5.60	90.43	92.10		92.12	0.000501	0.73	15.77	36.14	0.20	18.92
2101	11635	5yr_ Fut	AMCAI	5.60	90.43	92.10		92.12	0.000501	0.73	15.77	36.14	0.20	18.97
2101	11635	10yr_ Fut	CVC	6.60	90.43	92.20		92.22	0.000474	0.74	19.47	38.95	0.19	22.99
2101	11635	10yr_ Fut	AMCAI	6.60	90.43	92.20		92.22	0.000474	0.74	19.47	38.95	0.19	22.98
2101	11635	25yr_ Fut	CVC	8.20	90.43	92.27		92.29	0.000576	0.84	22.34	43.17	0.22	26.18
2101	11635	25yr_ Fut	AMCAI	8.20	90.43	92.27		92.29	0.000576	0.84	22.34	43.17	0.22	26.18
2101	11635	50yr_ Fut	CVC	10.20	90.43	92.35		92.38	0.000655	0.93	26.27	46.70	0.23	29.93
2101	11635	50yr_ Fut	AMCAI	10.20	90.43	92.35		92.38	0.000657	0.93	26.23	46.69	0.23	29.92
2101	11635	100yr_ Fut	CVC	12.50	90.43	92.42		92.46	0.000767	1.03	29.52	47.92	0.25	33.83
2101	11635	100yr_ Fut	AMCAI	12.50	90.43	92.42		92.46	0.000765	1.03	29.56	47.94	0.25	33.84
2101	11635	Reg_ Fut	CVC	34.30	90.43	92.75		92.85	0.002045	1.90	46.64	54.88	0.42	55.74
2101	11635	Reg_ Fut	AMCAI	34.30	90.43	92.76		92.85	0.002035	1.90	46.73	54.92	0.42	55.71
2101	11615	2yr_ Ex	CVC	3.80	90.33	91.83		91.85	0.000639	0.77	8.39	21.14	0.22	11.99
2101	11615	2yr_ Ex	AMCAI	3.80	90.33	91.83		91.85	0.000639	0.77	8.39	21.14	0.22	11.99
2101	11615	5yr_ Ex	CVC	5.00	90.33	91.98		92.01	0.000667	0.85	13.08	37.27	0.23	14.58
2101	11615	5yr_ Ex	AMCAI	5.00	90.33	91.98		92.01	0.000667	0.85	13.08	37.27	0.23	14.58
2101	11615	10yr_ Ex	CVC	5.70	90.33	92.07		92.10	0.000569	0.82	16.78	39.77	0.21	16.96
2101	11615	10yr_ Ex	AMCAI	5.70	90.33	92.07		92.10	0.000569	0.82	16.78	39.77	0.21	17.01
2101	11615	25yr_ Ex	CVC	7.10	90.33	92.14		92.16	0.000680	0.92	19.32	41.40	0.23	19.21
2101	11615	25yr_ Ex	AMCAI	7.10	90.33	92.14		92.16	0.000680	0.92	19.32	41.40	0.23	19.21
2101	11615	50yr_ Ex	CVC	8.90	90.33	92.20		92.24	0.000836	1.05	22.05	44.11	0.26	21.75
2101	11615	50yr_ Ex	AMCAI	8.90	90.33	92.20		92.24	0.000836	1.05	22.05	44.11	0.26	21.75
2101	11615	100yr_ Ex	CVC	11.50	90.33	92.27		92.32	0.001046	1.21	25.28	45.34	0.30	24.70
2101	11615	100yr_ Ex	AMCAI	11.50	90.33	92.27		92.32	0.001046	1.21	25.28	45.34	0.30	24.70
2101	11615	Reg_ Ex	CVC	33.50	90.33	92.70		92.80	0.002182	2.03	45.89	52.21	0.44	52.97
2101	11615	Reg_ Ex	AMCAI	33.50	90.33	92.70		92.80	0.002191	2.03	45.81	52.17	0.44	52.94
2101	11615	2yr_ Fut	CVC	4.40	90.33	91.95		91.98	0.000574	0.78	12.22	36.66	0.21	14.91
2101	11615	2yr_ Fut	AMCAI	4.40	90.33	91.95		91.98	0.000574	0.78	12.22	36.66	0.21	14.93
2101	11615	5yr_ Fut	CVC	5.60	90.33	92.09		92.11	0.000522	0.79	17.26	40.08	0.20	18.60
2101	11615	5yr_ Fut	AMCAI	5.60	90.33	92.09		92.11	0.000522	0.79	17.26	40.08	0.20	18.66
2101	11615	10yr_ Fut	CVC	6.60	90.33	92.19		92.21	0.000486	0.80	21.45	43.87	0.20	22.60
2101	11615	10yr_ Fut	AMCAI	6.60	90.33	92.19		92.21	0.000486	0.80	21.45	43.87	0.20	22.59
2101	11615	25yr_ Fut	CVC	8.20	90.33	92.26		92.28	0.000567	0.88	24.54	45.07	0.22	25.74
2101	11615	25yr_ Fut	AMCAI	8.20	90.33	92.26		92.28	0.000567	0.88	24.54	45.07	0.22	25.74
2101	11615	50yr_ Fut	CVC	10.20	90.33	92.34		92.37	0.000629	0.96	28.46	45.91	0.23	29.41
2101	11615	50yr_ Fut	AMCAI	10.20	90.33	92.34		92.37	0.000631	0.96	28.42	45.90	0.23	29.40
2101	11615	100yr_ Fut	CVC	12.50	90.33	92.41		92.44	0.000739	1.07	31.55	46.46	0.25	33.25
2101	11615	100yr_ Fut	AMCAI	12.50	90.33	92.41		92.44	0.000737	1.07	31.60	46.46	0.25	33.26
2101	11615	Reg_ Fut	CVC	34.30	90.33	92.71		92.81	0.002236	2.06	46.33	52.40	0.45	54.87
2101	11615	Reg_ Fut	AMCAI	34.30	90.33	92.71		92.81	0.002224	2.05	46.43	52.45	0.45	54.83
2101	11601	2yr_ Ex	CVC	3.80	90.27	91.84		91.84	0.000103	0.36	21.49	33.80	0.10	11.75
2101	11601	2yr_ Ex	AMCAI	3.80	90.27	91.84		91.84	0.000103	0.36	21.49	33.80	0.10	11.75
2101	11601	5yr_ Ex	CVC	5.00	90.27	91.99		92.00	0.000110	0.40	27.02	37.44	0.10	14.25
2101	11601	5yr_ Ex	AMCAI	5.00	90.27	91.99		92.00	0.000110	0.40	27.02	37.44	0.10	14.25
2101	11601	10yr_ Ex	CVC	5.70	90.27	92.08		92.09	0.000108	0.41	30.55	38.55	0.10	16.56
2101	11601	10yr_ Ex	AMCAI	5.70	90.27	92.08		92.09	0.000108	0.41	30.55	38.55	0.10	16.62
2101	11601	25yr_ Ex	CVC	7.10	90.27	92.15		92.15	0.000139	0.48	33.03	39.34	0.12	18.78
2101	11601	25yr_ Ex	AMCAI	7.10	90.27	92.15		92.15	0.000139	0.48	33.03	39.34	0.12	18.78
2101	11601	50yr_ Ex	CVC	8.90	90.27	92.21		92.22	0.000183	0.56	35.63	40.16	0.13	21.27
2101	11601	50yr_ Ex	AMCAI	8.90	90.27	92.21		92.22	0.000183	0.56	35.63	40.16	0.13	21.26
2101	11601	100yr_ Ex	CVC	11.50	90.27	92.29		92.30	0.000250	0.68	38.62	40.89	0.16	24.17
2101	11601	100yr_ Ex	AMCAI	11.50	90.27	92.29		92.30	0.000250	0.68	38.62	40.89	0.16	24.16
2101	11601	Reg_ Ex	CVC	33.50	90.27	92.71		92.76	0.000855	1.43	57.43	50.82	0.30	52.09
2101	11601	Reg_ Ex	AMCAI	33.50	90.27	92.71		92.76	0.000857	1.43	57.36	50.73	0.30	52.06
2101	11601	2yr_ Fut	CVC	4.40	90.27	91.97		91.97	0.000092	0.36	26.09	37.14	0.09	14.60
2101	11601	2yr_ Fut	AMCAI	4.40	90.27	91.97		91.97	0.000092	0.36	26.09	37.14	0.09	14.61
2101	11601	5yr_ Fut	CVC	5.60	90.27	92.09		92.10	0.000101	0.40	30.98	38.69	0.10	18.20
2101	11601	5yr_ Fut	AMCAI	5.60	90.27	92.09		92.10	0.000101	0.40	30.98	38.69	0.10	18.26
2101	11601	10yr_ Fut	CVC	6.60	90.27	92.19		92.20	0.000106	0.43	34.87	39.92	0.10	22.12
2101	11601	10yr_ Fut	AMCAI	6.60	90.27	92.19		92.20	0.000106	0.43	34.87	39.92	0.10	22.12
2101	11601	25yr_ Fut	CVC	8.20	90.27	92.26		92.27	0.000135	0.49	37.68	40.70	0.12	25.21
2101	11601	25yr_ Fut	AMCAI	8.20	90.27	92.26		92.27	0.000135	0.49	37.68	40.70	0.12	25.21
2101	11601	50yr_ Fut	CVC	10.20	90.27	92.35		92.36	0.000167	0.57	41.20	41.41	0.13	28.83
2101	11601	50yr_ Fut	AMCAI	10.20	90.27	92.35		92.36	0.000168	0.57	41.16	41.40	0.13	28.81
2101	11601	100yr_ Fut	CVC	12.50	90.27	92.42		92.43	0.000214	0.65	44.00	42.09	0.15	32.61
2101	11601	100yr_ Fut	AMCAI	12.50	90.27	92.42		92.43	0.000213	0.65	44.04	42.10	0.15	32.62
2101	11601	Reg_ Fut	CVC	34.30	90.27	92.72		92.78	0.000884	1.46	57.84	51.21	0.31	53.97
2101	11601	Reg_ Fut	AMCAI	34.30	90.27	92.72		92.78	0.000881	1.46	57.93	51.30	0.31	53.94
2101	11588	2yr_ Ex	CVC	3.80	90.21	91.83		91.84	0.000154	0.46	14.40	24.82	0.12	11.45
2101	11588	2yr_ Ex	AMCAI	3.80	90.21	91.83		91.84	0.000154	0.46	14.40	24.82	0.12	11.45
2101	11588	5yr_ Ex	CVC	5.00	90.21	91.98		91.99	0.000168	0.51	18.25	25.87	0.13	13.87
2101	11588	5yr_ Ex	AMCAI	5.00	90.21	91.98		91.99	0.000168	0.51	18.25	25.87	0.13	13.87
2101	11588	10yr_ Ex	CVC	5.70	90.21	92.08		92.09	0.000168	0.53	20.68	26.44	0.13	16.12
2101	11588	10yr_ Ex	AMCAI	5.70	90.21	92.08		92.09	0.000168	0.53	20.68	26.44	0.13	16.18
2101	11588	25yr_ Ex	CVC	7.10	90.21	92.14		92.15	0.000220	0.62	22.30	26.81	0.15	18.30
2101	11588	25yr_ Ex	AMCAI	7.10	90.21	92.14		92.15	0.000220	0.62	22.30	26.81	0.15	18.30
2101	11588	50yr_ Ex	CVC	8.90	90.21	92.20		92.22	0.000295	0.73	23.96	27.26	0.17	20.75
2101	11588	50yr_ Ex	AMCAI	8.90	90.21	92.20		92.22	0.000295	0.73	23.96	27.26	0.17	20.75
2101	11588	100yr_ Ex	CVC	11.50	90.21	92.27		92.29	0.000416	0.89				

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11588	10yr_Fut	CVC	6.60	90.21	92.19		92.20	0.000168	0.55	23.62	27.16	0.13	21.62
2101	11588	10yr_Fut	AMCAI	6.60	90.21	92.19		92.20	0.000168	0.55	23.62	27.16	0.13	21.61
2101	11588	25yr_Fut	CVC	8.20	90.21	92.25		92.27	0.000218	0.64	25.45	27.70	0.15	24.66
2101	11588	25yr_Fut	AMCAI	8.20	90.21	92.25		92.27	0.000218	0.64	25.45	27.70	0.15	24.66
2101	11588	50yr_Fut	CVC	10.20	90.21	92.33		92.35	0.000277	0.74	27.76	28.43	0.17	28.22
2101	11588	50yr_Fut	AMCAI	10.20	90.21	92.33		92.35	0.000278	0.74	27.73	28.42	0.17	28.21
2101	11588	100yr_Fut	CVC	12.50	90.21	92.40		92.42	0.000360	0.87	29.55	28.98	0.19	31.97
2101	11588	100yr_Fut	AMCAI	12.50	90.21	92.40		92.42	0.000359	0.86	29.58	28.99	0.19	31.97
2101	11588	Reg_Fut	CVC	34.30	90.21	92.61		92.75	0.001807	2.07	35.88	34.12	0.44	53.14
2101	11588	Reg_Fut	AMCAI	34.30	90.21	92.61		92.75	0.001798	2.06	35.96	34.18	0.43	53.10
2101	11577	2yr_Ex	CVC	5.70	90.16	91.81		91.84	0.000558	0.78	13.60	23.24	0.21	11.29
2101	11577	2yr_Ex	AMCAI	5.70	90.16	91.81		91.84	0.000558	0.78	13.60	23.24	0.21	11.29
2101	11577	5yr_Ex	CVC	7.50	90.16	91.96		91.99	0.000582	0.85	17.12	23.66	0.22	13.67
2101	11577	5yr_Ex	AMCAI	7.50	90.16	91.96		91.99	0.000582	0.85	17.12	23.66	0.22	13.67
2101	11577	10yr_Ex	CVC	9.50	90.16	92.05		92.08	0.000720	0.98	19.13	23.89	0.25	15.90
2101	11577	10yr_Ex	AMCAI	9.50	90.16	92.05		92.08	0.000720	0.98	19.13	23.89	0.25	15.95
2101	11577	25yr_Ex	CVC	11.30	90.16	92.10		92.14	0.000866	1.10	20.46	24.04	0.27	18.06
2101	11577	25yr_Ex	AMCAI	11.30	90.16	92.10		92.14	0.000866	1.10	20.46	24.04	0.27	18.06
2101	11577	50yr_Ex	CVC	13.30	90.16	92.16		92.21	0.001024	1.22	21.82	24.25	0.30	20.49
2101	11577	50yr_Ex	AMCAI	13.30	90.16	92.16		92.21	0.001024	1.22	21.82	24.25	0.30	20.49
2101	11577	100yr_Ex	CVC	15.60	90.16	92.22		92.28	0.001185	1.35	23.57	29.70	0.32	23.33
2101	11577	100yr_Ex	AMCAI	15.60	90.16	92.22		92.28	0.001185	1.35	23.57	29.70	0.32	23.32
2101	11577	Reg_Ex	CVC	39.10	90.16	92.54		92.71	0.003135	2.44	34.48	43.37	0.54	50.86
2101	11577	Reg_Ex	AMCAI	39.10	90.16	92.53		92.70	0.003236	2.47	34.01	42.51	0.55	50.84
2101	11577	2yr_Fut	CVC	7.10	90.16	91.94		91.96	0.000564	0.83	16.55	23.59	0.22	14.03
2101	11577	2yr_Fut	AMCAI	7.10	90.16	91.94		91.96	0.000564	0.83	16.55	23.59	0.22	14.05
2101	11577	5yr_Fut	CVC	9.80	90.16	92.06		92.09	0.000745	1.00	19.35	23.92	0.25	17.53
2101	11577	5yr_Fut	AMCAI	9.80	90.16	92.06		92.09	0.000745	1.00	19.35	23.92	0.25	17.59
2101	11577	10yr_Fut	CVC	12.60	90.16	92.14		92.19	0.000963	1.18	21.41	24.16	0.29	21.37
2101	11577	10yr_Fut	AMCAI	12.60	90.16	92.14		92.19	0.000963	1.18	21.41	24.16	0.29	21.36
2101	11577	25yr_Fut	CVC	14.70	90.16	92.20		92.26	0.001115	1.29	22.94	29.24	0.31	24.39
2101	11577	25yr_Fut	AMCAI	14.70	90.16	92.20		92.26	0.001115	1.29	22.94	29.24	0.31	24.39
2101	11577	50yr_Fut	CVC	17.40	90.16	92.28		92.34	0.001270	1.42	25.22	30.87	0.33	27.93
2101	11577	50yr_Fut	AMCAI	17.40	90.16	92.28		92.34	0.001274	1.42	25.18	30.84	0.34	27.91
2101	11577	100yr_Fut	CVC	20.70	90.16	92.33		92.41	0.001572	1.61	26.75	31.92	0.37	31.65
2101	11577	100yr_Fut	AMCAI	20.70	90.16	92.33		92.41	0.001567	1.61	26.79	31.95	0.37	31.66
2101	11577	Reg_Fut	CVC	40.10	90.16	92.53		92.72	0.003351	2.52	34.24	42.93	0.56	52.75
2101	11577	Reg_Fut	AMCAI	40.10	90.16	92.54		92.72	0.003289	2.50	34.52	43.44	0.55	52.71
2101	11566	2yr_Ex	CVC	5.70	90.08	91.76	90.97	91.82	0.001325	1.07	5.34	5.08	0.30	11.19
2101	11566	2yr_Ex	AMCAI	5.70	90.08	91.76	90.97	91.82	0.001325	1.07	5.34	5.08	0.30	11.19
2101	11566	5yr_Ex	CVC	7.50	90.08	91.91	91.12	91.97	0.001568	1.13	7.76	25.95	0.32	13.54
2101	11566	5yr_Ex	AMCAI	7.50	90.08	91.91	91.12	91.97	0.001568	1.13	7.76	25.95	0.32	13.54
2101	11566	10yr_Ex	CVC	9.50	90.08	92.00	91.25	92.06	0.001520	1.16	10.44	30.30	0.32	15.75
2101	11566	10yr_Ex	AMCAI	9.50	90.08	92.00	91.25	92.06	0.001520	1.16	10.44	30.30	0.32	15.80
2101	11566	25yr_Ex	CVC	11.30	90.08	92.07	91.36	92.13	0.001531	1.20	12.46	34.79	0.32	17.89
2101	11566	25yr_Ex	AMCAI	11.30	90.08	92.07	91.36	92.13	0.001531	1.20	12.46	34.79	0.32	17.89
2101	11566	50yr_Ex	CVC	13.30	90.08	92.14	91.48	92.20	0.001380	1.18	15.09	37.69	0.31	20.31
2101	11566	50yr_Ex	AMCAI	13.30	90.08	92.14	91.48	92.20	0.001380	1.18	15.09	37.69	0.31	20.30
2101	11566	100yr_Ex	CVC	15.60	90.08	92.22	91.98	92.27	0.001264	1.17	17.79	41.64	0.30	23.12
2101	11566	100yr_Ex	AMCAI	15.60	90.08	92.22	91.98	92.27	0.001264	1.17	17.79	41.64	0.30	23.12
2101	11566	Reg_Ex	CVC	39.10	90.08	92.57	92.27	92.64	0.001514	1.34	36.45	61.70	0.33	50.53
2101	11566	Reg_Ex	AMCAI	39.10	90.08	92.56	92.27	92.63	0.001580	1.36	35.83	61.07	0.34	50.51
2101	11566	2yr_Fut	CVC	7.10	90.08	91.88	91.09	91.94	0.001557	1.11	7.16	22.96	0.32	13.91
2101	11566	2yr_Fut	AMCAI	7.10	90.08	91.88	91.09	91.94	0.001557	1.11	7.16	22.96	0.32	13.92
2101	11566	5yr_Fut	CVC	9.80	90.08	92.01	91.27	92.07	0.001535	1.17	10.74	31.01	0.32	17.37
2101	11566	5yr_Fut	AMCAI	9.80	90.08	92.01	91.27	92.07	0.001535	1.17	10.74	31.01	0.32	17.43
2101	11566	10yr_Fut	CVC	12.60	90.08	92.12	91.44	92.17	0.001409	1.18	14.29	36.77	0.31	21.19
2101	11566	10yr_Fut	AMCAI	12.60	90.08	92.12	91.44	92.17	0.001409	1.18	14.29	36.77	0.31	21.18
2101	11566	25yr_Fut	CVC	14.70	90.08	92.19	91.55	92.24	0.001270	1.16	16.94	40.42	0.30	24.19
2101	11566	25yr_Fut	AMCAI	14.70	90.08	92.19	91.55	92.24	0.001270	1.16	16.94	40.42	0.30	24.19
2101	11566	50yr_Fut	CVC	17.40	90.08	92.28	92.01	92.32	0.001200	1.05	20.98	44.98	0.29	27.70
2101	11566	50yr_Fut	AMCAI	17.40	90.08	92.28	92.01	92.32	0.001208	1.05	20.93	44.91	0.29	27.69
2101	11566	100yr_Fut	CVC	20.70	90.08	92.33	92.10	92.38	0.001282	1.11	23.45	47.87	0.30	31.41
2101	11566	100yr_Fut	AMCAI	20.70	90.08	92.33	92.10	92.38	0.001273	1.11	23.51	47.94	0.30	31.41
2101	11566	Reg_Fut	CVC	40.10	90.08	92.57	92.27	92.64	0.001614	1.38	36.25	61.50	0.35	52.41
2101	11566	Reg_Fut	AMCAI	40.10	90.08	92.57	92.27	92.64	0.001564	1.36	36.70	61.92	0.34	52.37
2101	11562 4-Private Cr			Culvert										
2101	11558	2yr_Ex	CVC	5.70	89.88	91.35	90.75	91.42	0.001710	1.19	4.78	5.24	0.35	11.17
2101	11558	2yr_Ex	AMCAI	5.70	89.88	91.35	90.75	91.42	0.001710	1.19	4.78	5.24	0.35	11.17
2101	11558	5yr_Ex	CVC	7.50	89.88	91.48	90.88	91.58	0.002101	1.42	5.29	5.54	0.40	13.50
2101	11558	5yr_Ex	AMCAI	7.50	89.88	91.48	90.88	91.58	0.002101	1.42	5.29	5.54	0.40	13.50
2101	11558	10yr_Ex	CVC	9.50	89.88	91.58	91.00	91.72	0.002640	1.67	5.70	5.76	0.45	15.69
2101	11558	10yr_Ex	AMCAI	9.50	89.88	91.58	91.00	91.72	0.002640	1.67	5.70	5.76	0.45	15.75
2101	11558	25yr_Ex	CVC	11.30	89.88	91.66	91.10	91.84	0.003104	1.88	6.02	5.95	0.49	17.82
2101	11558	25yr_Ex	AMCAI	11.30	89.88	91.66	91.10	91.84	0.003104	1.88	6.02	5.95	0.49	17.82
2101	11558	50yr_Ex	CVC	13.30	89.88	91.80	91.21	91.97	0.003403	1.85	7.57	18.86	0.50	20.22
2101	11558	50yr_Ex	AMCAI	13.30	89.88	91.80	91.21	91.97	0.003403	1.85	7.57	18.86	0.50	20.22
2101	11558	100yr_Ex	CVC	15.60	89.88	91.98	91.32	92.09	0.002194	1.62	12.66	34.27	0.41	23.01
2101	11558	100yr_Ex	AMCAI	15.60	89.88	91.98	91.32	92.09	0.002194	1.62	12.66	34.27	0.41	23.01
2101	11558	Reg_Ex	CVC	39.10	89.88	92.47	92.22	92.54	0.001387	1.36	34.62	53.37	0.33	50.29
2101	11558	Reg_Ex	AMCAI	39.10	89.88	92.47	92.22	92.54	0.001382	1.36	34.66	53.42	0.33	50.27
2101	11558	2yr_Fut	CVC	7.10	89.88	91.45	90.86	91.55	0.002004	1.37	5.19	5.48	0.39	13.87
2101	11558	2yr_Fut	AMCAI	7.10	89.88	91.45	90.86	91.55	0.002004	1.37				

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11558	50yr_Fut	AMCAI	17.40	89.88	92.09	91.41	92.17	0.001613	1.45	16.56	39.65	0.36	27.56
2101	11558	100yr_Fut	CVC	20.70	89.88	92.14	91.97	92.23	0.001754	1.54	18.67	41.89	0.37	31.27
2101	11558	100yr_Fut	AMCAI	20.70	89.88	92.14	91.97	92.23	0.001745	1.54	18.71	41.91	0.37	31.27
2101	11558	Reg_Fut	CVC	40.10	89.88	92.48	92.22	92.55	0.001389	1.37	35.26	54.00	0.33	52.17
2101	11558	Reg_Fut	AMCAI	40.10	89.88	92.48	92.22	92.55	0.001390	1.37	35.25	54.00	0.33	52.13
2101	11537	2yr_Ex	CVC	5.70	90.19	91.24		91.36	0.003977	1.54	4.40	7.60	0.54	11.07
2101	11537	2yr_Ex	AMCAI	5.70	90.19	91.24		91.36	0.003977	1.54	4.40	7.60	0.54	11.07
2101	11537	5yr_Ex	CVC	7.50	90.19	91.37		91.51	0.004111	1.72	5.39	8.28	0.57	13.39
2101	11537	5yr_Ex	AMCAI	7.50	90.19	91.37		91.51	0.004111	1.72	5.39	8.28	0.57	13.39
2101	11537	10yr_Ex	CVC	9.50	90.19	91.44	91.23	91.63	0.005081	2.01	6.01	9.01	0.64	15.57
2101	11537	10yr_Ex	AMCAI	9.50	90.19	91.44	91.23	91.63	0.005081	2.01	6.01	9.01	0.64	15.62
2101	11537	25yr_Ex	CVC	11.30	90.19	91.50	91.32	91.73	0.005826	2.24	6.57	9.72	0.69	17.69
2101	11537	25yr_Ex	AMCAI	11.30	90.19	91.50	91.32	91.73	0.005826	2.24	6.57	9.72	0.69	17.69
2101	11537	50yr_Ex	CVC	13.30	90.19	91.61	91.39	91.86	0.005693	2.35	7.66	11.78	0.69	20.06
2101	11537	50yr_Ex	AMCAI	13.30	90.19	91.61	91.38	91.86	0.005693	2.35	7.66	11.78	0.69	20.06
2101	11537	100yr_Ex	CVC	15.60	90.19	91.63	91.51	91.96	0.007178	2.68	7.98	13.35	0.78	22.82
2101	11537	100yr_Ex	AMCAI	15.60	90.19	91.63	91.51	91.96	0.007178	2.68	7.98	13.35	0.78	22.82
2101	11537	Reg_Ex	CVC	39.10	90.19	92.20	92.20	92.45	0.004560	2.77	24.26	42.99	0.66	49.86
2101	11537	Reg_Ex	AMCAI	39.10	90.19	92.20	92.20	92.45	0.004599	2.78	24.18	42.90	0.67	49.84
2101	11537	2yr_Fut	CVC	7.10	90.19	91.35		91.48	0.004018	1.68	5.21	8.16	0.56	13.76
2101	11537	2yr_Fut	AMCAI	7.10	90.19	91.35		91.48	0.004018	1.68	5.21	8.16	0.56	13.78
2101	11537	5yr_Fut	CVC	9.80	90.19	91.45	91.24	91.65	0.005211	2.05	6.10	9.13	0.65	17.19
2101	11537	5yr_Fut	AMCAI	9.80	90.19	91.45	91.25	91.65	0.005211	2.05	6.10	9.13	0.65	17.24
2101	11537	10yr_Fut	CVC	12.60	90.19	91.56	91.36	91.81	0.005907	2.34	7.18	10.48	0.70	20.95
2101	11537	10yr_Fut	AMCAI	12.60	90.19	91.56	91.38	91.81	0.005907	2.34	7.18	10.48	0.70	20.95
2101	11537	25yr_Fut	CVC	14.70	90.19	91.59	91.47	91.91	0.007321	2.65	7.49	10.86	0.78	23.92
2101	11537	25yr_Fut	AMCAI	14.70	90.19	91.59	91.47	91.91	0.007321	2.65	7.49	10.86	0.78	23.92
2101	11537	50yr_Fut	CVC	17.40	90.19	91.68	91.68	92.03	0.007590	2.83	8.68	16.22	0.81	27.35
2101	11537	50yr_Fut	AMCAI	17.40	90.19	91.69	91.69	92.03	0.007385	2.80	8.81	16.70	0.80	27.34
2101	11537	100yr_Fut	CVC	20.70	90.19	91.88	91.88	92.13	0.004987	2.53	13.11	26.70	0.67	31.00
2101	11537	100yr_Fut	AMCAI	20.70	90.19	91.88	91.88	92.13	0.005016	2.54	13.07	26.65	0.67	31.01
2101	11537	Reg_Fut	CVC	40.10	90.19	92.21	92.21	92.46	0.004598	2.79	24.69	43.47	0.67	51.74
2101	11537	Reg_Fut	AMCAI	40.10	90.19	92.21	92.21	92.46	0.004591	2.79	24.71	43.49	0.67	51.69
2101	11492	2yr_Ex	CVC	5.70	90.13	90.89	90.84	91.07	0.011263	1.90	3.18	8.83	0.85	10.91
2101	11492	2yr_Ex	AMCAI	5.70	90.13	90.89	90.84	91.07	0.011263	1.90	3.18	8.83	0.85	10.90
2101	11492	5yr_Ex	CVC	7.50	90.13	90.95	90.95	91.19	0.013102	2.21	3.79	10.84	0.93	13.19
2101	11492	5yr_Ex	AMCAI	7.50	90.13	90.95	90.95	91.19	0.013102	2.21	3.79	10.84	0.93	13.18
2101	11492	10yr_Ex	CVC	9.50	90.13	91.07	91.07	91.31	0.010519	2.24	5.49	15.74	0.86	15.32
2101	11492	10yr_Ex	AMCAI	9.50	90.13	91.07	91.07	91.31	0.010519	2.24	5.49	15.74	0.86	15.37
2101	11492	25yr_Ex	CVC	11.30	90.13	91.14	91.14	91.39	0.010129	2.34	6.63	17.30	0.86	17.40
2101	11492	25yr_Ex	AMCAI	11.30	90.13	91.14	91.14	91.39	0.010129	2.34	6.63	17.30	0.86	17.40
2101	11492	50yr_Ex	CVC	13.30	90.13	91.16	91.16	91.49	0.012634	2.66	7.00	19.39	0.96	19.75
2101	11492	50yr_Ex	AMCAI	13.30	90.13	91.16	91.16	91.49	0.012634	2.66	7.00	19.39	0.96	19.74
2101	11492	100yr_Ex	CVC	15.60	90.13	91.26	91.26	91.57	0.010378	2.63	9.21	27.73	0.89	22.45
2101	11492	100yr_Ex	AMCAI	15.60	90.13	91.26	91.26	91.57	0.010378	2.63	9.21	27.73	0.89	22.44
2101	11492	Reg_Ex	CVC	39.10	90.13	91.64	91.78	92.12	0.012527	3.66	23.50	45.81	1.04	48.87
2101	11492	Reg_Ex	AMCAI	39.10	90.13	91.64	91.78	92.12	0.012467	3.65	23.56	45.90	1.03	48.85
2101	11492	2yr_Fut	CVC	7.10	90.13	90.93	90.93	91.17	0.013280	2.17	3.59	10.43	0.93	13.57
2101	11492	2yr_Fut	AMCAI	7.10	90.13	90.93	90.93	91.17	0.013280	2.17	3.59	10.43	0.93	13.58
2101	11492	5yr_Fut	CVC	9.80	90.13	91.08	91.08	91.32	0.010399	2.25	5.69	15.90	0.86	16.93
2101	11492	5yr_Fut	AMCAI	9.80	90.13	91.08	91.08	91.32	0.010399	2.25	5.69	15.90	0.86	16.96
2101	11492	10yr_Fut	CVC	12.60	90.13	91.16	91.16	91.45	0.011339	2.52	7.00	19.39	0.91	20.65
2101	11492	10yr_Fut	AMCAI	12.60	90.13	91.16	91.16	91.45	0.011339	2.52	7.00	19.39	0.91	20.64
2101	11492	25yr_Fut	CVC	14.70	90.13	91.27	91.27	91.54	0.008886	2.44	9.38	29.21	0.82	23.55
2101	11492	25yr_Fut	AMCAI	14.70	90.13	91.27	91.27	91.54	0.008886	2.44	9.38	29.21	0.82	23.55
2101	11492	50yr_Fut	CVC	17.40	90.13	91.32	91.39	91.63	0.010214	2.71	10.46	32.19	0.89	26.93
2101	11492	50yr_Fut	AMCAI	17.40	90.13	91.30	91.39	91.64	0.010787	2.76	10.18	31.59	0.91	26.93
2101	11492	100yr_Fut	CVC	20.70	90.13	91.32	91.46	91.77	0.014318	3.21	10.51	32.29	1.05	30.49
2101	11492	100yr_Fut	AMCAI	20.70	90.13	91.32	91.46	91.76	0.014260	3.20	10.53	32.33	1.05	30.49
2101	11492	Reg_Fut	CVC	40.10	90.13	91.66	91.79	92.13	0.012361	3.66	24.31	47.13	1.03	50.72
2101	11492	Reg_Fut	AMCAI	40.10	90.13	91.66	91.79	92.13	0.012366	3.67	24.30	47.12	1.03	50.67
2101	11444	2yr_Ex	CVC	5.70	90.00	90.72	90.57	90.76	0.003582	1.00	7.10	42.92	0.47	10.61
2101	11444	2yr_Ex	AMCAI	5.70	90.00	90.72	90.57	90.76	0.003582	1.00	7.10	42.92	0.47	10.61
2101	11444	5yr_Ex	CVC	7.50	90.00	90.82	90.62	90.85	0.002959	1.03	10.20	50.55	0.44	12.79
2101	11444	5yr_Ex	AMCAI	7.50	90.00	90.82	90.62	90.85	0.002959	1.03	10.20	50.55	0.44	12.79
2101	11444	10yr_Ex	CVC	9.50	90.00	90.92	90.68	90.95	0.002236	1.00	14.04	53.36	0.39	14.78
2101	11444	10yr_Ex	AMCAI	9.50	90.00	90.92	90.68	90.95	0.002236	1.00	14.04	53.36	0.39	14.84
2101	11444	25yr_Ex	CVC	11.30	90.00	91.02	90.73	91.05	0.001726	0.97	17.81	55.47	0.35	16.74
2101	11444	25yr_Ex	AMCAI	11.30	90.00	91.02	90.73	91.05	0.001726	0.97	17.81	55.47	0.35	16.75
2101	11444	50yr_Ex	CVC	13.30	90.00	91.12	90.77	91.15	0.001364	0.93	21.87	57.10	0.32	18.97
2101	11444	50yr_Ex	AMCAI	13.30	90.00	91.12	90.77	91.15	0.001364	0.93	21.87	57.10	0.32	18.97
2101	11444	100yr_Ex	CVC	15.60	90.00	91.24	90.81	91.26	0.001097	0.91	26.48	63.47	0.29	21.51
2101	11444	100yr_Ex	AMCAI	15.60	90.00	91.24	90.81	91.26	0.001097	0.91	26.48	63.47	0.29	21.50
2101	11444	Reg_Ex	CVC	39.10	90.00	91.83	91.07	91.87	0.000986	1.19	54.07	93.27	0.30	46.82
2101	11444	Reg_Ex	AMCAI	39.10	90.00	91.83	91.07	91.87	0.000986	1.19	54.07	93.27	0.30	46.80
2101	11444	2yr_Fut	CVC	7.10	90.00	90.80	90.61	90.83	0.003097	1.02	9.46	49.95	0.45	13.20
2101	11444	2yr_Fut	AMCAI	7.10	90.00	90.80	90.61	90.83	0.003097	1.02	9.46	49.95	0.45	13.21
2101	11444	5yr_Fut	CVC	9.80	90.00	90.94	90.69	90.97	0.002144	1.00	14.64	53.72	0.39	16.38
2101	11444	5yr_Fut	AMCAI	9.80	90.00	90.94	90.69	90.97	0.002144	1.00	14.64	53.72	0.39	16.44
2101	11444	10yr_Fut	CVC	12.60	90.00	91.09	90.76	91.11	0.001470	0.94	20.48	56.50	0.33	19.91
2101	11444	10yr_Fut	AMCAI	12.60	90.00	91.09	90.76	91.11	0.001470	0.94	20.48	56.50	0.33	19.91
2101	11444	25yr_Fut</												

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11420	2yr_ Ex	AMCAI	5.70	89.75	90.66	90.49	90.69	0.002972	1.05	8.97	34.10	0.44	10.41
2101	11420	5yr_ Ex	CVC	7.50	89.75	90.76	90.55	90.79	0.002329	1.04	12.85	37.37	0.40	12.50
2101	11420	5yr_ Ex	AMCAI	7.50	89.75	90.76	90.55	90.79	0.002329	1.04	12.85	37.37	0.40	12.50
2101	11420	10yr_ Ex	CVC	9.50	89.75	90.88	90.60	90.91	0.001857	1.03	17.33	39.72	0.37	14.39
2101	11420	10yr_ Ex	AMCAI	9.50	89.75	90.88	90.60	90.91	0.001857	1.03	17.33	39.72	0.37	14.44
2101	11420	25yr_ Ex	CVC	11.30	89.75	90.99	90.64	91.01	0.001470	0.99	21.59	40.23	0.33	16.24
2101	11420	25yr_ Ex	AMCAI	11.30	89.75	90.99	90.64	91.01	0.001470	0.99	21.59	40.23	0.33	16.24
2101	11420	50yr_ Ex	CVC	13.30	89.75	91.10	90.68	91.12	0.001219	0.97	26.14	42.99	0.31	18.36
2101	11420	50yr_ Ex	AMCAI	13.30	89.75	91.10	90.68	91.12	0.001219	0.97	26.14	42.99	0.31	18.35
2101	11420	100yr_ Ex	CVC	15.60	89.75	91.22	90.72	91.24	0.001025	0.96	31.48	47.51	0.29	20.75
2101	11420	100yr_ Ex	AMCAI	15.60	89.75	91.22	90.72	91.24	0.001025	0.96	31.48	47.51	0.29	20.75
2101	11420	Reg_ Ex	CVC	39.10	89.75	91.81	91.00	91.84	0.001022	1.27	66.82	116.39	0.31	44.95
2101	11420	Reg_ Ex	AMCAI	39.10	89.75	91.81	91.00	91.84	0.001022	1.27	66.82	116.39	0.31	44.93
2101	11420	2yr_ Fut	CVC	7.10	89.75	90.74	90.54	90.77	0.002453	1.04	11.98	36.88	0.41	12.93
2101	11420	2yr_ Fut	AMCAI	7.10	89.75	90.74	90.54	90.77	0.002453	1.04	11.98	36.88	0.41	12.94
2101	11420	5yr_ Fut	CVC	9.80	89.75	90.90	90.61	90.92	0.001786	1.02	18.03	39.80	0.36	15.96
2101	11420	5yr_ Fut	AMCAI	9.80	89.75	90.90	90.61	90.92	0.001786	1.02	18.03	39.80	0.36	16.02
2101	11420	10yr_ Fut	CVC	12.60	89.75	91.06	90.66	91.08	0.001293	0.98	24.56	42.30	0.32	19.34
2101	11420	10yr_ Fut	AMCAI	12.60	89.75	91.06	90.66	91.08	0.001293	0.98	24.56	42.30	0.32	19.33
2101	11420	25yr_ Fut	CVC	14.70	89.75	91.17	90.70	91.19	0.001100	0.97	29.35	45.43	0.30	21.96
2101	11420	25yr_ Fut	AMCAI	14.70	89.75	91.17	90.70	91.19	0.001100	0.97	29.35	45.43	0.30	21.96
2101	11420	50yr_ Fut	CVC	17.40	89.75	91.30	90.74	91.32	0.000908	0.95	35.95	52.52	0.27	24.98
2101	11420	50yr_ Fut	AMCAI	17.40	89.75	91.30	90.74	91.32	0.000908	0.95	35.95	52.52	0.27	24.98
2101	11420	100yr_ Fut	CVC	20.70	89.75	91.42	90.79	91.44	0.000864	0.99	42.19	55.86	0.27	28.20
2101	11420	100yr_ Fut	AMCAI	20.70	89.75	91.42	90.79	91.44	0.000864	0.99	42.19	55.86	0.27	28.21
2101	11420	Reg_ Fut	CVC	40.10	89.75	91.83	91.01	91.86	0.001032	1.29	67.80	119.42	0.31	46.73
2101	11420	Reg_ Fut	AMCAI	40.10	89.75	91.83	91.01	91.86	0.001032	1.29	67.80	119.42	0.31	46.69
2101	11388	2yr_ Ex	CVC	5.70	89.79	90.58	90.37	90.61	0.002207	1.05	8.67	30.58	0.40	10.12
2101	11388	2yr_ Ex	AMCAI	5.70	89.79	90.58	90.37	90.61	0.002207	1.05	8.67	30.58	0.40	10.11
2101	11388	5yr_ Ex	CVC	7.50	89.79	90.69	90.41	90.73	0.001889	1.08	11.13	33.18	0.38	12.09
2101	11388	5yr_ Ex	AMCAI	7.50	89.79	90.69	90.41	90.73	0.001889	1.08	11.13	33.18	0.38	12.09
2101	11388	10yr_ Ex	CVC	9.50	89.79	90.82	90.47	90.85	0.001624	1.10	13.84	40.79	0.36	13.83
2101	11388	10yr_ Ex	AMCAI	9.50	89.79	90.82	90.47	90.85	0.001624	1.10	13.84	40.79	0.36	13.89
2101	11388	25yr_ Ex	CVC	11.30	89.79	90.93	90.51	90.96	0.001407	1.10	16.40	45.17	0.34	15.55
2101	11388	25yr_ Ex	AMCAI	11.30	89.79	90.93	90.51	90.96	0.001407	1.10	16.40	45.17	0.34	15.55
2101	11388	50yr_ Ex	CVC	13.30	89.79	91.04	90.55	91.08	0.001268	1.12	19.03	47.41	0.33	17.51
2101	11388	50yr_ Ex	AMCAI	13.30	89.79	91.04	90.55	91.08	0.001268	1.12	19.03	47.41	0.33	17.51
2101	11388	100yr_ Ex	CVC	15.60	89.79	91.17	90.60	91.20	0.001161	1.14	21.99	49.84	0.32	19.74
2101	11388	100yr_ Ex	AMCAI	15.60	89.79	91.17	90.60	91.20	0.001161	1.14	21.99	49.84	0.32	19.73
2101	11388	Reg_ Ex	CVC	39.10	89.79	91.80	90.96	91.82	0.000637	1.10	76.57	100.99	0.25	42.65
2101	11388	Reg_ Ex	AMCAI	39.10	89.79	91.80	90.96	91.82	0.000637	1.10	76.57	100.99	0.25	42.63
2101	11388	2yr_ Fut	CVC	7.10	89.79	90.67	90.40	90.70	0.001949	1.07	10.59	32.54	0.38	12.54
2101	11388	2yr_ Fut	AMCAI	7.10	89.79	90.67	90.40	90.70	0.001949	1.07	10.59	32.54	0.38	12.56
2101	11388	5yr_ Fut	CVC	9.80	89.79	90.84	90.48	90.87	0.001588	1.10	14.25	41.65	0.36	15.39
2101	11388	5yr_ Fut	AMCAI	9.80	89.79	90.84	90.48	90.87	0.001588	1.10	14.25	41.65	0.36	15.45
2101	11388	10yr_ Fut	CVC	12.60	89.79	91.01	90.54	91.04	0.001308	1.11	18.13	46.82	0.33	18.55
2101	11388	10yr_ Fut	AMCAI	12.60	89.79	91.01	90.54	91.04	0.001308	1.11	18.13	46.82	0.33	18.54
2101	11388	25yr_ Fut	CVC	14.70	89.79	91.12	90.58	91.15	0.001193	1.13	20.83	48.57	0.32	21.02
2101	11388	25yr_ Fut	AMCAI	14.70	89.79	91.12	90.58	91.15	0.001193	1.13	20.83	48.57	0.32	21.02
2101	11388	50yr_ Fut	CVC	17.40	89.79	91.26	90.63	91.29	0.001097	1.16	24.44	55.71	0.31	23.83
2101	11388	50yr_ Fut	AMCAI	17.40	89.79	91.26	90.63	91.29	0.001097	1.16	24.44	55.71	0.31	23.83
2101	11388	100yr_ Fut	CVC	20.70	89.79	91.40	90.69	91.42	0.000561	0.89	47.61	65.45	0.23	26.83
2101	11388	100yr_ Fut	AMCAI	20.70	89.79	91.40	90.69	91.42	0.000561	0.89	47.61	65.45	0.23	26.83
2101	11388	Reg_ Fut	CVC	40.10	89.79	91.81	90.97	91.83	0.000641	1.11	77.78	101.33	0.25	44.38
2101	11388	Reg_ Fut	AMCAI	40.10	89.79	91.81	90.97	91.83	0.000641	1.11	77.78	101.33	0.25	44.34
2101	11355	2yr_ Ex	CVC	5.70	89.42	90.35	90.16	90.47	0.006482	1.59	3.59	5.91	0.65	9.88
2101	11355	2yr_ Ex	AMCAI	5.70	89.42	90.35	90.16	90.47	0.006482	1.59	3.59	5.91	0.65	9.88
2101	11355	5yr_ Ex	CVC	7.50	89.42	90.40	90.28	90.59	0.008304	1.91	3.94	6.20	0.75	11.78
2101	11355	5yr_ Ex	AMCAI	7.50	89.42	90.40	90.28	90.59	0.008303	1.91	3.94	6.20	0.75	11.78
2101	11355	10yr_ Ex	CVC	9.50	89.42	90.43	90.38	90.71	0.011491	2.31	4.13	6.35	0.88	13.45
2101	11355	10yr_ Ex	AMCAI	9.50	89.42	90.43	90.38	90.71	0.011490	2.31	4.13	6.35	0.88	13.50
2101	11355	25yr_ Ex	CVC	11.30	89.42	90.46	90.46	90.82	0.014223	2.64	4.31	6.50	0.99	15.09
2101	11355	25yr_ Ex	AMCAI	11.30	89.42	90.46	90.46	90.82	0.014223	2.64	4.31	6.50	0.99	15.09
2101	11355	50yr_ Ex	CVC	13.30	89.42	90.55	90.55	90.94	0.013239	2.76	4.92	6.96	0.97	16.96
2101	11355	50yr_ Ex	AMCAI	13.30	89.42	90.55	90.55	90.94	0.013239	2.76	4.92	6.96	0.97	16.95
2101	11355	100yr_ Ex	CVC	15.60	89.42	90.65	90.65	91.07	0.012389	2.87	5.62	7.45	0.96	19.07
2101	11355	100yr_ Ex	AMCAI	15.60	89.42	90.65	90.65	91.07	0.012389	2.87	5.62	7.45	0.96	19.07
2101	11355	Reg_ Ex	CVC	39.10	89.42	91.47	91.47	91.75	0.004656	2.70	25.37	51.59	0.66	40.96
2101	11355	Reg_ Ex	AMCAI	39.10	89.42	91.47	91.47	91.75	0.004656	2.70	25.37	51.59	0.66	40.95
2101	11355	2yr_ Fut	CVC	7.10	89.42	90.39	90.25	90.57	0.007848	1.84	3.87	6.15	0.72	12.26
2101	11355	2yr_ Fut	AMCAI	7.10	89.42	90.39	90.25	90.57	0.007848	1.84	3.87	6.15	0.72	12.27
2101	11355	5yr_ Fut	CVC	9.80	89.42	90.44	90.40	90.72	0.012131	2.38	4.14	6.36	0.91	14.99
2101	11355	5yr_ Fut	AMCAI	9.80	89.42	90.44	90.40	90.72	0.012128	2.38	4.14	6.36	0.91	15.05
2101	11355	10yr_ Fut	CVC	12.60	89.42	90.52	90.52	90.90	0.013766	2.73	4.68	6.78	0.99	18.02
2101	11355	10yr_ Fut	AMCAI	12.60	89.42	90.52	90.52	90.90	0.013766	2.73	4.68	6.78	0.99	18.02
2101	11355	25yr_ Fut	CVC	14.70	89.42	90.61	90.61	91.02	0.012688	2.83	5.34	7.26	0.96	20.39
2101	11355	25yr_ Fut	AMCAI	14.70	89.42	90.61	90.61	91.02	0.012688	2.83	5.34	7.26	0.96	20.40
2101	11355	50yr_ Fut	CVC	17.40	89.42	90.72	90.72	91.16	0.011889	2.96	6.16	7.82	0.95	23.09
2101	11355	50yr_ Fut	AMCAI	17.40	89.42	90.72	90.72	91.16	0.011889	2.96	6.16	7.82	0.95	23.08
2101	11355	100yr_ Fut	CVC	20.70	89.42	90.84	90.84	91.32	0.011332	3.11	7.11	8.50	0.95	25.93
2101	11355	100yr_ Fut	AMCAI	20.70	89.42	90.84	90.							

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	11335	50yr_Ex	CVC	13.30	89.17	90.48	90.47	90.62	0.005248	1.98	13.33	90.47	0.63	16.70
2101	11335	50yr_Ex	AMCAI	13.30	89.17	90.48	90.47	90.62	0.005257	1.98	13.32	90.45	0.63	16.69
2101	11335	100yr_Ex	CVC	15.60	89.17	90.54	90.52	90.67	0.006016	2.01	16.12	96.58	0.62	18.76
2101	11335	100yr_Ex	AMCAI	15.60	89.17	90.54	90.52	90.67	0.005024	2.01	16.11	96.53	0.62	18.75
2101	11335	Reg_Ex	CVC	39.10	89.17	91.00	90.80	91.02	0.001046	1.17	79.02	157.40	0.30	39.89
2101	11335	Reg_Ex	AMCAI	39.10	89.17	91.00	90.80	91.02	0.001051	1.17	78.89	157.31	0.30	39.88
2101	11335	2yr_Fut	CVC	7.10	89.17	90.32	90.11	90.44	0.004269	1.59	6.87	61.90	0.55	12.13
2101	11335	2yr_Fut	AMCAI	7.10	89.17	90.32	90.11	90.44	0.004269	1.59	6.87	61.90	0.55	12.14
2101	11335	5yr_Fut	CVC	9.80	89.17	90.40	90.38	90.53	0.004946	1.82	9.61	82.31	0.61	14.81
2101	11335	5yr_Fut	AMCAI	9.80	89.17	90.40	90.38	90.53	0.004953	1.82	9.60	82.29	0.61	14.87
2101	11335	10yr_Fut	CVC	12.60	89.17	90.47	90.46	90.61	0.005261	1.96	12.52	88.90	0.63	17.78
2101	11335	10yr_Fut	AMCAI	12.60	89.17	90.47	90.46	90.61	0.005267	1.96	12.52	88.88	0.63	17.77
2101	11335	25yr_Fut	CVC	14.70	89.17	90.52	90.50	90.66	0.005106	2.00	15.03	93.19	0.63	20.10
2101	11335	25yr_Fut	AMCAI	14.70	89.17	90.52	90.50	90.66	0.005115	2.00	15.02	93.17	0.63	20.10
2101	11335	50yr_Fut	CVC	17.40	89.17	90.58	90.55	90.71	0.004812	2.02	18.34	102.03	0.62	22.72
2101	11335	50yr_Fut	AMCAI	17.40	89.17	90.58	90.55	90.71	0.004820	2.02	18.32	102.00	0.62	22.72
2101	11335	100yr_Fut	CVC	20.70	89.17	90.65	90.60	90.77	0.004463	2.03	22.43	111.05	0.60	25.48
2101	11335	100yr_Fut	AMCAI	20.70	89.17	90.65	90.60	90.77	0.004480	2.03	22.40	110.99	0.60	25.48
2101	11335	Reg_Fut	CVC	40.10	89.17	91.02	90.80	91.04	0.001026	1.17	80.91	165.11	0.30	41.56
2101	11335	Reg_Fut	AMCAI	40.10	89.17	91.01	90.80	91.04	0.001042	1.17	80.48	164.91	0.30	41.52
2101	11309	2yr_Ex	CVC	5.70	89.16	90.18	89.94	90.26	0.003554	1.36	6.42	37.80	0.50	9.60
2101	11309	2yr_Ex	AMCAI	5.70	89.16	90.18	89.94	90.26	0.003562	1.36	6.41	37.76	0.50	9.60
2101	11309	5yr_Ex	CVC	7.50	89.16	90.25	90.19	90.33	0.003450	1.42	9.79	51.94	0.50	11.35
2101	11309	5yr_Ex	AMCAI	7.50	89.16	90.25	90.19	90.33	0.003444	1.42	9.80	51.99	0.50	11.34
2101	11309	10yr_Ex	CVC	9.50	89.16	90.33		90.40	0.003057	1.42	13.97	59.53	0.48	12.83
2101	11309	10yr_Ex	AMCAI	9.50	89.16	90.32		90.40	0.003104	1.43	13.86	59.48	0.48	12.88
2101	11309	25yr_Ex	CVC	11.30	89.16	90.38		90.44	0.002718	1.39	17.42	61.19	0.46	14.31
2101	11309	25yr_Ex	AMCAI	11.30	89.16	90.38		90.44	0.002719	1.39	17.41	61.19	0.46	14.31
2101	11309	50yr_Ex	CVC	13.30	89.16	90.44		90.50	0.002416	1.37	21.11	62.92	0.43	16.00
2101	11309	50yr_Ex	AMCAI	13.30	89.16	90.44		90.50	0.002426	1.37	21.07	62.91	0.44	15.99
2101	11309	100yr_Ex	CVC	15.60	89.16	90.50		90.55	0.002214	1.36	24.97	65.15	0.42	17.90
2101	11309	100yr_Ex	AMCAI	15.60	89.16	90.50		90.55	0.002221	1.36	24.94	65.14	0.42	17.90
2101	11309	Reg_Ex	CVC	39.10	89.16	90.94		90.98	0.001465	1.39	59.54	92.39	0.36	37.46
2101	11309	Reg_Ex	AMCAI	39.10	89.16	90.94		90.98	0.001474	1.40	59.41	92.34	0.36	37.45
2101	11309	2yr_Fut	CVC	7.10	89.16	90.24	90.02	90.32	0.003466	1.41	9.07	49.41	0.50	11.85
2101	11309	2yr_Fut	AMCAI	7.10	89.16	90.24	90.03	90.32	0.003475	1.41	9.05	49.36	0.50	11.87
2101	11309	5yr_Fut	CVC	9.80	89.16	90.34		90.41	0.002966	1.41	14.63	59.85	0.47	14.35
2101	11309	5yr_Fut	AMCAI	9.80	89.16	90.33		90.40	0.003028	1.42	14.48	59.78	0.48	14.41
2101	11309	10yr_Fut	CVC	12.60	89.16	90.42		90.48	0.002517	1.38	19.82	62.32	0.44	17.13
2101	11309	10yr_Fut	AMCAI	12.60	89.16	90.42		90.48	0.002525	1.38	19.79	62.31	0.44	17.12
2101	11309	25yr_Fut	CVC	14.70	89.16	90.48		90.53	0.002282	1.36	23.50	64.29	0.43	19.30
2101	11309	25yr_Fut	AMCAI	14.70	89.16	90.48		90.53	0.002288	1.36	23.47	64.27	0.43	19.30
2101	11309	50yr_Fut	CVC	17.40	89.16	90.55		90.59	0.002084	1.36	27.89	66.70	0.41	21.74
2101	11309	50yr_Fut	AMCAI	17.40	89.16	90.55		90.59	0.002089	1.36	27.87	66.69	0.41	21.74
2101	11309	100yr_Fut	CVC	20.70	89.16	90.62		90.67	0.001917	1.36	33.05	71.12	0.40	24.28
2101	11309	100yr_Fut	AMCAI	20.70	89.16	90.62		90.66	0.001926	1.36	32.99	71.09	0.40	24.29
2101	11309	Reg_Fut	CVC	40.10	89.16	90.96		91.00	0.001432	1.39	61.09	93.06	0.36	39.06
2101	11309	Reg_Fut	AMCAI	40.10	89.16	90.96		91.00	0.001461	1.40	60.66	92.87	0.36	39.04
2101	11268	2yr_Ex	CVC	5.70	89.08	90.04		90.10	0.004460	1.30	6.76	22.37	0.54	9.35
2101	11268	2yr_Ex	AMCAI	5.70	89.08	90.03		90.10	0.004582	1.31	6.69	22.22	0.54	9.35
2101	11268	5yr_Ex	CVC	7.50	89.08	90.10		90.17	0.004910	1.45	8.19	23.94	0.57	11.01
2101	11268	5yr_Ex	AMCAI	7.50	89.08	90.10		90.17	0.004837	1.44	8.24	23.96	0.57	11.00
2101	11268	10yr_Ex	CVC	9.50	89.08	90.18		90.26	0.004383	1.49	10.24	25.14	0.55	12.38
2101	11268	10yr_Ex	AMCAI	9.50	89.08	90.16		90.24	0.004966	1.55	9.77	24.85	0.58	12.44
2101	11268	25yr_Ex	CVC	11.30	89.08	90.21		90.30	0.005096	1.65	11.02	25.62	0.60	13.78
2101	11268	25yr_Ex	AMCAI	11.30	89.08	90.21		90.30	0.005106	1.65	11.02	25.61	0.60	13.78
2101	11268	50yr_Ex	CVC	13.30	89.08	90.27		90.36	0.005001	1.71	12.52	26.49	0.60	15.37
2101	11268	50yr_Ex	AMCAI	13.30	89.08	90.27		90.36	0.005092	1.72	12.44	26.45	0.60	15.37
2101	11268	100yr_Ex	CVC	15.60	89.08	90.32		90.42	0.005258	1.82	13.83	27.27	0.62	17.18
2101	11268	100yr_Ex	AMCAI	15.60	89.08	90.31		90.42	0.005321	1.83	13.77	27.23	0.62	17.18
2101	11268	Reg_Ex	CVC	39.10	89.08	90.67		90.87	0.006935	2.62	25.48	42.82	0.75	35.92
2101	11268	Reg_Ex	AMCAI	39.10	89.08	90.66		90.86	0.007298	2.67	24.95	42.07	0.77	35.92
2101	11268	2yr_Fut	CVC	7.10	89.08	90.09		90.16	0.004754	1.41	7.95	23.80	0.56	11.53
2101	11268	2yr_Fut	AMCAI	7.10	89.08	90.08		90.16	0.004869	1.43	7.87	23.76	0.57	11.55
2101	11268	5yr_Fut	CVC	9.80	89.08	90.19		90.27	0.004332	1.49	10.53	25.32	0.55	13.88
2101	11268	5yr_Fut	AMCAI	9.80	89.08	90.17		90.25	0.005010	1.57	9.97	24.97	0.59	13.95
2101	11268	10yr_Fut	CVC	12.60	89.08	90.25		90.34	0.005106	1.70	11.94	26.17	0.60	16.54
2101	11268	10yr_Fut	AMCAI	12.60	89.08	90.24		90.34	0.005206	1.71	11.86	26.12	0.61	16.53
2101	11268	25yr_Fut	CVC	14.70	89.08	90.30		90.40	0.005131	1.78	13.36	26.99	0.61	18.62
2101	11268	25yr_Fut	AMCAI	14.70	89.08	90.30		90.40	0.005194	1.78	13.30	26.95	0.61	18.62
2101	11268	50yr_Fut	CVC	17.40	89.08	90.36		90.47	0.005342	1.89	14.89	27.88	0.63	20.95
2101	11268	50yr_Fut	AMCAI	17.40	89.08	90.35		90.47	0.005390	1.90	14.85	27.86	0.63	20.95
2101	11268	100yr_Fut	CVC	20.70	89.08	90.42		90.54	0.005602	2.02	16.61	28.85	0.65	23.37
2101	11268	100yr_Fut	AMCAI	20.70	89.08	90.41		90.54	0.005698	2.03	16.51	28.80	0.66	23.38
2101	11268	Reg_Fut	CVC	40.10	89.08	90.68		90.88	0.007173	2.68	25.84	43.29	0.77	37.48
2101	11268	Reg_Fut	AMCAI	40.10	89.08	90.67		90.88	0.007292	2.69	25.48	42.82	0.77	37.48
2101	11227	2yr_Ex	CVC	5.70	89.14	89.71	89.71	89.84	0.009600	1.76	5.13	24.92	0.79	9.12
2101	11227	2yr_Ex	AMCAI	5.70	89.14	89.71	89.71	89.84	0.009276	1.74	5.21	25.14	0.78	9.12
2101	11227	5yr_Ex	CVC	7.50	89.14	89.78	89.78	89.91	0.008850	1.83	6.86	27.16	0.78	10.71
2101	11227	5yr_Ex	AMCAI	7.50	89.14	89.77	89.77	89.91	0.009082	1.85	6.78	27.01	0.79	10.71
2101	11227	10yr_Ex	CVC	9.50	89.14	89.80	89.80	89.98	0.011476	2.15	7.54	28.39	0.89	12.03
2101	11227	10yr_Ex	AMCAI	9.50	89.14	89.83	89.83	89.97	0.009262	1.98	8.29	30.19	0.81	12.09
2101	11227	25yr_Ex	CVC	11.30	89.14</									

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	11227	2yr_Fut	AMCAI	7.10	89.14	89.76	89.76	89.89	0.008868	1.81	6.53	26.76	0.78	11.26
2101	11227	5yr_Fut	CVC	9.80	89.14	89.80	89.80	89.99	0.011816	2.19	7.66	28.58	0.91	13.52
2101	11227	5yr_Fut	AMCAI	9.80	89.14	89.84	89.84	89.99	0.008794	1.97	8.81	31.01	0.79	13.68
2101	11227	10yr_Fut	CVC	12.60	89.14	89.90	89.90	90.06	0.009403	2.15	10.57	32.21	0.83	16.09
2101	11227	10yr_Fut	AMCAI	12.60	89.14	89.90	89.90	90.06	0.009055	2.12	10.73	32.31	0.81	16.09
2101	11227	25yr_Fut	CVC	14.70	89.14	89.94	89.94	90.12	0.009739	2.27	11.86	33.95	0.85	18.12
2101	11227	25yr_Fut	AMCAI	14.70	89.14	89.94	89.94	90.12	0.009514	2.25	11.97	34.05	0.84	18.13
2101	11227	50yr_Fut	CVC	17.40	89.14	89.99	89.99	90.18	0.009777	2.38	13.64	35.83	0.86	20.39
2101	11227	50yr_Fut	AMCAI	17.40	89.14	89.99	89.99	90.18	0.009617	2.37	13.73	35.93	0.86	20.39
2101	11227	100yr_Fut	CVC	20.70	89.14	90.04	90.04	90.24	0.009882	2.50	15.62	37.64	0.88	22.73
2101	11227	100yr_Fut	AMCAI	20.70	89.14	90.05	90.05	90.24	0.009590	2.48	15.81	37.83	0.86	22.74
2101	11227	Reg_Fut	CVC	40.10	89.14	90.27	90.27	90.53	0.010554	3.05	25.36	46.81	0.94	36.47
2101	11227	Reg_Fut	AMCAI	40.10	89.14	90.28	90.28	90.53	0.010048	2.99	25.83	47.23	0.92	36.47
2101	11176	2yr_Ex	CVC	5.70	88.30	89.29	89.29	89.43	0.006845	1.82	4.98	38.56	0.69	8.78
2101	11176	2yr_Ex	AMCAI	5.70	88.30	89.28	89.29	89.43	0.006996	1.83	4.92	38.40	0.70	8.78
2101	11176	5yr_Ex	CVC	7.50	88.30	89.33	89.33	89.42	0.005322	1.67	10.39	43.08	0.62	10.29
2101	11176	5yr_Ex	AMCAI	7.50	88.30	89.33	89.33	89.42	0.005322	1.67	10.39	43.08	0.62	10.29
2101	11176	10yr_Ex	CVC	9.50	88.30	89.33	89.36	89.48	0.008339	2.09	10.51	43.33	0.77	11.58
2101	11176	10yr_Ex	AMCAI	9.50	88.30	89.36	89.36	89.48	0.006844	1.94	11.56	45.51	0.70	11.80
2101	11176	25yr_Ex	CVC	11.30	88.30	89.34	89.40	89.53	0.010726	2.40	11.01	44.37	0.88	12.86
2101	11176	25yr_Ex	AMCAI	11.30	88.30	89.34	89.40	89.53	0.010749	2.40	11.00	44.35	0.88	12.86
2101	11176	50yr_Ex	CVC	13.30	88.30	89.39	89.45	89.58	0.010114	2.43	13.48	52.83	0.86	14.32
2101	11176	50yr_Ex	AMCAI	13.30	88.30	89.39	89.45	89.58	0.010346	2.45	13.33	52.43	0.87	14.32
2101	11176	100yr_Ex	CVC	15.60	88.30	89.43	89.48	89.62	0.010943	2.59	15.23	56.53	0.90	15.99
2101	11176	100yr_Ex	AMCAI	15.60	88.30	89.42	89.48	89.63	0.011113	2.61	15.13	56.48	0.91	15.98
2101	11176	Reg_Ex	CVC	39.10	88.30	89.65	89.71	89.91	0.014149	3.44	28.26	63.29	1.06	33.64
2101	11176	Reg_Ex	AMCAI	39.10	88.30	89.64	89.71	89.91	0.014955	3.51	27.64	62.69	1.09	33.63
2101	11176	2yr_Fut	CVC	7.10	88.30	89.31	89.33	89.50	0.008914	2.11	5.48	40.21	0.79	10.86
2101	11176	2yr_Fut	AMCAI	7.10	88.30	89.32	89.33	89.50	0.008398	2.07	5.66	41.06	0.77	10.86
2101	11176	5yr_Fut	CVC	9.80	88.30	89.34	89.36	89.49	0.008225	2.09	10.91	44.16	0.77	13.06
2101	11176	5yr_Fut	AMCAI	9.80	88.30	89.36	89.36	89.48	0.007048	1.97	11.74	45.89	0.71	13.08
2101	11176	10yr_Fut	CVC	12.60	88.30	89.38	89.44	89.56	0.010494	2.44	12.53	50.31	0.87	15.53
2101	11176	10yr_Fut	AMCAI	12.60	88.30	89.37	89.44	89.57	0.010811	2.47	12.35	49.80	0.89	15.53
2101	11176	25yr_Fut	CVC	14.70	88.30	89.42	89.47	89.61	0.010543	2.53	14.71	56.27	0.88	17.48
2101	11176	25yr_Fut	AMCAI	14.70	88.30	89.42	89.47	89.61	0.010705	2.54	14.62	56.23	0.89	17.48
2101	11176	50yr_Fut	CVC	17.40	88.30	89.45	89.50	89.65	0.011264	2.68	16.49	57.19	0.92	19.66
2101	11176	50yr_Fut	AMCAI	17.40	88.30	89.45	89.50	89.65	0.011392	2.69	16.41	57.15	0.92	19.66
2101	11176	100yr_Fut	CVC	20.70	88.30	89.48	89.54	89.70	0.011973	2.83	18.51	58.23	0.95	21.90
2101	11176	100yr_Fut	AMCAI	20.70	88.30	89.48	89.54	89.70	0.012231	2.86	18.35	58.15	0.96	21.91
2101	11176	Reg_Fut	CVC	40.10	88.30	89.65	89.72	89.92	0.014379	3.48	28.65	63.66	1.07	35.16
2101	11176	Reg_Fut	AMCAI	40.10	88.30	89.65	89.72	89.92	0.014861	3.52	28.27	63.30	1.09	35.15
2101	11133	2yr_Ex	CVC	5.70	87.26	87.90	88.14	88.66	0.078611	3.85	1.48	4.22	2.08	8.55
2101	11133	2yr_Ex	AMCAI	5.70	87.26	87.90	88.14	88.65	0.077450	3.83	1.49	4.23	2.06	8.55
2101	11133	5yr_Ex	CVC	7.50	87.26	88.00	88.25	88.78	0.066671	3.91	1.92	4.71	1.96	10.00
2101	11133	5yr_Ex	AMCAI	7.50	87.26	88.00	88.25	88.78	0.066671	3.91	1.92	4.71	1.96	10.00
2101	11133	10yr_Ex	CVC	9.50	87.26	88.17	88.35	88.76	0.037306	3.38	2.81	5.53	1.52	11.28
2101	11133	10yr_Ex	AMCAI	9.50	87.26	88.14	88.35	88.80	0.044233	3.60	2.64	5.40	1.64	11.27
2101	11133	25yr_Ex	CVC	11.30	87.26	88.32	88.45	88.81	0.025338	3.10	3.65	7.43	1.28	12.52
2101	11133	25yr_Ex	AMCAI	11.30	87.26	88.32	88.45	88.81	0.025297	3.10	3.65	7.44	1.28	12.52
2101	11133	50yr_Ex	CVC	13.30	87.26	88.41	88.64	88.91	0.021854	3.16	4.42	9.48	1.22	13.91
2101	11133	50yr_Ex	AMCAI	13.30	87.26	88.41	88.64	88.91	0.021487	3.14	4.45	9.56	1.21	13.91
2101	11133	100yr_Ex	CVC	15.60	87.26	88.52	88.69	89.00	0.017009	3.10	6.20	21.65	1.10	15.49
2101	11133	100yr_Ex	AMCAI	15.60	87.26	88.52	88.69	89.00	0.016988	3.10	6.20	21.67	1.10	15.49
2101	11133	Reg_Ex	CVC	39.10	87.26	89.12	89.07	89.29	0.050001	2.44	40.66	73.57	0.66	32.03
2101	11133	Reg_Ex	AMCAI	39.10	87.26	89.12	89.07	89.29	0.050001	2.44	40.66	73.57	0.66	32.04
2101	11133	2yr_Fut	CVC	7.10	87.26	88.01	88.23	88.67	0.054519	3.58	1.98	4.78	1.78	10.59
2101	11133	2yr_Fut	AMCAI	7.10	87.26	88.01	88.23	88.68	0.057156	3.65	1.95	4.74	1.82	10.59
2101	11133	5yr_Fut	CVC	9.80	87.26	88.19	88.36	88.77	0.036459	3.38	2.90	5.60	1.50	12.74
2101	11133	5yr_Fut	AMCAI	9.80	87.26	88.17	88.36	88.81	0.041733	3.55	2.76	5.49	1.60	12.74
2101	11133	10yr_Fut	CVC	12.60	87.26	88.38	88.49	88.88	0.022616	3.13	4.04	8.86	1.23	15.14
2101	11133	10yr_Fut	AMCAI	12.60	87.26	88.38	88.49	88.88	0.022118	3.11	4.07	8.96	1.22	15.14
2101	11133	25yr_Fut	CVC	14.70	87.26	88.48	88.67	88.97	0.018771	3.13	5.30	15.99	1.15	17.01
2101	11133	25yr_Fut	AMCAI	14.70	87.26	88.48	88.67	88.97	0.018616	3.12	5.33	16.31	1.14	17.02
2101	11133	50yr_Fut	CVC	17.40	87.26	88.59	88.78	89.05	0.015025	3.08	8.11	33.74	1.05	19.09
2101	11133	50yr_Fut	AMCAI	17.40	87.26	88.60	88.78	89.05	0.014959	3.07	8.14	33.86	1.05	19.09
2101	11133	100yr_Fut	CVC	20.70	87.26	88.69	88.84	89.12	0.013144	3.09	11.90	51.06	1.00	21.19
2101	11133	100yr_Fut	AMCAI	20.70	87.26	88.69	88.84	89.12	0.012941	3.07	12.14	51.29	0.99	21.20
2101	11133	Reg_Fut	CVC	40.10	87.26	89.15	89.08	89.31	0.004725	2.40	42.48	73.90	0.64	33.50
2101	11133	Reg_Fut	AMCAI	40.10	87.26	89.15	89.08	89.31	0.004725	2.40	42.48	73.90	0.64	33.49
2101	11088	2yr_Ex	CVC	5.70	87.05	87.54	87.54	87.73	0.016750	1.91	2.99	8.24	1.00	8.44
2101	11088	2yr_Ex	AMCAI	5.70	87.05	87.54	87.54	87.73	0.016750	1.91	2.99	8.24	1.00	8.45
2101	11088	5yr_Ex	CVC	7.50	87.05	87.62	87.62	87.84	0.015584	2.09	3.64	8.71	0.99	9.87
2101	11088	5yr_Ex	AMCAI	7.50	87.05	87.62	87.62	87.84	0.015584	2.09	3.64	8.71	0.99	9.87
2101	11088	10yr_Ex	CVC	9.50	87.05	87.70	87.70	87.95	0.014558	2.24	4.35	9.20	0.98	11.11
2101	11088	10yr_Ex	AMCAI	9.50	87.05	87.70	87.70	87.95	0.014558	2.24	4.35	9.20	0.98	11.11
2101	11088	25yr_Ex	CVC	11.30	87.05	87.76	87.76	88.05	0.014068	2.38	4.94	9.59	0.98	12.33
2101	11088	25yr_Ex	AMCAI	11.30	87.05	87.76	87.76	88.05	0.014068	2.38	4.94	9.59	0.98	12.33
2101	11088	50yr_Ex	CVC	13.30	87.05	87.83	87.83	88.14	0.013367	2.49	5.63	10.05	0.98	13.68
2101	11088	50yr_Ex	AMCAI	13.30	87.05	87.83	87.83	88.14	0.013367	2.49	5.63	10.05	0.98	13.68
2101	11088	100yr_Ex	CVC	15.60	87.05	87.87	87.90	88.25	0.014775	2.74	6.08	10.45	1.04	15.21
2101	11088	100yr_Ex	AMCAI	15.60	87.05	87.87	87.90	88.25	0.014777	2.74	6.08	10.45	1.04	15.21



HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	11088	50yr_Fut	CVC	17.40	87.05	87.90	87.96	88.33	0.016164	2.94	6.36	10.73	1.09	18.75
2101	11088	50yr_Fut	AMCAI	17.40	87.05	87.90	87.96	88.33	0.016225	2.94	6.35	10.72	1.10	18.75
2101	11088	100yr_Fut	CVC	20.70	87.05	87.99	88.06	88.47	0.015368	3.09	7.37	11.65	1.09	20.74
2101	11088	100yr_Fut	AMCAI	20.70	87.05	87.99	88.06	88.47	0.015551	3.10	7.34	11.62	1.09	20.74
2101	11088	Reg_Fut	CVC	40.10	87.05	88.63	88.63	89.03	0.006667	2.99	20.17	42.76	0.79	32.02
2101	11088	Reg_Fut	AMCAI	40.10	87.05	88.63	88.63	89.03	0.006667	2.99	20.17	42.76	0.79	32.02
2101	11051	2yr_Ex	CVC	5.20	86.50	87.57	86.95	87.59	0.000636	0.69	8.31	11.18	0.22	8.23
2101	11051	2yr_Ex	AMCAI	5.20	86.50	87.57	86.95	87.59	0.000636	0.69	8.31	11.18	0.22	8.24
2101	11051	5yr_Ex	CVC	7.20	86.50	87.62	87.04	87.66	0.001021	0.91	8.89	11.88	0.29	9.64
2101	11051	5yr_Ex	AMCAI	7.20	86.50	87.62	87.04	87.66	0.001021	0.91	8.89	11.88	0.29	9.64
2101	11051	10yr_Ex	CVC	8.90	86.50	87.66	87.12	87.71	0.001374	1.08	9.37	12.81	0.33	10.86
2101	11051	10yr_Ex	AMCAI	8.90	86.50	87.66	87.12	87.71	0.001374	1.08	9.37	12.81	0.33	10.86
2101	11051	25yr_Ex	CVC	10.70	86.50	87.69	87.19	87.77	0.001773	1.25	9.82	13.25	0.38	12.05
2101	11051	25yr_Ex	AMCAI	10.70	86.50	87.69	87.19	87.77	0.001773	1.25	9.82	13.25	0.38	12.05
2101	11051	50yr_Ex	CVC	12.70	86.50	87.73	87.26	87.83	0.002217	1.43	10.33	13.73	0.43	13.38
2101	11051	50yr_Ex	AMCAI	12.70	86.50	87.73	87.26	87.83	0.002217	1.43	10.33	13.73	0.43	13.38
2101	11051	100yr_Ex	CVC	15.00	86.50	87.77	87.34	87.90	0.002736	1.63	10.88	14.24	0.48	14.89
2101	11051	100yr_Ex	AMCAI	15.00	86.50	87.77	87.34	87.90	0.002736	1.63	10.88	14.24	0.48	14.89
2101	11051	Reg_Ex	CVC	42.20	86.50	87.99	88.12	88.66	0.011643	3.76	14.74	21.11	1.02	29.94
2101	11051	Reg_Ex	AMCAI	42.20	86.50	87.99	88.12	88.66	0.011591	3.75	14.78	21.13	1.01	29.95
2101	11051	2yr_Fut	CVC	8.20	86.50	87.64	87.09	87.69	0.001232	1.01	9.16	12.45	0.31	10.21
2101	11051	2yr_Fut	AMCAI	8.20	86.50	87.64	87.09	87.69	0.001232	1.01	9.16	12.45	0.31	10.21
2101	11051	5yr_Fut	CVC	11.30	86.50	87.70	87.21	87.79	0.001916	1.31	9.95	13.38	0.40	12.30
2101	11051	5yr_Fut	AMCAI	11.30	86.50	87.70	87.21	87.79	0.001916	1.31	9.95	13.38	0.40	12.30
2101	11051	10yr_Fut	CVC	14.80	86.50	87.77	87.33	87.89	0.002676	1.61	10.86	14.22	0.47	14.61
2101	11051	10yr_Fut	AMCAI	14.80	86.50	87.77	87.33	87.89	0.002676	1.61	10.86	14.22	0.47	14.61
2101	11051	25yr_Fut	CVC	17.60	86.50	87.81	87.42	87.97	0.003328	1.83	11.48	14.98	0.53	16.41
2101	11051	25yr_Fut	AMCAI	17.60	86.50	87.81	87.42	87.97	0.003328	1.83	11.48	14.98	0.53	16.41
2101	11051	50yr_Fut	CVC	20.80	86.50	87.85	87.52	88.06	0.004165	2.10	12.09	16.30	0.60	18.41
2101	11051	50yr_Fut	AMCAI	20.80	86.50	87.85	87.52	88.06	0.004165	2.10	12.09	16.30	0.60	18.41
2101	11051	100yr_Fut	CVC	24.00	86.50	87.89	87.60	88.15	0.004896	2.33	12.84	17.81	0.65	20.37
2101	11051	100yr_Fut	AMCAI	24.00	86.50	87.89	87.60	88.15	0.004896	2.33	12.84	17.81	0.65	20.37
2101	11051	Reg_Fut	CVC	44.30	86.50	88.07	88.18	88.70	0.010232	3.66	16.51	21.92	0.96	31.32
2101	11051	Reg_Fut	AMCAI	44.30	86.50	88.07	88.18	88.70	0.010227	3.66	16.52	21.92	0.96	31.31
2101	11011	2yr_Ex	CVC	5.20	86.10	87.56	86.52	87.57	0.000198	0.40	12.88	12.52	0.13	7.81
2101	11011	2yr_Ex	AMCAI	5.20	86.10	87.56	86.52	87.57	0.000198	0.40	12.88	12.52	0.13	7.82
2101	11011	5yr_Ex	CVC	7.20	86.10	87.62	86.62	87.63	0.000325	0.53	13.52	12.89	0.16	9.20
2101	11011	5yr_Ex	AMCAI	7.20	86.10	87.62	86.62	87.63	0.000325	0.53	13.52	12.89	0.16	9.20
2101	11011	10yr_Ex	CVC	8.90	86.10	87.65	86.69	87.67	0.000443	0.64	14.03	13.17	0.19	10.40
2101	11011	10yr_Ex	AMCAI	8.90	86.10	87.65	86.69	87.67	0.000443	0.64	14.03	13.17	0.19	10.40
2101	11011	25yr_Ex	CVC	10.70	86.10	87.69	86.76	87.72	0.000580	0.74	14.49	13.42	0.22	11.57
2101	11011	25yr_Ex	AMCAI	10.70	86.10	87.69	86.76	87.72	0.000580	0.74	14.49	13.42	0.22	11.57
2101	11011	50yr_Ex	CVC	12.70	86.10	87.73	86.84	87.76	0.000735	0.86	15.05	23.46	0.25	12.88
2101	11011	50yr_Ex	AMCAI	12.70	86.10	87.73	86.84	87.76	0.000735	0.86	15.05	23.46	0.25	12.88
2101	11011	100yr_Ex	CVC	15.00	86.10	87.77	86.91	87.81	0.000918	0.98	15.77	28.34	0.28	14.36
2101	11011	100yr_Ex	AMCAI	15.00	86.10	87.77	86.91	87.81	0.000918	0.98	15.77	28.34	0.28	14.36
2101	11011	Reg_Ex	CVC	42.20	86.10	88.14	87.58	88.32	0.002540	1.93	29.95	69.85	0.48	28.96
2101	11011	Reg_Ex	AMCAI	42.20	86.10	88.14	87.58	88.32	0.002540	1.93	29.95	69.85	0.48	28.97
2101	11011	2yr_Fut	CVC	8.20	86.10	87.64	86.66	87.66	0.000395	0.60	13.81	13.05	0.18	9.76
2101	11011	2yr_Fut	AMCAI	8.20	86.10	87.64	86.66	87.66	0.000395	0.60	13.81	13.05	0.18	9.76
2101	11011	5yr_Fut	CVC	11.30	86.10	87.70	86.79	87.73	0.000629	0.78	14.62	14.51	0.23	11.81
2101	11011	5yr_Fut	AMCAI	11.30	86.10	87.70	86.79	87.73	0.000629	0.78	14.62	14.51	0.23	11.81
2101	11011	10yr_Fut	CVC	14.80	86.10	87.76	86.91	87.81	0.000897	0.96	15.74	28.22	0.27	14.08
2101	11011	10yr_Fut	AMCAI	14.80	86.10	87.76	86.91	87.81	0.000897	0.96	15.74	28.22	0.27	14.08
2101	11011	25yr_Fut	CVC	17.60	86.10	87.81	86.99	87.87	0.001123	1.11	16.57	31.73	0.31	15.84
2101	11011	25yr_Fut	AMCAI	17.60	86.10	87.81	86.99	87.87	0.001123	1.11	16.57	31.73	0.31	15.84
2101	11011	50yr_Fut	CVC	20.80	86.10	87.85	87.09	87.93	0.001404	1.26	17.36	38.59	0.35	17.79
2101	11011	50yr_Fut	AMCAI	20.80	86.10	87.85	87.09	87.93	0.001404	1.26	17.36	38.59	0.35	17.79
2101	11011	100yr_Fut	CVC	24.00	86.10	87.90	87.18	88.00	0.001644	1.40	18.32	46.23	0.38	19.70
2101	11011	100yr_Fut	AMCAI	24.00	86.10	87.90	87.18	88.00	0.001644	1.40	18.32	46.23	0.38	19.70
2101	11011	Reg_Fut	CVC	44.30	86.10	88.16	87.61	88.34	0.002699	2.00	30.57	70.39	0.50	30.29
2101	11011	Reg_Fut	AMCAI	44.30	86.10	88.16	87.61	88.34	0.002699	2.00	30.57	70.39	0.50	30.29
2101	10997	2yr_Ex	CVC	5.20	85.79	87.55	86.68	87.57	0.000372	0.58	11.68	30.38	0.17	7.64
2101	10997	2yr_Ex	AMCAI	5.20	85.79	87.55	86.68	87.57	0.000372	0.58	11.68	30.38	0.17	7.64
2101	10997	5yr_Ex	CVC	7.20	85.79	87.59	86.80	87.62	0.000617	0.76	13.01	34.01	0.22	9.01
2101	10997	5yr_Ex	AMCAI	7.20	85.79	87.59	86.80	87.62	0.000617	0.76	13.01	34.01	0.22	9.01
2101	10997	10yr_Ex	CVC	8.90	85.79	87.62	86.89	87.66	0.000843	0.91	14.03	34.43	0.26	10.20
2101	10997	10yr_Ex	AMCAI	8.90	85.79	87.62	86.89	87.66	0.000843	0.91	14.03	34.43	0.26	10.20
2101	10997	25yr_Ex	CVC	10.70	85.79	87.65	86.97	87.70	0.001115	1.06	14.87	37.79	0.30	11.37
2101	10997	25yr_Ex	AMCAI	10.70	85.79	87.65	86.97	87.70	0.001115	1.06	14.87	37.79	0.30	11.37
2101	10997	50yr_Ex	CVC	12.70	85.79	87.67	87.06	87.74	0.001431	1.21	15.76	41.42	0.35	12.66
2101	10997	50yr_Ex	AMCAI	12.70	85.79	87.67	87.06	87.74	0.001431	1.21	15.76	41.42	0.35	12.66
2101	10997	100yr_Ex	CVC	15.00	85.79	87.70	87.15	87.78	0.001822	1.39	16.65	45.18	0.39	14.12
2101	10997	100yr_Ex	AMCAI	15.00	85.79	87.70	87.15	87.78	0.001822	1.39	16.65	45.18	0.39	14.12
2101	10997	Reg_Ex	CVC	42.20	85.79	87.96	87.96	88.24	0.005238	2.67	33.60	76.44	0.68	28.44
2101	10997	Reg_Ex	AMCAI	42.20	85.79	87.96	87.96	88.24	0.005238	2.67	33.60	76.44	0.68	28.45
2101	10997	2yr_Fut	CVC	8.20	85.79	87.61	86.85	87.64	0.000752	0.85	13.58	34.24	0.25	9.57
2101	10997	2yr_Fut	AMCAI	8.20	85.79	87.61	86.85	87.64	0.000752	0.85	13.58	34.24	0.25	9.57
2101	10997	5yr_Fut	CVC	11.30	85.79	87.65	87.00	87.71	0.001217	1.11	15.07	38.95	0.32	11.61
2101	10997	5yr_Fut	AMCAI	11.30	85.79	87.65	87.00	87.71	0.001217	1.11	15.07	38.95	0.32	11.61
2101	10997	10yr_Fut	CVC	14.80	85.79	87.70	87.14	87.78	0.001769	1.3				

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10993 2-Private			Culvert										
2101	10989	2yr_ Ex	CVC	5.20	85.89	87.54	86.62	87.56	0.000282	0.50	14.22	34.15	0.15	7.57
2101	10989	2yr_ Ex	AMCAI	5.20	85.89	87.54	86.62	87.56	0.000282	0.50	14.22	34.15	0.15	7.57
2101	10989	5yr_ Ex	CVC	7.20	85.89	87.59	86.73	87.61	0.000461	0.65	15.78	37.39	0.19	8.93
2101	10989	5yr_ Ex	AMCAI	7.20	85.89	87.59	86.73	87.61	0.000461	0.65	15.78	37.39	0.19	8.93
2101	10989	10yr_ Ex	CVC	8.90	85.89	87.62	86.82	87.65	0.000630	0.78	16.98	39.78	0.23	10.10
2101	10989	10yr_ Ex	AMCAI	8.90	85.89	87.62	86.82	87.65	0.000630	0.78	16.98	39.78	0.23	10.10
2101	10989	25yr_ Ex	CVC	10.70	85.89	87.65	86.90	87.68	0.000822	0.90	18.15	43.02	0.26	11.26
2101	10989	25yr_ Ex	AMCAI	10.70	85.89	87.65	86.90	87.68	0.000822	0.90	18.15	43.02	0.26	11.26
2101	10989	50yr_ Ex	CVC	12.70	85.89	87.67	86.98	87.72	0.001053	1.04	19.40	49.63	0.30	12.55
2101	10989	50yr_ Ex	AMCAI	12.70	85.89	87.67	86.98	87.72	0.001053	1.04	19.40	49.63	0.30	12.55
2101	10989	100yr_ Ex	CVC	15.00	85.89	87.70	87.09	87.77	0.001327	1.18	21.03	59.76	0.33	13.99
2101	10989	100yr_ Ex	AMCAI	15.00	85.89	87.70	87.09	87.77	0.001327	1.18	21.03	59.76	0.33	13.99
2101	10989	Reg_ Ex	CVC	42.20	85.89	87.99	87.87	88.16	0.003492	2.19	40.89	80.32	0.56	28.11
2101	10989	Reg_ Ex	AMCAI	42.20	85.89	87.99	87.87	88.16	0.003475	2.18	40.99	80.82	0.56	28.12
2101	10989	2yr_ Fut	CVC	8.20	85.89	87.61	86.78	87.63	0.000560	0.73	16.47	38.77	0.21	9.48
2101	10989	2yr_ Fut	AMCAI	8.20	85.89	87.61	86.78	87.63	0.000560	0.73	16.47	38.77	0.21	9.48
2101	10989	5yr_ Fut	CVC	11.30	85.89	87.65	86.92	87.70	0.000893	0.94	18.47	44.64	0.27	11.50
2101	10989	5yr_ Fut	AMCAI	11.30	85.89	87.65	86.92	87.70	0.000893	0.94	18.47	44.64	0.27	11.50
2101	10989	10yr_ Fut	CVC	14.80	85.89	87.70	87.09	87.76	0.001304	1.17	20.89	59.34	0.33	13.72
2101	10989	10yr_ Fut	AMCAI	14.80	85.89	87.70	87.09	87.76	0.001304	1.17	20.89	59.34	0.33	13.72
2101	10989	25yr_ Fut	CVC	17.60	85.89	87.74	87.16	87.81	0.001609	1.32	23.10	64.82	0.37	15.44
2101	10989	25yr_ Fut	AMCAI	17.60	85.89	87.74	87.16	87.81	0.001609	1.32	23.10	64.82	0.37	15.45
2101	10989	50yr_ Fut	CVC	20.80	85.89	87.77	87.27	87.87	0.001948	1.48	25.43	66.60	0.41	17.36
2101	10989	50yr_ Fut	AMCAI	20.80	85.89	87.77	87.27	87.87	0.001948	1.48	25.43	66.60	0.41	17.36
2101	10989	100yr_ Fut	CVC	24.00	85.89	87.81	87.37	87.92	0.002245	1.62	27.85	68.40	0.44	19.23
2101	10989	100yr_ Fut	AMCAI	24.00	85.89	87.81	87.37	87.92	0.002245	1.62	27.85	68.40	0.44	19.23
2101	10989	Reg_ Fut	CVC	44.30	85.89	88.00	87.90	88.19	0.003602	2.24	42.29	87.06	0.57	29.40
2101	10989	Reg_ Fut	AMCAI	44.30	85.89	88.00	87.90	88.19	0.003606	2.24	42.26	86.94	0.57	29.40
2101	10942	2yr_ Ex	CVC	5.20	85.89	87.55		87.55	0.000007	0.10	53.47	40.12	0.03	5.99
2101	10942	2yr_ Ex	AMCAI	5.20	85.89	87.55		87.55	0.000007	0.10	53.47	40.12	0.03	5.99
2101	10942	5yr_ Ex	CVC	7.20	85.89	87.60		87.60	0.000013	0.13	55.35	40.36	0.03	7.26
2101	10942	5yr_ Ex	AMCAI	7.20	85.89	87.60		87.60	0.000013	0.13	55.35	40.36	0.03	7.26
2101	10942	10yr_ Ex	CVC	8.90	85.89	87.63		87.63	0.000018	0.16	56.74	40.54	0.04	8.38
2101	10942	10yr_ Ex	AMCAI	8.90	85.89	87.63		87.63	0.000018	0.16	56.74	40.54	0.04	8.38
2101	10942	25yr_ Ex	CVC	10.70	85.89	87.66		87.66	0.000024	0.19	58.05	40.71	0.05	9.48
2101	10942	25yr_ Ex	AMCAI	10.70	85.89	87.66		87.66	0.000024	0.19	58.05	40.71	0.05	9.48
2101	10942	50yr_ Ex	CVC	12.70	85.89	87.69		87.70	0.000032	0.22	59.33	40.87	0.06	10.71
2101	10942	50yr_ Ex	AMCAI	12.70	85.89	87.69		87.70	0.000032	0.22	59.33	40.87	0.06	10.71
2101	10942	100yr_ Ex	CVC	15.00	85.89	87.73		87.73	0.000042	0.25	60.76	41.05	0.06	12.08
2101	10942	100yr_ Ex	AMCAI	15.00	85.89	87.73		87.73	0.000042	0.25	60.76	41.05	0.06	12.08
2101	10942	Reg_ Ex	CVC	42.20	85.89	88.04		88.06	0.000182	0.60	74.75	48.96	0.14	25.41
2101	10942	Reg_ Ex	AMCAI	42.20	85.89	88.04		88.06	0.000182	0.60	74.80	49.02	0.14	25.42
2101	10942	2yr_ Fut	CVC	8.20	85.89	87.62		87.62	0.000016	0.15	56.16	40.46	0.04	7.78
2101	10942	2yr_ Fut	AMCAI	8.20	85.89	87.62		87.62	0.000016	0.15	56.16	40.46	0.04	7.78
2101	10942	5yr_ Fut	CVC	11.30	85.89	87.67		87.67	0.000027	0.20	58.40	40.75	0.05	9.70
2101	10942	5yr_ Fut	AMCAI	11.30	85.89	87.67		87.67	0.000027	0.20	58.40	40.75	0.05	9.70
2101	10942	10yr_ Fut	CVC	14.80	85.89	87.73		87.73	0.000041	0.25	60.65	41.04	0.06	11.81
2101	10942	10yr_ Fut	AMCAI	14.80	85.89	87.73		87.73	0.000041	0.25	60.65	41.04	0.06	11.81
2101	10942	25yr_ Fut	CVC	17.60	85.89	87.77		87.77	0.000053	0.29	62.34	41.25	0.07	13.45
2101	10942	25yr_ Fut	AMCAI	17.60	85.89	87.77		87.77	0.000053	0.29	62.34	41.25	0.07	13.45
2101	10942	50yr_ Fut	CVC	20.80	85.89	87.81		87.81	0.000068	0.34	64.06	42.34	0.08	15.27
2101	10942	50yr_ Fut	AMCAI	20.80	85.89	87.81		87.81	0.000068	0.34	64.06	42.34	0.08	15.27
2101	10942	100yr_ Fut	CVC	24.00	85.89	87.85		87.86	0.000084	0.38	65.82	43.83	0.09	17.04
2101	10942	100yr_ Fut	AMCAI	24.00	85.89	87.85		87.86	0.000084	0.38	65.82	43.83	0.09	17.04
2101	10942	Reg_ Fut	CVC	44.30	85.89	88.06		88.08	0.000194	0.62	75.69	51.50	0.14	26.64
2101	10942	Reg_ Fut	AMCAI	44.30	85.89	88.06		88.08	0.000194	0.62	75.68	51.46	0.14	26.64
2101	10889	2yr_ Ex	CVC	5.20	85.89	87.54	86.30	87.55	0.000060	0.27	31.73	59.99	0.07	3.69
2101	10889	2yr_ Ex	AMCAI	5.20	85.89	87.54	86.30	87.55	0.000060	0.27	31.73	59.99	0.07	3.69
2101	10889	5yr_ Ex	CVC	7.20	85.89	87.59	86.40	87.59	0.000100	0.36	34.41	61.03	0.10	4.86
2101	10889	5yr_ Ex	AMCAI	7.20	85.89	87.59	86.39	87.59	0.000100	0.36	34.41	61.03	0.10	4.86
2101	10889	10yr_ Ex	CVC	8.90	85.89	87.62	86.46	87.63	0.000138	0.43	36.35	61.78	0.11	5.89
2101	10889	10yr_ Ex	AMCAI	8.90	85.89	87.62	86.47	87.63	0.000138	0.43	36.35	61.78	0.11	5.89
2101	10889	25yr_ Ex	CVC	10.70	85.89	87.65	86.53	87.66	0.000182	0.50	38.17	62.36	0.13	6.91
2101	10889	25yr_ Ex	AMCAI	10.70	85.89	87.65	86.53	87.66	0.000182	0.50	38.17	62.36	0.13	6.91
2101	10889	50yr_ Ex	CVC	12.70	85.89	87.68	86.60	87.69	0.000235	0.57	39.90	62.69	0.15	8.07
2101	10889	50yr_ Ex	AMCAI	12.70	85.89	87.68	86.60	87.69	0.000235	0.57	39.90	62.69	0.15	8.07
2101	10889	100yr_ Ex	CVC	15.00	85.89	87.71	86.67	87.73	0.000298	0.65	41.83	63.06	0.17	9.36
2101	10889	100yr_ Ex	AMCAI	15.00	85.89	87.71	86.67	87.73	0.000298	0.65	41.83	63.06	0.17	9.36
2101	10889	Reg_ Ex	CVC	42.20	85.89	87.96	87.33	88.03	0.001153	1.42	58.41	70.23	0.34	21.95
2101	10889	Reg_ Ex	AMCAI	42.20	85.89	87.96	87.34	88.04	0.001150	1.42	58.49	70.28	0.34	21.95
2101	10889	2yr_ Fut	CVC	8.20	85.89	87.61	86.44	87.61	0.000122	0.40	35.53	61.46	0.11	5.32
2101	10889	2yr_ Fut	AMCAI	8.20	85.89	87.61	86.44	87.61	0.000122	0.40	35.53	61.46	0.11	5.32
2101	10889	5yr_ Fut	CVC	11.30	85.89	87.66	86.55	87.67	0.000198	0.52	38.64	62.45	0.14	7.12
2101	10889	5yr_ Fut	AMCAI	11.30	85.89	87.66	86.55	87.67	0.000198	0.52	38.64	62.45	0.14	7.12
2101	10889	10yr_ Fut	CVC	14.80	85.89	87.71	86.66	87.72	0.000292	0.65	41.68	63.03	0.17	9.10
2101	10889	10yr_ Fut	AMCAI	14.80	85.89	87.71	86.67	87.72	0.000292	0.65	41.68	63.03	0.17	9.10
2101	10889	25yr_ Fut	CVC	17.60	85.89	87.74	86.75	87.76	0.000371	0.74	43.93	63.46	0.19	10.63
2101	10889	25yr_ Fut	AMCAI	17.60	85.89	87.74	86.75	87.76	0.000371	0.74	43.93	63.46	0.19	10.64
2101	10889	50yr_ Fut	CVC	20.80	85.89	87.78	86.83	87.80	0.000468	0.84	46.13	63.88	0.21	12.36
2101	10889	50yr_ Fut	AMCAI	20.80	85.89	87.78	86.83	87.80	0.000468	0.84	46.13	63.88	0.21	12.36
2101	10889	100yr_ Fut	CVC	24.00	85.89	87.81	86.91	87.84	0.000564	0.94	48.31	64.29	0.23	14.04
2														

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10885	5yr_ Ex	AMCAI	7.20	84.83	85.72		85.93	0.009266	2.03	3.55	4.73	0.75	4.78
2101	10885	10yr_ Ex	CVC	8.90	84.83	85.71	85.67	86.04	0.014376	2.52	3.53	4.72	0.93	5.81
2101	10885	10yr_ Ex	AMCAI	8.90	84.83	85.71	85.67	86.04	0.014376	2.52	3.53	4.72	0.93	5.81
2101	10885	25yr_ Ex	CVC	10.70	84.83	85.78	85.78	86.17	0.016637	2.79	3.83	4.86	1.01	6.83
2101	10885	25yr_ Ex	AMCAI	10.70	84.83	85.78	85.78	86.17	0.016409	2.78	3.85	4.87	1.00	6.83
2101	10885	50yr_ Ex	CVC	12.70	84.83	85.88	85.88	86.32	0.016332	2.91	4.37	5.12	1.01	7.97
2101	10885	50yr_ Ex	AMCAI	12.70	84.83	85.89	85.89	86.32	0.016154	2.90	4.38	5.12	1.00	7.97
2101	10885	100yr_ Ex	CVC	15.00	84.83	86.00	86.00	86.46	0.016078	3.02	4.96	5.38	1.01	9.26
2101	10885	100yr_ Ex	AMCAI	15.00	84.83	86.00	86.00	86.46	0.015843	3.01	4.99	5.39	1.00	9.26
2101	10885	Reg_ Ex	CVC	42.20	84.83	86.95	86.95	87.62	0.012526	3.65	12.07	10.80	0.96	21.78
2101	10885	Reg_ Ex	AMCAI	42.20	84.83	86.96	86.96	87.62	0.012378	3.63	12.12	10.82	0.96	21.78
2101	10885	2yr_ Fut	CVC	8.20	84.83	85.72		85.99	0.011748	2.29	3.58	4.74	0.84	5.25
2101	10885	2yr_ Fut	AMCAI	8.20	84.83	85.72		85.99	0.011748	2.29	3.58	4.74	0.84	5.25
2101	10885	5yr_ Fut	CVC	11.30	84.83	85.81	85.81	86.22	0.016545	2.83	3.99	4.94	1.01	7.03
2101	10885	5yr_ Fut	AMCAI	11.30	84.83	85.81	85.81	86.22	0.016436	2.82	4.00	4.95	1.00	7.03
2101	10885	10yr_ Fut	CVC	14.80	84.83	85.99	85.99	86.45	0.016104	3.01	4.91	5.36	1.01	8.99
2101	10885	10yr_ Fut	AMCAI	14.80	84.83	85.99	85.99	86.45	0.015968	3.00	4.93	5.37	1.00	8.99
2101	10885	25yr_ Fut	CVC	17.60	84.83	86.12	86.12	86.62	0.015690	3.13	5.63	5.66	1.00	10.52
2101	10885	25yr_ Fut	AMCAI	17.60	84.83	86.12	86.12	86.62	0.015603	3.12	5.64	5.67	1.00	10.53
2101	10885	50yr_ Fut	CVC	20.80	84.83	86.26	86.26	86.79	0.015344	3.22	6.45	6.09	1.00	12.24
2101	10885	50yr_ Fut	AMCAI	20.80	84.83	86.26	86.26	86.79	0.015275	3.22	6.46	6.09	1.00	12.24
2101	10885	100yr_ Fut	CVC	24.00	84.83	86.39	86.39	86.94	0.015125	3.30	7.27	6.60	1.00	13.91
2101	10885	100yr_ Fut	AMCAI	24.00	84.83	86.39	86.39	86.94	0.015022	3.29	7.29	6.61	1.00	13.91
2101	10885	Reg_ Fut	CVC	44.30	84.83	87.00	87.00	87.69	0.012252	3.69	12.63	11.03	0.96	22.96
2101	10885	Reg_ Fut	AMCAI	44.30	84.83	87.01	87.01	87.69	0.012174	3.68	12.66	11.04	0.96	22.96
2101	10880	2yr_ Ex	CVC	5.20	84.56	85.73		85.75	0.000778	0.68	8.57	16.34	0.24	3.59
2101	10880	2yr_ Ex	AMCAI	5.20	84.56	85.73		85.75	0.000778	0.68	8.57	16.34	0.24	3.60
2101	10880	5yr_ Ex	CVC	7.20	84.56	85.83		85.86	0.000993	0.83	10.32	19.41	0.28	4.74
2101	10880	5yr_ Ex	AMCAI	7.20	84.56	85.83		85.86	0.000993	0.83	10.32	19.41	0.28	4.74
2101	10880	10yr_ Ex	CVC	8.90	84.56	85.89		85.94	0.001175	0.95	11.68	21.47	0.30	5.77
2101	10880	10yr_ Ex	AMCAI	8.90	84.56	85.89		85.94	0.001175	0.95	11.68	21.47	0.30	5.77
2101	10880	25yr_ Ex	CVC	10.70	84.56	85.96	85.40	86.01	0.001340	1.05	13.14	24.03	0.33	6.78
2101	10880	25yr_ Ex	AMCAI	10.70	84.56	85.96	85.41	86.01	0.001340	1.05	13.14	24.03	0.33	6.78
2101	10880	50yr_ Ex	CVC	12.70	84.56	86.02	85.48	86.08	0.001515	1.16	14.71	26.69	0.35	7.92
2101	10880	50yr_ Ex	AMCAI	12.70	84.56	86.02	85.48	86.08	0.001515	1.16	14.71	26.69	0.35	7.92
2101	10880	100yr_ Ex	CVC	15.00	84.56	86.09	85.56	86.16	0.001685	1.28	16.58	29.53	0.37	9.19
2101	10880	100yr_ Ex	AMCAI	15.00	84.56	86.09	85.56	86.16	0.001685	1.28	16.58	29.53	0.37	9.19
2101	10880	Reg_ Ex	CVC	42.20	84.56	86.65	86.24	86.81	0.002547	2.04	37.01	41.40	0.49	21.63
2101	10880	Reg_ Ex	AMCAI	42.20	84.56	86.65	86.25	86.81	0.002547	2.04	37.01	41.40	0.49	21.63
2101	10880	2yr_ Fut	CVC	8.20	84.56	85.87		85.91	0.001094	0.90	11.16	20.71	0.29	5.20
2101	10880	2yr_ Fut	AMCAI	8.20	84.56	85.87		85.91	0.001094	0.90	11.16	20.71	0.29	5.20
2101	10880	5yr_ Fut	CVC	11.30	84.56	85.98	85.42	86.03	0.001390	1.09	13.63	24.89	0.34	6.97
2101	10880	5yr_ Fut	AMCAI	11.30	84.56	85.98	85.43	86.03	0.001390	1.09	13.63	24.89	0.34	6.97
2101	10880	10yr_ Fut	CVC	14.80	84.56	86.08	85.56	86.16	0.001672	1.27	16.41	29.29	0.37	8.93
2101	10880	10yr_ Fut	AMCAI	14.80	84.56	86.08	85.56	86.16	0.001672	1.27	16.41	29.29	0.37	8.93
2101	10880	25yr_ Fut	CVC	17.60	84.56	86.16	85.65	86.24	0.001843	1.39	18.72	32.04	0.40	10.45
2101	10880	25yr_ Fut	AMCAI	17.60	84.56	86.16	85.65	86.24	0.001843	1.39	18.72	32.04	0.40	10.45
2101	10880	50yr_ Fut	CVC	20.80	84.56	86.24	85.74	86.34	0.001993	1.50	21.35	34.09	0.42	12.15
2101	10880	50yr_ Fut	AMCAI	20.80	84.56	86.24	85.74	86.34	0.001993	1.50	21.35	34.09	0.42	12.15
2101	10880	100yr_ Fut	CVC	24.00	84.56	86.31	85.83	86.42	0.002114	1.60	23.88	35.34	0.43	13.81
2101	10880	100yr_ Fut	AMCAI	24.00	84.56	86.31	85.83	86.42	0.002114	1.60	23.88	35.34	0.43	13.81
2101	10880	Reg_ Fut	CVC	44.30	84.56	86.71	86.27	86.87	0.002452	2.04	39.35	42.48	0.49	22.80
2101	10880	Reg_ Fut	AMCAI	44.30	84.56	86.71	86.28	86.87	0.002452	2.04	39.35	42.48	0.49	22.80
2101	10840	2yr_ Ex	CVC	5.20	84.85	85.61		85.69	0.004017	1.42	7.43	26.29	0.54	3.25
2101	10840	2yr_ Ex	AMCAI	5.20	84.85	85.61		85.69	0.004020	1.42	7.42	26.29	0.54	3.25
2101	10840	5yr_ Ex	CVC	7.20	84.85	85.69		85.78	0.004223	1.57	9.74	26.98	0.57	4.31
2101	10840	5yr_ Ex	AMCAI	7.20	84.85	85.69		85.78	0.004223	1.57	9.74	26.98	0.57	4.31
2101	10840	10yr_ Ex	CVC	8.90	84.85	85.74		85.84	0.004884	1.76	10.95	27.38	0.62	5.27
2101	10840	10yr_ Ex	AMCAI	8.90	84.85	85.74		85.84	0.004884	1.76	10.95	27.38	0.62	5.27
2101	10840	25yr_ Ex	CVC	10.70	84.85	85.79		85.91	0.005259	1.90	12.35	27.82	0.65	6.22
2101	10840	25yr_ Ex	AMCAI	10.70	84.85	85.79		85.91	0.005259	1.90	12.35	27.82	0.65	6.22
2101	10840	50yr_ Ex	CVC	12.70	84.85	85.83		85.96	0.006082	2.09	13.36	28.13	0.70	7.30
2101	10840	50yr_ Ex	AMCAI	12.70	84.85	85.83		85.96	0.006082	2.09	13.36	28.13	0.70	7.30
2101	10840	100yr_ Ex	CVC	15.00	84.85	85.87		86.03	0.006902	2.29	14.48	28.44	0.75	8.52
2101	10840	100yr_ Ex	AMCAI	15.00	84.85	85.87		86.03	0.006902	2.29	14.48	28.44	0.75	8.52
2101	10840	Reg_ Ex	CVC	42.20	84.85	86.30	86.23	86.61	0.009760	3.50	27.54	33.05	0.95	20.24
2101	10840	Reg_ Ex	AMCAI	42.20	84.85	86.30	86.23	86.61	0.009760	3.50	27.54	33.05	0.95	20.24
2101	10840	2yr_ Fut	CVC	8.20	84.85	85.73		85.82	0.004400	1.65	10.68	27.29	0.58	4.73
2101	10840	2yr_ Fut	AMCAI	8.20	84.85	85.73		85.82	0.004400	1.65	10.68	27.29	0.58	4.73
2101	10840	5yr_ Fut	CVC	11.30	84.85	85.81		85.93	0.005329	1.93	12.83	27.98	0.65	6.40
2101	10840	5yr_ Fut	AMCAI	11.30	84.85	85.81		85.93	0.005329	1.93	12.83	27.98	0.65	6.40
2101	10840	10yr_ Fut	CVC	14.80	84.85	85.86		86.02	0.006844	2.28	14.37	28.41	0.75	8.26
2101	10840	10yr_ Fut	AMCAI	14.80	84.85	85.86		86.02	0.006844	2.28	14.37	28.41	0.75	8.26
2101	10840	25yr_ Fut	CVC	17.60	84.85	85.91		86.09	0.007689	2.49	15.70	28.80	0.80	9.70
2101	10840	25yr_ Fut	AMCAI	17.60	84.85	85.91		86.09	0.007689	2.49	15.70	28.80	0.80	9.70
2101	10840	50yr_ Fut	CVC	20.80	84.85	85.96		86.17	0.008398	2.70	17.24	29.27	0.84	11.32
2101	10840	50yr_ Fut	AMCAI	20.80	84.85	85.96		86.17	0.008398	2.70	17.24	29.27	0.84	11.32
2101	10840	100yr_ Fut	CVC	24.00	84.85	86.01	85.97	86.25	0.008875	2.87	18.80	29.74	0.87	12.89
2101	10840	100yr_ Fut	AMCAI	24.00	84.85	86.01	85.97	86.25	0.008875	2.87	18.80	29.74	0.87	12.89
2101	10840	Reg_ Fut	CVC	44.30	84.85	86.32	86.24	86.66	0.010418	3.65	28.31	35.12	0.98	21.34
2101	10840	Reg_ Fut	AMCAI	44.30	84.85	86.32	86.26	86.66	0.010418	3.65	28.31	35.12	0.98	21.34
2101	10790	2yr_ Ex	CVC	5.20	84.83	85.30	85.30	85.40	0.010780	1.66	6.59	33.21	0.82	2.97
2101	10790	2												

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	10790	100yr_ Ex	CVC	15.00	84.83	85.57	85.51	85.68	0.008716	2.06	16.41	39.38	0.80	7.92
2101	10790	100yr_ Ex	AMCAI	15.00	84.83	85.57	85.51	85.68	0.008716	2.06	16.41	39.38	0.80	7.92
2101	10790	Reg_ Ex	CVC	42.20	84.83	86.18	85.82	86.29	0.004397	2.24	42.16	44.51	0.63	18.91
2101	10790	Reg_ Ex	AMCAI	42.20	84.83	86.18	85.82	86.29	0.004397	2.24	42.16	44.51	0.63	18.91
2101	10790	2yr_ Fut	CVC	8.20	84.83	85.37	85.37	85.50	0.013321	2.03	8.86	36.08	0.93	4.34
2101	10790	2yr_ Fut	AMCAI	8.20	84.83	85.37	85.37	85.50	0.013321	2.03	8.86	36.08	0.93	4.34
2101	10790	5yr_ Fut	CVC	11.30	84.83	85.44	85.44	85.58	0.012502	2.17	11.70	37.89	0.92	5.91
2101	10790	5yr_ Fut	AMCAI	11.30	84.83	85.44	85.44	85.58	0.012502	2.17	11.70	37.89	0.92	5.91
2101	10790	10yr_ Fut	CVC	14.80	84.83	85.56	85.50	85.67	0.008800	2.06	16.20	39.33	0.80	7.67
2101	10790	10yr_ Fut	AMCAI	14.80	84.83	85.56	85.50	85.67	0.008800	2.06	16.20	39.33	0.80	7.67
2101	10790	25yr_ Fut	CVC	17.60	84.83	85.64	85.55	85.75	0.007399	2.04	19.44	40.00	0.75	9.02
2101	10790	25yr_ Fut	AMCAI	17.60	84.83	85.64	85.55	85.75	0.007399	2.04	19.44	40.00	0.75	9.03
2101	10790	50yr_ Fut	CVC	20.80	84.83	85.73	85.59	85.83	0.006409	2.04	22.93	40.73	0.71	10.54
2101	10790	50yr_ Fut	AMCAI	20.80	84.83	85.73	85.59	85.83	0.006409	2.04	22.93	40.73	0.71	10.54
2101	10790	100yr_ Fut	CVC	24.00	84.83	85.82	85.63	85.91	0.005573	2.03	26.53	41.50	0.67	12.02
2101	10790	100yr_ Fut	AMCAI	24.00	84.83	85.82	85.63	85.91	0.005573	2.03	26.53	41.50	0.67	12.02
2101	10790	Reg_ Fut	CVC	44.30	84.83	86.21	85.85	86.32	0.004409	2.28	43.53	44.75	0.63	19.97
2101	10790	Reg_ Fut	AMCAI	44.30	84.83	86.21	85.85	86.32	0.004409	2.28	43.53	44.75	0.63	19.97
2101	10761	2yr_ Ex	CVC	5.20	84.11	84.82	84.68	84.92	0.005227	1.53	5.24	14.33	0.61	2.77
2101	10761	2yr_ Ex	AMCAI	5.20	84.11	84.82	84.68	84.93	0.005165	1.53	5.27	14.39	0.61	2.77
2101	10761	5yr_ Ex	CVC	7.20	84.11	84.88	84.76	85.03	0.007350	1.92	6.06	16.21	0.73	3.71
2101	10761	5yr_ Ex	AMCAI	7.20	84.11	84.88	84.76	85.03	0.007350	1.92	6.06	16.21	0.73	3.71
2101	10761	10yr_ Ex	CVC	8.90	84.11	84.94	84.86	85.12	0.007981	2.12	7.14	18.50	0.78	4.56
2101	10761	10yr_ Ex	AMCAI	8.90	84.11	84.94	84.86	85.12	0.007981	2.12	7.14	18.50	0.78	4.56
2101	10761	25yr_ Ex	CVC	10.70	84.11	84.96	84.98	85.20	0.010086	2.43	7.61	19.20	0.88	5.42
2101	10761	25yr_ Ex	AMCAI	10.70	84.11	84.96	84.98	85.20	0.010086	2.43	7.61	19.20	0.88	5.42
2101	10761	50yr_ Ex	CVC	12.70	84.11	85.04	85.04	85.28	0.009419	2.50	9.13	20.29	0.86	6.37
2101	10761	50yr_ Ex	AMCAI	12.70	84.11	85.04	85.04	85.28	0.009419	2.50	9.13	20.29	0.86	6.37
2101	10761	100yr_ Ex	CVC	15.00	84.11	85.12	85.12	85.37	0.009120	2.61	10.82	22.90	0.86	7.43
2101	10761	100yr_ Ex	AMCAI	15.00	84.11	85.12	85.12	85.37	0.009120	2.61	10.82	22.90	0.86	7.43
2101	10761	Reg_ Ex	CVC	42.20	84.11	85.77	85.77	86.08	0.007181	3.28	31.89	44.50	0.83	17.56
2101	10761	Reg_ Ex	AMCAI	42.20	84.11	85.77	85.77	86.08	0.007181	3.28	31.89	44.50	0.83	17.56
2101	10761	2yr_ Fut	CVC	8.20	84.11	84.91	84.84	85.09	0.007917	2.05	6.63	17.45	0.77	4.07
2101	10761	2yr_ Fut	AMCAI	8.20	84.11	84.91	84.84	85.09	0.007917	2.05	6.63	17.45	0.77	4.07
2101	10761	5yr_ Fut	CVC	11.30	84.11	85.00	85.00	85.23	0.009374	2.41	8.26	19.73	0.85	5.56
2101	10761	5yr_ Fut	AMCAI	11.30	84.11	85.00	85.00	85.23	0.009387	2.41	8.25	19.73	0.85	5.56
2101	10761	10yr_ Fut	CVC	14.80	84.11	85.11	85.11	85.37	0.009166	2.60	10.67	22.79	0.86	7.18
2101	10761	10yr_ Fut	AMCAI	14.80	84.11	85.11	85.11	85.37	0.009166	2.60	10.67	22.79	0.86	7.18
2101	10761	25yr_ Fut	CVC	17.60	84.11	85.18	85.18	85.46	0.009268	2.75	12.37	23.94	0.88	8.45
2101	10761	25yr_ Fut	AMCAI	17.60	84.11	85.18	85.18	85.46	0.009268	2.75	12.37	23.94	0.88	8.45
2101	10761	50yr_ Fut	CVC	20.80	84.11	85.26	85.26	85.56	0.009423	2.91	14.18	25.10	0.89	9.87
2101	10761	50yr_ Fut	AMCAI	20.80	84.11	85.26	85.26	85.56	0.009423	2.91	14.18	25.10	0.89	9.87
2101	10761	100yr_ Fut	CVC	24.00	84.11	85.31	85.31	85.64	0.010192	3.12	15.49	25.91	0.94	11.25
2101	10761	100yr_ Fut	AMCAI	24.00	84.11	85.31	85.31	85.64	0.010192	3.12	15.49	25.91	0.94	11.25
2101	10761	Reg_ Fut	CVC	44.30	84.11	85.79	85.79	86.11	0.007329	3.35	32.89	44.71	0.84	18.58
2101	10761	Reg_ Fut	AMCAI	44.30	84.11	85.79	85.79	86.11	0.007329	3.35	32.89	44.71	0.84	18.58
2101	10727	2yr_ Ex	CVC	5.20	83.81	84.48	84.46	84.67	0.011569	2.01	3.85	19.61	0.87	2.62
2101	10727	2yr_ Ex	AMCAI	5.20	83.81	84.47	84.46	84.67	0.011815	2.02	3.80	19.55	0.88	2.62
2101	10727	5yr_ Ex	CVC	7.20	83.81	84.60	84.60	84.76	0.008843	2.00	6.37	24.07	0.79	3.52
2101	10727	5yr_ Ex	AMCAI	7.20	83.81	84.60	84.60	84.76	0.008843	2.00	6.37	24.07	0.79	3.52
2101	10727	10yr_ Ex	CVC	8.90	83.81	84.65	84.65	84.84	0.009346	2.17	7.60	30.09	0.82	4.32
2101	10727	10yr_ Ex	AMCAI	8.90	83.81	84.65	84.65	84.84	0.009346	2.17	7.60	30.09	0.82	4.32
2101	10727	25yr_ Ex	CVC	10.70	83.81	84.75	84.75	84.91	0.007486	2.12	11.33	41.04	0.75	5.12
2101	10727	25yr_ Ex	AMCAI	10.70	83.81	84.75	84.75	84.91	0.007486	2.12	11.33	41.04	0.75	5.12
2101	10727	50yr_ Ex	CVC	12.70	83.81	84.77	84.81	84.97	0.008939	2.36	12.37	42.25	0.82	6.04
2101	10727	50yr_ Ex	AMCAI	12.70	83.81	84.77	84.81	84.97	0.008939	2.36	12.37	42.25	0.82	6.04
2101	10727	100yr_ Ex	CVC	15.00	83.81	84.79	84.86	85.04	0.011345	2.69	13.04	43.66	0.93	7.06
2101	10727	100yr_ Ex	AMCAI	15.00	83.81	84.79	84.86	85.04	0.011345	2.69	13.04	43.66	0.93	7.06
2101	10727	Reg_ Ex	CVC	42.20	83.81	84.99	85.20	85.64	0.027521	4.82	22.80	53.54	1.50	16.72
2101	10727	Reg_ Ex	AMCAI	42.20	83.81	84.99	85.20	85.64	0.027521	4.82	22.80	53.54	1.50	16.73
2101	10727	2yr_ Fut	CVC	8.20	83.81	84.63	84.63	84.81	0.008857	2.08	7.21	28.78	0.80	3.85
2101	10727	2yr_ Fut	AMCAI	8.20	83.81	84.63	84.63	84.81	0.008857	2.08	7.21	28.78	0.80	3.85
2101	10727	5yr_ Fut	CVC	11.30	83.81	84.76	84.76	84.93	0.007799	2.18	11.75	41.46	0.77	5.25
2101	10727	5yr_ Fut	AMCAI	11.30	83.81	84.76	84.76	84.93	0.007790	2.18	11.76	41.46	0.77	5.25
2101	10727	10yr_ Fut	CVC	14.80	83.81	84.79	84.85	85.03	0.011165	2.67	12.97	43.62	0.92	6.82
2101	10727	10yr_ Fut	AMCAI	14.80	83.81	84.79	84.85	85.03	0.011165	2.67	12.97	43.62	0.92	6.82
2101	10727	25yr_ Fut	CVC	17.60	83.81	84.82	84.89	85.10	0.012711	2.92	14.44	46.37	0.99	8.03
2101	10727	25yr_ Fut	AMCAI	17.60	83.81	84.82	84.89	85.10	0.012711	2.92	14.44	46.37	0.99	8.03
2101	10727	50yr_ Fut	CVC	20.80	83.81	84.85	84.94	85.18	0.014406	3.18	15.99	47.78	1.06	9.40
2101	10727	50yr_ Fut	AMCAI	20.80	83.81	84.85	84.94	85.18	0.014406	3.18	15.99	47.78	1.06	9.40
2101	10727	100yr_ Fut	CVC	24.00	83.81	84.89	85.00	85.24	0.015349	3.37	17.79	49.38	1.10	10.73
2101	10727	100yr_ Fut	AMCAI	24.00	83.81	84.89	85.00	85.24	0.015349	3.37	17.79	49.38	1.10	10.73
2101	10727	Reg_ Fut	CVC	44.30	83.81	85.00	85.22	85.67	0.027758	4.89	23.68	53.94	1.51	17.72
2101	10727	Reg_ Fut	AMCAI	44.30	83.81	85.00	85.22	85.67	0.027758	4.89	23.68	53.94	1.51	17.72
2101	10684	2yr_ Ex	CVC	5.20	83.38	84.16	84.16	84.27	0.006762	1.77	6.83	32.93	0.70	2.40
2101	10684	2yr_ Ex	AMCAI	5.20	83.38	84.16	84.16	84.27	0.006593	1.76	6.92	33.05	0.69	2.40
2101	10684	5yr_ Ex	CVC	7.20	83.38	84.18	84.23	84.36	0.010228	2.24	7.74	34.08	0.86	3.23
2101	10684	5yr_ Ex	AMCAI	7.20	83.38	84.18	84.23	84.36	0.010228	2.24	7.74	34.08	0.86	3.23
2101	10684	10yr_ Ex	CVC	8.90	83.38	84.23	84.28	84.42	0.010777	2.40	9.29	35.95	0.89	3.98
2101	10684	10yr_ Ex	AMCAI	8.90	83.38	84.23	84.28	84.42	0.010777	2.40	9.29	35.95	0.89	3.98
2101	10684	25yr_ Ex	CVC	10.70	83.38	84.24	84.32	84.49	0.013912	2.76	9.80	36		

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10684	5yr_Fut	AMCAI	11.30	83.38	84.26	84.33	84.50	0.013260	2.74	10.64	39.20	1.00	4.80
2101	10684	10yr_Fut	CVC	14.80	83.38	84.36	84.39	84.56	0.010989	2.70	14.56	41.98	0.93	6.26
2101	10684	10yr_Fut	AMCAI	14.80	83.38	84.36	84.40	84.56	0.010989	2.70	14.56	41.98	0.93	6.26
2101	10684	25yr_Fut	CVC	17.60	83.38	84.43	84.44	84.61	0.009904	2.70	17.44	43.29	0.89	7.39
2101	10684	25yr_Fut	AMCAI	17.60	83.38	84.43	84.44	84.61	0.009904	2.70	17.44	43.29	0.89	7.39
2101	10684	50yr_Fut	CVC	20.80	83.38	84.52	84.48	84.67	0.007820	2.56	21.72	45.17	0.80	8.64
2101	10684	50yr_Fut	AMCAI	20.80	83.38	84.52	84.49	84.67	0.007820	2.56	21.72	45.17	0.80	8.64
2101	10684	100yr_Fut	CVC	24.00	83.38	84.63	84.53	84.75	0.005891	2.38	26.73	46.57	0.71	9.84
2101	10684	100yr_Fut	AMCAI	24.00	83.38	84.63	84.53	84.75	0.005891	2.38	26.73	46.57	0.71	9.84
2101	10684	Reg_Fut	CVC	44.30	83.38	84.86	84.73	85.04	0.007660	3.06	37.58	49.58	0.83	16.48
2101	10684	Reg_Fut	AMCAI	44.30	83.38	84.86	84.74	85.04	0.007660	3.06	37.58	49.58	0.83	16.48
2101	10648	2yr_Ex	CVC	5.20	83.07	83.84	83.76	83.92	0.004621	1.41	7.69	31.41	0.57	2.17
2101	10648	2yr_Ex	AMCAI	5.20	83.07	83.84	83.77	83.92	0.004621	1.41	7.69	31.41	0.57	2.17
2101	10648	5yr_Ex	CVC	7.20	83.07	83.96	83.84	84.02	0.003737	1.42	11.73	38.25	0.52	2.93
2101	10648	5yr_Ex	AMCAI	7.20	83.07	83.96	83.84	84.02	0.003737	1.42	11.73	38.25	0.52	2.93
2101	10648	10yr_Ex	CVC	8.90	83.07	84.03	83.91	84.10	0.003353	1.43	14.80	41.72	0.50	3.61
2101	10648	10yr_Ex	AMCAI	8.90	83.07	84.03	83.92	84.10	0.003353	1.43	14.80	41.72	0.50	3.61
2101	10648	25yr_Ex	CVC	10.70	83.07	84.11	83.95	84.17	0.002927	1.42	18.27	45.03	0.48	4.27
2101	10648	25yr_Ex	AMCAI	10.70	83.07	84.11	83.96	84.17	0.002927	1.42	18.27	45.03	0.48	4.27
2101	10648	50yr_Ex	CVC	12.70	83.07	84.20	84.00	84.25	0.002532	1.41	22.27	48.67	0.45	5.03
2101	10648	50yr_Ex	AMCAI	12.70	83.07	84.20	84.00	84.25	0.002532	1.41	22.27	48.67	0.45	5.03
2101	10648	100yr_Ex	CVC	15.00	83.07	84.30	84.04	84.34	0.002129	1.37	27.14	51.50	0.42	5.87
2101	10648	100yr_Ex	AMCAI	15.00	83.07	84.30	84.04	84.34	0.002129	1.37	27.14	51.50	0.42	5.86
2101	10648	Reg_Ex	CVC	42.20	83.07	84.77		84.84	0.002644	1.95	53.51	61.16	0.50	14.21
2101	10648	Reg_Ex	AMCAI	42.20	83.07	84.77		84.84	0.002644	1.95	53.51	61.16	0.50	14.22
2101	10648	2yr_Fut	CVC	8.20	83.07	84.00	83.88	84.07	0.003520	1.43	13.51	40.39	0.51	3.19
2101	10648	2yr_Fut	AMCAI	8.20	83.07	84.00	83.88	84.07	0.003520	1.43	13.51	40.39	0.51	3.19
2101	10648	5yr_Fut	CVC	11.30	83.07	84.14	83.97	84.19	0.002802	1.42	19.45	46.16	0.47	4.34
2101	10648	5yr_Fut	AMCAI	11.30	83.07	84.14	83.97	84.19	0.002802	1.42	19.45	46.16	0.47	4.34
2101	10648	10yr_Fut	CVC	14.80	83.07	84.29	84.04	84.33	0.002155	1.38	26.74	51.33	0.42	5.64
2101	10648	10yr_Fut	AMCAI	14.80	83.07	84.29	84.04	84.33	0.002155	1.38	26.74	51.33	0.42	5.64
2101	10648	25yr_Fut	CVC	17.60	83.07	84.40	84.09	84.44	0.001823	1.35	32.44	53.63	0.40	6.64
2101	10648	25yr_Fut	AMCAI	17.60	83.07	84.40	84.09	84.44	0.001823	1.35	32.44	53.63	0.40	6.64
2101	10648	50yr_Fut	CVC	20.80	83.07	84.51		84.54	0.001614	1.35	38.37	55.91	0.38	7.74
2101	10648	50yr_Fut	AMCAI	20.80	83.07	84.51		84.54	0.001614	1.35	38.37	55.91	0.38	7.74
2101	10648	100yr_Fut	CVC	24.00	83.07	84.61		84.65	0.001433	1.34	44.34	57.32	0.36	8.78
2101	10648	100yr_Fut	AMCAI	24.00	83.07	84.61		84.65	0.001433	1.34	44.34	57.32	0.36	8.77
2101	10648	Reg_Fut	CVC	44.30	83.07	84.80		84.87	0.002723	2.00	55.39	65.07	0.51	15.10
2101	10648	Reg_Fut	AMCAI	44.30	83.07	84.80		84.87	0.002723	2.00	55.39	65.07	0.51	15.10
2101	10616	2yr_Ex	CVC	5.20	82.76	83.66	83.45	83.76	0.004518	1.48	4.77	21.23	0.56	1.95
2101	10616	2yr_Ex	AMCAI	5.20	82.76	83.66	83.45	83.76	0.004518	1.48	4.77	21.23	0.56	1.95
2101	10616	5yr_Ex	CVC	7.20	82.76	83.78	83.64	83.89	0.004000	1.56	8.34	32.24	0.54	2.57
2101	10616	5yr_Ex	AMCAI	7.20	82.76	83.78	83.62	83.89	0.004000	1.56	8.34	32.24	0.54	2.57
2101	10616	10yr_Ex	CVC	8.90	82.76	83.89	83.77	83.98	0.003258	1.52	11.91	35.19	0.50	3.13
2101	10616	10yr_Ex	AMCAI	8.90	82.76	83.89	83.77	83.98	0.003258	1.52	11.91	35.19	0.50	3.13
2101	10616	25yr_Ex	CVC	10.70	82.76	83.99		84.07	0.002741	1.50	15.63	38.42	0.47	3.66
2101	10616	25yr_Ex	AMCAI	10.70	82.76	83.99		84.07	0.002741	1.50	15.63	38.42	0.47	3.66
2101	10616	50yr_Ex	CVC	12.70	82.76	84.09		84.16	0.002346	1.47	19.68	41.10	0.44	4.28
2101	10616	50yr_Ex	AMCAI	12.70	82.76	84.09		84.16	0.002346	1.47	19.68	41.10	0.44	4.28
2101	10616	100yr_Ex	CVC	15.00	82.76	84.21		84.27	0.001982	1.44	24.57	44.63	0.41	4.94
2101	10616	100yr_Ex	AMCAI	15.00	82.76	84.21		84.27	0.001982	1.44	24.57	44.63	0.41	4.94
2101	10616	Reg_Ex	CVC	42.20	82.76	84.55		84.71	0.004458	2.54	41.21	53.75	0.64	12.53
2101	10616	Reg_Ex	AMCAI	42.20	82.76	84.55		84.71	0.004458	2.54	41.21	53.75	0.64	12.53
2101	10616	2yr_Fut	CVC	8.20	82.76	83.85	83.73	83.94	0.003512	1.53	10.47	33.85	0.52	2.76
2101	10616	2yr_Fut	AMCAI	8.20	82.76	83.85	83.74	83.94	0.003512	1.53	10.47	33.85	0.52	2.76
2101	10616	5yr_Fut	CVC	11.30	82.76	84.02		84.10	0.002606	1.49	16.86	39.21	0.46	3.69
2101	10616	5yr_Fut	AMCAI	11.30	82.76	84.02		84.10	0.002606	1.49	16.86	39.21	0.46	3.69
2101	10616	10yr_Fut	CVC	14.80	82.76	84.20		84.26	0.002004	1.44	24.18	44.49	0.41	4.73
2101	10616	10yr_Fut	AMCAI	14.80	82.76	84.20		84.26	0.002004	1.44	24.18	44.49	0.41	4.73
2101	10616	25yr_Fut	CVC	17.60	82.76	84.32		84.38	0.001718	1.42	29.69	46.50	0.39	5.53
2101	10616	25yr_Fut	AMCAI	17.60	82.76	84.32		84.38	0.001718	1.42	29.69	46.50	0.39	5.54
2101	10616	50yr_Fut	CVC	20.80	82.76	84.43		84.49	0.001570	1.43	35.13	48.40	0.37	6.43
2101	10616	50yr_Fut	AMCAI	20.80	82.76	84.43		84.49	0.001570	1.43	35.13	48.40	0.37	6.43
2101	10616	100yr_Fut	CVC	24.00	82.76	84.54		84.59	0.001493	1.46	40.64	53.50	0.37	7.26
2101	10616	100yr_Fut	AMCAI	24.00	82.76	84.54		84.59	0.001493	1.46	40.64	53.50	0.37	7.26
2101	10616	Reg_Fut	CVC	44.30	82.76	84.58		84.75	0.004474	2.57	42.78	54.45	0.64	13.36
2101	10616	Reg_Fut	AMCAI	44.30	82.76	84.58		84.75	0.004474	2.57	42.78	54.45	0.64	13.36
2101	10590	2yr_Ex	CVC	5.20	82.64	83.31	83.31	83.55	0.015294	2.18	2.56	6.82	0.99	1.86
2101	10590	2yr_Ex	AMCAI	5.20	82.64	83.31	83.31	83.55	0.015294	2.18	2.56	6.82	0.99	1.86
2101	10590	5yr_Ex	CVC	7.20	82.64	83.46	83.46	83.71	0.011762	2.27	3.87	16.33	0.90	2.40
2101	10590	5yr_Ex	AMCAI	7.20	82.64	83.46	83.46	83.71	0.011762	2.27	3.87	16.33	0.90	2.40
2101	10590	10yr_Ex	CVC	8.90	82.64	83.55	83.55	83.82	0.011026	2.39	4.85	21.22	0.89	2.88
2101	10590	10yr_Ex	AMCAI	8.90	82.64	83.55	83.55	83.82	0.011026	2.39	4.85	21.22	0.89	2.88
2101	10590	25yr_Ex	CVC	10.70	82.64	83.63	83.63	83.92	0.010596	2.52	5.84	24.52	0.89	3.34
2101	10590	25yr_Ex	AMCAI	10.70	82.64	83.63	83.63	83.92	0.010596	2.52	5.84	24.52	0.89	3.34
2101	10590	50yr_Ex	CVC	12.70	82.64	83.71	83.71	84.03	0.010229	2.64	6.94	27.84	0.89	3.86
2101	10590	50yr_Ex	AMCAI	12.70	82.64	83.71	83.71	84.03	0.010229	2.64	6.94	27.84	0.89	3.86
2101	10590	100yr_Ex	CVC	15.00	82.64	83.78	83.78	84.14	0.010608	2.83	7.94	30.79	0.92	4.42
2101	10590	100yr_Ex	AMCAI	15.00	82.64	83.78	83.78	84.14	0.010608	2.83	7.94	30.79	0.92	4.42
2101	10590	Reg_Ex	CVC	42.20	82.64	84.38	84.27	84.58	0.005091	2.71	38.40	51.54	0.69	11.36
2101	10590	Reg_Ex	AMCAI	42.20	82.64	84.38	84.27	84.58	0.005091	2.71	38.40	51.54	0.69	11.36
2101	10590	2yr_Fut	CVC	8.20	82.64	83.51	83.51	83.77	0.011354	2.35	4.44	19.46	0.90	2.54
2101	10590	2yr_Fut	AM											

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m³/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m²)	Top Width (m)	Froude # Chl	Volume (1000 m³)
2101	10590	100yr Fut	CVC	24.00	82.64	84.09	84.09	84.48	0.008769	3.10	13.56	44.51	0.88	6.32
2101	10590	100yr Fut	AMCAI	24.00	82.64	84.09	84.09	84.48	0.008769	3.10	13.56	44.51	0.88	6.32
2101	10590	Reg Fut	CVC	44.30	82.64	84.41	84.29	84.61	0.005062	2.74	39.98	52.45	0.69	12.14
2101	10590	Reg Fut	AMCAI	44.30	82.64	84.41	84.29	84.61	0.005058	2.73	39.99	52.46	0.69	12.14
2101	10559	2yr Ex	CVC	5.20	82.14	83.02	82.89	83.15	0.006321	1.66	3.74	7.64	0.66	1.76
2101	10559	2yr Ex	AMCAI	5.20	82.14	83.02	82.89	83.15	0.006321	1.66	3.74	7.64	0.66	1.76
2101	10559	5yr Ex	CVC	7.20	82.14	83.12	83.01	83.30	0.007270	1.96	4.51	7.98	0.73	2.28
2101	10559	5yr Ex	AMCAI	7.20	82.14	83.12	83.01	83.30	0.007270	1.96	4.51	7.98	0.73	2.28
2101	10559	10yr Ex	CVC	8.90	82.14	83.18	83.09	83.41	0.008150	2.20	5.06	8.21	0.78	2.74
2101	10559	10yr Ex	AMCAI	8.90	82.14	83.18	83.09	83.41	0.008150	2.20	5.06	8.21	0.78	2.74
2101	10559	25yr Ex	CVC	10.70	82.14	83.24	83.17	83.52	0.009323	2.46	5.51	9.29	0.85	3.16
2101	10559	25yr Ex	AMCAI	10.70	82.14	83.24	83.17	83.52	0.009323	2.46	5.51	9.29	0.85	3.16
2101	10559	50yr Ex	CVC	12.70	82.14	83.29	83.26	83.64	0.010737	2.74	5.93	13.33	0.92	3.66
2101	10559	50yr Ex	AMCAI	12.70	82.14	83.29	83.26	83.64	0.010737	2.74	5.93	13.33	0.92	3.66
2101	10559	100yr Ex	CVC	15.00	82.14	83.40	83.34	83.77	0.009852	2.84	6.97	18.48	0.89	4.18
2101	10559	100yr Ex	AMCAI	15.00	82.14	83.40	83.34	83.77	0.009852	2.84	6.97	18.48	0.89	4.18
2101	10559	Reg Ex	CVC	42.20	82.14	84.08	84.08	84.42	0.006642	3.26	29.62	55.74	0.80	10.58
2101	10559	Reg Ex	AMCAI	42.20	82.14	84.08	84.08	84.42	0.006642	3.26	29.62	55.74	0.80	10.58
2101	10559	2yr Fut	CVC	8.20	82.14	83.16	83.06	83.37	0.007750	2.10	4.85	8.12	0.76	2.41
2101	10559	2yr Fut	AMCAI	8.20	82.14	83.16	83.06	83.37	0.007750	2.10	4.85	8.12	0.76	2.41
2101	10559	5yr Fut	CVC	11.30	82.14	83.25	83.20	83.56	0.009759	2.55	5.64	10.17	0.87	3.16
2101	10559	5yr Fut	AMCAI	11.30	82.14	83.25	83.20	83.56	0.009759	2.55	5.64	10.17	0.87	3.16
2101	10559	10yr Fut	CVC	14.80	82.14	83.40	83.33	83.76	0.009714	2.82	6.94	18.40	0.89	3.98
2101	10559	10yr Fut	AMCAI	14.80	82.14	83.40	83.33	83.76	0.009714	2.82	6.94	18.40	0.89	3.98
2101	10559	25yr Fut	CVC	17.60	82.14	83.42	83.45	83.91	0.012833	3.28	7.12	18.83	1.02	4.60
2101	10559	25yr Fut	AMCAI	17.60	82.14	83.42	83.45	83.91	0.012833	3.28	7.12	18.83	1.02	4.60
2101	10559	50yr Fut	CVC	20.80	82.14	83.53	83.56	84.04	0.012261	3.42	10.55	25.63	1.02	5.28
2101	10559	50yr Fut	AMCAI	20.80	82.14	83.53	83.56	84.04	0.012262	3.42	10.55	25.63	1.02	5.28
2101	10559	100yr Fut	CVC	24.00	82.14	83.59	83.78	84.16	0.013053	3.64	12.15	29.20	1.06	5.92
2101	10559	100yr Fut	AMCAI	24.00	82.14	83.59	83.78	84.16	0.013053	3.64	12.15	29.20	1.06	5.92
2101	10559	Reg Fut	CVC	44.30	82.14	84.11	84.11	84.45	0.006609	3.30	31.00	57.26	0.80	11.32
2101	10559	Reg Fut	AMCAI	44.30	82.14	84.11	84.11	84.45	0.006618	3.30	30.98	57.24	0.80	11.32
2101	10509	2yr Ex	CVC	5.20	81.91	82.65	82.57	82.77	0.009516	1.55	3.37	8.94	0.76	1.59
2101	10509	2yr Ex	AMCAI	5.20	81.91	82.65	82.57	82.77	0.009516	1.55	3.37	8.94	0.76	1.59
2101	10509	5yr Ex	CVC	7.20	81.91	82.75	82.66	82.90	0.008551	1.71	4.47	12.16	0.75	2.05
2101	10509	5yr Ex	AMCAI	7.20	81.91	82.75	82.66	82.90	0.008551	1.71	4.47	12.16	0.75	2.05
2101	10509	10yr Ex	CVC	8.90	81.91	82.83	82.74	83.00	0.007835	1.80	5.68	16.18	0.73	2.47
2101	10509	10yr Ex	AMCAI	8.90	81.91	82.83	82.74	83.00	0.007835	1.80	5.68	16.18	0.73	2.47
2101	10509	25yr Ex	CVC	10.70	81.91	82.92	82.82	83.08	0.007102	1.86	7.12	20.34	0.71	2.85
2101	10509	25yr Ex	AMCAI	10.70	81.91	82.92	82.82	83.08	0.007102	1.86	7.12	20.34	0.71	2.85
2101	10509	50yr Ex	CVC	12.70	81.91	83.00	82.89	83.18	0.006508	1.92	9.18	27.77	0.70	3.27
2101	10509	50yr Ex	AMCAI	12.70	81.91	83.00	82.89	83.18	0.006508	1.92	9.18	27.77	0.70	3.27
2101	10509	100yr Ex	CVC	15.00	81.91	82.98	82.95	83.25	0.010193	2.36	8.58	26.98	0.87	3.76
2101	10509	100yr Ex	AMCAI	15.00	81.91	82.98	82.95	83.25	0.010193	2.36	8.58	26.98	0.87	3.76
2101	10509	Reg Ex	CVC	42.20	81.91	83.33	83.49	83.90	0.015349	3.75	19.72	34.96	1.13	9.21
2101	10509	Reg Ex	AMCAI	42.20	81.91	83.33	83.49	83.90	0.015349	3.75	19.72	34.96	1.13	9.21
2101	10509	2yr Fut	CVC	8.20	81.91	82.80	82.71	82.96	0.008132	1.77	5.16	15.55	0.74	2.16
2101	10509	2yr Fut	AMCAI	8.20	81.91	82.80	82.71	82.96	0.008132	1.77	5.16	15.55	0.74	2.16
2101	10509	5yr Fut	CVC	11.30	81.91	82.94	82.85	83.11	0.006890	1.88	7.67	22.45	0.71	2.82
2101	10509	5yr Fut	AMCAI	11.30	81.91	82.94	82.85	83.11	0.006890	1.88	7.67	22.45	0.71	2.82
2101	10509	10yr Fut	CVC	14.80	81.91	82.97	82.95	83.24	0.010262	2.36	8.42	26.76	0.87	3.57
2101	10509	10yr Fut	AMCAI	14.80	81.91	82.97	82.95	83.24	0.010262	2.36	8.42	26.76	0.87	3.57
2101	10509	25yr Fut	CVC	17.60	81.91	83.07	83.07	83.32	0.008597	2.35	11.26	29.68	0.81	4.10
2101	10509	25yr Fut	AMCAI	17.60	81.91	83.07	83.07	83.32	0.008536	2.34	11.31	29.70	0.81	4.11
2101	10509	50yr Fut	CVC	20.80	81.91	83.10	83.15	83.42	0.010552	2.65	12.05	30.33	0.90	4.69
2101	10509	50yr Fut	AMCAI	20.80	81.91	83.10	83.15	83.42	0.010531	2.65	12.06	30.34	0.90	4.69
2101	10509	100yr Fut	CVC	24.00	81.91	83.15	83.20	83.50	0.010799	2.79	13.74	31.44	0.92	5.25
2101	10509	100yr Fut	AMCAI	24.00	81.91	83.15	83.20	83.50	0.010799	2.79	13.74	31.44	0.92	5.25
2101	10509	Reg Fut	CVC	44.30	81.91	83.36	83.52	83.93	0.015262	3.80	20.65	35.53	1.14	9.88
2101	10509	Reg Fut	AMCAI	44.30	81.91	83.36	83.52	83.93	0.015250	3.79	20.65	35.53	1.14	9.88
2101	10476	2yr Ex	CVC	5.20	81.51	82.12	82.12	82.35	0.016782	2.13	2.45	5.34	1.00	1.49
2101	10476	2yr Ex	AMCAI	5.20	81.51	82.12	82.12	82.35	0.016782	2.13	2.45	5.34	1.00	1.49
2101	10476	5yr Ex	CVC	7.20	81.51	82.25	82.25	82.51	0.015883	2.28	3.16	5.98	1.00	1.93
2101	10476	5yr Ex	AMCAI	7.20	81.51	82.25	82.25	82.51	0.015883	2.28	3.16	5.98	1.00	1.93
2101	10476	10yr Ex	CVC	8.90	81.51	82.34	82.34	82.63	0.015507	2.39	3.72	6.37	1.00	2.31
2101	10476	10yr Ex	AMCAI	8.90	81.51	82.34	82.34	82.63	0.015507	2.39	3.72	6.37	1.00	2.31
2101	10476	25yr Ex	CVC	10.70	81.51	82.43	82.43	82.74	0.015082	2.48	4.32	21.07	1.00	2.66
2101	10476	25yr Ex	AMCAI	10.70	81.51	82.43	82.43	82.74	0.015082	2.48	4.32	21.07	1.00	2.66
2101	10476	50yr Ex	CVC	12.70	81.51	82.52	82.52	82.85	0.014834	2.54	5.00	42.18	1.00	3.01
2101	10476	50yr Ex	AMCAI	12.70	81.51	82.52	82.52	82.85	0.014834	2.54	5.00	42.18	1.00	3.01
2101	10476	100yr Ex	CVC	15.00	81.51	82.66	82.66	82.91	0.009744	2.29	8.64	53.09	0.83	3.42
2101	10476	100yr Ex	AMCAI	15.00	81.51	82.66	82.66	82.91	0.009744	2.29	8.64	53.09	0.83	3.42
2101	10476	Reg Ex	CVC	42.20	81.51	83.18	83.18	83.54	0.008668	3.04	24.08	70.34	0.86	8.29
2101	10476	Reg Ex	AMCAI	42.20	81.51	83.18	83.18	83.54	0.008668	3.04	24.08	70.34	0.86	8.29
2101	10476	2yr Fut	CVC	8.20	81.51	82.30	82.30	82.58	0.015734	2.35	3.49	6.21	1.00	2.01
2101	10476	2yr Fut	AMCAI	8.20	81.51	82.30	82.30	82.58	0.015734	2.35	3.49	6.21	1.00	2.01
2101	10476	5yr Fut	CVC	11.30	81.51	82.46	82.46	82.77	0.015006	2.49	4.54	30.39	1.00	2.61
2101	10476	5yr Fut	AMCAI	11.30	81.51	82.46	82.46	82.77	0.015006	2.49	4.54	30.39	1.00	2.61
2101	10476	10yr Fut	CVC	14.80	81.51	82.66	82.66	82.91	0.009623	2.27	8.57	53.04	0.83	3.23
2101	10476	10yr Fut	AMCAI	14.80	81.51	82.66	82.66	82.91	0.009623	2.27	8.57	53.04	0.83	3.23
2101	10476	25yr Fut	CVC	17.60	81.51	82.70	82.74	83.00	0.011201	2.53	9.50	53.76	0.90	3.70
2101	10476	25yr Fut	AMCAI	17.60	81.51	82.70	82.74	83.00	0.011201	2.53	9.			

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10441	5yr_ Ex	CVC	7.20	79.61	80.79	80.04	80.81	0.000101	0.64	11.18	11.15	0.21	1.67
2101	10441	5yr_ Ex	AMCAI	7.20	79.61	80.79	80.04	80.81	0.000101	0.64	11.18	11.15	0.21	1.67
2101	10441	10yr_ Ex	CVC	8.90	79.61	81.02	80.11	81.05	0.000083	0.64	13.84	11.82	0.19	2.00
2101	10441	10yr_ Ex	AMCAI	8.90	79.61	81.02	80.11	81.05	0.000083	0.64	13.84	11.82	0.19	2.00
2101	10441	25yr_ Ex	CVC	10.70	79.61	81.22	80.17	81.24	0.000076	0.66	16.18	12.38	0.18	2.29
2101	10441	25yr_ Ex	AMCAI	10.70	79.61	81.22	80.17	81.24	0.000076	0.66	16.18	12.38	0.18	2.29
2101	10441	50yr_ Ex	CVC	12.70	79.61	81.40	80.23	81.43	0.000073	0.69	18.51	12.91	0.18	2.57
2101	10441	50yr_ Ex	AMCAI	12.70	79.61	81.40	80.23	81.43	0.000073	0.69	18.51	12.91	0.18	2.57
2101	10441	100yr_ Ex	CVC	15.00	79.61	81.59	80.31	81.62	0.000072	0.71	21.01	13.53	0.18	2.85
2101	10441	100yr_ Ex	AMCAI	15.00	79.61	81.59	80.31	81.62	0.000072	0.71	21.01	13.53	0.18	2.85
2101	10441	Reg_ Ex	CVC	42.20	79.61	82.75	80.94	82.81	0.000086	1.08	46.58	86.19	0.22	6.75
2101	10441	Reg_ Ex	AMCAI	42.20	79.61	82.75	80.94	82.81	0.000086	1.08	46.58	86.19	0.22	6.75
2101	10441	2yr_ Fut	CVC	8.20	79.61	80.85	80.08	80.87	0.000113	0.70	11.78	11.31	0.22	1.74
2101	10441	2yr_ Fut	AMCAI	8.20	79.61	80.85	80.08	80.87	0.000113	0.70	11.78	11.31	0.22	1.74
2101	10441	5yr_ Fut	CVC	11.30	79.61	81.19	80.19	81.22	0.000090	0.71	15.86	12.30	0.20	2.24
2101	10441	5yr_ Fut	AMCAI	11.30	79.61	81.19	80.19	81.22	0.000090	0.71	15.86	12.30	0.20	2.24
2101	10441	10yr_ Fut	CVC	14.80	79.61	81.49	80.30	81.52	0.000084	0.75	19.65	13.16	0.20	2.69
2101	10441	10yr_ Fut	AMCAI	14.80	79.61	81.49	80.30	81.52	0.000084	0.75	19.65	13.16	0.20	2.69
2101	10441	25yr_ Fut	CVC	17.60	79.61	81.74	80.38	81.77	0.000079	0.76	23.05	14.48	0.19	3.08
2101	10441	25yr_ Fut	AMCAI	17.60	79.61	81.74	80.38	81.77	0.000079	0.76	23.05	14.48	0.19	3.08
2101	10441	50yr_ Fut	CVC	20.80	79.61	81.96	80.46	81.99	0.000074	0.79	26.48	16.12	0.19	3.45
2101	10441	50yr_ Fut	AMCAI	20.80	79.61	81.96	80.46	81.99	0.000074	0.79	26.48	16.12	0.19	3.45
2101	10441	100yr_ Fut	CVC	24.00	79.61	82.21	80.55	82.24	0.000064	0.80	30.37	17.95	0.18	3.82
2101	10441	100yr_ Fut	AMCAI	24.00	79.61	82.21	80.55	82.24	0.000064	0.80	30.37	17.95	0.18	3.81
2101	10441	Reg_ Fut	CVC	44.30	79.61	82.79	80.97	82.86	0.000089	1.12	48.06	86.93	0.22	7.32
2101	10441	Reg_ Fut	AMCAI	44.30	79.61	82.79	80.97	82.86	0.000089	1.12	48.06	86.93	0.22	7.32
2101	10423	1-Lakeshore Rd		Culvert										
2101	10405	2yr_ Ex	CVC	5.20	79.31	80.49	79.63	80.50	0.000045	0.44	11.84	10.91	0.13	1.16
2101	10405	2yr_ Ex	AMCAI	5.20	79.31	80.49	79.63	80.50	0.000045	0.44	11.84	10.91	0.13	1.16
2101	10405	5yr_ Ex	CVC	7.20	79.31	80.76	79.70	80.77	0.000044	0.48	14.87	11.33	0.13	1.48
2101	10405	5yr_ Ex	AMCAI	7.20	79.31	80.76	79.70	80.77	0.000044	0.48	14.87	11.33	0.13	1.48
2101	10405	10yr_ Ex	CVC	8.90	79.31	80.99	79.76	81.00	0.000041	0.51	17.50	11.78	0.13	1.77
2101	10405	10yr_ Ex	AMCAI	8.90	79.31	80.99	79.76	81.00	0.000041	0.51	17.50	11.78	0.13	1.77
2101	10405	25yr_ Ex	CVC	10.70	79.31	81.18	79.82	81.19	0.000042	0.54	19.75	12.19	0.14	2.03
2101	10405	25yr_ Ex	AMCAI	10.70	79.31	81.18	79.82	81.19	0.000042	0.54	19.75	12.19	0.14	2.03
2101	10405	50yr_ Ex	CVC	12.70	79.31	81.35	79.88	81.37	0.000044	0.58	21.94	12.58	0.14	2.27
2101	10405	50yr_ Ex	AMCAI	12.70	79.31	81.35	79.88	81.37	0.000044	0.58	21.94	12.58	0.14	2.27
2101	10405	100yr_ Ex	CVC	15.00	79.31	81.53	79.94	81.55	0.000046	0.62	24.23	13.15	0.14	2.53
2101	10405	100yr_ Ex	AMCAI	15.00	79.31	81.53	79.94	81.55	0.000046	0.62	24.23	13.15	0.14	2.53
2101	10405	Reg_ Ex	CVC	42.20	79.31	82.40	80.56	82.46	0.000092	1.10	61.15	136.37	0.22	5.99
2101	10405	Reg_ Ex	AMCAI	42.20	79.31	82.40	80.56	82.46	0.000092	1.10	61.15	136.37	0.22	5.99
2101	10405	2yr_ Fut	CVC	8.20	79.31	80.81	79.74	80.82	0.000051	0.53	15.40	11.40	0.15	1.54
2101	10405	2yr_ Fut	AMCAI	8.20	79.31	80.81	79.74	80.82	0.000051	0.53	15.40	11.40	0.15	1.55
2101	10405	5yr_ Fut	CVC	11.30	79.31	81.14	79.84	81.16	0.000050	0.58	19.35	12.12	0.15	1.99
2101	10405	5yr_ Fut	AMCAI	11.30	79.31	81.14	79.84	81.16	0.000050	0.58	19.35	12.12	0.15	1.99
2101	10405	10yr_ Fut	CVC	14.80	79.31	81.43	79.94	81.45	0.000053	0.65	22.87	12.74	0.15	2.39
2101	10405	10yr_ Fut	AMCAI	14.80	79.31	81.43	79.94	81.45	0.000053	0.65	22.87	12.74	0.15	2.39
2101	10405	25yr_ Fut	CVC	17.60	79.31	81.66	80.01	81.69	0.000051	0.68	25.93	16.57	0.15	2.73
2101	10405	25yr_ Fut	AMCAI	17.60	79.31	81.66	80.01	81.69	0.000051	0.68	25.93	16.57	0.15	2.73
2101	10405	50yr_ Fut	CVC	20.80	79.31	81.88	80.10	81.90	0.000051	0.73	28.73	32.97	0.16	3.06
2101	10405	50yr_ Fut	AMCAI	20.80	79.31	81.88	80.10	81.90	0.000051	0.73	28.73	32.97	0.16	3.06
2101	10405	100yr_ Fut	CVC	24.00	79.31	82.08	80.17	82.11	0.000051	0.77	31.69	92.21	0.16	3.40
2101	10405	100yr_ Fut	AMCAI	24.00	79.31	82.08	80.17	82.11	0.000051	0.77	31.69	92.21	0.16	3.40
2101	10405	Reg_ Fut	CVC	44.30	79.31	82.44	80.60	82.50	0.000095	1.13	63.62	141.52	0.22	6.49
2101	10405	Reg_ Fut	AMCAI	44.30	79.31	82.44	80.60	82.50	0.000095	1.13	63.62	141.52	0.22	6.49
2101	10396	2yr_ Ex	CVC	9.10	78.80	80.08	80.08	80.40	0.003140	2.50	3.63	5.62	0.99	1.09
2101	10396	2yr_ Ex	AMCAI	9.10	78.80	80.08	80.08	80.40	0.003140	2.50	3.63	5.62	0.99	1.09
2101	10396	5yr_ Ex	CVC	13.00	78.80	80.26	80.26	80.66	0.003051	2.77	4.69	6.03	1.00	1.39
2101	10396	5yr_ Ex	AMCAI	13.00	78.80	80.26	80.26	80.66	0.003051	2.77	4.69	6.03	1.00	1.39
2101	10396	10yr_ Ex	CVC	16.80	78.80	80.43	80.43	80.87	0.002913	2.95	5.69	6.40	1.00	1.67
2101	10396	10yr_ Ex	AMCAI	16.80	78.80	80.43	80.43	80.87	0.002913	2.95	5.69	6.40	1.00	1.67
2101	10396	25yr_ Ex	CVC	20.30	78.80	80.56	80.56	81.05	0.002821	3.09	6.56	6.71	1.00	1.91
2101	10396	25yr_ Ex	AMCAI	20.30	78.80	80.56	80.56	81.05	0.002821	3.09	6.56	6.71	1.00	1.91
2101	10396	50yr_ Ex	CVC	23.80	78.80	80.67	80.67	81.21	0.002728	3.25	7.34	7.21	1.00	2.14
2101	10396	50yr_ Ex	AMCAI	23.80	78.80	80.67	80.67	81.21	0.002728	3.25	7.34	7.21	1.00	2.14
2101	10396	100yr_ Ex	CVC	27.60	78.80	80.79	80.79	81.38	0.002612	3.41	8.21	7.85	0.99	2.38
2101	10396	100yr_ Ex	AMCAI	27.60	78.80	80.79	80.79	81.38	0.002612	3.41	8.21	7.85	0.99	2.38
2101	10396	Reg_ Ex	CVC	57.70	78.80	81.91	81.91	82.34	0.000929	3.15	45.81	125.47	0.66	5.40
2101	10396	Reg_ Ex	AMCAI	57.70	78.80	81.91	81.91	82.34	0.000929	3.15	45.81	125.47	0.66	5.40
2101	10396	2yr_ Fut	CVC	13.80	78.80	80.30	80.30	80.70	0.002979	2.80	4.93	6.12	1.00	1.45
2101	10396	2yr_ Fut	AMCAI	13.80	78.80	80.30	80.30	80.70	0.002979	2.80	4.93	6.12	1.00	1.45
2101	10396	5yr_ Fut	CVC	19.70	78.80	80.53	80.53	81.02	0.002884	3.09	6.39	6.64	1.00	1.87
2101	10396	5yr_ Fut	AMCAI	19.70	78.80	80.53	80.53	81.02	0.002884	3.09	6.39	6.64	1.00	1.87
2101	10396	10yr_ Fut	CVC	25.40	78.80	80.72	80.72	81.28	0.002689	3.33	7.69	7.48	1.00	2.25
2101	10396	10yr_ Fut	AMCAI	25.40	78.80	80.72	80.72	81.28	0.002689	3.33	7.69	7.48	1.00	2.25
2101	10396	25yr_ Fut	CVC	30.60	78.80	80.88	80.88	81.50	0.002519	3.51	8.94	8.34	0.99	2.57
2101	10396	25yr_ Fut	AMCAI	30.60	78.80	80.88	80.88	81.50	0.002519	3.51	8.94	8.34	0.99	2.57
2101	10396	50yr_ Fut	CVC	35.60	78.80	81.02	81.02	81.70	0.002401	3.67	10.18	9.11	0.98	2.87
2101	10396	50yr_ Fut	AMCAI	35.60	78.80	81.02	81.02	81.70	0.002401	3.67	10.18	9.11	0.98	2.87
2101	10396	100yr_ Fut	CVC	40.80	78.80	81.16	81.16	81.90	0.002286	3.82	11.52	9.88	0.97	3.17
2101	10396	100yr_ Fut	AMCAI	40.80	78.80	81.16	81.16	81.90	0.002286	3.82	11.52	9.88	0.97	3.17
2101	10396	Reg_ Fut	CVC	60.50	78.									

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10341	25yr_Ex	AMCAI	20.30	78.41	79.96	80.19	80.79	0.006068	4.04	5.02	6.05	1.42	1.59
2101	10341	50yr_Ex	CVC	23.80	78.41	80.06	80.31	80.96	0.005862	4.19	5.67	6.27	1.41	1.78
2101	10341	50yr_Ex	AMCAI	23.80	78.41	80.06	80.31	80.96	0.005861	4.19	5.68	6.27	1.41	1.78
2101	10341	100yr_Ex	CVC	27.60	78.41	80.17	80.43	81.13	0.005733	4.35	6.34	6.47	1.40	1.98
2101	10341	100yr_Ex	AMCAI	27.60	78.41	80.17	80.43	81.13	0.005731	4.35	6.34	6.47	1.40	1.98
2101	10341	Reg_Ex	CVC	57.70	78.41	80.96	81.64	82.18	0.003476	4.91	12.50	9.65	1.20	3.53
2101	10341	Reg_Ex	AMCAI	57.70	78.41	80.96	81.64	82.18	0.003476	4.91	12.50	9.65	1.20	3.53
2101	10341	2yr_Fut	CVC	13.80	78.41	79.73	79.93	80.43	0.006747	3.71	3.72	5.61	1.45	1.21
2101	10341	2yr_Fut	AMCAI	13.80	78.41	79.73	79.93	80.43	0.006741	3.70	3.73	5.61	1.45	1.21
2101	10341	5yr_Fut	CVC	19.70	78.41	79.94	80.17	80.76	0.006099	4.01	4.91	6.02	1.42	1.56
2101	10341	5yr_Fut	AMCAI	19.70	78.41	79.94	80.17	80.76	0.006097	4.01	4.91	6.02	1.42	1.56
2101	10341	10yr_Fut	CVC	25.40	78.41	80.11	80.36	81.03	0.005808	4.26	5.96	6.35	1.41	1.87
2101	10341	10yr_Fut	AMCAI	25.40	78.41	80.11	80.36	81.03	0.005786	4.26	5.96	6.36	1.40	1.87
2101	10341	25yr_Fut	CVC	30.60	78.41	80.24	80.52	81.26	0.005653	4.47	6.85	6.63	1.40	2.13
2101	10341	25yr_Fut	AMCAI	30.60	78.41	80.25	80.52	81.26	0.005647	4.47	6.85	6.63	1.40	2.13
2101	10341	50yr_Fut	CVC	35.60	78.41	80.36	80.66	81.47	0.005504	4.66	7.65	6.93	1.40	2.38
2101	10341	50yr_Fut	AMCAI	35.60	78.41	80.36	80.66	81.47	0.005506	4.66	7.65	6.93	1.40	2.38
2101	10341	100yr_Fut	CVC	40.80	78.41	80.48	80.79	81.67	0.005171	4.82	8.50	7.41	1.38	2.61
2101	10341	100yr_Fut	AMCAI	40.80	78.41	80.48	80.79	81.67	0.005171	4.82	8.50	7.41	1.38	2.61
2101	10341	Reg_Fut	CVC	60.50	78.41	81.11	81.69	82.23	0.002864	4.71	14.18	13.58	1.10	3.75
2101	10341	Reg_Fut	AMCAI	60.50	78.41	81.11	81.69	82.23	0.002864	4.71	14.18	13.58	1.10	3.75
2101	10290	2yr_Ex	CVC	9.10	78.01	79.14	79.31	79.73	0.007858	3.40	2.68	5.22	1.52	0.77
2101	10290	2yr_Ex	AMCAI	9.10	78.01	79.14	79.31	79.73	0.007842	3.40	2.68	5.22	1.51	0.77
2101	10290	5yr_Ex	CVC	13.00	78.01	79.28	79.50	80.01	0.007660	3.79	3.43	5.50	1.53	0.99
2101	10290	5yr_Ex	AMCAI	13.00	78.01	79.28	79.50	80.01	0.007654	3.79	3.43	5.50	1.53	0.99
2101	10290	10yr_Ex	CVC	16.80	78.01	79.40	79.65	80.25	0.007409	4.08	4.12	5.75	1.54	1.18
2101	10290	10yr_Ex	AMCAI	16.80	78.01	79.40	79.66	80.25	0.007405	4.07	4.12	5.75	1.54	1.18
2101	10290	25yr_Ex	CVC	20.30	78.01	79.51	79.79	80.45	0.007206	4.29	4.74	5.96	1.54	1.34
2101	10290	25yr_Ex	AMCAI	20.30	78.01	79.51	79.79	80.45	0.007211	4.29	4.73	5.96	1.54	1.34
2101	10290	50yr_Ex	CVC	23.80	78.01	79.61	79.91	80.62	0.007024	4.46	5.33	6.15	1.53	1.50
2101	10290	50yr_Ex	AMCAI	23.80	78.01	79.61	79.92	80.62	0.007022	4.46	5.33	6.15	1.53	1.50
2101	10290	100yr_Ex	CVC	27.60	78.01	79.71	80.03	80.80	0.006888	4.64	5.95	6.35	1.53	1.67
2101	10290	100yr_Ex	AMCAI	27.60	78.01	79.71	80.03	80.80	0.006894	4.64	5.95	6.35	1.53	1.67
2101	10290	Reg_Ex	CVC	57.70	78.01	80.36	80.81	81.93	0.005238	5.56	10.74	8.59	1.44	2.94
2101	10290	Reg_Ex	AMCAI	57.70	78.01	80.36	80.83	81.93	0.005223	5.55	10.75	8.60	1.44	2.94
2101	10290	2yr_Fut	CVC	13.80	78.01	79.31	79.53	80.07	0.007604	3.86	3.58	5.56	1.54	1.03
2101	10290	2yr_Fut	AMCAI	13.80	78.01	79.31	79.53	80.07	0.007600	3.86	3.58	5.56	1.54	1.03
2101	10290	5yr_Fut	CVC	19.70	78.01	79.49	79.77	80.41	0.007229	4.25	4.63	5.92	1.53	1.31
2101	10290	5yr_Fut	AMCAI	19.70	78.01	79.49	79.77	80.41	0.007233	4.25	4.63	5.92	1.54	1.31
2101	10290	10yr_Fut	CVC	25.40	78.01	79.65	79.95	80.70	0.006965	4.54	5.59	6.24	1.53	1.58
2101	10290	10yr_Fut	AMCAI	25.40	78.01	79.65	79.97	80.70	0.006977	4.54	5.59	6.24	1.53	1.58
2101	10290	25yr_Fut	CVC	30.60	78.01	79.78	80.12	80.94	0.006789	4.76	6.42	6.50	1.53	1.80
2101	10290	25yr_Fut	AMCAI	30.60	78.01	79.78	80.12	80.94	0.006775	4.76	6.43	6.50	1.53	1.80
2101	10290	50yr_Fut	CVC	35.60	78.01	79.89	80.25	81.15	0.006678	4.96	7.18	6.73	1.53	2.00
2101	10290	50yr_Fut	AMCAI	35.60	78.01	79.89	80.26	81.15	0.006678	4.96	7.18	6.73	1.53	2.00
2101	10290	100yr_Fut	CVC	40.80	78.01	80.00	80.39	81.36	0.006475	5.16	7.91	7.10	1.53	2.20
2101	10290	100yr_Fut	AMCAI	40.80	78.01	80.00	80.39	81.36	0.006499	5.17	7.91	7.09	1.53	2.20
2101	10290	Reg_Fut	CVC	60.50	78.01	80.43	80.93	82.00	0.004927	5.56	11.37	8.96	1.41	3.10
2101	10290	Reg_Fut	AMCAI	60.50	78.01	80.43	80.93	82.00	0.004927	5.56	11.37	8.96	1.41	3.10
2101	10253	2yr_Ex	CVC	9.10	77.70	78.83	79.00	79.43	0.008086	3.43	2.65	5.22	1.54	0.67
2101	10253	2yr_Ex	AMCAI	9.10	77.70	78.83	79.00	79.43	0.008079	3.43	2.65	5.22	1.54	0.67
2101	10253	5yr_Ex	CVC	13.00	77.70	78.96	79.19	79.72	0.007992	3.85	3.38	5.49	1.57	0.86
2101	10253	5yr_Ex	AMCAI	13.00	77.70	78.96	79.19	79.72	0.007989	3.85	3.38	5.49	1.57	0.86
2101	10253	10yr_Ex	CVC	16.80	77.70	79.08	79.34	79.96	0.007821	4.15	4.05	5.72	1.58	1.02
2101	10253	10yr_Ex	AMCAI	16.80	77.70	79.08	79.35	79.96	0.007818	4.15	4.05	5.73	1.58	1.02
2101	10253	25yr_Ex	CVC	20.30	77.70	79.18	79.48	80.16	0.007682	4.38	4.63	5.93	1.58	1.16
2101	10253	25yr_Ex	AMCAI	20.30	77.70	79.18	79.48	80.16	0.007685	4.38	4.63	5.93	1.58	1.16
2101	10253	50yr_Ex	CVC	23.80	77.70	79.28	79.60	80.35	0.007537	4.58	5.20	6.12	1.58	1.30
2101	10253	50yr_Ex	AMCAI	23.80	77.70	79.28	79.60	80.35	0.007536	4.58	5.20	6.12	1.58	1.30
2101	10253	100yr_Ex	CVC	27.60	77.70	79.37	79.72	80.53	0.007413	4.76	5.80	6.31	1.59	1.44
2101	10253	100yr_Ex	AMCAI	27.60	77.70	79.37	79.72	80.53	0.007416	4.76	5.80	6.31	1.59	1.44
2101	10253	Reg_Ex	CVC	57.70	77.70	79.99	80.49	81.71	0.006043	5.81	10.14	8.00	1.53	2.55
2101	10253	Reg_Ex	AMCAI	57.70	77.70	79.99	80.49	81.70	0.006035	5.80	10.14	8.00	1.53	2.55
2101	10253	2yr_Fut	CVC	13.80	77.70	78.99	79.22	79.77	0.007958	3.92	3.52	5.54	1.57	0.89
2101	10253	2yr_Fut	AMCAI	13.80	77.70	78.99	79.23	79.77	0.007956	3.92	3.52	5.54	1.57	0.89
2101	10253	5yr_Fut	CVC	19.70	77.70	79.17	79.46	80.13	0.007703	4.34	4.53	5.89	1.58	1.14
2101	10253	5yr_Fut	AMCAI	19.70	77.70	79.17	79.46	80.13	0.007704	4.35	4.53	5.89	1.58	1.14
2101	10253	10yr_Fut	CVC	25.40	77.70	79.32	79.64	80.42	0.007484	4.66	5.45	6.20	1.59	1.37
2101	10253	10yr_Fut	AMCAI	25.40	77.70	79.32	79.66	80.42	0.007491	4.66	5.45	6.20	1.59	1.37
2101	10253	25yr_Fut	CVC	30.60	77.70	79.45	79.81	80.67	0.007321	4.89	6.25	6.45	1.59	1.56
2101	10253	25yr_Fut	AMCAI	30.60	77.70	79.45	79.81	80.67	0.007312	4.89	6.26	6.45	1.59	1.56
2101	10253	50yr_Fut	CVC	35.60	77.70	79.56	79.94	80.88	0.007205	5.09	6.99	6.68	1.59	1.74
2101	10253	50yr_Fut	AMCAI	35.60	77.70	79.56	79.95	80.88	0.007205	5.09	6.99	6.68	1.59	1.74
2101	10253	100yr_Fut	CVC	40.80	77.70	79.66	80.08	81.10	0.007075	5.30	7.70	6.93	1.59	1.90
2101	10253	100yr_Fut	AMCAI	40.80	77.70	79.66	80.08	81.10	0.007093	5.31	7.69	6.93	1.59	1.90
2101	10253	Reg_Fut	CVC	60.50	77.70	80.05	80.55	81.79	0.005800	5.84	10.63	8.21	1.51	2.69
2101	10253	Reg_Fut	AMCAI	60.50	77.70	80.05	80.56	81.79	0.005800	5.84	10.63	8.21	1.51	2.69
2101	10202	2yr_Ex	CVC	9.10	77.39	78.58	78.69	79.05	0.005550	3.03	3.01	5.35	1.29	0.53
2101	10202	2yr_Ex	AMCAI	9.10	77.39	78.58	78.69	79.05	0.005551	3.03	3.01	5.35	1.29	0.53
2101	10202	5yr_Ex	CVC	13.00	77.39	78.72	78.88	79.33	0.005877	3.47	3.75	5.62	1.36	0.68
2101	10202	5yr_Ex	AMCAI	13.00	77.39	78.72	78.88	79.33	0.005877	3.47	3.75	5.62	1.36	0.68
2101	10202	10yr_Ex	CVC	16.80	77.39	78.84	79.03	79.57	0					



HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10202	2yr_Fut	CVC	13.80	77.39	78.74	78.91	79.39	0.005918	3.54	3.89	5.67	1.37	0.71
2101	10202	2yr_Fut	AMCAI	13.80	77.39	78.74	78.91	79.39	0.005918	3.54	3.89	5.67	1.37	0.71
2101	10202	5yr_Fut	CVC	19.70	77.39	78.92	79.15	79.74	0.006135	4.02	4.90	6.01	1.42	0.90
2101	10202	5yr_Fut	AMCAI	19.70	77.39	78.92	79.15	79.74	0.006135	4.02	4.90	6.01	1.42	0.90
2101	10202	10yr_Fut	CVC	25.40	77.39	79.06	79.33	80.04	0.006248	4.37	5.81	6.31	1.46	1.08
2101	10202	10yr_Fut	AMCAI	25.40	77.39	79.06	79.33	80.04	0.006249	4.37	5.81	6.31	1.46	1.08
2101	10202	25yr_Fut	CVC	30.60	77.39	79.19	79.50	80.29	0.006307	4.64	6.59	6.55	1.48	1.23
2101	10202	25yr_Fut	AMCAI	30.60	77.39	79.19	79.50	80.28	0.006305	4.64	6.59	6.55	1.48	1.23
2101	10202	50yr_Fut	CVC	35.60	77.39	79.29	79.63	80.50	0.006343	4.87	7.31	6.77	1.50	1.37
2101	10202	50yr_Fut	AMCAI	35.60	77.39	79.29	79.64	80.50	0.006343	4.87	7.31	6.77	1.50	1.37
2101	10202	100yr_Fut	CVC	40.80	77.39	79.39	79.77	80.73	0.006300	5.12	7.99	7.23	1.51	1.51
2101	10202	100yr_Fut	AMCAI	40.80	77.39	79.39	79.78	80.73	0.006305	5.12	7.98	7.23	1.51	1.51
2101	10202	Reg_Fut	CVC	60.50	77.39	79.72	80.48	81.49	0.005970	5.89	10.70	9.02	1.53	2.15
2101	10202	Reg_Fut	AMCAI	60.50	77.39	79.72	80.49	81.49	0.005970	5.89	10.70	9.02	1.53	2.15
2101	10154	2yr_Ex	CVC	9.10	77.00	78.13	78.30	78.72	0.008015	3.42	2.66	5.22	1.53	0.39
2101	10154	2yr_Ex	AMCAI	9.10	77.00	78.13	78.30	78.72	0.008030	3.42	2.66	5.22	1.53	0.39
2101	10154	5yr_Ex	CVC	13.00	77.00	78.27	78.49	79.00	0.007619	3.79	3.43	5.50	1.53	0.51
2101	10154	5yr_Ex	AMCAI	13.00	77.00	78.27	78.49	79.00	0.007619	3.79	3.43	5.50	1.53	0.51
2101	10154	10yr_Ex	CVC	16.80	77.00	78.39	78.64	79.24	0.007446	4.08	4.12	5.75	1.54	0.80
2101	10154	10yr_Ex	AMCAI	16.80	77.00	78.39	78.65	79.24	0.007446	4.08	4.12	5.75	1.54	0.80
2101	10154	25yr_Ex	CVC	20.30	77.00	78.49	78.78	79.44	0.007358	4.32	4.70	5.95	1.55	0.69
2101	10154	25yr_Ex	AMCAI	20.30	77.00	78.49	78.78	79.44	0.007358	4.32	4.70	5.95	1.55	0.69
2101	10154	50yr_Ex	CVC	23.80	77.00	78.59	78.90	79.63	0.007282	4.52	5.26	6.13	1.56	0.77
2101	10154	50yr_Ex	AMCAI	23.80	77.00	78.59	78.91	79.63	0.007282	4.52	5.26	6.13	1.56	0.77
2101	10154	100yr_Ex	CVC	27.60	77.00	78.68	79.02	79.82	0.007245	4.72	5.84	6.32	1.57	0.86
2101	10154	100yr_Ex	AMCAI	27.60	77.00	78.68	79.02	79.82	0.007245	4.72	5.84	6.32	1.57	0.86
2101	10154	Reg_Ex	CVC	57.70	77.00	79.23	79.96	81.08	0.006832	6.02	9.96	9.35	1.62	1.55
2101	10154	Reg_Ex	AMCAI	57.70	77.00	79.23	79.98	81.07	0.006828	6.02	9.96	9.35	1.62	1.55
2101	10154	2yr_Fut	CVC	13.80	77.00	78.30	78.52	79.06	0.007568	3.85	3.58	5.56	1.53	0.53
2101	10154	2yr_Fut	AMCAI	13.80	77.00	78.30	78.52	79.06	0.007569	3.85	3.58	5.56	1.53	0.53
2101	10154	5yr_Fut	CVC	19.70	77.00	78.48	78.76	79.41	0.007374	4.28	4.60	5.91	1.55	0.68
2101	10154	5yr_Fut	AMCAI	19.70	77.00	78.48	78.76	79.41	0.007374	4.28	4.60	5.91	1.55	0.68
2101	10154	10yr_Fut	CVC	25.40	77.00	78.63	78.94	79.71	0.007256	4.61	5.51	6.21	1.56	0.81
2101	10154	10yr_Fut	AMCAI	25.40	77.00	78.63	78.96	79.71	0.007256	4.61	5.51	6.21	1.56	0.81
2101	10154	25yr_Fut	CVC	30.60	77.00	78.75	79.11	79.95	0.007169	4.86	6.30	6.46	1.57	0.92
2101	10154	25yr_Fut	AMCAI	30.60	77.00	78.75	79.11	79.95	0.007168	4.86	6.30	6.46	1.57	0.92
2101	10154	50yr_Fut	CVC	35.60	77.00	78.86	79.25	80.17	0.007128	5.07	7.02	6.68	1.58	1.03
2101	10154	50yr_Fut	AMCAI	35.60	77.00	78.86	79.26	80.17	0.007128	5.07	7.02	6.68	1.58	1.03
2101	10154	100yr_Fut	CVC	40.80	77.00	78.96	79.51	80.40	0.007132	5.31	7.68	7.12	1.60	1.13
2101	10154	100yr_Fut	AMCAI	40.80	77.00	78.96	79.52	80.40	0.007135	5.31	7.68	7.11	1.60	1.13
2101	10154	Reg_Fut	CVC	60.50	77.00	79.28	80.00	81.17	0.006727	6.10	10.40	9.74	1.62	1.65
2101	10154	Reg_Fut	AMCAI	60.50	77.00	79.28	80.00	81.17	0.006727	6.10	10.40	9.74	1.62	1.65
2101	10100	2yr_Ex	CVC	9.10	76.55	77.67	77.85	78.28	0.008349	3.47	2.63	5.20	1.56	0.25
2101	10100	2yr_Ex	AMCAI	9.10	76.55	77.67	77.85	78.28	0.008355	3.47	2.62	5.20	1.56	0.25
2101	10100	5yr_Ex	CVC	13.10	76.55	77.81	78.04	78.58	0.008042	3.87	3.39	5.49	1.57	0.32
2101	10100	5yr_Ex	AMCAI	13.10	76.55	77.81	78.04	78.58	0.008043	3.87	3.39	5.49	1.57	0.32
2101	10100	10yr_Ex	CVC	16.90	76.55	77.93	78.20	78.82	0.007959	4.18	4.04	5.72	1.59	0.38
2101	10100	10yr_Ex	AMCAI	16.90	76.55	77.93	78.20	78.82	0.007959	4.18	4.04	5.72	1.59	0.38
2101	10100	25yr_Ex	CVC	20.40	76.55	78.03	78.34	79.03	0.007892	4.43	4.61	5.91	1.60	0.44
2101	10100	25yr_Ex	AMCAI	20.40	76.55	78.03	78.34	79.03	0.007892	4.43	4.61	5.91	1.60	0.44
2101	10100	50yr_Ex	CVC	24.00	76.55	78.12	78.46	79.22	0.007770	4.64	5.18	6.11	1.61	0.49
2101	10100	50yr_Ex	AMCAI	24.00	76.55	78.12	78.46	79.22	0.007770	4.64	5.18	6.11	1.61	0.49
2101	10100	100yr_Ex	CVC	27.80	76.55	78.21	78.59	79.41	0.007728	4.84	5.74	6.29	1.62	0.54
2101	10100	100yr_Ex	AMCAI	27.80	76.55	78.21	78.59	79.41	0.007728	4.84	5.74	6.29	1.62	0.54
2101	10100	Reg_Ex	CVC	58.40	76.55	78.76	79.36	80.68	0.007403	6.18	10.35	24.38	1.68	0.98
2101	10100	Reg_Ex	AMCAI	58.40	76.55	78.76	79.36	80.68	0.007400	6.18	10.35	24.39	1.68	0.98
2101	10100	2yr_Fut	CVC	13.90	76.55	77.84	78.08	78.63	0.008022	3.94	3.53	5.54	1.58	0.34
2101	10100	2yr_Fut	AMCAI	13.90	76.55	77.84	78.08	78.63	0.008023	3.94	3.53	5.54	1.58	0.34
2101	10100	5yr_Fut	CVC	19.90	76.55	78.02	78.32	79.00	0.007840	4.38	4.54	5.89	1.60	0.43
2101	10100	5yr_Fut	AMCAI	19.90	76.55	78.02	78.32	79.00	0.007840	4.38	4.54	5.89	1.60	0.43
2101	10100	10yr_Fut	CVC	25.80	76.55	78.17	78.52	79.30	0.007640	4.71	5.47	6.20	1.60	0.52
2101	10100	10yr_Fut	AMCAI	25.80	76.55	78.17	78.52	79.30	0.007641	4.71	5.47	6.20	1.60	0.52
2101	10100	25yr_Fut	CVC	30.90	76.55	78.29	78.71	79.55	0.007625	4.98	6.21	6.43	1.62	0.59
2101	10100	25yr_Fut	AMCAI	30.90	76.55	78.29	78.71	79.55	0.007624	4.98	6.21	6.43	1.62	0.59
2101	10100	50yr_Fut	CVC	36.10	76.55	78.40	78.86	79.77	0.007505	5.19	6.96	6.66	1.62	0.66
2101	10100	50yr_Fut	AMCAI	36.10	76.55	78.40	78.86	79.77	0.007505	5.19	6.96	6.66	1.62	0.66
2101	10100	100yr_Fut	CVC	41.30	76.55	78.50	79.00	80.00	0.007519	5.42	7.63	7.81	1.64	0.72
2101	10100	100yr_Fut	AMCAI	41.30	76.55	78.50	79.00	80.00	0.007521	5.43	7.63	7.80	1.64	0.72
2101	10100	Reg_Fut	CVC	61.20	76.55	78.79	79.37	80.78	0.007388	6.28	10.82	26.49	1.69	1.03
2101	10100	Reg_Fut	AMCAI	61.20	76.55	78.79	79.37	80.78	0.007388	6.28	10.82	26.49	1.69	1.03
2101	10028	2yr_Ex	CVC	9.10	76.05	77.22	77.35	77.73	0.006241	3.15	2.89	5.30	1.36	0.05
2101	10028	2yr_Ex	AMCAI	9.10	76.05	77.22	77.35	77.73	0.006239	3.15	2.89	5.30	1.36	0.05
2101	10028	5yr_Ex	CVC	13.10	76.05	77.36	77.54	78.02	0.006510	3.60	3.64	5.58	1.42	0.07
2101	10028	5yr_Ex	AMCAI	13.10	76.05	77.36	77.54	78.02	0.006510	3.60	3.64	5.58	1.42	0.07
2101	10028	10yr_Ex	CVC	16.90	76.05	77.47	77.70	78.26	0.006628	3.93	4.30	5.81	1.46	0.08
2101	10028	10yr_Ex	AMCAI	16.90	76.05	77.47	77.70	78.26	0.006628	3.93	4.30	5.81	1.46	0.08
2101	10028	25yr_Ex	CVC	20.40	76.05	77.57	77.84	78.47	0.006710	4.19	4.87	6.00	1.49	0.09
2101	10028	25yr_Ex	AMCAI	20.40	76.05	77.57	77.84	78.47	0.006710	4.19	4.87	6.00	1.49	0.09
2101	10028	50yr_Ex	CVC	24.00	76.05	77.66	77.96	78.66	0.006776	4.42	5.43	6.19	1.51	0.10
2101	10028	50yr_Ex	AMCAI	24.00	76.05	77.66	77.96	78.66	0.006776	4.42	5.43	6.19	1.51	0.10
2101	10028	100yr_Ex	CVC	27.80	76.05	77.75	78.08	78.85	0.006826	4.64	6.00	6.37	1.53	0.12
2101	10028	100yr_Ex	AMCAI	27.80	76.05	77.75	78.08	78.85	0.006827	4.64	6.00	6.37		

HEC-RAS River: Clearview Creek Reach: 2101 (Continued)

Reach	River Sta	Profile	Plan	Q Total (m3/s)	Min Ch El (m)	W.S. Elev (m)	Crit W.S. (m)	E.G. Elev (m)	E.G. Slope (m/m)	Vel Chnl (m/s)	Flow Area (m2)	Top Width (m)	Froude # Chl	Volume (1000 m3)
2101	10028	25yr_Fut	AMCAI	30.90	76.05	77.82	78.16	79.00	0.006856	4.79	6.44	6.51	1.54	0.13
2101	10028	50yr_Fut	CVC	36.10	76.05	77.93	78.31	79.22	0.006889	5.03	7.17	6.73	1.56	0.14
2101	10028	50yr_Fut	AMCAI	36.10	76.05	77.93	78.31	79.22	0.006889	5.03	7.17	6.73	1.56	0.14
2101	10028	100yr_Fut	CVC	41.30	76.05	78.03	78.45	79.45	0.006877	5.28	7.83	7.06	1.57	0.16
2101	10028	100yr_Fut	AMCAI	41.30	76.05	78.03	78.45	79.45	0.006878	5.28	7.83	7.06	1.57	0.16
2101	10028	Reg_Fut	CVC	61.20	76.05	78.35	78.96	80.24	0.006611	6.10	10.32	8.48	1.61	0.21
2101	10028	Reg_Fut	AMCAI	61.20	76.05	78.35	78.96	80.24	0.006611	6.10	10.32	8.48	1.61	0.21
2101	10022	2yr_Ex	CVC	9.10	74.94	75.80	76.24	77.54	0.021544	5.84	1.56	2.68	2.45	0.04
2101	10022	2yr_Ex	AMCAI	9.10	74.94	75.80	76.24	77.54	0.021542	5.84	1.56	2.68	2.45	0.04
2101	10022	5yr_Ex	CVC	13.10	74.94	75.97	76.43	77.83	0.030760	6.03	2.17	5.02	2.93	0.05
2101	10022	5yr_Ex	AMCAI	13.10	74.94	75.97	76.43	77.83	0.030778	6.03	2.17	5.02	2.93	0.05
2101	10022	10yr_Ex	CVC	16.90	74.94	76.08	76.59	78.07	0.026431	6.26	2.70	5.23	2.78	0.06
2101	10022	10yr_Ex	AMCAI	16.90	74.94	76.08	76.59	78.07	0.026419	6.26	2.70	5.23	2.78	0.06
2101	10022	25yr_Ex	CVC	20.40	74.94	76.16	76.72	78.28	0.023815	6.44	3.17	5.41	2.68	0.07
2101	10022	25yr_Ex	AMCAI	20.40	74.94	76.16	76.72	78.28	0.023815	6.44	3.17	5.41	2.68	0.07
2101	10022	50yr_Ex	CVC	24.00	74.94	76.25	76.85	78.47	0.021910	6.60	3.64	5.58	2.61	0.08
2101	10022	50yr_Ex	AMCAI	24.00	74.94	76.25	76.85	78.47	0.021908	6.60	3.64	5.58	2.61	0.08
2101	10022	100yr_Ex	CVC	27.80	74.94	76.33	76.96	78.66	0.020408	6.76	4.11	5.75	2.55	0.09
2101	10022	100yr_Ex	AMCAI	27.80	74.94	76.33	76.96	78.66	0.020407	6.76	4.11	5.75	2.55	0.09
2101	10022	Reg_Ex	CVC	58.40	74.94	76.87	77.75	79.96	0.015772	7.78	7.50	6.84	2.37	0.15
2101	10022	Reg_Ex	AMCAI	58.40	74.94	76.87	77.75	79.96	0.015771	7.78	7.50	6.84	2.37	0.15
2101	10022	2yr_Fut	CVC	13.90	74.94	75.99	76.47	77.88	0.029658	6.08	2.29	5.07	2.89	0.05
2101	10022	2yr_Fut	AMCAI	13.90	74.94	75.99	76.47	77.88	0.029658	6.08	2.29	5.07	2.89	0.05
2101	10022	5yr_Fut	CVC	19.90	74.94	76.15	76.71	78.25	0.024138	6.41	3.10	5.38	2.70	0.07
2101	10022	5yr_Fut	AMCAI	19.90	74.94	76.15	76.71	78.25	0.024136	6.41	3.10	5.38	2.70	0.07
2101	10022	10yr_Fut	CVC	25.80	74.94	76.29	76.91	78.56	0.021147	6.68	3.86	5.66	2.58	0.08
2101	10022	10yr_Fut	AMCAI	25.80	74.94	76.29	76.91	78.56	0.021145	6.68	3.86	5.66	2.58	0.08
2101	10022	25yr_Fut	CVC	30.90	74.94	76.40	77.05	78.81	0.019439	6.87	4.50	5.88	2.51	0.09
2101	10022	25yr_Fut	AMCAI	30.90	74.94	76.40	77.05	78.81	0.019439	6.87	4.50	5.88	2.51	0.09
2101	10022	50yr_Fut	CVC	36.10	74.94	76.50	77.20	79.04	0.018168	7.05	5.12	6.09	2.46	0.10
2101	10022	50yr_Fut	AMCAI	36.10	74.94	76.50	77.20	79.04	0.018161	7.05	5.12	6.09	2.45	0.10
2101	10022	100yr_Fut	CVC	41.30	74.94	76.60	77.33	79.27	0.017331	7.23	5.71	6.28	2.42	0.12
2101	10022	100yr_Fut	AMCAI	41.30	74.94	76.60	77.33	79.26	0.017329	7.23	5.71	6.28	2.42	0.12
2101	10022	Reg_Fut	CVC	61.20	74.94	76.91	77.81	80.06	0.015285	7.85	7.80	6.96	2.34	0.16
2101	10022	Reg_Fut	AMCAI	61.20	74.94	76.91	77.81	80.06	0.015285	7.85	7.80	6.96	2.34	0.16
2101	10010	2yr_Ex	CVC	9.10	74.55	74.99	75.41	77.00	0.122771	6.28	1.45	4.70	3.61	0.02
2101	10010	2yr_Ex	AMCAI	9.10	74.55	74.99	75.41	77.00	0.122765	6.28	1.45	4.70	3.61	0.02
2101	10010	5yr_Ex	CVC	13.10	74.55	75.11	75.59	77.20	0.095413	6.41	2.04	5.29	3.29	0.02
2101	10010	5yr_Ex	AMCAI	13.10	74.55	75.11	75.59	77.20	0.095442	6.41	2.04	5.29	3.29	0.02
2101	10010	10yr_Ex	CVC	16.90	74.55	75.19	75.72	77.51	0.089264	6.74	2.51	5.70	3.25	0.03
2101	10010	10yr_Ex	AMCAI	16.90	74.55	75.19	75.72	77.51	0.089243	6.74	2.51	5.70	3.25	0.03
2101	10010	25yr_Ex	CVC	20.40	74.55	75.26	75.82	77.75	0.085357	6.99	2.92	6.08	3.22	0.03
2101	10010	25yr_Ex	AMCAI	20.40	74.55	75.26	75.82	77.75	0.085348	6.99	2.92	6.08	3.22	0.03
2101	10010	50yr_Ex	CVC	24.00	74.55	75.33	75.91	77.97	0.083522	7.20	3.33	6.52	3.22	0.03
2101	10010	50yr_Ex	AMCAI	24.00	74.55	75.33	75.91	77.97	0.083505	7.20	3.33	6.52	3.22	0.03
2101	10010	100yr_Ex	CVC	27.80	74.55	75.39	76.00	78.18	0.082305	7.40	3.76	6.99	3.22	0.04
2101	10010	100yr_Ex	AMCAI	27.80	74.55	75.39	76.00	78.18	0.082303	7.40	3.76	6.99	3.22	0.04
2101	10010	Reg_Ex	CVC	58.40	74.55	75.75	76.61	79.53	0.076931	8.61	6.79	9.75	3.27	0.06
2101	10010	Reg_Ex	AMCAI	58.40	74.55	75.75	76.61	79.53	0.076928	8.61	6.79	9.75	3.27	0.06
2101	10010	2yr_Fut	CVC	13.90	74.55	75.12	75.63	77.27	0.093968	6.49	2.14	5.38	3.28	0.02
2101	10010	2yr_Fut	AMCAI	13.90	74.55	75.12	75.63	77.27	0.093961	6.49	2.14	5.38	3.28	0.02
2101	10010	5yr_Fut	CVC	19.90	74.55	75.25	75.81	77.72	0.085715	6.96	2.86	6.02	3.22	0.03
2101	10010	5yr_Fut	AMCAI	19.90	74.55	75.25	75.81	77.72	0.085712	6.96	2.86	6.02	3.22	0.03
2101	10010	10yr_Fut	CVC	25.80	74.55	75.36	75.95	78.07	0.082989	7.30	3.53	6.75	3.22	0.04
2101	10010	10yr_Fut	AMCAI	25.80	74.55	75.36	75.95	78.07	0.082981	7.30	3.54	6.75	3.22	0.04
2101	10010	25yr_Fut	CVC	30.90	74.55	75.44	76.07	78.34	0.081457	7.54	4.10	7.34	3.22	0.04
2101	10010	25yr_Fut	AMCAI	30.90	74.55	75.44	76.07	78.34	0.081457	7.54	4.10	7.34	3.22	0.04
2101	10010	50yr_Fut	CVC	36.10	74.55	75.51	76.18	78.58	0.080181	7.77	4.65	7.88	3.23	0.05
2101	10010	50yr_Fut	AMCAI	36.10	74.55	75.51	76.18	78.58	0.080161	7.77	4.65	7.88	3.23	0.05
2101	10010	100yr_Fut	CVC	41.30	74.55	75.57	76.29	78.82	0.079409	7.98	5.18	8.36	3.24	0.05
2101	10010	100yr_Fut	AMCAI	41.30	74.55	75.57	76.29	78.82	0.079403	7.98	5.18	8.36	3.24	0.05
2101	10010	Reg_Fut	CVC	61.20	74.55	75.77	76.66	79.64	0.075804	8.71	7.05	9.87	3.26	0.07
2101	10010	Reg_Fut	AMCAI	61.20	74.55	75.77	76.66	79.64	0.075804	8.71	7.05	9.87	3.26	0.07
2101	10001	2yr_Ex	CVC	9.10	74.50	74.63	74.76	75.14	0.205315	3.16	2.88	23.96	2.90	
2101	10001	2yr_Ex	AMCAI	9.10	74.50	74.63	74.76	75.14	0.205340	3.16	2.88	23.96	2.90	
2101	10001	5yr_Ex	CVC	13.10	74.50	74.65	74.82	75.45	0.277260	3.95	3.31	24.57	3.44	
2101	10001	5yr_Ex	AMCAI	13.10	74.50	74.65	74.82	75.45	0.277260	3.95	3.31	24.57	3.44	
2101	10001	10yr_Ex	CVC	16.90	74.50	74.67	74.88	75.74	0.332433	4.58	3.69	25.10	3.82	
2101	10001	10yr_Ex	AMCAI	16.90	74.50	74.67	74.88	75.74	0.332272	4.58	3.69	25.10	3.82	
2101	10001	25yr_Ex	CVC	20.40	74.50	74.68	74.92	76.00	0.370284	5.08	4.02	25.41	4.08	
2101	10001	25yr_Ex	AMCAI	20.40	74.50	74.68	74.92	75.99	0.370250	5.08	4.02	25.41	4.08	
2101	10001	50yr_Ex	CVC	24.00	74.50	74.69	74.97	76.23	0.391852	5.49	4.37	25.69	4.25	
2101	10001	50yr_Ex	AMCAI	24.00	74.50	74.69	74.97	76.23	0.391785	5.49	4.37	25.69	4.25	
2101	10001	100yr_Ex	CVC	27.80	74.50	74.71	75.01	76.46	0.405370	5.86	4.75	25.97	4.37	
2101	10001	100yr_Ex	AMCAI	27.80	74.50	74.71	75.01	76.46	0.405305	5.86	4.75	25.97	4.37	
2101	10001	Reg_Ex	CVC	58.40	74.50	74.81	75.30	77.96	0.444316	7.87	7.42	27.93	4.87	
2101	10001	Reg_Ex	AMCAI	58.40	74.50	74.81	75.30	77.96	0.444364	7.87	7.42	27.93	4.87	
2101	10001	2yr_Fut	CVC	13.90	74.50	74.65	74.84	75.51	0.290200	4.10	3.39	24.69	3.53	
2101	10001	2yr_Fut	AMCAI	13.90	74.50	74.65	74.84	75.51	0.290200	4.10	3.39	24.69	3.53	
2101	10001	5yr_Fut	CVC	19.90	74.50	74.68	74.92	75.96	0.366379	5.02	3.97	25.37	4.05	
2101	10001	5yr_Fut	AMCAI	19.90	74.50	74.68	74.92	75.96	0.366344	5.02	3.97	25.37	4.05	
2101	10001	10yr_Fut	CVC	25.80	74.50	74.70	74.99	76.34	0.398939	5.67	4.55	25.82	4.31	
2101	10001	10yr_Fut	AMCAI	25.80	74.50	74.70								

**CHART D5 - 13A & B****CHART D5-13A - MAXIMUM PERMISSIBLE AVERAGE VELOCITIES IN ERODIBLE CHANNELS<sup>1</sup>**

Material	Maximum permissible velocities for		
	Clear water	Water carrying fine silts	Water carrying sand and gravel
Fine sand (noncolloidal) .....	m/s 0.46	m/s 0.76	m/s 0.46
Sandy loam (noncolloidal) .....	0.52	0.76	0.61
Silt loam (noncolloidal) .....	0.61	0.91	0.61
Ordinary firm loam .....	0.76	1.07	0.67
Volcanic ash .....	0.76	1.07	0.61
Fine gravel .....	0.76	1.52	1.13
Stiff clay (very colloidal) .....	1.13	1.52	0.91
Graded, loam to cobbles (noncolloidal) .....	1.13	1.52	1.52
Graded, silt to cobbles (colloidal) ...	1.22	1.68	1.52
Alluvial silts (noncolloidal) .....	0.61	1.07	0.61
Alluvial silts (colloidal) .....	1.13	1.52	0.91
Coarse gravel (noncolloidal) .....	1.22	1.83	1.98
Cobbles and Shingles .....	1.52	1.68	1.98
Shales and hard pans .....	1.83	1.83	1.52

<sup>1</sup> As recommended by Special Committee on Irrigation Research, American Society of Civil Engineers, 1926, for channels with straight alignment. For sinuous channels multiply allowable velocity by 0.95 for slightly sinuous, by 0.9 for moderately sinuous channels, and by 0.8 for highly sinuous channels. Based on uniform flow in continuously wet channel (47).

**CHART D5-13B - MAXIMUM PERMISSIBLE AVERAGE VELOCITIES IN GRASSED CHANNELS<sup>1 2</sup>, LINED WITH UNIFORM STANDS OF VARIOUS GRASS COVERS.**

Cover	Slope range	Maximum permissible velocity for	
		Erosion-resistant soils	Easily eroded soils
	%	m/s	m/s
Bermudagrass	0-5	2.44	1.83
	5-10	2.13	1.52
	over 10	1.83	1.22
Buffalograss	0-5	2.13	1.52
Kentucky bluegrass	5-10	1.83	1.22
Smooth brome	over 10	1.52	0.91
Blue grama			
<b>Grass mixture</b>	<b>0-5<sup>3</sup></b>	<b>1.52</b>	<b>1.22</b>
	0-10 <sup>3</sup>	1.22	0.91
Lespedeza sericea			
Weeping lovegrass			
Yellow bluestem			
Kudzu	0-5 <sup>4</sup>	1.07	0.76
Alfalfa			
Crabgrass			
Common lespedeza <sup>5</sup>	0-5 <sup>4</sup>	1.07	0.76
Sudangrass <sup>5</sup>			

<sup>1</sup> From Handbook of Channel Design for Soil and Water Conservation.  
<sup>2</sup> Use velocities over 1.5 m/s only where good covers and proper maintenance can be obtained.  
<sup>3</sup> Do not use on slopes steeper than 10 percent.  
<sup>4</sup> Use on slopes steeper than 5 percent is not recommended.  
<sup>5</sup> Annuals, used on mild slopes or as temporary protection until permanent covers are established (47).

**APPENDIX E**  
**SANITARY SERVICING (ALTERNATIVE 3)**





**LEGEND**


x 96.00    EXISTING ELEVATION

**12.6 ha**  
**1251575**    AREA (ha)  
POPULATION (PERSONS)  
EQUIVALENT POPULATION DENSITY (PERSONS/HECTARE)

-----    EXISTING SANITARY SEWER  
-----    PROPOSED FORCEMAIN  
-----    PROPOSED SANITARY

●    PROPOSED PRIVATE PUMP CHAMBER  
■    PROPOSED REGIONAL PUMPING STATION

**3**    SANITARY ALTERNATIVE 3  
**4**    SANITARY ALTERNATIVE 4

 a.m.candaras associates inc.  
consulting engineers  
8551 Weston rd., suite 203  
Woodbridge ont. L4L 9R4  
905-850-8020 Fax 905-850-8099  
Email: civil@amcal.com

**PROPOSED SANITARY SERVING**

**SPECULATIVE MULTI TENANT INDUSTRIAL BUILDINGS**  
772 WINSTON CHURCHILL BLVD.  
TOWN OF OAKVILLE  
REGION OF HALTON

SCALE	N.T.S.	DATE	JANUARY 2021	PROJ NO.	1113
DRAWN	F.P.	PLAN NO.			
DESIGNED	F.P.	FIGURE 2			



### **Alternative 3:**

#### **Connection to the existing 300 mm sanitary sewer at Beryl Road and Winston Churchill to service all four properties, 824, 772, 568 and 570/580 Winston Churchill**

*The existing manhole invert of 94.59 m, located at Beryl Road and Winston Churchill intersection, is approximately equivalent to the centerline elevation of Winston Churchill adjacent to the 772 Winston Churchill site.*

A Regional wastewater pumping station would be therefore be required. The pumping station would be located at the northeast portion of the 772 Winston Churchill Blvd site and a municipal forcemain would discharge to the sanitary manhole on Beryl Road. A 200 m length of municipal forcemain would be required along Winston Churchill Drive. In addition, about 400 m of 300 mm sanitary sewer on Winston Churchill Blvd to service the 13.24 ha (570/580 and 568 Winston Churchill Blvd) lands to the south.

There is an existing 300mm sanitary sewer on Beryl Road as shown in Figure 2. The conveyance capacity of the existing 300 mm sanitary sewer system along Beryl Road are as follows:

Minimum capacity	=	24.7 l/s (Based on 300 mm @ 0.06%)
Maximum capacity	=	55.6 l/s (Based on 300 mm @ 0.33%)

The existing sanitary flows discharging to the Beryl Road 300 mm sanitary sewer, based on the light industrial area flows as per the Region of Halton design criteria are:

Existing flows north of Beryl Road	=	6.1 l/s
Existing flows along Beryl Road	=	<u>22.8 l/s</u>
Total Flow	=	28.9 l/s

With the additional sanitary flows, that will be generated by the proposed development at 772 Winston Churchill plus future developments at 824, 568 and 570/580 Winston Churchill. The total sanitary flows would be:

Total existing flow to Beryl Road	=	28.9 l/s	
Additional flows from future developments	=	<u>39.7 l/s</u>	(See Section 2.1)
Total		68.6 l/s	

This will require about 475 m of 300 mm dia. sanitary sewer on Beryl Road to be replaced with 375 mm at an average slope of 0.18%.

