



SERVICING AND STORMWATER MANAGEMENT REPORT

PROPOSED WAREHOUSE
2360 BRISTOL CIRCLE
OAKVILLE, ON

PREPARED FOR:
KANEFF GROUP
8501 MISSISSAUGA ROAD
BRAMPTON, ON L6Y 5G8

DATE: SEPTEMBER 2023

PROJECT NO. 231423

PREPARED BY HUSSON
200 CACHET WOODS COURT, SUITE 204
MARKHAM, ON L6C 0Z8
GENERAL@HUSSON.CA

TABLE OF CONTENTS

1.0	Introduction	1
2.0	Stormwater Design	1
2.1	Design Criteria	1
2.2	Major and Minor System Drainage	2
2.2.1	Existing Drainage	2
2.2.1	Minor System Design	2
2.2.2	Major System Design	3
2.3	Peak Flow Controls	4
2.3.1	Rooftop Storage	4
2.3.2	Underground Pipe Storage	5
2.3.3	Surface Storage	5
2.3.4	Uncontrolled Runoff	6
2.3.5	Hydrology Modelling	6
2.4	Quality Control	7
3.0	Sanitary Servicing	7
4.0	Water Servicing	8
5.0	Erosion and Sediment Control	8
5.1	Existing Site Condition	8
5.2	Erosion and Sediment Control Plan	8
6.0	Conclusions	9

LIST OF FIGURES

- Figure 1. Site Location Plan
- Figure 2. Existing SWM Plan
- Figure 3. Storm Drainage Plan
- Figure 4. Proposed SWM Plan

LIST OF TABLES

Table 1.	Catchbasin Inlet Capacity Summary	3
Table 2.	Target Release Rates	4
Table 3.	Rooftop Storage	5
Table 4.	Underground Storage Summary	5
Table 5.	Surface Storage Summary	5
Table 6.	Orifice Control Summary	6
Table 7.	Catchment Parameters	6
Table 8.	Storage Volume Summary	6
Table 9.	Peak Flow Comparison	7
Table 10.	Oil/Grit Separator Sizing	7

LIST OF APPENDICES

- Appendix A – Background Information
- Appendix B – Storm Drainage Calculations
- Appendix C – Controlled Flow Roof Drainage Details
- Appendix D – Stormwater Management Calculations
- Appendix E – Hydrology Modelling
- Appendix F – Quality Control Device Specifications

LIST OF DRAWINGS

- Drawing SW1. Grading Plan West Side
- Drawing SW2. Servicing Plan West Side
- Drawing SW3. Erosion and Sediment Control Plan

1.0 INTRODUCTION

The purpose of this report is to provide detailed design information related to the stormwater management (SWM) plan and servicing design for the proposed new Warehouse at 2360 Bristol Circle in Oakville, Ontario. This report will demonstrate the measures that will be undertaken to deal with storm and sanitary drainage, and water servicing for the site.

The site is located at the northwest corner of Bristol Circle and Brighton Road in the Town of Oakville. There is an existing office building located on the site. The site area is 1.20ha. **Figure 1** shows the site location.

Site Development Plan A 1.0, prepared by Pearce McClusky Architects, shows the proposed development. It is proposed to construct a 2,880m² warehouse on the vacant portion at the southeast corner and associated landscape and parking areas. The building will be industrial and include truck loading bays along the south side of the buildings.

The servicing and stormwater management plan has been designed to meet the requirements of the Town of Oakville. The following materials were referenced in the preparation of this report.


- Winston Industrial Business Park Guidelines for Preparation of Stormwater Management Report (Winston Park SWM Guidelines), provided by the Town (refer to **Appendix A**).
- The Stormwater Management Planning and Design Manual (MECP Guidelines), prepared by the Ministry of the Environment, Conservation and Parks, March 2003.
- The Erosion & Sediment Control Guideline for Urban Construction, prepared by the Greater Golden Horseshoe Area Conservation Authorities (GGHA CA), December 2006.

2.0 STORMWATER DESIGN

2.1 Design Criteria

The stormwater management criteria is outlined in the Winston Park SWM Guidelines.

- Runoff from the 5-year storm should be limited to 100 litres/sec/hectare, based on the 4-hour Chicago Distribution.
- Runoff from the 100-year storm should be limited to 200 litres/sec/hectare, based on the 4-hour Chicago Distribution.
- Drainage is to be self-contained unless a communal facility is feasible. The development has been almost entirely built out, therefore, a communal facility would not be practical at this stage.
- Overland flow is to be directed to a safe outlet without negatively impacting neighbouring properties.
- The system should have redundancy if possible.

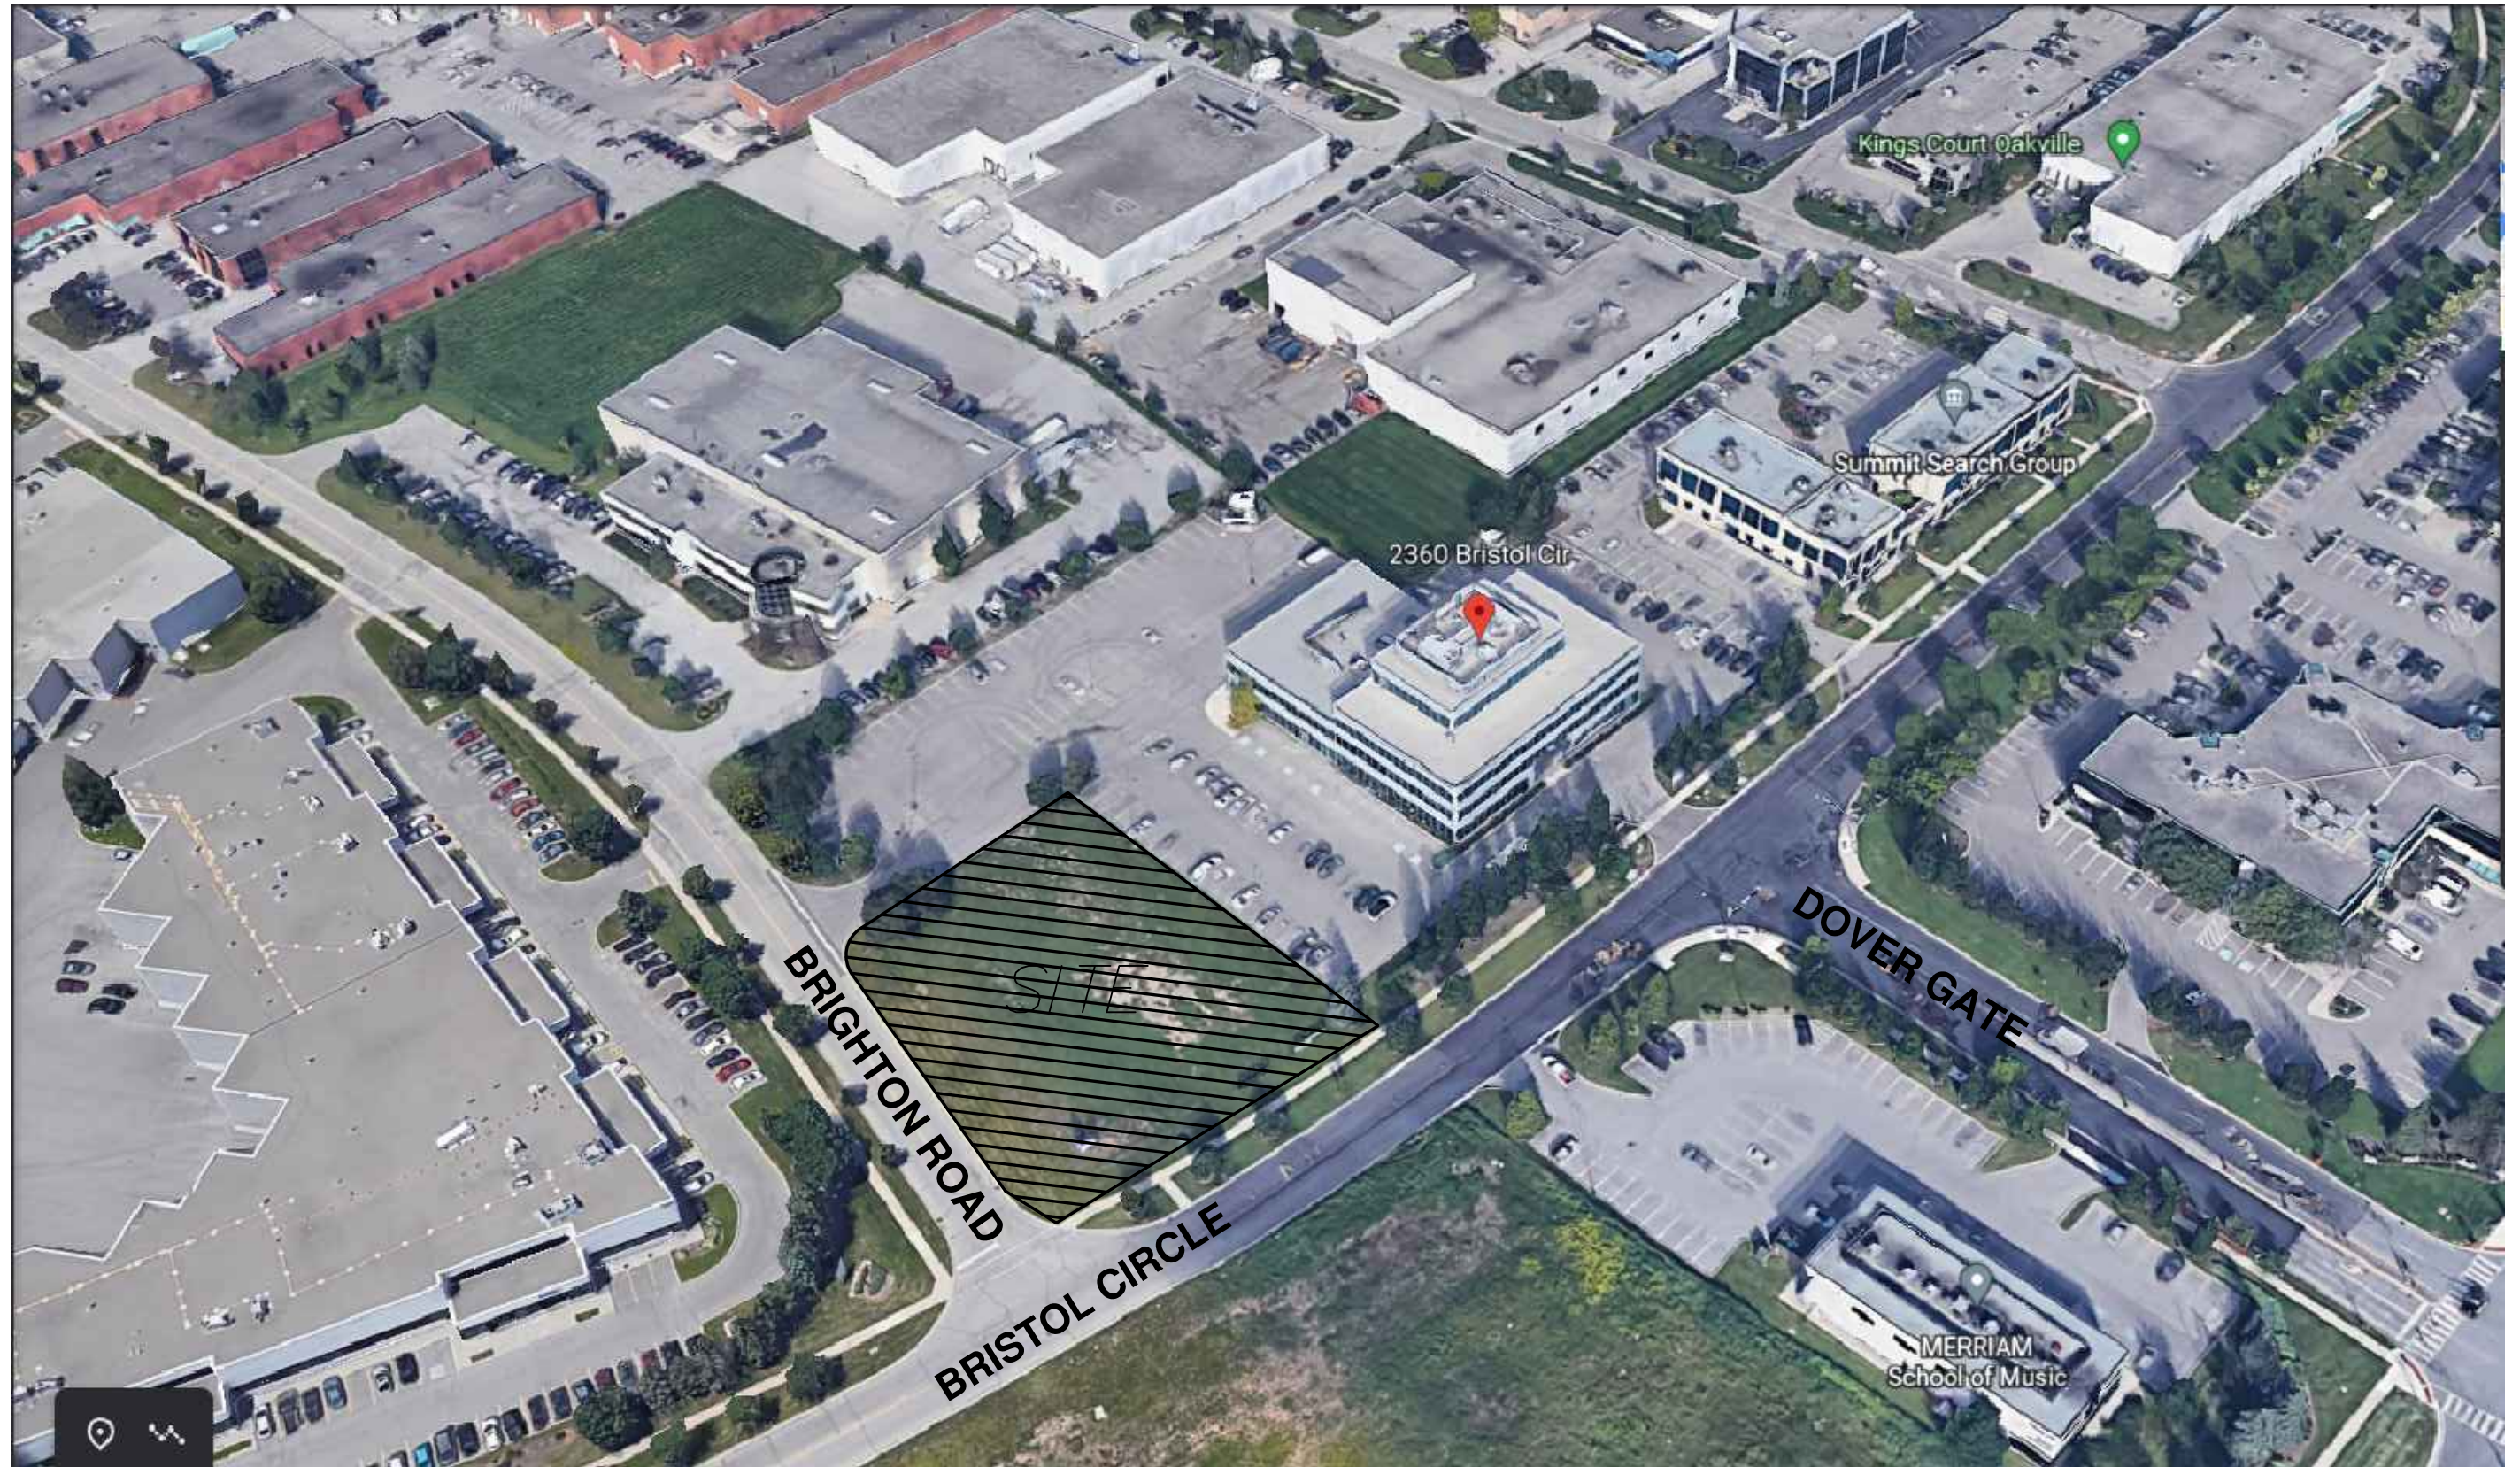

- Outlet control devices will be located in a manhole at the property line. The control device shall be installed on the upstream side of the manhole. The controlled device is standardized, being comprised of a two-plate bolted design with minimum 75mm square diamond shape opening.
- No area ponding of the 5-year storm is allowed on any paved area with the exception of depressed loading dock areas where it should be kept to a minimum. Ponding over the 5-year storm shall be limited to remote parking areas only, not driveways or access ways.
- Hydrology modelling is to be completed with Otthymo/Interhymo computer model.
- On-site water quality facilities must be clearly defined. The Town will accept oil/grit separators only where no other available measure to control water quality can be obtained.
- An emergency overland flow rate must be designed to convey stormwater to a safe outlet. Avoid fire routes where major ponding or overland flows are proposed.

2.2 Major and Minor System Drainage

2.2.1 Existing Drainage

The Grading & Servicing Plan for the existing site was prepared by Cosburn Patterson Mather Limited (CPM) in 1999. The plan is provided in **Appendix A**. The existing drainage on the site and on the adjacent roads is shown on **Figure 2** and summarized below:


- There is a 525mm diameter storm sewer on Bristol Circle, draining from west to east across the frontage of the site.
- There is a storm sewer on Brighton Road, draining south to north across the frontage of the site.
- There are two storm service connections to the site; and 450mm connected to the Brighton Road storm sewer and one connected to the Bristol Storm sewer. Each service connection has a 125mm x 125mm diamond shaped orifice control.

The site has saw-toothed grading with drainage directed to on-site catchbasins. Surplus storage is provided in two oversized pipes; a 1200mm diameter sewer upstream of the Brighton outlet and a 1350mm diameter sewer upstream of the Bristol outlet. The existing storm drainage is shown on **Figure 2**.


2.2.1 Minor System Design

As discussed above, two existing sewer outlets to the site; one to Bristol Circle and one to Brighton Road. Storm sewer systems have been designed to convey the 5-year runoff from the subject lands to these storm sewer connection points. The proposed grading design consists of sawtoothed grading through the parking lot with water ponding above the catchbasins. With this type of design, the majority of the 100-year storm will be captured in the minor (storm sewer) system. Details of the on-site ponding are provided in **Section 2.3**.


The existing oversized storm sewer connected to Bristol Circle is located under the proposed building and will be removed. The new storm sewer, west of the building will not need to be oversized based on the proposed controls, as discussed in Section 2.3.

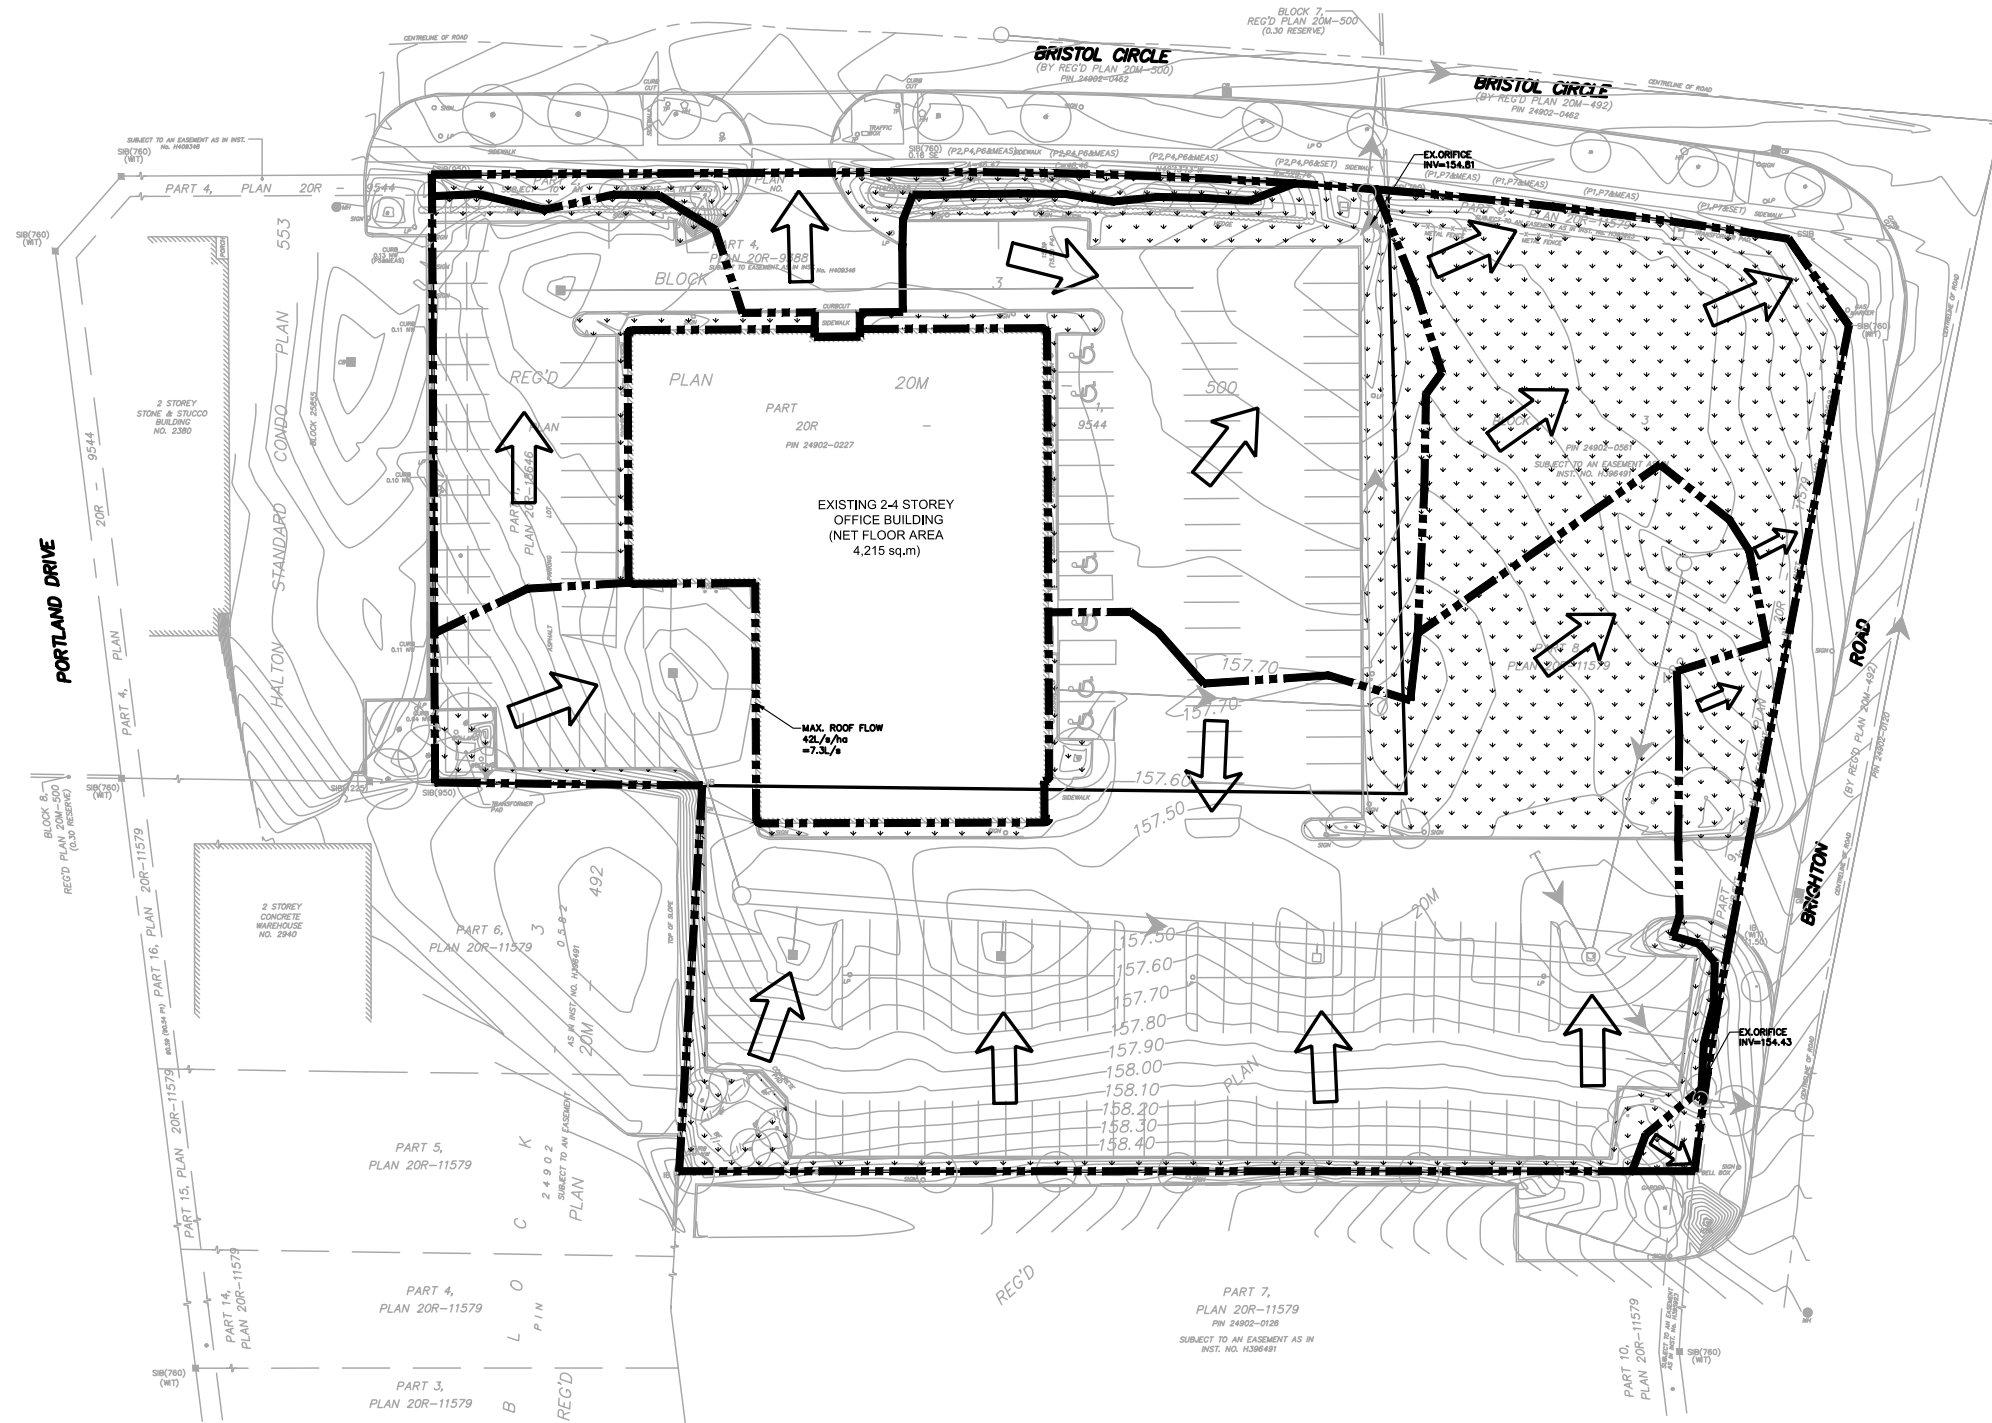

LEGEND




CATCHMENT AREA
CATCHMENT ID



OVERLAND FLOW DIRECTION



CATCHMENT BOUNDARY



PERVIOUS AREA

HUSSON
ENGINEERING + MANAGEMENT
P 905.709.5825
300 CACHET WOODS COURT, SUITE 204
MARKHAM, ON L3C 0Z8
HUSSON.CA

FIGURE 2
2360 BRISTOL CIRCLE
EXISTING SWM PLAN

DATE: SEPTEMBER 2023 SCALE: 1:750 PROJECT: 231423

As well, the Town does not permit surface ponding within the fire route in the 100-year event. The fire route is located above the 100-year ponding elevation within each catchment. Further, the Town has requested that the minor system will not surcharge above the catchbasin top elevations within the fire route during the 100-year storm. The catchbasins have been located outside of the fire route and will overtop the curb before there is any significant ponding within the fire route.

Drawing SW2 shows the proposed storm sewer system design and the storm sewer design sheet for the site can be referenced in **Appendix B**.

An analysis was completed to ensure that the on-site catchbasins have capacity for the 5-year design storm, to limit surface ponding during frequent events. MTO Design Chart 4.19: Inlet Capacity at a Sag was referenced to determine the inlet capacity of each catchbasin. The capacity was determined assuming 50 percent blockage. **Table 1** provides a summary of the inlet capacities for each catchbasin. Refer to **Figure 3** for the catchment areas and **Appendix B** for calculations.

Table 1. Catchbasin Inlet Capacity Summary


Catchbasin	Catchment Area (m ²)	5 Year Post-Development Peak Flow (L/s)	Depth (mm)	Inlet Capacity (With 50% blockage) (L/s)
CB2	518	14.8	250	90
CB3	686	19.6	250	90
CB4	302	8.6	180	71.5
CB5	401	11.4	70	12.5
CB6	199	5.7	70	12.5
EX.CB1	359	10.3	70	12.5
EX.CBMH2	114	3.3	150	60
EX.CB3	1063	30.4	260	93.5
EX.CB4	751	21.4	270	95

Therefore, all catchbasins will have capacity to accept the 5-year peak flow. Refer to detailed calculations in **Appendix A**.

Stormwater management controls will be provided to limit the release rate to each outlet, during the 5 and 100-year storm events, to the allowable site release rate. Details of the on-site stormwater management design are provided in **Section 2.3**.

2.2.2 Major System Design

In the event of a blockage, or a storm greater than the 100-year event, an emergency overland flow route has been incorporated into the design so that ponding above the new catchbasins does not exceed 0.25m. Note that there are existing catchbasins that will have up to 0.27m of ponding, but this is likely the result of settlement the time they were installed and could be adjusted as part of the site maintenance program.

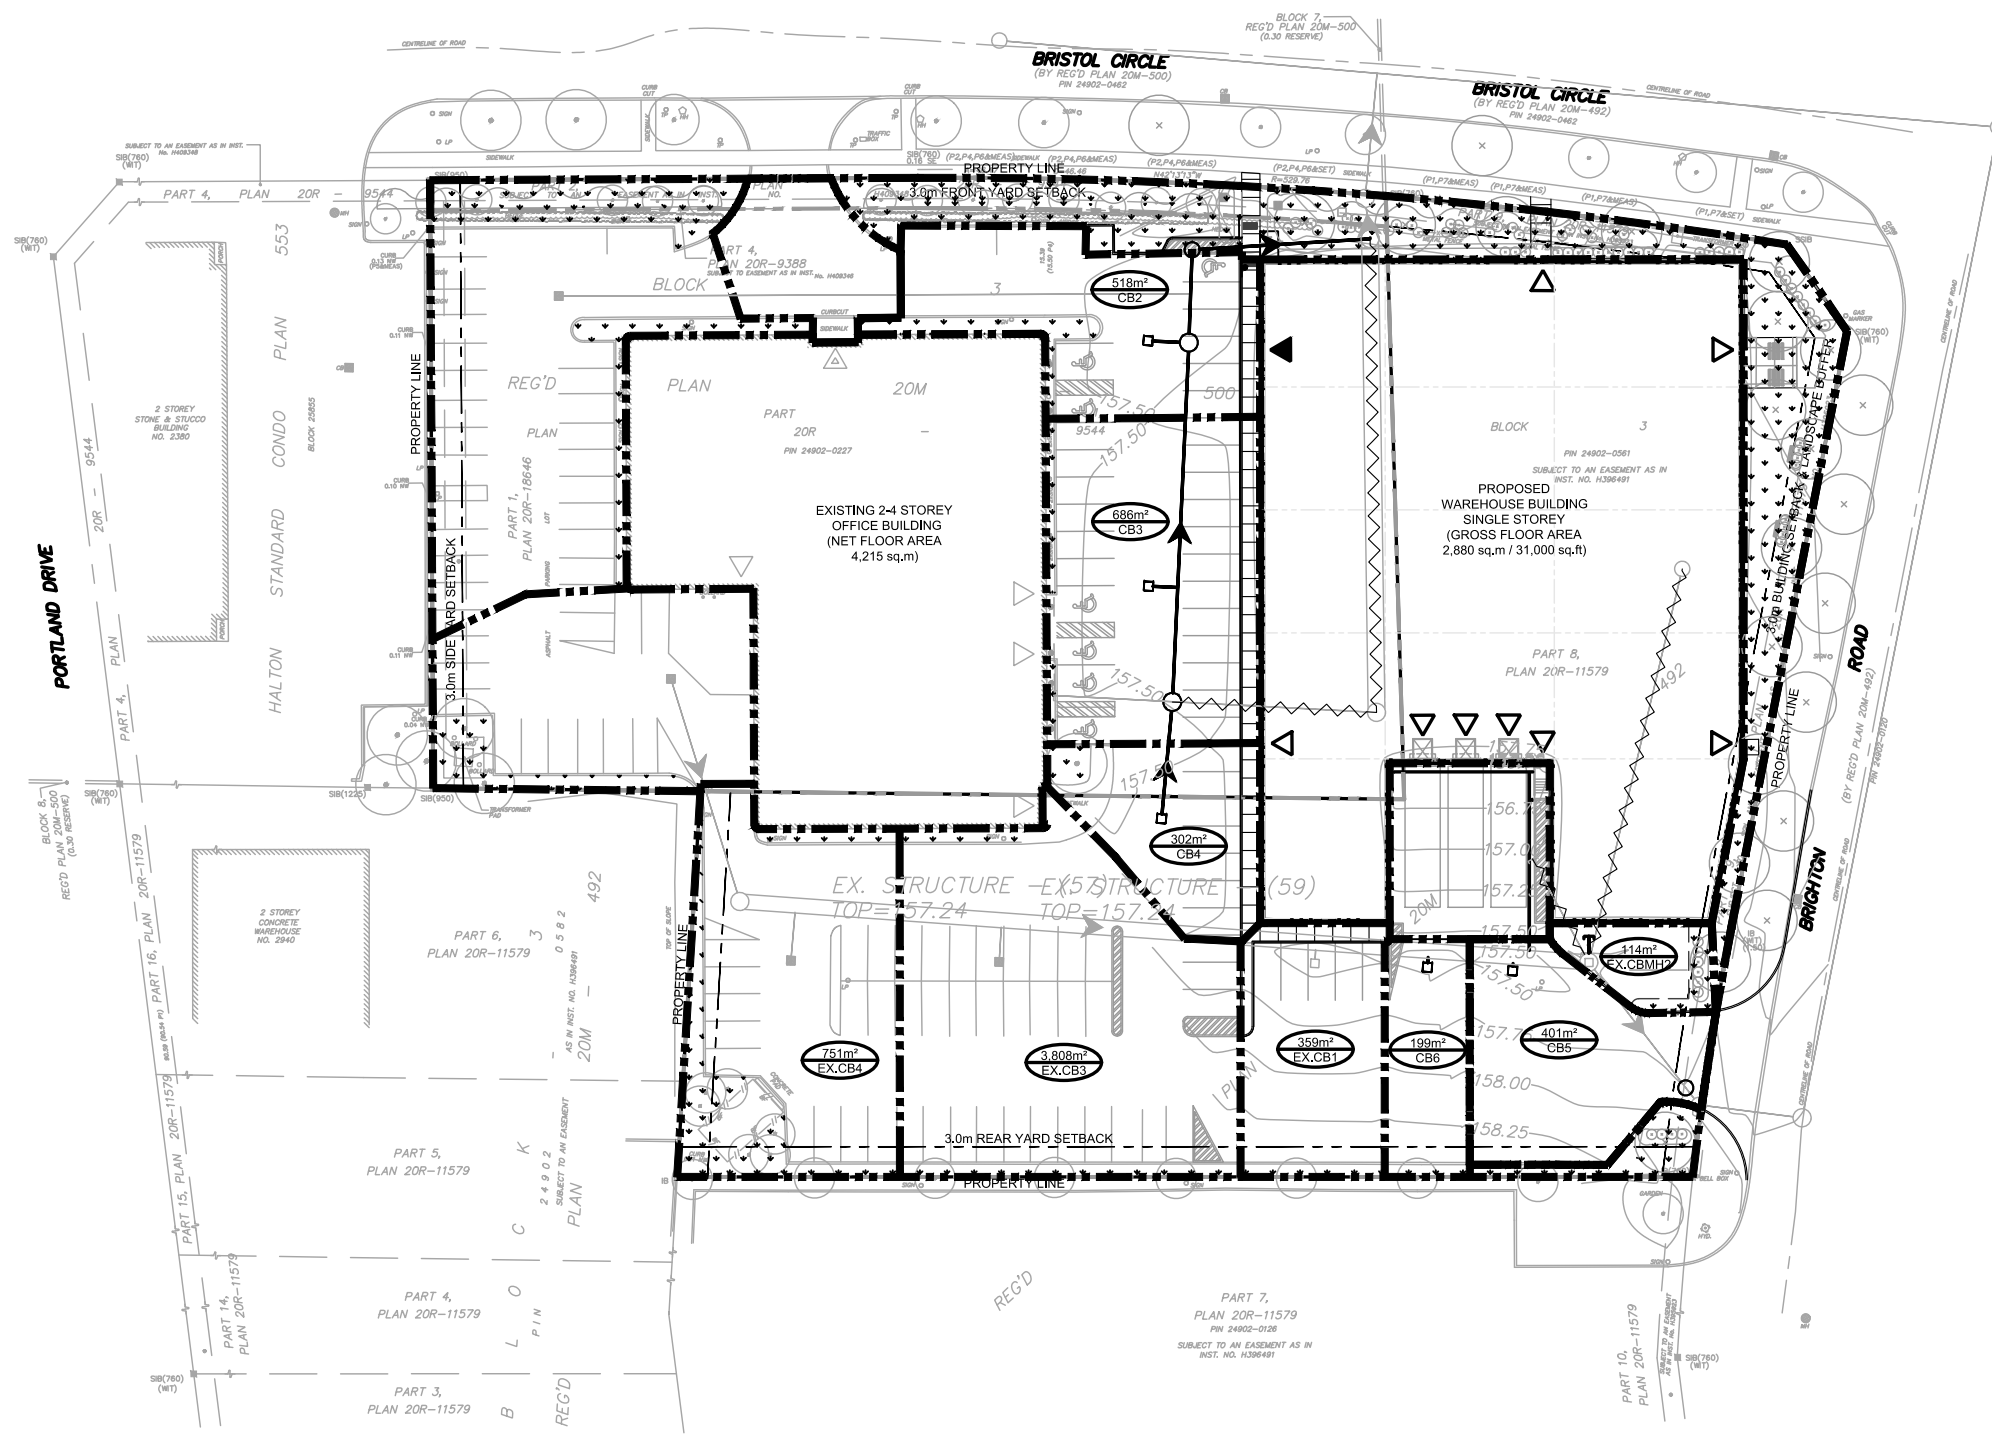

LEGEND

100m² CATCHMENT AREA
 CB0 CATCHBASIN ID

CATCHMENT BOUNDARY
 PERVIOUS AREA

HUSSON
 ENGINEERING + MANAGEMENT
 P 905.709.5825
 300 CACHET WOODS COURT, SUITE 304
 MARKHAM, ON L3C 0Z8
 HUSSON.CA

FIGURE 3
 2360 BRISTOL CIRCLE
 STORM DRAINAGE PLAN

DATE: SEPTEMBER 2023 SCALE: 1:750 PROJECT: 231423

The emergency overland flow will be directed to Bristol Circle. Overland flow from the re-development area will be directed between the existing and proposed buildings to a low point near the northwest corner of the Warehouse building. The drainage from the parking area behind the existing building will drain along this route as well. There will be no changes to the drainage north and west of the existing building. Refer to **Drawing SW1** for the site grading.

2.3 Peak Flow Controls

Unit flow release rates have been set in the Winston Park SWM Guidelines. **Table 2** provides the allowable release rates from the site.

Table 2. Target Release Rates

Storm Event	Unit Release Rate (L/s/ha)	Catchment Area (ha)	Target Release Rate (L/s)
5-Year	100	1.20	120
100-Year	200	1.20	240

To meet the target release rates, it is proposed to use a combination of controlled flow roof drainage, oversized pipes and parking lot surface detention.

The existing site outlets, and controls will be maintained, such that there will be minimal change from the site to the receiving sewers.

2.3.1 Rooftop Storage

As per the CPM Servicing & Grading Plan, the existing building has controlled roof drainage with a controlled release rate of 42L/s/ha. As well, the Electrical and Gas Services Plan, prepared by Fred Jewett Engineering Limited indicates that the building expansion had two roof drains with 1 weir per drain and a peak flow rate of 1.5L/s per drain. Since the available storage and controls on the remainder of the existing roof cannot be verified, these controls are not considered in the design. If the controls are in place, they would result in reduced frequency of surface ponding.

The new warehouse building will be flat and capable of storing stormwater. The following is used in the design of the rooftop controls.

- There will be 10 roof drains, each with 2 weirs.
- The roof drains will be Zurn Z-105 (or equivalent), providing 10 gallons per minute flow per 25mm head.
- The maximum controlled flow depth will be 100mm.
- The rise from the roof drain to the parapet will be 100mm. Therefore, the storage volume is calculated based on conical storage ($\text{Area} \times \text{Depth} / 3$).
- Relief scuppers will be installed at 125mm depth.
- The controlled flow drains will be installed with vandal proof screws.

Based on the above assumptions, **Table 3** provides the assumed storage-discharge for each building. Calculations for flow and storage are provided in **Appendix C**.

Table 3. Rooftop Storage

Building	Area (ha)	Number of Weirs	Controlled Flow Rate (L/s)	Storage Provided (m ³)	Drawdown Time (hours)
Warehouse	0.288	20	50.5	98	1.1

Refer to **Figure 4** for catchment locations.

Upon completion of each building construction, a certification letter will be required (signed and sealed by the design engineer) confirming that the building rooftop controls were constructed in accordance with the approved design.

2.3.2 Underground Pipe Storage

As noted above, the existing site was designed with 2 oversized storm sewers for stormwater storage. The one 1350mm diameter pipe will be located under the new building, and will be removed. The available storage, based on the proposed storm servicing design is provided in **Table 4**.

Table 4. Underground Storage Summary

Catchment	Pipe Storage (m ³)	MH Storage (m ³)	CB Storage (m ³)	Total Underground Storage (m ³)
102	21.0	13.3	1.3	35.7
103	99.5	24.7	2.1	126.2

The above volumes will be added to the surface storage volumes below to generate a storage-discharge curve for the hydrology modelling.

2.3.3 Surface Storage


Runoff can be stored in the depressions above the catchbasins in landscaped or parking areas. Surface storage will be limited to a maximum depth of 0.25m as described in Section 2.2.

Surface storage volumes are calculated in 0.05m increments above the trench drains and catchbasins. For Catchment 102, it is calculated from the lowest CB elevation of 157.25, and for Catchment 103 it is calculated from the trench drain elevation in the loading area of 156.55. **Table 5** provides a summary of the available surface storage for each catchment.

Table 5. Surface Storage Summary

Catchment	Lowest Elevation (m)	Overflow Elevation (m)	Surface Storage (m ³)
102	157.25	157.50	59
103	156.55	157.50	172

Based on the changes to the catchment areas on the site, it is proposed to modify the orifice plates. **Table 6** provides a summary of the flow controls for each outlet.

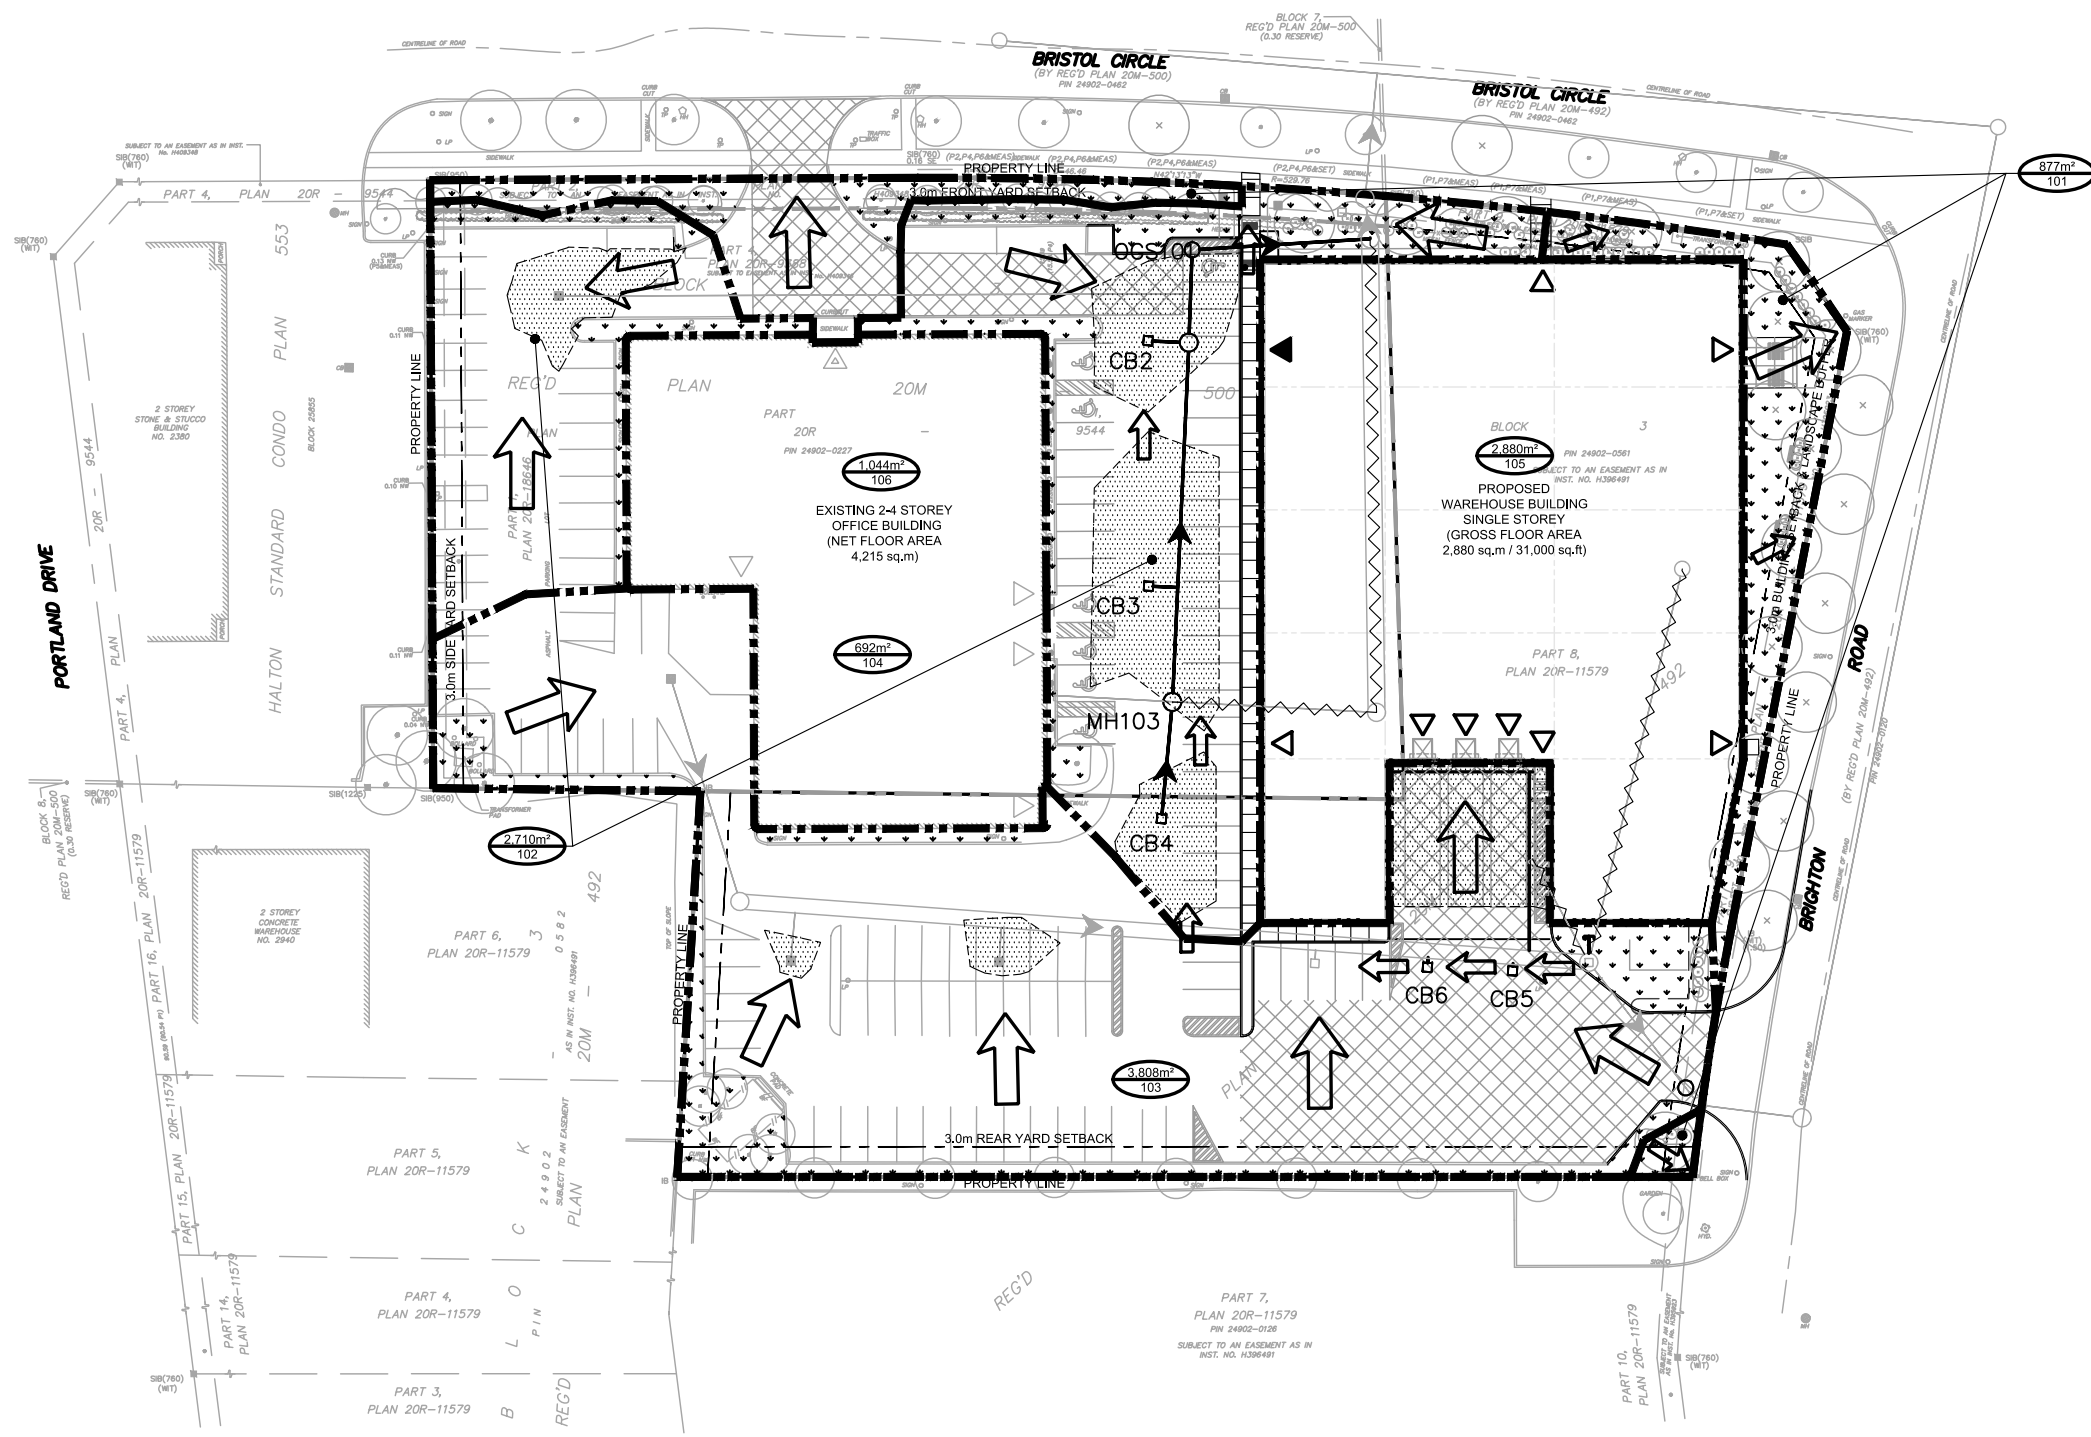

LEGEND

- 100m² — CATCHMENT AREA
- 100 — CATCHMENT ID
- OVERLAND FLOW DIRECTION

- CATCHMENT BOUNDARY
- 100-YR PONDING
- PERVIOUS AREA

FIGURE 4
2360 BRISTOL CIRCLE
STORMWATER MANAGEMENT PLAN

DATE: SEPTEMBER 2023 SCALE: 1:750 PROJECT: 231423

HUSSON
 ENGINEERING + MANAGEMENT
 P 905.709.5825
 300 CACHET WOODS COURT, SUITE 304
 MARKHAM, ON L3C 0Z8
 HUSSON.CA

Table 6. Orifice Control Summary

Catchment	HWL (m)	Invert (m)	Orifice Plate (mm)	Maximum Flow (L/s)
102	157.50	154.81	160x160	113
103	157.50	154.43	100x100	48

Refer to **Appendix D** for calculations of the storage-discharge for each catchment.

2.3.4 Uncontrolled Runoff

A portion of the site, including the driveway entrances and perimeter will not drain to the on-site catchbasins. These areas will drain overland to the adjacent municipal roads. These areas are identified as Catchment 101 on **Figure 4**.

2.3.5 Hydrology Modelling

A Visual Otthymo 6 (VO6) model was prepared to simulate the post development site plan with the proposed controls in place. VO6 is a single event hydrology model that is based on unit hydrograph theory. The simulation for this site uses the StandHyd method for the primarily impervious catchments and Route Reservoir to simulate the surface and rooftop storage. **Table 7** provides a summary of the catchment parameters.

Table 7. Catchment Parameters

Catchment	Catchment Area (m ²)	Imperviousness
101	887	28%
102	2,710	82%
103	3,808	91%
104 (Existing Roof)	1,736	100%
105 (Proposed Roof)	2,880	100%

Table 8 provides a comparison of the required and provided storage volumes for each catchment.

Table 8. Storage Volume Summary

Catchment	Storage Provided (m ³)	Storage Required (m ³) 5-Year	Storage Required (m ³) 100-Year	100 Year Storage Depth (mm)
101	-	-	-	-
102	95	34	87	23
103	298	121	225	100*
105	98	55	98	100

* Excludes loading area storage depth.

Table 9 provides a comparison of the allowable and post-development peak flows. Refer to **Appendix E** for the post-development model output. As shown above, adequate storage is provided in each catchment. The 5-year storage will be contained underground and the maximum storage depth in the parking areas during the 100-year storm will be less than 250mm.

Table 9. Peak Flow Comparison

Outlet	5-Year Flow (L/s)	100-Year (L/s)
Uncontrolled	10	24
Bristol (Controlled)	90	113
Brighton (Controlled)	35	46
Total*	117	179
Target	120	240

*Flows calculated by addition of hydrographs, not peak flows.

Table 9 shows that the post development peak flows are less than the allowable flow for the full site. Therefore, quantity controls from the site have been satisfied.

2.4 Quality Control

As per the Winston Park criteria, on-site water quality facilities must be clearly defined. The Town will accept oil/grit separators only where no other available measure to control water quality can be obtained. As water quality facilities have not been installed in the past, there are limited opportunities to provide a treatment-train for quality control. Therefore, it is proposed to provide two oil/grit separators upstream of the site outlets.

Two CDS OGS unit are proposed at the site outlets, to provide treatment prior to the flows discharging from the site. The units use indirect screening to separate solids from runoff. This system is less susceptible to clogging than a direct screening process. Oil and other floatables rise to the surface within the unit, where they are trapped above the outlet. The manufacturer has provided calculations for Average Annual TSS removal as summarized in **Table 10**.

Table 10. Oil/Grit Separator Sizing

Unit	Catchment Area (ha)	Runoff Coefficient	Recommended Unit	Treatment Efficiency
OGS101	0.45	0.90	CDS 2015-4	82.8%
OGS102	0.67	0.90	CDS 2020	83.3%

Therefore, the quality control target of 80 percent TSS removal is achieved for the site. Refer to **Appendix F** for sizing and details.

3.0 SANITARY SERVICING

The CPM Grading & Servicing Plan for the existing site was reviewed for the existing sanitary servicing. The existing sanitary sewers on the site and adjacent roads is summarized below:

- There is a 300mm diameter sanitary sewer on Bristol Circle, draining from west to east across the frontage of the site.
- There is a sanitary sewer on Brighton Road, draining south to north across the frontage of the site.
- The existing sanitary service to the site is 200mm diameter and is connected to the sewer on Brighton Road.

It is proposed to maintain the existing sanitary service connection. The on-site sanitary sewers will be re-aligned around the proposed building and a new connection will be extended to the warehouse building. The proposed servicing is shown on **Drawing SW2**.

The proposed development is light industrial which is generally consistent, or a lower use, compared with other uses in the area. Therefore, no capacity issues are anticipated.

4.0 WATER SERVICING

There is an existing 300mm diameter watermain located in the west boulevard of Brighton Road, across the site frontage. There is also a 400mm diameter watermain on Bristol Circle.

Water servicing for the existing building is provided from Bristol Circle.

It is proposed to provide a new water service connection to Brighton Road which will provide a 150mm fire and 100mm domestic service to the building. The water meter and backflow preventer will be provided in the building.

A new site fire hydrant will be required to meet the minimum distance of 45m to the fire department connection.

Refer to **Drawing SW2** for water servicing details.

5.0 EROSION AND SEDIMENT CONTROL

An erosion and sediment control plan, shown on **Drawing SW3**, has been prepared for the site. The plan has been prepared following the Erosion and Sediment Control Guidelines for Urban Construction (ESC Guidelines), prepared by The Greater Golden Horseshoe Area Conservation Authorities, December 2006. The plan has been designed to limit sediment and debris from leaving the site during all stages of construction.

5.1 Existing Site Condition

The existing site is developed with a grassed area over part of the proposed re-development area draining toward the adjacent roads. Overland flow is generally directed towards the southeast at an average grade of 2 percent. Based on the soils and gentle slopes across the site, there is a moderate potential for erosion from the site.

5.2 Erosion and Sediment Control Plan

The sediment control plan for this site consists of the following:

- A sediment control fence will be installed along the perimeter of the site where the grade will direct flows off-site.
- Site access will be limited to one entrance per phase of construction. A gravel access pad will be installed for staging of construction material and vehicles.
- Any mud tracked from the site should be swept immediately and a sweeper truck should be used as necessary to remove any additional debris.
- Trucks leaving the site should be covered with tarpaulin.
- During dry weather, above freezing construction periods, dust control measures including wetting the site and egress points should be implemented on an as needed basis.
- Once the storm sewer system has been constructed, catchbasin sediment control and protection devices will be installed and maintained until the site is ready to be paved.

Erosion measures will be in place prior to stripping topsoil from the site. A program will be in place to monitor and maintain the erosion and sediment controls. The sediment controls will be inspected by the Site Engineer and contractor:

- Once every 7 days and/or
- Within 24 hours following any significant rainfall event or snowmelt.

The inspection frequency can be extended to monthly inspections if there is no construction activity on-site.

Proper construction sequencing will also help with erosion and sediment control. The following schedule is recommended:

1. Install sediment control fence and access road.
2. Install sediment control devices on existing catchbasins receiving runoff from areas to be disturbed during construction.
3. Install perimeter swales.
4. Rough grade site to subgrade elevations.
5. Install services and sediment control devices on new catchbasins.
6. Re-vegetate disturbed areas including lands left untouched for more than 30 days.
7. Remove sediment controls once the site has been 95 percent stabilized.

6.0 CONCLUSIONS

The storm drainage design for the site has been designed to meet the criteria outlined by the Town, MECP, and subdivision plan. The plan will consist of the following:

- A combination of rooftop, underground and surface storage, in conjunction with orifice plate controls will be used to limit peak runoff from the site to the 5- and 100-year target flows.
- There will be no surface ponding during the 5-year storm event.
- Quality control will be provided by two new oil/grit separators; one at each outlet.
- An erosion and sediment control plan has been prepared to limit sediment and debris from leaving the site during construction.

- Water and sanitary services are available for the site. The existing sanitary service will be used and a new water service connection to the watermain on Brighton Road are proposed.




Greg Rapp, P.Eng.



APPENDIX A

BACKGROUND INFORMATION

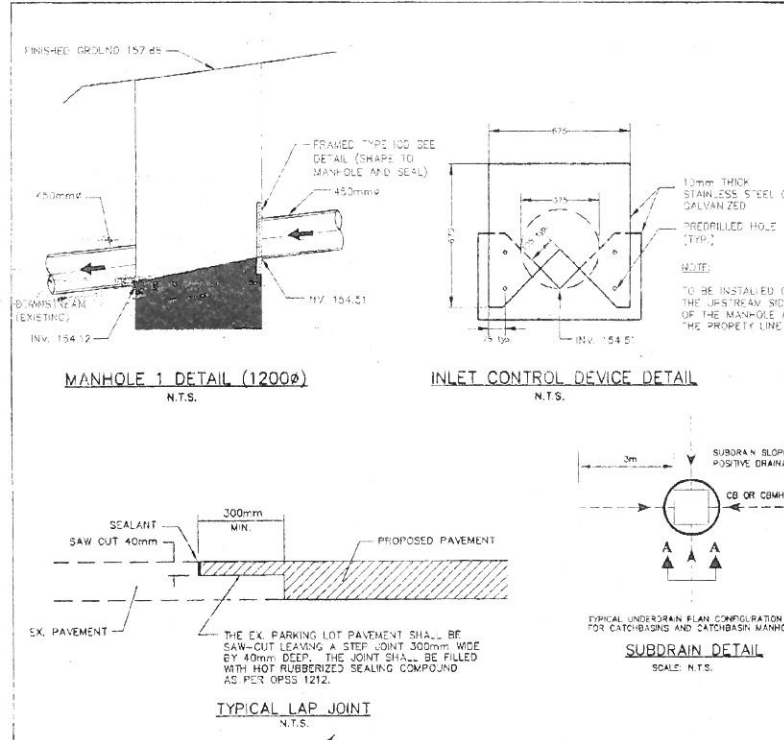

BENCHMARK NOTES:


ELEVATIONS HEREON ARE DERIVED FROM THE CITY OF MISSISSAUGA BENCHMARK NUMBER 826, ASSESSMENT AREA 2-25, A BRONZE CAP ON BRICK WALL AT THE NORTH-EAST CORNER OF WINSTON CHURCHILL BLVD. AND DUNDAS STREET WEST, 17.6m EAST OF CENTRELINE OF WINSTON CHURCHILL BLVD., SET VERTICALLY ON THE WEST FACE, 0.12m SOUTH OF THE NORTH-WEST CORNER, 0.3m ABOVE GRADE.
ELEVATION = 151.957 METRES.

LOCAL BENCHMARK No.1
THE MOST WESTERLY CORNER OF CONCRETE PAD CONTAINING HYDRO JUNCTION BOX LOCATED AT THE MOST WESTERLY CORNER OF THE PARKING LOT.
ELEVATION = 152.57 METRES

LOCAL BENCHMARK No.2
FINISHED FLOOR OF EXISTING BUILDING MAIN ENTRANCE THAT FACES NORTH TO BRISTOL CIRCLE.
ELEVATION = 157.72 METRES



GENERAL NOTES:

- ALL WORK TO CONFORM WITH MINISTRY OF TRANSPORTATION OF ONTARIO, TOWN OF OAKVILLE, REGION OF HALTON, AND ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS AS THEY APPLY.
- WATERMAIN SHALL BE POLYVINYL CHLORIDE (PVC) CLASS 150 DR 18 PIPE WITH GASKETED JOINTS UNLESS OTHERWISE SPECIFIED.
- ALL WATERMAIN SHALL HAVE MINIMUM COVER OF 1.70m.
- ALL WATERMAIN BEDDING SHALL BE AS PER OPSD 1102.02 CLASS 'B'.
- ALL FLUGS, CAPS, TEES AND BENDS MUST BE MECHANICALLY RESTRAINED. CONCRETE 'THURST' BLOCKS SHALL NOT BE USED.
- ALL STORM MANHOLES TO BE AS PER OPSD 701.01 WITH GRATES AS PER OPSD 401.01 UNLESS OTHERWISE SPECIFIED (TYPE 'B' TOP).
- ALL CATCHBASIN MANHOLES TO BE AS PER OPSD 700.03.
- ALL CATCHBASINS TO BE PRECAST AS PER OPSD 705.02 WITH GRATES AS PER OPSD 400.02 UNLESS OTHERWISE SPECIFIED.
- STORM SEWER PIPE BEDDING AS PER OPSD 802.03 TO BE CLASS 'B' BEDDING WITH NATIVE BACKFILL, COMPACTED 98% STANDARD PROCTOR DENSITY.
- ALL CONCRETE SEWER PIPES 525mm DIAMETER AND LARGER SHALL BE EQUAL TO C.S.A. 4-297-2 REINFORCED CL. 500, 550, 1000, 1400 OR LATEST AMENDMENT UNLESS OTHERWISE NOTED.
- ALL SINGLE CATCHBASIN LEADS TO BE 250mmø UNLESS OTHERWISE SPECIFIED. ALL CATCHBASIN LEADS TO BE A.S.T.M. D3034 PVC SDR-35.
- ALL POLYVINYL CHLORIDE (PVC) SANITARY SEWER PIPES TO CONFORM TO A.S.T.M. 3034 UNLESS OTHERWISE NOTED.
- ALL SANITARY MANHOLES TO BE AS PER OPSD STD. 1001.01 WITH GRATES AS PER OPSD 401.01 UNLESS OTHERWISE SPECIFIED (TYPE 'A' TOP).
- ALL SANITARY MANHOLES SERVING UP TO 300mm SEWER LINES SHALL BE BENCH TO SPRINGLINE.
- ALL MANHOLE AND CATCHBASIN EXCAVATIONS TO BE BACKFILLED WITH GRANULAR 'B' COMPACTED TO 98% STANDARD PROCTOR DENSITY.
- 'MODULOC' OR APPROVED MANHOLE AND CATCHBASIN ADAPTERS TO BE USED IN LIEU OF BRICKING.
- ALL GRANULAR BASE COURSE MATERIALS TO BE COMPACTED TO MIN. 98% SPO.
- LIGHT DUTY ASPHALT TO BE CONSTRUCTED AS FOLLOWS:
 - 60mm HL-3 SURFACE ASPHALT COURSE
 - 100mm 20mm CRUSHER RUN LESTONE SUB-BASE COURSE (GRAN. 'A')
 - 250mm 50mm CRUSHER RUN LESTONE SUB-BASE (GRAN. 'B' TYPE I)
- HEAVY DUTY ASPHALT TO BE CONSTRUCTED AS FOLLOWS:
 - 50mm HL-3 SURFACE ASPHALT COURSE
 - 70mm HL-8 BASE ASPHALT COURSE
 - 150mm 20mm CRUSHER RUN LESTONE SUB-BASE COURSE (GRAN. 'A')
 - 300mm 50mm CRUSHER RUN LESTONE SUB-BASE (GRAN. 'B' TYPE I)
- ALL DISTURBED GRASSED AREAS TO BE RESTORED WITH 100mm TOPSOIL & SOD.

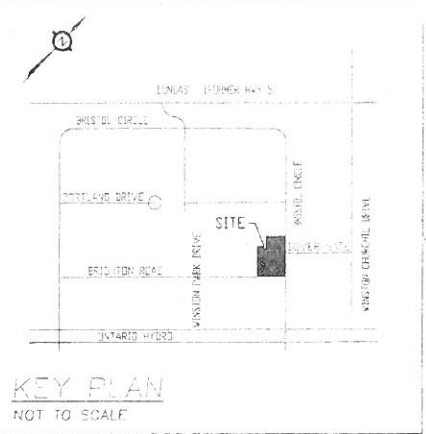

LEGEND:

- MH.1 PROPOSED STORM SEWER
- MH.10 PROPOSED STORM/CEPTOR MANHOLE
- MH.1A PROPOSED SANITARY SEWER
- CB.4 CATCHBASIN
- DCB.2 DOUBLE CATCHBASIN
- CBMH.2 CATCHBASIN MANHOLE
- SDA.1M PROPOSED WATERMAIN
- M.V.B. VALVE & BOX
- H.Y. HYDRANT
- CURBED ISLAND
- PAV'D ISLAND
- PROPOSED GRADE
- EX. CONTOUR
- OVERLAND FLOOD
- DRAINAGE DIRECTION
- HEAVY DUTY BASEMENT

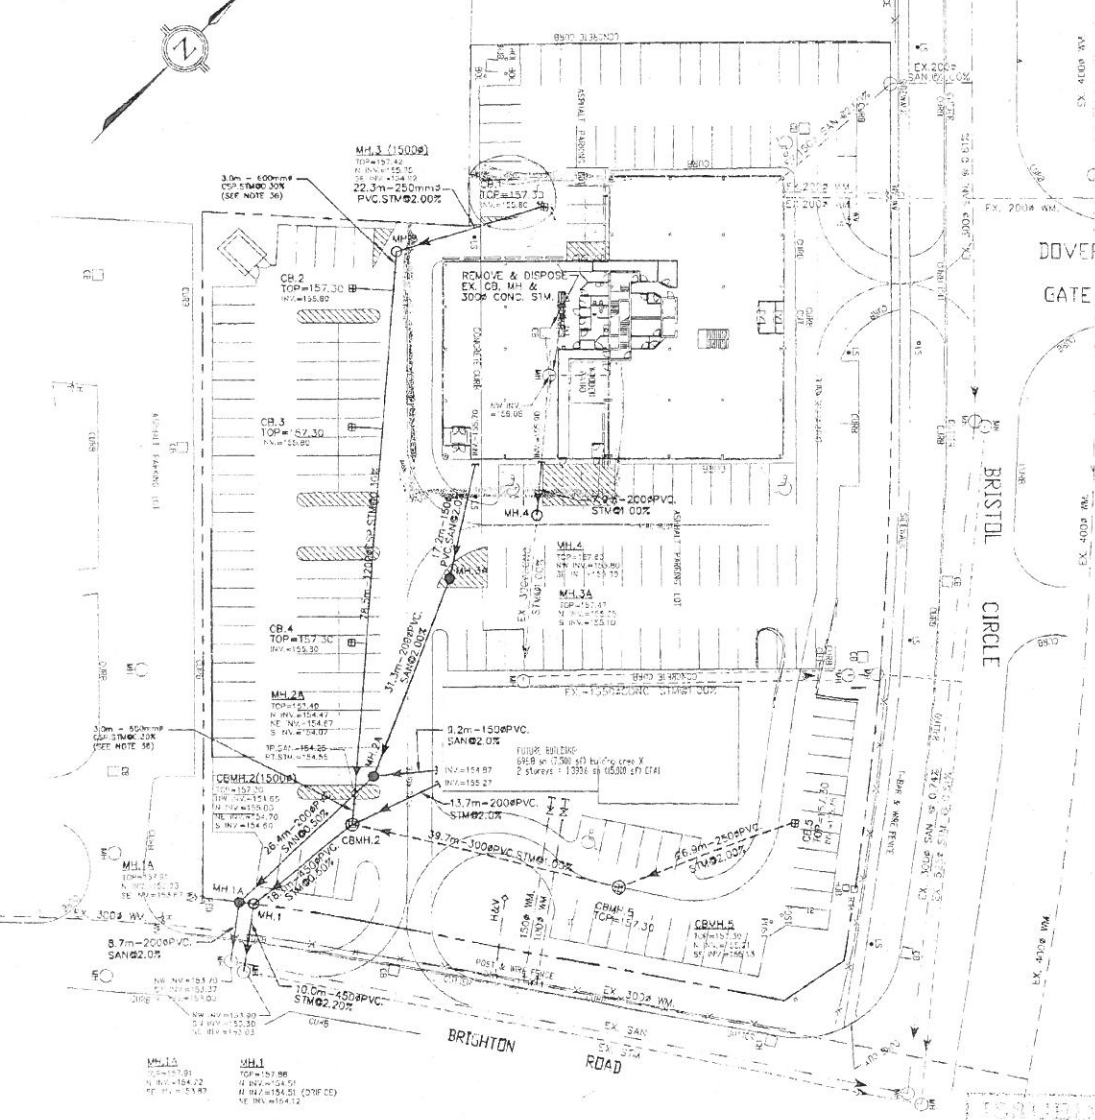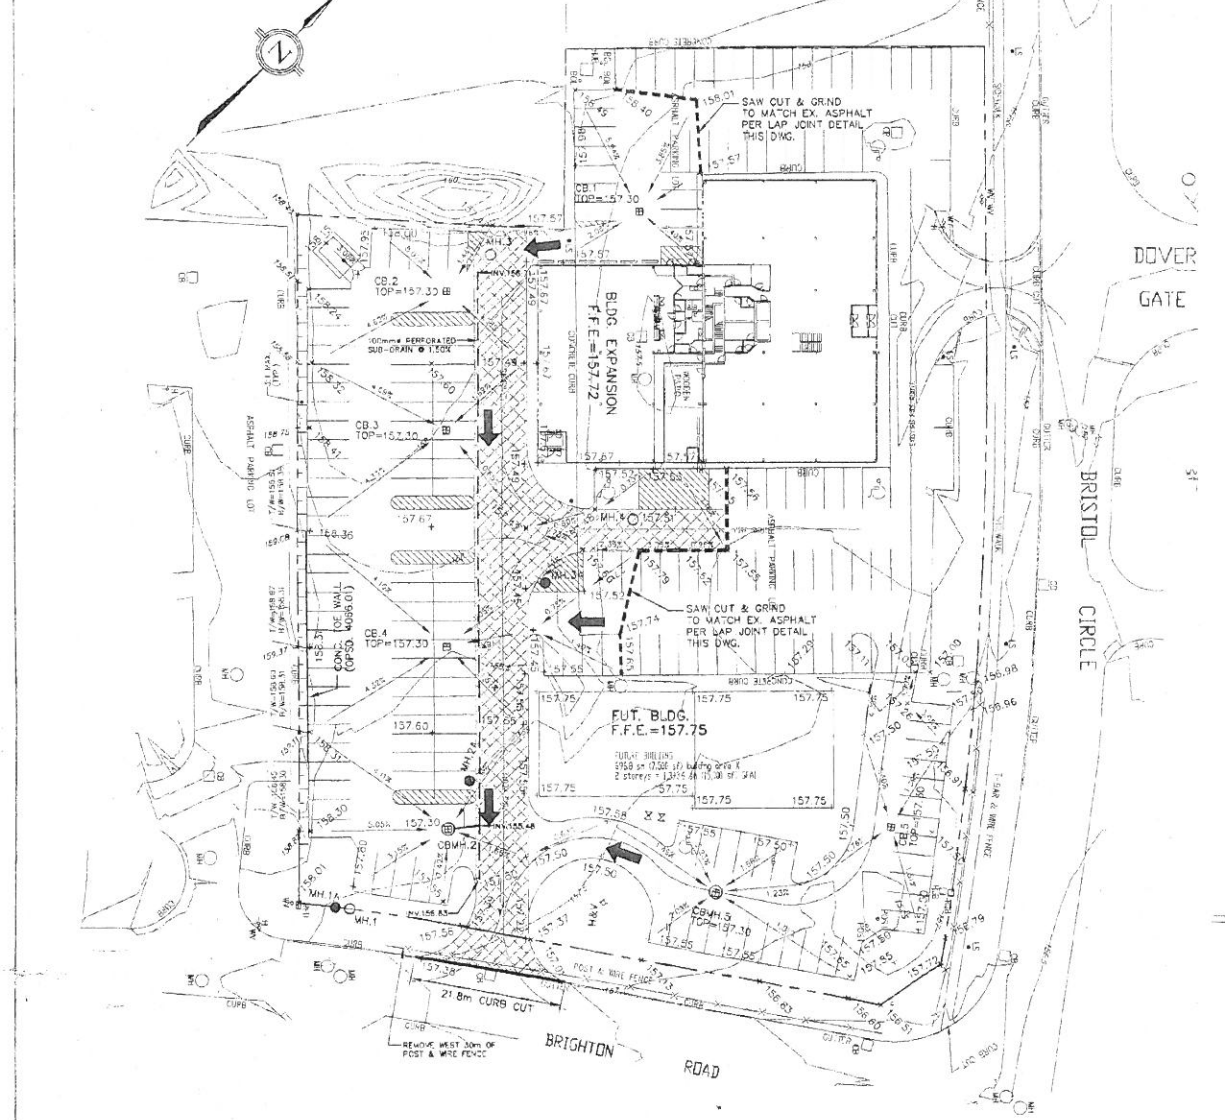

REVISIONS	
No.	Date
1	4/22/96

Design	GKR/AGS	Checked	DAFS	Date
Drawn	DS	Checked	AGS	APRIL 1990

APPROVALS	
Municipal	Regional
APPROVED IN PRINCIPLE SUBJECT TO DETAIL CONSTRUCTION CONFORMING TO TOWN STANDARDS AND SPECIFICATIONS	APPROVED SUBJECT TO DETAIL CONSTRUCTION CONFORMING TO HALTON REGION STANDARDS & SPECIFICATIONS & LOCATION APPROVAL FROM AREA MUNICIPALITY

COSBURN PATTERSON MATHER LIMITED CONSULTING ENGINEERS 7770 WOODBINE AVE., SUITE 300, MARKHAM, ONT. TELEPHONE: (905) 474-0455 FAX: (905) 474-9689	
REGIONAL MUNICIPALITY OF HALTON TOWN OF OAKVILLE	
MATTAMY OFFICE EXPANSION GRADING & SERVICING PLAN	
MATTAMY HOMES LIMITED	

TOPOGRAPHICAL AND SURVEY INFORMATION
AS TAKEN FROM SURVEY PREPARED BY:

SURVEYING LAND INFORMATION SERVICES
OFFICE OF ORIGIN:
J.D. BARNES LIMITED
450 BRITANNIA ROAD EAST, SUITE 4508
MISSISSAUGA, ONTARIO L4Z 1K9
TEL: (505) 507-6767
FAX: (505) 507-6977

DRAWN BY: TS CHECKED BY: AP REFERENCE NO.: 97-28-289-01-4

MARCH 8th, 1999 04:28:289014.dgn

SURVEY NOTES:

SKETCH SHOWING

LOCATION OF TOPOGRAPHIC SURFACE FEATURES,
ROADWAY DETAIL, AND SPOT ELEVATIONS

ELEVATION NOTES

ELEVATIONS HEREON ARE DERIVED FROM THE CITY OF MISSISSAUGA
BENCHMARK NUMBER 612, ASSESSMENT AREA 7-25, A BRICK LAF ON BRICK
WALL AT THE NORTH-EAST CORNER OF WINSTON CHURCHILL BLVD.
AND DUNDAS STREET WEST, 17.6M EAST OF CENTRELINE OF WINSTON
CHURCHILL BLVD. SET VERTICALLY ON THE WEST FACE, 0.12M SOUTH OF THE
NORTH-WEST CORNER, 0.30M ABOVE GRADE.
ELEVATION = 151.567 METRES

LOCAL BENCHMARK NO.1

THE MOST WESTERLY CORNER OF CONCRETE PAD CONTAINING HYDRO
JUNCTION BOX LOCATED AT THE MOST WESTERLY CORNER OF THE PARKING LOT.
ELEVATION = 158.57 METRES

LOCAL BENCHMARK NO.2

FINISHED FLOOR OF EXISTING BUILDING MAIN ENTRANCE
THAT FACES NORTH TO BRISTOL CIRCLE.
ELEVATION = 157.72 METRES

IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY THAT THE
LOCAL BENCHMARKS HAVE NOT BEEN ALTERED OR DISTURBED AND
THE INFORMATION SHOWN ON THIS PLAN

BEFORE DIGGING, UNDERGROUND SERVICES
SHOULD BE LOCATED ON SITE BY
THE RESPECTIVE AGENCIES.

METRIC DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND
CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048.

LEGEND

- MH DENOTES MANHOLE
- CB DENOTES SINGLE CATCH BASIN
- LS DENOTES LIGHT STANDARD
- POST DENOTES POST
- BOL DENOTES SAFETY POST
- WV DENOTES WATER VALVE
- SD DENOTES STAND PIPE
- H DENOTES FIRE HYDRANT
- PE DENOTES TELEPHONE PEDESTAL
- HJB DENOTES HYDRO JUNCTION BOX
- BM DENOTES LOCAL BENCHMARK

ALL CURB ELEVATIONS REPRESENT TOP OF CURB.

CAUTION

THIS IS NOT A PLAN OF SURVEY AND SHALL NOT
BE USED FOR TRANSACTION OR MORTGAGE PURPOSES.
THIS SKETCH IS PROTECTED BY COPYRIGHT.

THIS TOPOGRAPHIC SURVEY WAS COMPLETED ON MARCH 2nd, 1999

DATE _____ A. RICCAFORTE
ONTARIO LAND SURVEYOR

LEGAL DESCRIPTION OF SITE:

PARTS 1 & 2 OF BLOCK 3, REGISTERED
PLAN 20M-522 AND PARTS 8 & 9 OF
BLOCK 3, REGISTERED PLAN 20M-492
TOWN OF OAKVILLE,
REGIONAL MUNICIPALITY OF HALTON




NEW ASPHALT PAVING AS PER RECOMMENDATIONS OF
GEO TECHNICAL INVESTIGATION BY G.K. BELL &
ASSOCIATES LTD. DATED APRIL 1999

- PARKING LOT PAVING**
- 60mm ASPHALTIC CONCRETE #1.3 SURFACE TO 92%
MARSHALL DENSITY
- 100mm OPSS GRANULAR #1 BASE TO 92%
STANDARD PROCTOR MAXIMUM DRY DENSITY
- 75mm OPSS GRANULAR #1 TYPE II SUBBASE TO 98%
STANDARD PROCTOR MAXIMUM DRY DENSITY
- TOP 300 OF SUBGRADE TO 98% STANDARD PROCTOR DENSITY

- TRUCK ACCESS LEAVING AT 75% WIDE FIRE ROUTE**
- 80mm ASPHALTIC CONCRETE #1.3 SURFACE TO 91%
MARSHALL DENSITY
- 70mm ASPHALTIC CONCRETE #1.8 BINDER TO 92%
MARSHALL DENSITY
- 150mm OPSS GRANULAR #1 BASE TO 98%
STANDARD PROCTOR MAXIMUM DRY DENSITY
- 300mm OPSS GRANULAR #1 TYPE II SUBBASE TO 98%
STANDARD PROCTOR MAXIMUM DRY DENSITY
- TOP 300 OF SUBGRADE TO 98% STANDARD PROCTOR DENSITY

PART 4 PLAN 20R-11579



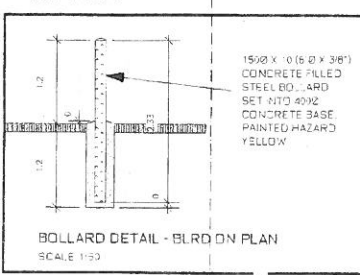


PART 5 PLAN 20R-11579

PART 6 PLAN 20R-11579

PART 3 PLAN 20R-9544

PART 7 PLAN 20R-11579

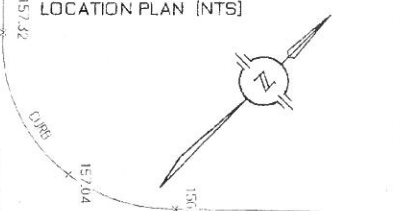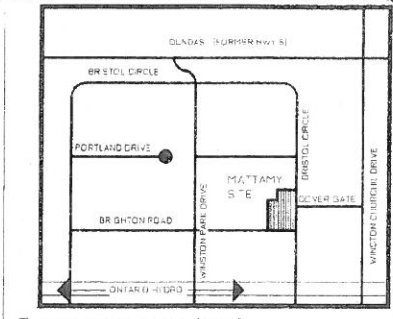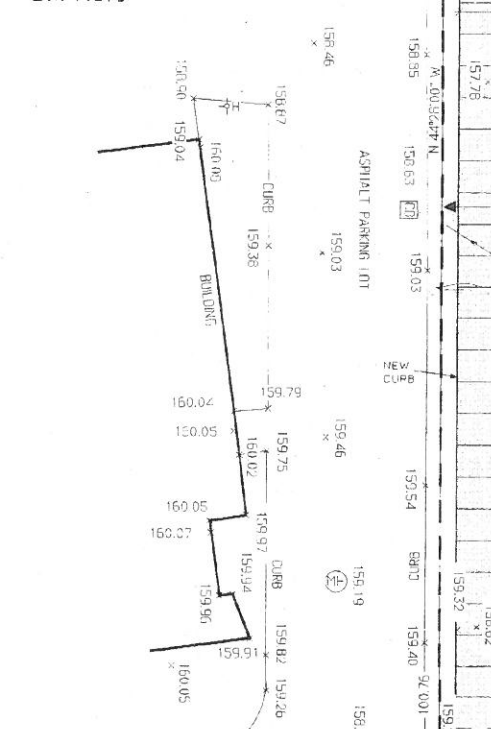

BRISTOL CIRCLE

BLOCK 3 R.P. 20M-492

BLOCK 3 R.P. 20M-500

SUBJECT TO EASEMENT
AS IN LT 409346

SUBJECT TO EASEMENT
AS IN LT 409346

SUBJECT TO EASEMENT
AS IN LT 395923

SUBJECT TO EASEMENT
AS IN LT 395923

SUBJECT TO EASEMENT
AS IN LT 395923

SUBJECT TO EASEMENT
AS IN LT 395923

SUBJECT TO EASEMENT
AS IN LT 395923

NO.	DATE	BY	REVISION
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			

JACKSON RYDER ARCHITECTS INCORPORATED
171 LANESHIRE ROAD EAST
OAKVILLE, ONTARIO L6H 3H6
TEL: (505) 849-5500
FAX: (505) 849-7387
www.jrarchitectural.com

ONTARIO ASSOCIATION OF ARCHITECTS
LICENSED PROFESSIONAL ARCHITECT
1975-1976
1977-1978
1979-1980
1981-1982
1983-1984
1985-1986
1987-1988
1989-1990
1991-1992
1993-1994
1995-1996
1997-1998
1999-2000
2001-2002
2003-2004
2005-2006
2007-2008
2009-2010
2011-2012
2013-2014
2015-2016
2017-2018
2019-2020
2021-2022
2023-2024
2025-2026
2027-2028
2029-2030

**ADDITION TO MATTAMY OFFICES
2360 BRISTOL CIRCLE**

MATTAMY

ARCHITECTURAL SITE PLAN

NO.	DATE	BY	REVISION
1			
2			
3			
4			
5			
6			
7			
8			
9			
10			

A-0 9858

NOTE:

- FOR SITE SERVICES, GRADING AND DRAINAGE REFER TO GRADING & DRAINAGE PLAN 9885 SHEET 1 OF 1 CONSULT PATERSON MATHER.
- FOR LANDSCAPE AND PLANTING INFORMATION REFER TO LANDSCAPE MASTER PLAN - 31 REYNOLDS & ASSOCIATES LANDSCAPE ARCHITECTS.
- FOR MECHANICAL AND ELECTRICAL SITE INFORMATION REFER TO MECHANICAL AND ELECTRICAL SITE PLAN BY FRED J. KETT ENGINEERING LTD.

SITE STATISTICS - MAY 7, 1999

ITEM	AREA (sq. m)	AREA (sq. ft)	ACRES
SITE AREA	12,011.50	27,977.00	6.96
ASPHALT PAVING	6,336.17	13,687.95	3.38
EXISTING OFFICES	1,131.00	2,421.00	0.28
ADDITION OFFICES	1,131.00	2,421.00	0.28
TOTAL OFFICES	2,262.00	4,842.00	0.56
LANDSCAPED AREA	3,007.13	6,556.00	0.74
TOTAL SPA	2,262.00	4,842.00	0.56

EXISTING OFFICES LEASABLE AREA: 2,050 sq. m (4,410 sq. ft)
ADDITION LEASABLE AREA: 1,131 sq. m (2,421 sq. ft)
TOTAL LEASABLE AREA: 3,181 sq. m (6,831 sq. ft)
PARKING REQUIRED (5.1 SPACE/38 sq. m): 56 SPACES
PARKING PROVIDED (INCL. 1 HC): 56 SPACES

FRONT YARD AREA OF 134.56 sq. m (293.87 sq. ft) IS REQUIRED FOR LANDSCAPE REQUIRED WITH A 2% SLOPE FROM NOT MORE THAN 25% OF ALL OTHER YARDS TOTAL 3,939.00 sq. m (8,547.00 sq. ft) IS REQUIRED FOR LANDSCAPE REQUIRED. ALL OTHER YARDS LANDSCAPE PROVIDED: 1,395 sq. m (3,007.13 sq. ft)

ZONING CLASSIFICATION: R10 SPECIAL PROVISION 4-3
DEC 1992 CLASSIFICATION: R10 SPECIAL PROVISION 4-3
327.50 GROUP O.P. TO 2 STOREYS SPRINGERED WITH A 2% SLOPE FROM NOT MORE THAN 25% OF ALL OTHER YARDS TOTAL 3,939.00 sq. m (8,547.00 sq. ft) IS REQUIRED FOR LANDSCAPE REQUIRED. ALL OTHER YARDS LANDSCAPE PROVIDED: 1,395 sq. m (3,007.13 sq. ft)

TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 1 HR.

WINSTON INDUSTRIAL BUSINESS PARK GUIDELINES FOR PREPARATION OF STORMWATER MANAGEMENT REPORT

GENERAL

A Stormwater Management Study shall be prepared for each site plan application within the Winston Park Industrial Subdivision. A master overall stormwater computer model has been prepared by the firm of Thorburn Penny Limited on behalf of the original subdivider. This model included an intensified stormwater computer simulation for the entire park utilizing the original OTTHYMO Model. As part of the model, the Park utilizes a combination of a single detention pond facility and on-site detention areas. It was proposed that on-site storage be used to minimize the total stormwater flow from the Park. The individual Site Plan report must comply with the recommendations of the overall Stormwater Management Model, developed by Thorburn Penny Limited. All Stormwater Management Reports will be approved by Development Engineering staff with copies being reviewed by the Credit Valley Conservation Authority.

It should be noted that the following criteria shall act as a guideline only. Original and innovative approaches on a site specific basis will be considered. Each developer or his agent must submit a detailed study for his respective application.

In addition to stormwater quantity control, water quality control measures are also required for all sites. The type of control and release rates must be fully documented in the report for approval.

SITE GRADING PLANS

Site grading plans are the responsibility of the applicant's engineer, and shall be approved by this individual prior to any submission proceeding to the Town for review.

The detailed site grading shall comply with the overall subdivision grade control and shall not impede drainage from or direct drainage to the adjacent properties.

Provide a separate detailed site erosion and sedimentation control plan and schedule.

RUN-OFF REQUIREMENTS

Each site must comply with the following run-off requirements:

5 Year Town of Oakville

- Chicago 4 Hour Storm Distribution - 100 litres/sec/hectare - to minor system

100 Year Town of Oakville

- Chicago 4 Hour Storm Distribution - 200 litres/sec/hectare - net release limit

All design parameters are to conform to the Town of Oakville Department of Public Works Storm Drainage Policies and Criteria Manual, in addition to the Development Engineering Procedures and Guidelines Manual. Copies may be obtained by contacting the Planning Services Department at (905) 845-6601.

Design storm parameter information is attached to this document.

OTHER REQUIREMENTS

1. Each property shall be analyzed individually, and shall have, where possible, a self-contained drainage system, although the Town would encourage a communal detention storage facility in areas where it is appropriate.
2. Overland flow patterns shall be consigned to a safe outlet, without negatively impacting neighbouring lands.
3. The system should have redundancy if possible. (As an example, if a pipe system fails, there should be an alternate method of discharge to prevent flooding, without causing flood damage to proposed buildings or adjoining properties).
4. Outlet control devices will be located in a manhole at the property line. The control device shall be installed on the upstream side of the manhole. The controlled device is standardized, being comprised of a two plate bolted design with minimum 75mm square diamond shape opening (see detail at end of this document).
5. No area ponding of the 5 year storm is allowed on any paved area with the exception of depressed loading dock areas where it should be kept to a minimum. Ponding over the 5 year storm shall be limited to remote parking areas only, not driveways or access ways.

6. As-built drawings to be completed with OTTHYMO/INTERHYMO computer model diskette and submitted to the Town upon final completion of the development.
7. On-site water quality facilities must be clearly defined. The Town will accept "Stormceptor" manholes only if no other available measure to control water quality can be obtained.
8. An emergency overland flow rate must be designed to convey stormwater to a safe outlet. Avoid fire routes where major ponding or overland flows are proposed.

MODELLING REQUIREMENTS

Site Plans shall be modelled using OTTHYMO or INTERHYMO (latest version) for the 5 year and 100 year rainfall. Other models are discouraged, unless they are compatible with the overall master model, and will only be used after prior approval is obtained from the Development Engineering Section.

STORAGE TECHNIQUES

The following storage techniques, in order of preference, will be utilized:

1. Storage in swales and landscaped areas at locations approved by staff;
2. Roof top storage - the type of control device and release rate must be specified;
3. Paved area storage over and above the 5 year storm shall be allowed in remote areas of the site;
4. Underground storage in oversized pipes or vaults;
5. Maximum storage depth shall be 250mm on hard surfaces traversed by passenger vehicles and pedestrian movements, and 400mm shall be allowed in areas accessed by heavy vehicles only;
6. No "hard surface" ponding is to occur in the proximity of any building entry features.

SITE PLAN AGREEMENTS REGISTERED ON TITLE

The Town requires the following conditions being registered on title by way of Agreement:

1. Owners are responsible for maintenance of Stormwater Management Facilities and are responsible for any liabilities related to tampering;
2. Owner gives the Town the right to enter, inspect and repair Stormwater Management Facilities at the owner's expense, should the owner fail to do so.

REPORT OUTLINE

The report shall have, as a minimum, the following components:

1. Title page clearly defining site, consultant and date
2. Executive Summary

3. Section 1 - Introduction

A brief introduction describing:

- site location
- site size - contributing areas

4. Section 2 - Methodology

Any assumptions made and the method of analysis used

5. Section 3 - Storage Requirements

- type and description of storage (tanks, ponds, super pipe)

- Out Flow Hydrograph

- Detail outflow hydrograph, graphical and tabular
- 5 and 100 year maximum flow in litres/sec/hectares

6. Section 4 - Water Quality Techniques

7. Section 5 - Summary

- Summarize storm water system


8. Appendix - Include complete input and output file for all

- Input parameters
- Include orifice calculations
- All construction or manufacturers' details

9. Diskette


10. Site Plan - A site plan will be prepared, including the following:

- Key Plan
- Location of:
 - buildings
 - property limits
 - grassed and landscaped areas
 - road right-of-ways
 - paved areas
 - drainage area
 - contours, existing and proposed elevations
 - area of ponding for 5 and 100 year storage
 - location of water quality control features
- stamp or seal of Storm Water Management Designer/Engineer

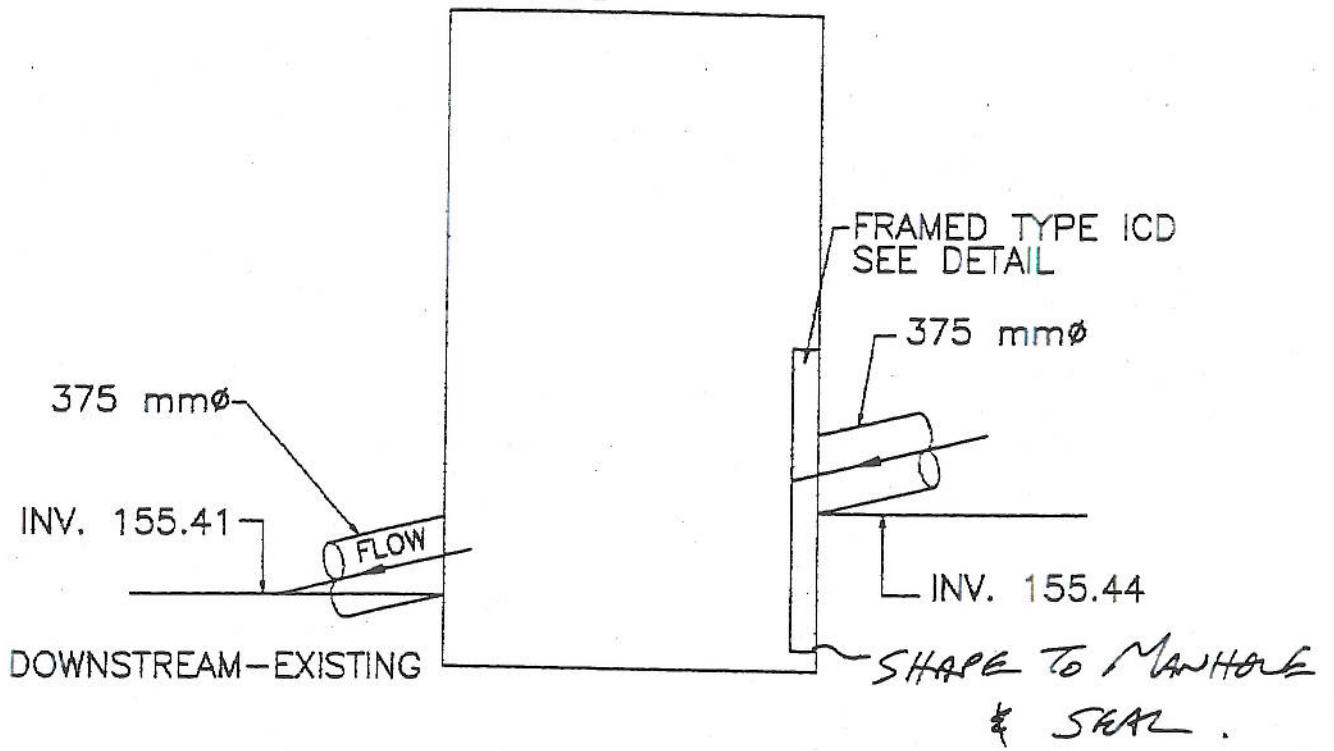

MANHOLE AT PROPERTY LINE

N.T.S.

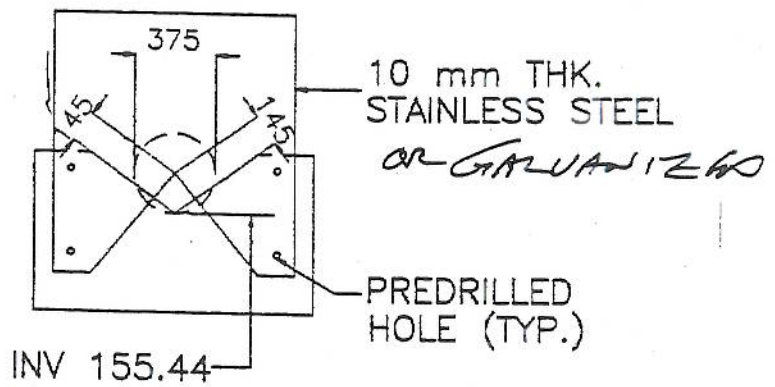

INLET CONTROL DEVICE DETAIL

N.T.S.

NOTE:

TO BE INSTALLED ON THE UPSTREAM SIDE OF
THE MANHOLE AT THE PROPERTY LINE

NOTES

APPROVALS

Approval for each Site Plan applicant's Stormwater Report must be obtained from the Development Engineering Section prior to building permit issuance. Before approving the Stormwater Management Report, staff will confirm with the applicant's engineer that the lot grading has been approved by them. The report and appropriate plans will then accompany the formal site plan submission. Upon final site inspection clearance, a diskette combining the 5 year and 100 year OTTHYMO/INTERHYMO input and out files are required by the applicant.

Copies of the final site specific Stormwater Management Report shall be submitted as follows:


Credit Valley Conservation Authority - one
Town of Oakville Development Services Department - two

INQUIRIES

Town of Oakville Mr. D. Bijsterveld, Planning Application Co-ordinator
(905) 845-6601, Ext. 3763

Mr. G. Trenkler, Development Technologist
(905) 845-6601, Ext. 3343

\\Winston-SWM.DOC

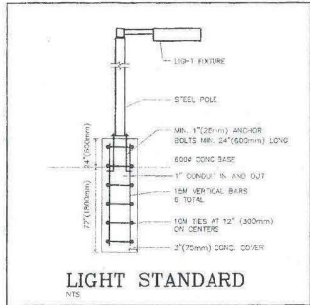

LIGHT STANDARD
NTS


PART 7 PLAN
20R-11579

PART 5 PLAN
20R-11579

PART 6 PLAN
20R-11579

PART 3 PLAN
20R-9544

PART 3 PLAN
20R-9544



LOCATION PLAN INTS

DOVER
GATE

BRISTOL CIRCLE

BRIGHTON ROAD

*Electric
Cable Running*

LEGAL DESCRIPTION OF SITE
PARTS 3, 5 & 6 OF BLOCK 3 REGISTERED
PLANNING AND ZONING BY-LAW NO. 403348
PART 3'S SUBSTANTIAL PLAN 20R-9544
PART 5'S SUBSTANTIAL PLAN 20R-11579
PART 6'S SUBSTANTIAL PLAN 20R-11579
ALL INFORMATION SUBJECT TO THE
REVISIONS AND AMENDMENTS TO THE
PLANNING AND ZONING BY-LAW NO. 403348

DATE	DESCRIPTION	BY

**FRED
JEWETT
ENGINEERING
LIMITED**



**ADDITION TO MATTAMY O.
2360 BRISTOL CIRCLE**

**ELECTRICAL
AND
GAS SERVICES
PLAN**

DATE	APRIL 1, 1999
SCALE	AS SHOWN
PROJECT	1,300 (mehls)
DATE	
SCALE	
PROJECT	

EM1 9858



APPENDIX B

**STORM DRAINAGE
CALCULATIONS**

**Storm Design Sheet
Town of Oakville**

HUSSON

$$\text{Rainfall Intensity} = \frac{A}{(Tc+B)^c}$$

	5-Year	100-Year
A =	1170	2150
B =	5.8	5.7
c =	0.843	0.861

Project: 2360 Bristol Circle
 Project No: 231423
 Date: 6-Sep-23
 Designed by: GKR

Starting Tc = 10 min

STREET	FROM MH	TO MH	5-YR AREA (ha)	5-YR RUNOFF COEFFICIENT "R"	5-YR "AR"	5-YR ACCUM. "AR"	5-YR RAINFALL INTENSITY (mm/hr)	5-YR ACCUM. FLOW (m3/s)	EXT or BLDG Area (ha)	EXT/BLDG FLOW RATE (l/s/ha)	EXT or BLDG FLOW (m3/s)	ACCUM. EXT/BLDG FLOW (m3/s)	Control Flow	Total Flow (m3/s)	LENGTH (m)	SLOPE (%)	PIPE DIAMETER (mm)	FULL FLOW CAPACITY (m3/s)	FULL FLOW VELOCITY (m/s)	TIME OF CONCENTRATION (min)	ACC. TIME OF CONC. (min)
	EX.BLD	MH103					114.21		0.174	42.000	0.007	0.007	External	0.007	11.8	1.00	200	0.033	1.044	0.188	10.188
Site	MH103	MH102	0.10	0.82	0.08	0.08	113.08	0.026				0.007	5-yr	0.033	35.7	0.84	675	0.770	2.153	0.276	10.464
Site	MH103	OGS101	0.18				113.08					0.007	External	0.007	9.2	0.93	450	0.275	1.729	0.089	10.276
Site	OGS101	EX. STM MH					112.56					0.007	External	0.007	17.7	0.91	450	0.272	1.710	0.173	10.449
Site	EX.MH3	EX.CBMH2	0.33	0.82	0.27	0.27	114.21	0.086					5-yr	0.086	46.1	0.47	1200	2.671	2.363	0.325	10.325
Site	PROP.BLD	EX.CBMH2					114.21		1.000	50.500	0.051	0.051	External	0.051	11.8	2.00	250	0.084	1.713	0.114	10.114
Site	EX.CBMH2	EX.MH1	0.04	0.73	0.03	0.30	112.27	0.093				0.051	5-yr	0.144	46.1	0.90	450	0.270	1.701	0.452	10.777


Rational Method Calc.

Project: 2360 Bristol Circle
 Project No.: 231423
 Municipality: Oakville

A: 1170.00
 B: 5.80
 C: 0.84
 Tc: 10.000

CATCH BASIN/ AREA DRAIN	DRAINAGE AREA (m ²)	RUNOFF COEFFICIENT (C)	5yr. INTENSITY @ Tc=10min (mm/hr)	5yr. FLOW (L/s)	Depth (mm)	Inlet Capacity (With 50% blockage) (L/s)*
CB2	518	0.90	114.2	14.8	250	90
CB3	686	0.90	114.2	19.6	250	90
CB4	302	0.90	114.2	8.6	180	71.5
CB5	401	0.90	114.2	11.4	70	12.5
CB6	199	0.90	114.2	5.7	70	12.5
EX.CB1	359	0.90	114.2	10.3	70	12.5
EX.CBMH2	114	0.90	114.2	3.3	150	60
EX.CB3	1063	0.90	114.2	30.4	260	93.5
EX.CB4	751	0.90	114.2	21.4	270	95

Design Chart 4.19: Inlet Capacity at Road Sag

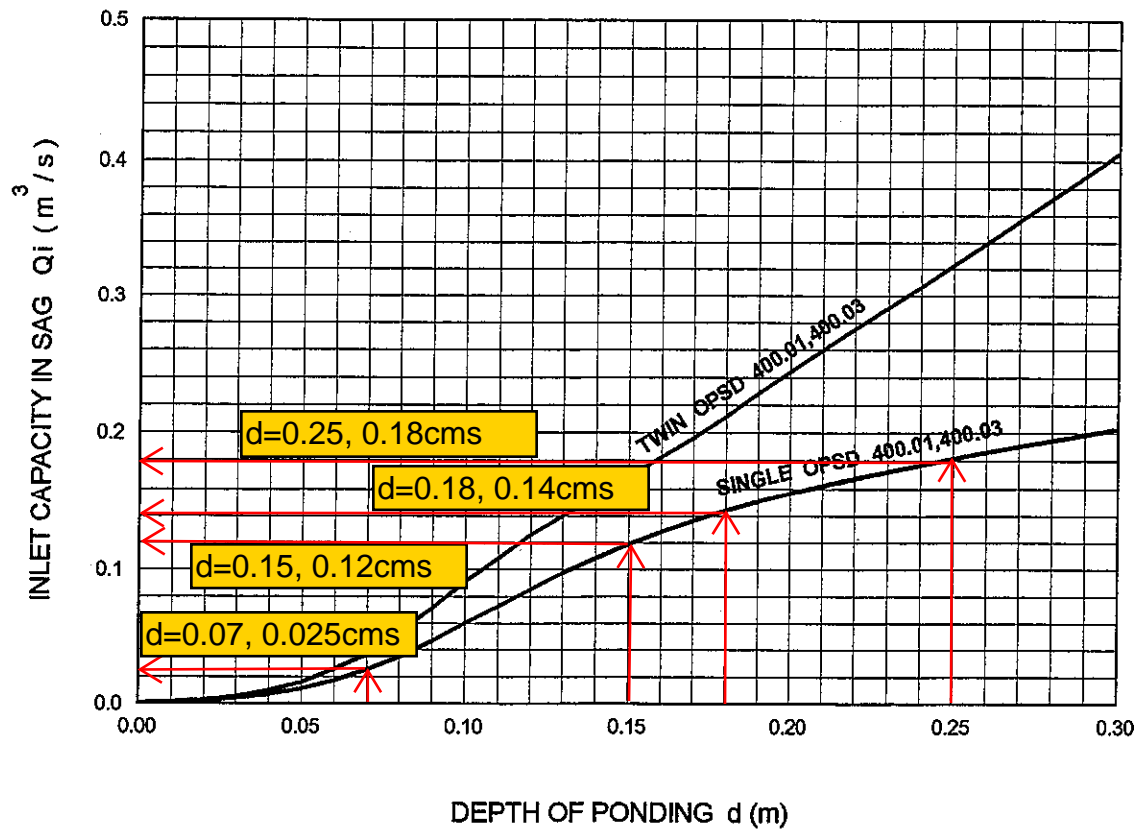



APPENDIX C

**CONTROLLED FLOW ROOF
DRAINAGE DETAILS**

Controlled Flow Roof Drains

Project: 2360 Bristol Circle
Project No.: 231423
Municipality: Town of Oakville
Building: Warehouse
Drain Type: Zurn Z-105

Number of Roof Drains: 10
Max. Head (H) 4 inch
101.6 mm
Flow per weir weir: 10 gpm per inch of depth
2.52 L/s

Total Weirs: 20
weirs per drain: 2.00
Flow per drain 5.05 L/s

Relief Scuppers: 125 mm

Building Area (A) 0.288 ha

Total Flow: 50.5 L/s
Storage Estimate: 98 m³ Estimate based on $H \times A / 3$




Z105
CONTROL-FLO ROOF DRAIN
W/ PARABOLIC WEIR

SPECIFICATION SHEET

TAG _____

Dimensional Data (inches and [mm]) are Subject to Manufacturing Tolerances and Change Without Notice

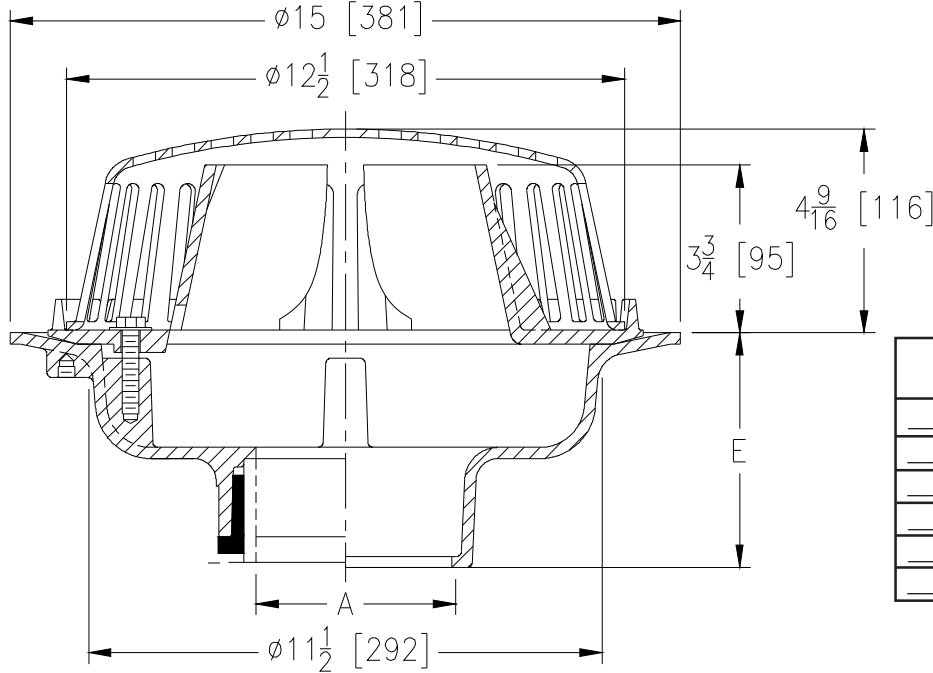

Specify Number of Notches in Weir	
___-N1	One Notch
___-N2	Two Notches
___-N3	Three Notches
___-N4	Four Notches
___-N5	Five Notches
___-N6	Six Notches

A- Pipe Size In.[mm]	Approx. Wt. Lbs. [kg]	Dome Open Area Sq. In. [cm ²]
2,3,4 [51,76,102]	34 [15]	103 [665]

ENGINEERING SPECIFICATION: ZURN Z105

15" [381mm] Diameter Control-Flo roof drain for dead-level roof construction, Dura-Coated cast iron body, Control-Flo weir shall be linear functioning with integral membrane flashing clamp/gravel guard and Poly-Dome. All data shall be verified proportional to flow rates. Each notch will allow 10 GPM [LPM] of flow per 1" [25mm] of rain water build up above the drain.

OPTIONS (Check/specify appropriate options)

PIPE SIZE

- 3, 4 [76, 102]
- 2, 3, 4 [51, 76, 102]
- 2, 3, 4 [51, 76, 102]

(Specify size/type) **OUTLET**

- ___ IC Inside Caulk
- ___ NH No-Hub
- ___ NL Neo-Loc

E BODY HT. DIM.

- 5-1/4 [133]
- 5-1/4 [133]
- 4-9/16 [116]

PREFIXES

- ___ Z D.C.C.I. Body with Poly-Dome*
- ___ ZA D.C.C.I. Body with Aluminum Dome
- ___ ZC D.C.C.I. Body with Cast Iron Dome

SUFFIXES

- ___ -C Underdeck Clamp
- ___ -DP Top-Set® Deck Plate (Replaces both -C & -R)
- ___ -E Static Extension 1 [25] thru 4 [102] (Specify Ht.)
- ___ -EA Adjustable Extension Assembly
2-1/8 [54] thru 3-1/2 [89]
- ___ -G Galvanized Cast Iron
- ___ -R Roof Sump Receiver
- ___ -TC Neo-Loc Test Cap Gasket (2,3,4 [51,76,102] NL Bottom Outlet Only)
- ___ -VP Vandal Proof Secured Top
- ___ -10 6 [152] High Parabolic Weir for Sloped Roof (ZC or ZA)

* Regularly furnished unless otherwise specified.



APPENDIX D

**STORMWATER MANAGEMENT
CALCULATIONS**



Project: 2360 Bristol Circle
 Project No.: 231423
 Municipality: Town of Oakville
 Catchment: 102

Orifice Plate
 Invert 154.81 m @ MH101
 Size 160 mm
 Co-efficient 0.62
 Area 0.0256 m²
 Centroid 0.11 m

Elevation	Area (m ²)	Incremental Storage (m ³)	Total Storage (m ³)	Head on Orifice (m)	Orifice Flow (m ³ /s)
154.81	0	0.00	0.0	0.00	0.000
156.12	0	21.03	21.0	1.20	0.077
156.62	0	14.67	35.7	1.70	0.092
157.25	0	0.00	35.7	2.33	0.107
157.3	23	0.57	36.3	2.38	0.108
157.35	94	2.93	39.2	2.43	0.110
157.4	238	8.32	47.5	2.48	0.111
157.45	459	17.44	65.0	2.53	0.112
157.5	729	29.71	94.7	2.58	0.113

Pipe/Structure Storage Volumes



Project: 2360 Bristol Circle
 Project No.: 231423
 Municipality: Town of Oakville
 Catchment: 103

Pipe Storage

Diameter	Length	Storage Volume
150	0	0.00
200	0	0.00
250	81	3.98
300	0	0.00
375	0	0.00
450	26.9	4.28
525	0	0.00
600	0	0.00
675	35.7	12.78
750	0	0.00
825	0	0.00
900	0	0.00
975	0	0.00
1050	0	0.00
1200	0	0.00
1350	0	0.00
1500	0	0.00
1800	0	0.00

Total 21.03 m³

Manhole Storage

Description	MH Inside Diam. (mm)	Invert (m)	Top Elev. (m)	Storage Depth (m)	Storage Volume (m ³)
EXMH	1200	154.81	157.50	2.69	3.04
OGS101	1200	155.05	157.50	2.45	2.77
MH102	1500	155.22	157.38	2.16	3.82
MH103	1500	155.2	157.30	2.10	3.71

Total 13.34 m³

Catchbasin Storage

Description	CB Inside Dim. (mm)	Invert (m)	Top Elev. (m)	Storage Depth (m)	Storage Volume (m ³)
CB	600x600	94.55	95.40	0.85	0.31
CB	600x600	94.55	95.40	0.85	0.31
CB	600x600	94.55	95.40	0.85	0.31
CB	600x600	94.25	95.40	1.15	0.41

Total	1.33 m ³
Total Storage	35.7 m ³



Project: 2360 Bristol Circle
 Project No.: 231423
 Municipality: Town of Oakville
 Catchment: 103

Orifice Plate
 Invert 154.43 m @ MH101
 Size 100 mm
 Co-efficient 0.62
 Area 0.0100 m²
 Centroid 0.07 m

Elevation	Area (m ²)	Incremental Storage (m ³)	Total Storage (m ³)	Head on Orifice (m)	Orifice Flow (m ³ /s)
154.43	0	0.00	0.0	0.00	0.000
155.07	0	99.48	99.5	0.57	0.021
156.5	0	26.70	126.2	2.00	0.039
156.55	17	0.43	126.6	2.05	0.039
156.65	42	2.93	129.5	2.15	0.040
156.75	67	5.45	135.0	2.25	0.041
156.85	94	8.06	143.1	2.35	0.042
156.95	120	10.70	153.8	2.45	0.043
157	133	6.34	160.1	2.50	0.043
157.05	147	7.01	167.1	2.55	0.044
157.15	173	15.99	183.1	2.65	0.045
157.25	199	18.63	201.7	2.75	0.046
157.3	228	10.70	212.4	2.80	0.046
157.35	283	12.78	225.2	2.85	0.046
157.4	380	16.57	241.8	2.90	0.047
157.45	532	22.80	264.6	2.95	0.047
157.5	813	33.63	298.2	3.00	0.048

Pipe/Structure Storage Volumes



Project: 2360 Bristol Circle
 Project No.: 231423
 Municipality: Town of Oakville
 Catchment: 103

Pipe Storage

Diameter	Length	Storage Volume
150	0	0.00
200	0	0.00
250	33	1.62
300	0	0.00
375	0	0.00
450	18	2.86
525	0	0.00
600	0	0.00
675	0	0.00
750	0	0.00
825	0	0.00
900	0	0.00
975	0	0.00
1050	0	0.00
1200	84	95.00

Total 99.48 m³

Manhole Storage

Description	MH Inside Diam. (mm)	Invert (m)	Top Elev. (m)	Storage Depth (m)	Storage Volume (m ³)
MH101	2400	154.54	157.47	2.93	13.26
MH102	2400	154.94	157.46	2.52	11.40

Total 24.66 m³

Catchbasin Storage

Description	CB Inside Dim. (mm)	Invert (m)	Top Elev. (m)	Storage Depth (m)	Storage Volume (m ³)
CB	600x600	155.87	157.25	1.38	0.50
CB	600x600	155.80	157.25	1.45	0.52
CB	600x600	155.80	157.25	1.45	0.52
CB	600x600	155.93	157.34	1.41	0.51


Total 2.05 m³

Total Storage 126.2 m³



APPENDIX E

HYDROLOGY MODELLING

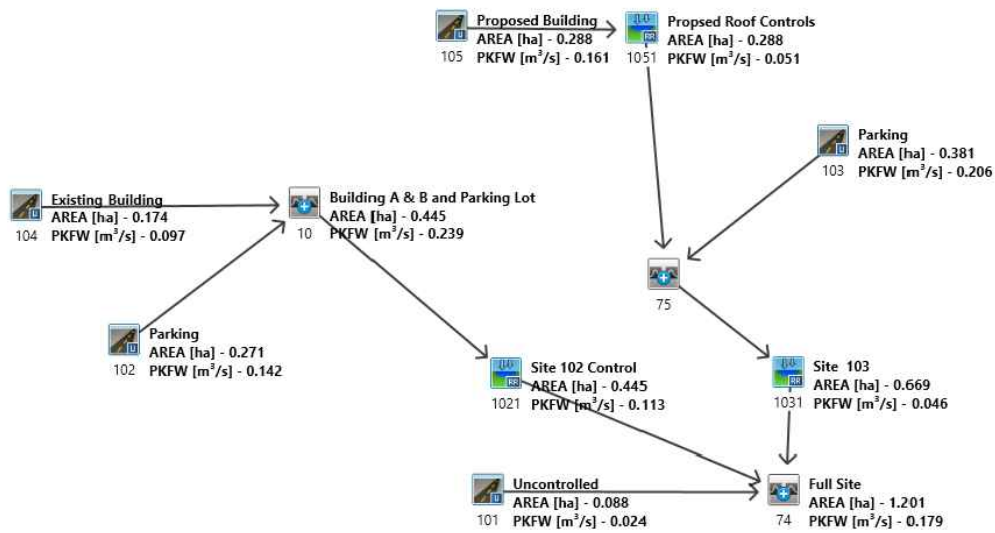

ENGINEERING + MANAGEMENT

P 905.709.5826
 200 CACHET WOODS COURT, SUITE 304
 MARKHAM, ON L3C 0Z8
 HUSSON.CA

FIGURE E1

2360 BRISTOL CIRCLE VO6 POST DEVELOPMENT

DATE: SEPTEMBER 2023 SCALE: N.T.S. PROJECT: 231243

=====

=====

```

V V I SSSSS U U A L (v 6.2.2014)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSSS UUUUU A A LLLLL

```

```

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

```

Developed and Distributed by Smart City Water Inc
 Copyright 2007 - 2022 Smart City Water Inc
 All rights reserved.

***** D E T A I L E D O U T P U T *****

```

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat
Output filename: C:\Users\workstation\AppData\Local\Civica\XH5\d32691b7-9361-410b-808a-65824bdc2d5f\35f00ca2-3ddd-499e-8e19-ebffef529fcf\
Summary filename: C:\Users\workstation\AppData\Local\Civica\XH5\d32691b7-9361-410b-808a-65824bdc2d5f\35f00ca2-3ddd-499e-8e19-ebffef529fcf\

```

DATE: 09-06-2023 TIME: 10:34:01

USER:

COMMENTS: _____

```

*****
** SIMULATION : 100 Year Chicgo **
*****

```

```

-----
| CHICAGO STORM | IDF curve parameters: A=2150.000
| Ptotal= 71.76 mm | B= 5.700
| | C= 0.861
-----
used in: INTENSITY = A / (t + B)^C

Duration of storm = 3.00 hrs
Storm time step = 10.00 min
Time to peak ratio = 0.33

```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.00	4.93	0.83	200.80	1.67	9.50	2.50	4.68
0.17	6.26	1.00	54.01	1.83	7.85	2.67	4.26
0.33	8.66	1.17	25.55	2.00	6.70	2.83	3.91
0.50	14.21	1.33	16.41	2.17	5.85		
0.67	39.75	1.50	12.04	2.33	5.19		

```

-----
| CALIB |
| STANDHYD ( 0105) | Area (ha)= 0.29
| ID= 1 DT= 2.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.29	0.00
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	43.82	2.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----

```

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.033	4.93	0.800	39.75	1.567	12.04	2.33	5.85
0.067	4.93	0.833	39.75	1.600	12.04	2.37	5.19
0.100	4.93	0.867	200.80	1.633	12.04	2.40	5.19

0.133	4.93	0.900	200.80	1.667	12.04	2.43	5.19
0.167	4.93	0.933	200.80	1.700	9.50	2.47	5.19
0.200	6.26	0.967	200.80	1.733	9.50	2.50	5.19
0.233	6.26	1.000	200.80	1.767	9.50	2.53	4.68
0.267	6.26	1.033	54.01	1.800	9.50	2.57	4.68
0.300	6.26	1.067	54.01	1.833	9.50	2.60	4.68
0.333	6.26	1.100	54.01	1.867	7.85	2.63	4.68
0.367	8.66	1.133	54.01	1.900	7.85	2.67	4.68
0.400	8.66	1.167	54.01	1.933	7.85	2.70	4.26
0.433	8.66	1.200	25.55	1.967	7.85	2.73	4.26
0.467	8.66	1.233	25.55	2.000	7.85	2.77	4.26
0.500	8.66	1.267	25.55	2.033	6.70	2.80	4.26
0.533	14.21	1.300	25.55	2.067	6.70	2.83	4.26
0.567	14.21	1.333	25.55	2.100	6.70	2.87	3.91
0.600	14.21	1.367	16.41	2.133	6.70	2.90	3.91
0.633	14.21	1.400	16.41	2.167	6.70	2.93	3.91
0.667	14.21	1.433	16.41	2.200	5.85	2.97	3.91
0.700	39.75	1.467	16.41	2.233	5.85	3.00	3.91
0.733	39.75	1.500	16.41	2.267	5.85		
0.767	39.75	1.533	12.04	2.300	5.85		

Max.Eff.Inten.(mm/hr)= 200.80 193.98
over (min) 5.00 2.00
Storage Coeff. (min)= 1.18 (ii) 1.32 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.49 0.66

TOTALS

PEAK FLOW (cms)= 0.16 0.00 0.161 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 70.76 65.43 70.70
TOTAL RAINFALL (mm)= 71.76 71.76 71.76
RUNOFF COEFFICIENT = 0.99 0.91 0.99

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

RESERVOIR(1051)	OVERFLOW IS OFF				
IN= 2----> OUT= 1					
DT= 2.0 min					

	OUTFLOW	STORAGE	OUTFLOW	STORAGE	
	(cms)	(ha.m.)	(cms)	(ha.m.)	
	0.0000	0.0000	0.2300	0.0110	
	0.0510	0.0098	0.0000	0.0000	
		AREA	QPEAK	TPEAK	R.V.
		(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 (0105)	0.288	0.161	1.00	70.70	
OUTFLOW: ID= 1 (1051)	0.288	0.051	1.10	70.54	
		PEAK FLOW REDUCTION [Qout/Qin] (%)=	31.92		
		TIME SHIFT OF PEAK FLOW (min)=	6.00		
		MAXIMUM STORAGE USED (ha.m.)=	0.0098		

CALIB				
STANDHYD (0103)	Area (ha)=	0.38		
ID= 1 DT= 2.0 min	Total Imp(%)=	91.00	Dir. Conn.(%)=	91.00

	IMPERVIOUS	PERVIOUS (i)		
Surface Area (ha)=	0.35	0.03		
Dep. Storage (mm)=	1.00	5.00		
Average Slope (%)=	4.00	2.00		
Length (m)=	50.39	5.00		
Mannings n =	0.013	0.250		

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.033	4.93	0.800	39.75	1.567	12.04	2.33	5.85
0.067	4.93	0.833	39.75	1.600	12.04	2.37	5.19
0.100	4.93	0.867	200.80	1.633	12.04	2.40	5.19
0.133	4.93	0.900	200.80	1.667	12.04	2.43	5.19
0.167	4.93	0.933	200.80	1.700	9.50	2.47	5.19
0.200	6.26	0.967	200.80	1.733	9.50	2.50	5.19

0.233	6.26	1.000	200.80	1.767	9.50	2.53	4.68
0.267	6.26	1.033	54.01	1.800	9.50	2.57	4.68
0.300	6.26	1.067	54.01	1.833	9.50	2.60	4.68
0.333	6.26	1.100	54.01	1.867	7.85	2.63	4.68
0.367	8.66	1.133	54.01	1.900	7.85	2.67	4.68
0.400	8.66	1.167	54.01	1.933	7.85	2.70	4.26
0.433	8.66	1.200	25.55	1.967	7.85	2.73	4.26
0.467	8.66	1.233	25.55	2.000	7.85	2.77	4.26
0.500	8.66	1.267	25.55	2.033	6.70	2.80	4.26
0.533	14.21	1.300	25.55	2.067	6.70	2.83	4.26
0.567	14.21	1.333	25.55	2.100	6.70	2.87	3.91
0.600	14.21	1.367	16.41	2.133	6.70	2.90	3.91
0.633	14.21	1.400	16.41	2.167	6.70	2.93	3.91
0.667	14.21	1.433	16.41	2.200	5.85	2.97	3.91
0.700	39.75	1.467	16.41	2.233	5.85	3.00	3.91
0.733	39.75	1.500	16.41	2.267	5.85		
0.767	39.75	1.533	12.04	2.300	5.85		

```

Max.Eff.Inten.(mm/hr)= 200.80 110.38
over (min) 5.00 2.00
Storage Coeff. (min)= 0.85 (ii) 1.45 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.53 0.64
                                     *TOTALS*
PEAK FLOW (cms)= 0.19 0.01 0.206 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 70.76 39.94 67.99
TOTAL RAINFALL (mm)= 71.76 71.76 71.76
RUNOFF COEFFICIENT = 0.99 0.56 0.95

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0075) |
| 1 + 2 = 3 |
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
ID1= 1 ( 0103): 0.38 0.206 1.00 67.99
+ ID2= 2 ( 1051): 0.29 0.051 1.10 70.54
=====
ID = 3 ( 0075): 0.67 0.248 1.00 69.09

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 1031) | OVERFLOW IS OFF
| IN= 2----> OUT= 1 |
| DT= 2.0 min |
-----
          OUTFLOW   STORAGE   | OUTFLOW   STORAGE
          (cms)   (ha.m.) | (cms)   (ha.m.)
0.0000 0.0000 | 0.0434 0.0160
0.0207 0.0099 | 0.0438 0.0167
0.0393 0.0127 | 0.0447 0.0183
0.0403 0.0130 | 0.0464 0.0225
0.0412 0.0135 | 0.0472 0.0265
0.0421 0.0143 | 0.0476 0.0298
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
INFLOW : ID= 2 ( 0075) 0.669 0.248 1.00 69.09
OUTFLOW: ID= 1 ( 1031) 0.669 0.046 1.57 68.91

```

```

PEAK FLOW REDUCTION [Qout/Qin](%)= 18.68
TIME SHIFT OF PEAK FLOW (min)= 34.00
MAXIMUM STORAGE USED (ha.m.)= 0.0225

```

```

-----
| CALIB |
| STANDHYD ( 0104) | Area (ha)= 0.17
| ID= 1 DT= 2.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00
-----

```

```

          IMPERVIOUS   PERVIOUS (i)
Surface Area (ha)= 0.17 0.00
Dep. Storage (mm)= 1.00 1.50
Average Slope (%)= 1.00 2.00
Length (m)= 34.02 5.00
Mannings n = 0.013 0.250

```


NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.033	4.93	0.800	39.75	1.567	12.04	2.33	5.85
0.067	4.93	0.833	39.75	1.600	12.04	2.37	5.19
0.100	4.93	0.867	200.80	1.633	12.04	2.40	5.19
0.133	4.93	0.900	200.80	1.667	12.04	2.43	5.19
0.167	4.93	0.933	200.80	1.700	9.50	2.47	5.19
0.200	6.26	0.967	200.80	1.733	9.50	2.50	5.19
0.233	6.26	1.000	200.80	1.767	9.50	2.53	4.68
0.267	6.26	1.033	54.01	1.800	9.50	2.57	4.68
0.300	6.26	1.067	54.01	1.833	9.50	2.60	4.68
0.333	6.26	1.100	54.01	1.867	7.85	2.63	4.68
0.367	8.66	1.133	54.01	1.900	7.85	2.67	4.68
0.400	8.66	1.167	54.01	1.933	7.85	2.70	4.26
0.433	8.66	1.200	25.55	1.967	7.85	2.73	4.26
0.467	8.66	1.233	25.55	2.000	7.85	2.77	4.26
0.500	8.66	1.267	25.55	2.033	6.70	2.80	4.26
0.533	14.21	1.300	25.55	2.067	6.70	2.83	4.26
0.567	14.21	1.333	25.55	2.100	6.70	2.87	3.91
0.600	14.21	1.367	16.41	2.133	6.70	2.90	3.91
0.633	14.21	1.400	16.41	2.167	6.70	2.93	3.91
0.667	14.21	1.433	16.41	2.200	5.85	2.97	3.91
0.700	39.75	1.467	16.41	2.233	5.85	3.00	3.91
0.733	39.75	1.500	16.41	2.267	5.85		
0.767	39.75	1.533	12.04	2.300	5.85		

Max.Eff.Inten.(mm/hr)= 200.80 193.98
over (min) 5.00 2.00
Storage Coeff. (min)= 1.01 (ii) 1.26 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.51 0.68

TOTALS

PEAK FLOW (cms)= 0.10 0.00 0.097 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 70.76 65.43 70.71
TOTAL RAINFALL (mm)= 71.76 71.76 71.76
RUNOFF COEFFICIENT = 0.99 0.91 0.99

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0102) | Area (ha)= 0.27
| ID= 1 DT= 2.0 min | Total Imp(%)= 82.00 Dir. Conn.(%)= 82.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.22	0.05
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	4.00	2.00
Length (m)=	42.50	5.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.033	4.93	0.800	39.75	1.567	12.04	2.33	5.85
0.067	4.93	0.833	39.75	1.600	12.04	2.37	5.19
0.100	4.93	0.867	200.80	1.633	12.04	2.40	5.19
0.133	4.93	0.900	200.80	1.667	12.04	2.43	5.19
0.167	4.93	0.933	200.80	1.700	9.50	2.47	5.19
0.200	6.26	0.967	200.80	1.733	9.50	2.50	5.19
0.233	6.26	1.000	200.80	1.767	9.50	2.53	4.68
0.267	6.26	1.033	54.01	1.800	9.50	2.57	4.68
0.300	6.26	1.067	54.01	1.833	9.50	2.60	4.68
0.333	6.26	1.100	54.01	1.867	7.85	2.63	4.68
0.367	8.66	1.133	54.01	1.900	7.85	2.67	4.68
0.400	8.66	1.167	54.01	1.933	7.85	2.70	4.26
0.433	8.66	1.200	25.55	1.967	7.85	2.73	4.26
0.467	8.66	1.233	25.55	2.000	7.85	2.77	4.26

0.500	8.66	1.267	25.55	2.033	6.70	2.80	4.26
0.533	14.21	1.300	25.55	2.067	6.70	2.83	4.26
0.567	14.21	1.333	25.55	2.100	6.70	2.87	3.91
0.600	14.21	1.367	16.41	2.133	6.70	2.90	3.91
0.633	14.21	1.400	16.41	2.167	6.70	2.93	3.91
0.667	14.21	1.433	16.41	2.200	5.85	2.97	3.91
0.700	39.75	1.467	16.41	2.233	5.85	3.00	3.91
0.733	39.75	1.500	16.41	2.267	5.85		
0.767	39.75	1.533	12.04	2.300	5.85		

```

Max.Eff.Inten.(mm/hr)= 200.80 110.38
over (min) 5.00 2.00
Storage Coeff. (min)= 0.76 (ii) 1.60 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.54 0.61
*TOTALS*
PEAK FLOW (cms)= 0.12 0.02 0.142 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 70.76 39.94 65.21
TOTAL RAINFALL (mm)= 71.76 71.76 71.76
RUNOFF COEFFICIENT = 0.99 0.56 0.91

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0010) |
| 1 + 2 = 3 |
-----
| AREA QPEAK TPEAK R.V. |
| (ha) (cms) (hrs) (mm) |
-----
ID1= 1 ( 0102): 0.27 0.142 1.00 65.21
+ ID2= 2 ( 0104): 0.17 0.097 1.00 70.71
=====
ID = 3 ( 0010): 0.44 0.239 1.00 67.36

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 1021) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 2.0 min |
-----
| OUTFLOW STORAGE | OUTFLOW STORAGE |
| (cms) (ha.m.) | (cms) (ha.m.) |
-----
0.0000 0.0000 | 0.1100 0.0039
0.0770 0.0021 | 0.1110 0.0048
0.0920 0.0036 | 0.1130 0.0095
0.1070 0.0037 | 0.0000 0.0000
-----
| AREA QPEAK TPEAK R.V. |
| (ha) (cms) (hrs) (mm) |
-----
INFLOW : ID= 2 ( 0010) 0.445 0.239 1.00 67.36
OUTFLOW: ID= 1 ( 1021) 0.445 0.113 1.07 67.35

```

```

PEAK FLOW REDUCTION [Qout/Qin](%)= 47.07
TIME SHIFT OF PEAK FLOW (min)= 4.00
MAXIMUM STORAGE USED (ha.m.)= 0.0087

```

```

-----
| CALIB |
| STANDHYD ( 0101) | Area (ha)= 0.09
| ID= 1 DT= 2.0 min | Total Imp(%)= 25.00 Dir. Conn.(%)= 25.00
-----

```

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.02	0.07
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	2.00	2.00
Length (m)=	24.18	25.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

```

-----
| TRANSFORMED HYETOGRAPH |
| TIME RAIN | TIME RAIN | TIME RAIN | TIME RAIN |
| hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs mm/hr |
-----
0.033 4.93 | 0.800 39.75 | 1.567 12.04 | 2.33 5.85
0.067 4.93 | 0.833 39.75 | 1.600 12.04 | 2.37 5.19
0.100 4.93 | 0.867 200.80 | 1.633 12.04 | 2.40 5.19

```

0.133	4.93	0.900	200.80	1.667	12.04	2.43	5.19
0.167	4.93	0.933	200.80	1.700	9.50	2.47	5.19
0.200	6.26	0.967	200.80	1.733	9.50	2.50	5.19
0.233	6.26	1.000	200.80	1.767	9.50	2.53	4.68
0.267	6.26	1.033	54.01	1.800	9.50	2.57	4.68
0.300	6.26	1.067	54.01	1.833	9.50	2.60	4.68
0.333	6.26	1.100	54.01	1.867	7.85	2.63	4.68
0.367	8.66	1.133	54.01	1.900	7.85	2.67	4.68
0.400	8.66	1.167	54.01	1.933	7.85	2.70	4.26
0.433	8.66	1.200	25.55	1.967	7.85	2.73	4.26
0.467	8.66	1.233	25.55	2.000	7.85	2.77	4.26
0.500	8.66	1.267	25.55	2.033	6.70	2.80	4.26
0.533	14.21	1.300	25.55	2.067	6.70	2.83	4.26
0.567	14.21	1.333	25.55	2.100	6.70	2.87	3.91
0.600	14.21	1.367	16.41	2.133	6.70	2.90	3.91
0.633	14.21	1.400	16.41	2.167	6.70	2.93	3.91
0.667	14.21	1.433	16.41	2.200	5.85	2.97	3.91
0.700	39.75	1.467	16.41	2.233	5.85	3.00	3.91
0.733	39.75	1.500	16.41	2.267	5.85		
0.767	39.75	1.533	12.04	2.300	5.85		

Max.Eff.Inten.(mm/hr)= 200.80 110.38
over (min) 5.00 8.00
Storage Coeff. (min)= 0.67 (ii) 6.92 (ii)
Unit Hyd. Tpeak (min)= 4.00 8.00
Unit Hyd. peak (cms)= 0.55 0.15

TOTALS

PEAK FLOW (cms)= 0.01 0.01 0.024 (iii)
TIME TO PEAK (hrs)= 1.00 1.07 1.00
RUNOFF VOLUME (mm)= 70.76 39.94 47.60
TOTAL RAINFALL (mm)= 71.76 71.76 71.76
RUNOFF COEFFICIENT = 0.99 0.56 0.66

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

ADD HYD (0074)	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
1 + 2 = 3				
ID1= 1 (0101):	0.09	0.024	1.00	47.60
+ ID2= 2 (1021):	0.44	0.113	1.07	67.35
=====				
ID = 3 (0074):	0.53	0.136	1.00	64.09

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

ADD HYD (0074)	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
3 + 2 = 1				
ID1= 3 (0074):	0.53	0.136	1.00	64.09
+ ID2= 2 (1031):	0.67	0.046	1.57	68.91
=====				
ID = 1 (0074):	1.20	0.179	1.03	66.78

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

CALIB	Area (ha)	IMP (i)
STANDHYD (0106)	0.07	
ID= 1 DT= 2.0 min	99.00	99.00

Surface Area (ha)=	0.07	0.00
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	21.56	5.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME RAIN	TIME RAIN	TIME RAIN	TIME RAIN
hrs mm/hr	hrs mm/hr	hrs mm/hr	hrs mm/hr

0.033	4.93	0.800	39.75	1.567	12.04	2.33	5.85
0.067	4.93	0.833	39.75	1.600	12.04	2.37	5.19
0.100	4.93	0.867	200.80	1.633	12.04	2.40	5.19
0.133	4.93	0.900	200.80	1.667	12.04	2.43	5.19
0.167	4.93	0.933	200.80	1.700	9.50	2.47	5.19
0.200	6.26	0.967	200.80	1.733	9.50	2.50	5.19
0.233	6.26	1.000	200.80	1.767	9.50	2.53	4.68
0.267	6.26	1.033	54.01	1.800	9.50	2.57	4.68
0.300	6.26	1.067	54.01	1.833	9.50	2.60	4.68
0.333	6.26	1.100	54.01	1.867	7.85	2.63	4.68
0.367	8.66	1.133	54.01	1.900	7.85	2.67	4.68
0.400	8.66	1.167	54.01	1.933	7.85	2.70	4.26
0.433	8.66	1.200	25.55	1.967	7.85	2.73	4.26
0.467	8.66	1.233	25.55	2.000	7.85	2.77	4.26
0.500	8.66	1.267	25.55	2.033	6.70	2.80	4.26
0.533	14.21	1.300	25.55	2.067	6.70	2.83	4.26
0.567	14.21	1.333	25.55	2.100	6.70	2.87	3.91
0.600	14.21	1.367	16.41	2.133	6.70	2.90	3.91
0.633	14.21	1.400	16.41	2.167	6.70	2.93	3.91
0.667	14.21	1.433	16.41	2.200	5.85	2.97	3.91
0.700	39.75	1.467	16.41	2.233	5.85	3.00	3.91
0.733	39.75	1.500	16.41	2.267	5.85		
0.767	39.75	1.533	12.04	2.300	5.85		

Max.Eff.Inten.(mm/hr)= 200.80 193.98
over (min) 5.00 2.00
Storage Coeff. (min)= 0.77 (ii) 1.01 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.54 0.73

TOTALS

PEAK FLOW (cms)= 0.04 0.00 0.039 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 70.76 65.43 70.70
TOTAL RAINFALL (mm)= 71.76 71.76 71.76
RUNOFF COEFFICIENT = 0.99 0.91 0.99

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| RESERVOIR( 1061)| OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 2.0 min |
-----

```

	OUTFLOW (cms)	STORAGE (ha.m.)	OUTFLOW (cms)	STORAGE (ha.m.)
	0.0000	0.0000	0.0300	0.0040
	0.0030	0.0035	0.0000	0.0000

	AREA (ha)	QPEAK (cms)	TPEAK (hrs)	R.V. (mm)
INFLOW : ID= 2 (0106)	0.070	0.039	1.00	70.70
OUTFLOW: ID= 1 (1061)	0.070	0.004	1.37	66.50

PEAK FLOW REDUCTION [Qout/Qin](%)= 11.15
TIME SHIFT OF PEAK FLOW (min)= 22.00
MAXIMUM STORAGE USED (ha.m.)= 0.0035

=====

```

V V I SSSS U U A L (v 6.2.2014)
V V I SS U U A A L
V V I SS U U AAAAA L
V V I SS U U A A L
VV I SSSS UUUU A A LLLL

OOO TTTT TTTT H H Y Y M M OOO TM
O O T T H H Y Y MM MM O O
O O T T H H Y M M O O
OOO T T H H Y M M OOO

```

Developed and Distributed by Smart City Water Inc
Copyright 2007 - 2022 Smart City Water Inc
All rights reserved.

***** D E T A I L E D O U T P U T *****

Input filename: C:\Program Files (x86)\Visual OTTHYMO 6.2\VO2\voin.dat
 Output filename: C:\Users\workstation\AppData\Local\Civica\XH5\d32691b7-9361-410b-808a-65824bdc2d5f
 \f09a3238-6a58-454c-9412-0fff94beed06\
 Summary filename: C:\Users\workstation\AppData\Local\Civica\XH5\d32691b7-9361-410b-808a-65824bdc2d5f
 \f09a3238-6a58-454c-9412-0fff94beed06\

DATE: 09-06-2023

TIME: 10:34:02

USER:

COMMENTS: _____

 ** SIMULATION : 5 Year Chicgo **

 | CHICAGO STORM | IDF curve parameters: A= 838.490
 | Ptotal= 43.99 mm | B= 3.750
 C= 0.776

 used in: INTENSITY = A / (t + B)^C
 Duration of storm = 3.00 hrs
 Storm time step = 10.00 min
 Time to peak ratio = 0.33

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.00	4.22	0.83	109.69	1.67	7.20	2.50	4.04
0.17	5.14	1.00	30.02	1.83	6.17	2.67	3.74
0.33	6.68	1.17	16.00	2.00	5.43	2.83	3.48
0.50	9.94	1.33	11.18	2.17	4.86		
0.67	23.00	1.50	8.71	2.33	4.41		

 | CALIB |
 | STANDHYD (0105) | Area (ha)= 0.29
 | ID= 1 DT= 2.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.29	0.00
Dep. Storage (mm)=	1.00	1.50
Average Slope (%)=	1.00	2.00
Length (m)=	43.82	2.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

----- TRANSFORMED HYETOGRAPH -----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.033	4.22	0.800	23.00	1.567	8.71	2.33	4.86
0.067	4.22	0.833	23.00	1.600	8.71	2.37	4.41
0.100	4.22	0.867	109.69	1.633	8.71	2.40	4.41
0.133	4.22	0.900	109.69	1.667	8.71	2.43	4.41
0.167	4.22	0.933	109.69	1.700	7.20	2.47	4.41
0.200	5.14	0.967	109.69	1.733	7.20	2.50	4.41
0.233	5.14	1.000	109.69	1.767	7.20	2.53	4.04
0.267	5.14	1.033	30.02	1.800	7.20	2.57	4.04
0.300	5.14	1.067	30.02	1.833	7.20	2.60	4.04
0.333	5.14	1.100	30.02	1.867	6.17	2.63	4.04
0.367	6.68	1.133	30.02	1.900	6.17	2.67	4.04
0.400	6.68	1.167	30.02	1.933	6.17	2.70	3.74
0.433	6.68	1.200	16.00	1.967	6.17	2.73	3.74
0.467	6.68	1.233	16.00	2.000	6.17	2.77	3.74
0.500	6.68	1.267	16.00	2.033	5.43	2.80	3.74
0.533	9.94	1.300	16.00	2.067	5.43	2.83	3.74
0.567	9.94	1.333	16.00	2.100	5.43	2.87	3.48
0.600	9.94	1.367	11.18	2.133	5.43	2.90	3.48
0.633	9.94	1.400	11.18	2.167	5.43	2.93	3.48
0.667	9.94	1.433	11.18	2.200	4.86	2.97	3.48
0.700	23.00	1.467	11.18	2.233	4.86	3.00	3.48
0.733	23.00	1.500	11.18	2.267	4.86		
0.767	23.00	1.533	8.71	2.300	4.86		


```

Max.Eff.Inten.(mm/hr)= 109.69 101.43
over (min) 5.00 2.00
Storage Coeff. (min)= 1.50 (ii) 1.68 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.46 0.59

PEAK FLOW (cms)= 0.09 0.00 *TOTALS*
TIME TO PEAK (hrs)= 1.00 1.00 0.087 (iii)
RUNOFF VOLUME (mm)= 42.99 37.87 42.93
TOTAL RAINFALL (mm)= 43.99 43.99 43.99
RUNOFF COEFFICIENT = 0.98 0.86 0.98

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| RESERVOIR( 1051) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 2.0 min |
-----
| OUTFLOW | STORAGE | OUTFLOW | STORAGE
| (cms) | (ha.m.) | (cms) | (ha.m.)
|-----|-----|-----|-----|
| 0.0000 | 0.0000 | 0.2300 | 0.0110
| 0.0510 | 0.0098 | 0.0000 | 0.0000
|-----|-----|-----|-----|
| AREA | QPEAK | TPEAK | R.V.
| (ha) | (cms) | (hrs) | (mm)
|-----|-----|-----|-----|
| INFLOW : ID= 2 ( 0105) | 0.288 | 0.087 | 1.00 | 42.93
| OUTFLOW: ID= 1 ( 1051) | 0.288 | 0.028 | 1.10 | 42.78
|-----|-----|-----|-----|
| PEAK FLOW REDUCTION [Qout/Qin] (%)= 32.48
| TIME SHIFT OF PEAK FLOW (min)= 6.00
| MAXIMUM STORAGE USED (ha.m.)= 0.0055
|-----|-----|-----|-----|

```

```

-----
| CALIB
| STANDHYD ( 0103) | Area (ha)= 0.38
| ID= 1 DT= 2.0 min | Total Imp (%)= 91.00 Dir. Conn. (%)= 91.00
|-----|-----|-----|-----|
| IMPERVIOUS | PERVIOUS (i)
| Surface Area (ha)= 0.35 0.03
| Dep. Storage (mm)= 1.00 5.00
| Average Slope (%)= 4.00 2.00
| Length (m)= 50.39 5.00
| Mannings n = 0.013 0.250
|-----|-----|-----|-----|

```

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

```

-----
| TRANSFORMED HYETOGRAPH
|-----|-----|-----|-----|
| TIME | RAIN | TIME | RAIN | TIME | RAIN | TIME | RAIN
| hrs | mm/hr | hrs | mm/hr | hrs | mm/hr | hrs | mm/hr
|-----|-----|-----|-----|-----|-----|-----|-----|
| 0.033 | 4.22 | 0.800 | 23.00 | 1.567 | 8.71 | 2.33 | 4.86
| 0.067 | 4.22 | 0.833 | 23.00 | 1.600 | 8.71 | 2.37 | 4.41
| 0.100 | 4.22 | 0.867 | 109.69 | 1.633 | 8.71 | 2.40 | 4.41
| 0.133 | 4.22 | 0.900 | 109.69 | 1.667 | 8.71 | 2.43 | 4.41
| 0.167 | 4.22 | 0.933 | 109.69 | 1.700 | 7.20 | 2.47 | 4.41
| 0.200 | 5.14 | 0.967 | 109.69 | 1.733 | 7.20 | 2.50 | 4.41
| 0.233 | 5.14 | 1.000 | 109.69 | 1.767 | 7.20 | 2.53 | 4.04
| 0.267 | 5.14 | 1.033 | 30.02 | 1.800 | 7.20 | 2.57 | 4.04
| 0.300 | 5.14 | 1.067 | 30.02 | 1.833 | 7.20 | 2.60 | 4.04
| 0.333 | 5.14 | 1.100 | 30.02 | 1.867 | 6.17 | 2.63 | 4.04
| 0.367 | 6.68 | 1.133 | 30.02 | 1.900 | 6.17 | 2.67 | 4.04
| 0.400 | 6.68 | 1.167 | 30.02 | 1.933 | 6.17 | 2.70 | 3.74
| 0.433 | 6.68 | 1.200 | 16.00 | 1.967 | 6.17 | 2.73 | 3.74
| 0.467 | 6.68 | 1.233 | 16.00 | 2.000 | 6.17 | 2.77 | 3.74
| 0.500 | 6.68 | 1.267 | 16.00 | 2.033 | 5.43 | 2.80 | 3.74
| 0.533 | 9.94 | 1.300 | 16.00 | 2.067 | 5.43 | 2.83 | 3.74
| 0.567 | 9.94 | 1.333 | 16.00 | 2.100 | 5.43 | 2.87 | 3.48
| 0.600 | 9.94 | 1.367 | 11.18 | 2.133 | 5.43 | 2.90 | 3.48
| 0.633 | 9.94 | 1.400 | 11.18 | 2.167 | 5.43 | 2.93 | 3.48
| 0.667 | 9.94 | 1.433 | 11.18 | 2.200 | 4.86 | 2.97 | 3.48
| 0.700 | 23.00 | 1.467 | 11.18 | 2.233 | 4.86 | 3.00 | 3.48
| 0.733 | 23.00 | 1.500 | 11.18 | 2.267 | 4.86 |
| 0.767 | 23.00 | 1.533 | 8.71 | 2.300 | 4.86 |
|-----|-----|-----|-----|-----|-----|-----|-----|

```

```

Max.Eff.Inten.(mm/hr)= 109.69 40.38
over (min) 5.00 2.00
Storage Coeff. (min)= 1.08 (ii) 1.85 (ii)

```

```

Unit Hyd. Tpeak (min)=      4.00      2.00
Unit Hyd. peak  (cms)=      0.50      0.56
                                     *TOTALS*
PEAK FLOW      (cms)=      0.11      0.01      0.111 (iii)
TIME TO PEAK   (hrs)=      1.00      1.00      1.00
RUNOFF VOLUME  (mm)=      42.99     18.13     40.75
TOTAL RAINFALL (mm)=      43.99     43.99     43.99
RUNOFF COEFFICIENT =      0.98      0.41      0.93

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0075) |
| 1 + 2 = 3 |
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
ID1= 1 ( 0103):  0.38  0.111  1.00  40.75
+ ID2= 2 ( 1051):  0.29  0.028  1.10  42.78
=====
ID = 3 ( 0075):  0.67  0.134  1.00  41.62

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 1031) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 2.0 min |
-----
          OUTFLOW   STORAGE | OUTFLOW   STORAGE
          (cms)     (ha.m.) | (cms)     (ha.m.)
0.0000   0.0000 | 0.0434   0.0160
0.0207   0.0099 | 0.0438   0.0167
0.0393   0.0127 | 0.0447   0.0183
0.0403   0.0130 | 0.0464   0.0225
0.0412   0.0135 | 0.0472   0.0265
0.0421   0.0143 | 0.0476   0.0298
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
INFLOW : ID= 2 ( 0075)  0.669  0.134  1.00  41.62
OUTFLOW: ID= 1 ( 1031)  0.669  0.035  1.40  41.44
-----
PEAK FLOW REDUCTION [Qout/Qin] (%) = 26.17
TIME SHIFT OF PEAK FLOW (min) = 24.00
MAXIMUM STORAGE USED (ha.m.) = 0.0121

```

```

-----
| CALIB
| STANDHYD ( 0104) | Area (ha)= 0.17
| ID= 1 DT= 2.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00
-----
          IMPERVIOUS   PERVIOUS (i)
Surface Area (ha)= 0.17 0.00
Dep. Storage (mm)= 1.00 1.50
Average Slope (%)= 1.00 2.00
Length (m)= 34.02 5.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

```

-----
          ---- TRANSFORMED HYETOGRAPH ----
          TIME RAIN | TIME RAIN | TIME RAIN | TIME RAIN
          hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs mm/hr
0.033 4.22 | 0.800 23.00 | 1.567 8.71 | 2.33 4.86
0.067 4.22 | 0.833 23.00 | 1.600 8.71 | 2.37 4.41
0.100 4.22 | 0.867 109.69 | 1.633 8.71 | 2.40 4.41
0.133 4.22 | 0.900 109.69 | 1.667 8.71 | 2.43 4.41
0.167 4.22 | 0.933 109.69 | 1.700 7.20 | 2.47 4.41
0.200 5.14 | 0.967 109.69 | 1.733 7.20 | 2.50 4.41
0.233 5.14 | 1.000 109.69 | 1.767 7.20 | 2.53 4.04
0.267 5.14 | 1.033 30.02 | 1.800 7.20 | 2.57 4.04
0.300 5.14 | 1.067 30.02 | 1.833 7.20 | 2.60 4.04
0.333 5.14 | 1.100 30.02 | 1.867 6.17 | 2.63 4.04
0.367 6.68 | 1.133 30.02 | 1.900 6.17 | 2.67 4.04
0.400 6.68 | 1.167 30.02 | 1.933 6.17 | 2.70 3.74
0.433 6.68 | 1.200 16.00 | 1.967 6.17 | 2.73 3.74
0.467 6.68 | 1.233 16.00 | 2.000 6.17 | 2.77 3.74

```

0.500	6.68	1.267	16.00	2.033	5.43	2.80	3.74
0.533	9.94	1.300	16.00	2.067	5.43	2.83	3.74
0.567	9.94	1.333	16.00	2.100	5.43	2.87	3.48
0.600	9.94	1.367	11.18	2.133	5.43	2.90	3.48
0.633	9.94	1.400	11.18	2.167	5.43	2.93	3.48
0.667	9.94	1.433	11.18	2.200	4.86	2.97	3.48
0.700	23.00	1.467	11.18	2.233	4.86	3.00	3.48
0.733	23.00	1.500	11.18	2.267	4.86		
0.767	23.00	1.533	8.71	2.300	4.86		

Max.Eff.Inten.(mm/hr)= 109.69 101.43
over (min) 5.00 2.00
Storage Coeff. (min)= 1.29 (ii) 1.60 (ii)
Unit Hyd. Tpeak (min)= 4.00 2.00
Unit Hyd. peak (cms)= 0.48 0.61

TOTALS

PEAK FLOW (cms)= 0.05 0.00 0.053 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 42.99 37.87 42.93
TOTAL RAINFALL (mm)= 43.99 43.99 43.99
RUNOFF COEFFICIENT = 0.98 0.86 0.98

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

| CALIB |
| STANDHYD (0102) | Area (ha)= 0.27
| ID= 1 DT= 2.0 min | Total Imp(%)= 82.00 Dir. Conn.(%)= 82.00

	IMPERVIOUS	PERVIOUS (i)
Surface Area (ha)=	0.22	0.05
Dep. Storage (mm)=	1.00	5.00
Average Slope (%)=	4.00	2.00
Length (m)=	42.50	5.00
Mannings n =	0.013	0.250

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

---- TRANSFORMED HYETOGRAPH ----

TIME	RAIN	TIME	RAIN	TIME	RAIN	TIME	RAIN
hrs	mm/hr	hrs	mm/hr	hrs	mm/hr	hrs	mm/hr
0.033	4.22	0.800	23.00	1.567	8.71	2.33	4.86
0.067	4.22	0.833	23.00	1.600	8.71	2.37	4.41
0.100	4.22	0.867	109.69	1.633	8.71	2.40	4.41
0.133	4.22	0.900	109.69	1.667	8.71	2.43	4.41
0.167	4.22	0.933	109.69	1.700	7.20	2.47	4.41
0.200	5.14	0.967	109.69	1.733	7.20	2.50	4.41
0.233	5.14	1.000	109.69	1.767	7.20	2.53	4.04
0.267	5.14	1.033	30.02	1.800	7.20	2.57	4.04
0.300	5.14	1.067	30.02	1.833	7.20	2.60	4.04
0.333	5.14	1.100	30.02	1.867	6.17	2.63	4.04
0.367	6.68	1.133	30.02	1.900	6.17	2.67	4.04
0.400	6.68	1.167	30.02	1.933	6.17	2.70	3.74
0.433	6.68	1.200	16.00	1.967	6.17	2.73	3.74
0.467	6.68	1.233	16.00	2.000	6.17	2.77	3.74
0.500	6.68	1.267	16.00	2.033	5.43	2.80	3.74
0.533	9.94	1.300	16.00	2.067	5.43	2.83	3.74
0.567	9.94	1.333	16.00	2.100	5.43	2.87	3.48
0.600	9.94	1.367	11.18	2.133	5.43	2.90	3.48
0.633	9.94	1.400	11.18	2.167	5.43	2.93	3.48
0.667	9.94	1.433	11.18	2.200	4.86	2.97	3.48
0.700	23.00	1.467	11.18	2.233	4.86	3.00	3.48
0.733	23.00	1.500	11.18	2.267	4.86		
0.767	23.00	1.533	8.71	2.300	4.86		

Max.Eff.Inten.(mm/hr)= 109.69 40.38
over (min) 5.00 4.00
Storage Coeff. (min)= 0.97 (ii) 2.04 (ii)
Unit Hyd. Tpeak (min)= 4.00 4.00
Unit Hyd. peak (cms)= 0.52 0.40

TOTALS

PEAK FLOW (cms)= 0.07 0.01 0.074 (iii)
TIME TO PEAK (hrs)= 1.00 1.00 1.00
RUNOFF VOLUME (mm)= 42.99 18.13 38.51
TOTAL RAINFALL (mm)= 43.99 43.99 43.99
RUNOFF COEFFICIENT = 0.98 0.41 0.88

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0010) |
| 1 + 2 = 3 |
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
ID1= 1 ( 0102): 0.27  0.074  1.00  38.51
+ ID2= 2 ( 0104): 0.17  0.053  1.00  42.93
=====
ID = 3 ( 0010): 0.44  0.127  1.00  40.23
  
```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| RESERVOIR( 1021) | OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 2.0 min |
-----
          OUTFLOW   STORAGE | OUTFLOW   STORAGE
          (cms)   (ha.m.) | (cms)   (ha.m.)
0.0000   0.0000 | 0.1100   0.0039
0.0770   0.0021 | 0.1110   0.0048
0.0920   0.0036 | 0.1130   0.0095
0.1070   0.0037 | 0.0000   0.0000

          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
INFLOW : ID= 2 ( 0010) 0.445  0.127  1.00  40.23
OUTFLOW: ID= 1 ( 1021) 0.445  0.090  1.03  40.22

          PEAK FLOW REDUCTION [Qout/Qin] (%) = 70.65
          TIME SHIFT OF PEAK FLOW (min) = 2.00
          MAXIMUM STORAGE USED (ha.m.) = 0.0034
  
```

```

-----
| CALIB |
| STANDHYD ( 0101) | Area (ha) = 0.09
| ID= 1 DT= 2.0 min | Total Imp (%) = 25.00 Dir. Conn. (%) = 25.00
-----
          IMPERVIOUS   PERVIOUS (i)
Surface Area (ha) = 0.02 0.07
Dep. Storage (mm) = 1.00 5.00
Average Slope (%) = 2.00 2.00
Length (m) = 24.18 25.00
Mannings n = 0.013 0.250
  
```

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

```

-----
          ---- TRANSFORMED HYETOGRAPH ----
          TIME RAIN | TIME RAIN | TIME RAIN | TIME RAIN
          hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs mm/hr
0.033 4.22 | 0.800 23.00 | 1.567 8.71 | 2.33 4.86
0.067 4.22 | 0.833 23.00 | 1.600 8.71 | 2.37 4.41
0.100 4.22 | 0.867 109.69 | 1.633 8.71 | 2.40 4.41
0.133 4.22 | 0.900 109.69 | 1.667 8.71 | 2.43 4.41
0.167 4.22 | 0.933 109.69 | 1.700 7.20 | 2.47 4.41
0.200 5.14 | 0.967 109.69 | 1.733 7.20 | 2.50 4.41
0.233 5.14 | 1.000 109.69 | 1.767 7.20 | 2.53 4.04
0.267 5.14 | 1.033 30.02 | 1.800 7.20 | 2.57 4.04
0.300 5.14 | 1.067 30.02 | 1.833 7.20 | 2.60 4.04
0.333 5.14 | 1.100 30.02 | 1.867 6.17 | 2.63 4.04
0.367 6.68 | 1.133 30.02 | 1.900 6.17 | 2.67 4.04
0.400 6.68 | 1.167 30.02 | 1.933 6.17 | 2.70 3.74
0.433 6.68 | 1.200 16.00 | 1.967 6.17 | 2.73 3.74
0.467 6.68 | 1.233 16.00 | 2.000 6.17 | 2.77 3.74
0.500 6.68 | 1.267 16.00 | 2.033 5.43 | 2.80 3.74
0.533 9.94 | 1.300 16.00 | 2.067 5.43 | 2.83 3.74
0.567 9.94 | 1.333 16.00 | 2.100 5.43 | 2.87 3.48
0.600 9.94 | 1.367 11.18 | 2.133 5.43 | 2.90 3.48
0.633 9.94 | 1.400 11.18 | 2.167 5.43 | 2.93 3.48
0.667 9.94 | 1.433 11.18 | 2.200 4.86 | 2.97 3.48
0.700 23.00 | 1.467 11.18 | 2.233 4.86 | 3.00 3.48
0.733 23.00 | 1.500 11.18 | 2.267 4.86 |
0.767 23.00 | 1.533 8.71 | 2.300 4.86 |
  
```

```

Max.Eff.Inten.(mm/hr)= 109.69 40.38
                    over (min) 5.00 10.00
Storage Coeff. (min)= 0.85 (ii) 8.81 (ii)
Unit Hyd. Tpeak (min)= 4.00 10.00
Unit Hyd. peak (cms)= 0.53 0.12

                    *TOTALS*
PEAK FLOW (cms)= 0.01 0.00 0.010 (iii)
TIME TO PEAK (hrs)= 1.00 1.13 1.00
RUNOFF VOLUME (mm)= 42.99 18.13 24.29
TOTAL RAINFALL (mm)= 43.99 43.99 43.99
RUNOFF COEFFICIENT = 0.98 0.41 0.55

```

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 85.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| ADD HYD ( 0074) |
| 1 + 2 = 3 |
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
-----
ID1= 1 ( 0101): 0.09 0.010 1.00 24.29
+ ID2= 2 ( 1021): 0.44 0.090 1.03 40.22
=====
ID = 3 ( 0074): 0.53 0.099 1.03 37.60

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| ADD HYD ( 0074) |
| 3 + 2 = 1 |
-----
          AREA   QPEAK   TPEAK   R.V.
          (ha)   (cms)   (hrs)   (mm)
-----
ID1= 3 ( 0074): 0.53 0.099 1.03 37.60
+ ID2= 2 ( 1031): 0.67 0.035 1.40 41.44
=====
ID = 1 ( 0074): 1.20 0.117 1.03 39.74

```

NOTE: PEAK FLOWS DO NOT INCLUDE BASEFLOWS IF ANY.

```

-----
| CALIB |
| STANDHYD ( 0106) | Area (ha)= 0.07
| ID= 1 DT= 2.0 min | Total Imp(%)= 99.00 Dir. Conn.(%)= 99.00
-----
          IMPERVIOUS   PERVIOUS (i)
Surface Area (ha)= 0.07 0.00
Dep. Storage (mm)= 1.00 1.50
Average Slope (%)= 1.00 2.00
Length (m)= 21.56 5.00
Mannings n = 0.013 0.250

```

NOTE: RAINFALL WAS TRANSFORMED TO 2.0 MIN. TIME STEP.

```

----- TRANSFORMED HYETOGRAPH -----
TIME RAIN | TIME RAIN | TIME RAIN | TIME RAIN
hrs mm/hr | hrs mm/hr | hrs mm/hr | hrs mm/hr
-----
0.033 4.22 | 0.800 23.00 | 1.567 8.71 | 2.33 4.86
0.067 4.22 | 0.833 23.00 | 1.600 8.71 | 2.37 4.41
0.100 4.22 | 0.867 109.69 | 1.633 8.71 | 2.40 4.41
0.133 4.22 | 0.900 109.69 | 1.667 8.71 | 2.43 4.41
0.167 4.22 | 0.933 109.69 | 1.700 7.20 | 2.47 4.41
0.200 5.14 | 0.967 109.69 | 1.733 7.20 | 2.50 4.41
0.233 5.14 | 1.000 109.69 | 1.767 7.20 | 2.53 4.04
0.267 5.14 | 1.033 30.02 | 1.800 7.20 | 2.57 4.04
0.300 5.14 | 1.067 30.02 | 1.833 7.20 | 2.60 4.04
0.333 5.14 | 1.100 30.02 | 1.867 6.17 | 2.63 4.04
0.367 6.68 | 1.133 30.02 | 1.900 6.17 | 2.67 4.04
0.400 6.68 | 1.167 30.02 | 1.933 6.17 | 2.70 3.74
0.433 6.68 | 1.200 16.00 | 1.967 6.17 | 2.73 3.74
0.467 6.68 | 1.233 16.00 | 2.000 6.17 | 2.77 3.74
0.500 6.68 | 1.267 16.00 | 2.033 5.43 | 2.80 3.74
0.533 9.94 | 1.300 16.00 | 2.067 5.43 | 2.83 3.74
0.567 9.94 | 1.333 16.00 | 2.100 5.43 | 2.87 3.48
0.600 9.94 | 1.367 11.18 | 2.133 5.43 | 2.90 3.48
0.633 9.94 | 1.400 11.18 | 2.167 5.43 | 2.93 3.48
0.667 9.94 | 1.433 11.18 | 2.200 4.86 | 2.97 3.48
0.700 23.00 | 1.467 11.18 | 2.233 4.86 | 3.00 3.48

```

	0.733	23.00		1.500	11.18		2.267	4.86	
	0.767	23.00		1.533	8.71		2.300	4.86	
Max.Eff.Inten.(mm/hr)=				109.69			101.43		
over (min)				5.00			2.00		
Storage Coeff. (min)=				0.98 (ii)			1.29 (ii)		
Unit Hyd. Tpeak (min)=				4.00			2.00		
Unit Hyd. peak (cms)=				0.52			0.67		
									TOTALS
PEAK FLOW (cms)=				0.02			0.00		0.021 (iii)
TIME TO PEAK (hrs)=				1.00			1.00		1.00
RUNOFF VOLUME (mm)=				42.99			37.87		42.92
TOTAL RAINFALL (mm)=				43.99			43.99		43.99
RUNOFF COEFFICIENT =				0.98			0.86		0.98

***** WARNING: STORAGE COEFF. IS SMALLER THAN TIME STEP!

- (i) CN PROCEDURE SELECTED FOR PERVIOUS LOSSES:
CN* = 98.0 Ia = Dep. Storage (Above)
- (ii) TIME STEP (DT) SHOULD BE SMALLER OR EQUAL
THAN THE STORAGE COEFFICIENT.
- (iii) PEAK FLOW DOES NOT INCLUDE BASEFLOW IF ANY.

```

-----
| RESERVOIR( 1061)| OVERFLOW IS OFF
| IN= 2---> OUT= 1 |
| DT= 2.0 min |
-----

```

	OUTFLOW	STORAGE		OUTFLOW	STORAGE
	(cms)	(ha.m.)		(cms)	(ha.m.)
	0.0000	0.0000		0.0300	0.0040
	0.0030	0.0035		0.0000	0.0000

	AREA	QPEAK	TPEAK	R.V.
	(ha)	(cms)	(hrs)	(mm)
INFLOW : ID= 2 (0106)	0.070	0.021	1.00	42.92
OUTFLOW: ID= 1 (1061)	0.070	0.002	1.57	38.68

PEAK FLOW REDUCTION [Qout/Qin](%)=	8.27
TIME SHIFT OF PEAK FLOW (min)=	34.00
MAXIMUM STORAGE USED (ha.m.)=	0.0020

```

-----
FINISH
=====
=====

```




APPENDIX F

**QUALITY CONTROL DEVICE
SPECIFICATIONS**



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION
BASED ON THE RATIONAL RAINFALL METHOD
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



Project Name: 2360 Bristol Circle	Engineer: Husson Engineering + Management
Location: Oakville	Contact: Greg Rapp
OGS #: OGS 101	Report Date: 5-Sep-23

Area	0.45 ha	Rainfall Station #	204
Weighted C	0.9	Particle Size Distribution	FINE
CDS Model	2015-4	CDS Treatment Capacity	20 l/s

<u>Rainfall Intensity¹</u> (mm/hr)	<u>Percent Rainfall Volume¹</u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (l/s)</u>	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.4%	9.4%	0.6	0.6	2.8	98.0	9.2
1.0	11.0%	20.4%	1.1	1.1	5.7	97.2	10.7
1.5	10.1%	30.5%	1.7	1.7	8.5	96.4	9.7
2.0	9.6%	40.1%	2.3	2.3	11.4	95.6	9.2
2.5	7.9%	48.0%	2.8	2.8	14.2	94.8	7.5
3.0	6.4%	54.4%	3.4	3.4	17.0	94.0	6.0
3.5	4.4%	58.8%	3.9	3.9	19.9	93.2	4.1
4.0	4.2%	63.0%	4.5	4.5	22.7	92.3	3.9
4.5	3.7%	66.7%	5.1	5.1	25.6	91.5	3.4
5.0	3.3%	70.0%	5.6	5.6	28.4	90.7	3.0
6.0	5.6%	75.6%	6.8	6.8	34.1	89.1	4.9
7.0	4.0%	79.6%	7.9	7.9	39.8	87.5	3.5
8.0	3.5%	83.1%	9.0	9.0	45.4	85.8	3.0
9.0	2.2%	85.3%	10.1	10.1	51.1	84.2	1.9
10.0	1.7%	87.0%	11.3	11.3	56.8	82.6	1.4
15.0	6.3%	93.3%	16.9	16.9	85.2	74.4	4.7
20.0	2.3%	95.6%	22.5	19.8	100.0	61.8	1.4
25.0	1.8%	97.3%	28.1	19.8	100.0	49.4	0.9
30.0	0.8%	98.2%	33.8	19.8	100.0	41.2	0.3
35.0	0.9%	99.0%	39.4	19.8	100.0	35.3	0.3
40.0	0.3%	99.3%	45.0	19.8	100.0	30.9	0.1
45.0	0.5%	99.8%	50.7	19.8	100.0	27.5	0.1
50.0	0.2%	100.0%	56.3	19.8	100.0	24.7	0.0

89.3

Removal Efficiency Adjustment² = 6.5%

Predicted Net Annual Load Removal Efficiency = 82.8%

Predicted % Annual Rainfall Treated = 97.9%



- 1 - Based on 44 years of hourly rainfall data from Canadian Station 6158733, Toronto ON (Airport)
 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
 3 - CDS Efficiency based on testing conducted at the University of Central Florida
 4 - CDS design flowrate and scaling based on standard manufacturer model & product specifications

CDS PMSU2015-4-C DESIGN NOTES

THE STANDARD CDS PMSU2015-4-C CONFIGURATION IS SHOWN. ALTERNATE CONFIGURATIONS ARE AVAILABLE AND ARE LISTED BELOW. SOME CONFIGURATIONS MAY BE COMBINED TO SUIT SITE REQUIREMENTS.

CONFIGURATION DESCRIPTION


- GRATED INLET ONLY (NO INLET PIPE)
- GRATED INLET WITH INLET PIPE OR PIPES
- CURB INLET ONLY (NO INLET PIPE)
- CURB INLET WITH INLET PIPE OR PIPES
- CUSTOMIZABLE SUMP DEPTH AVAILABLE
- ANTI-FLOTATION DESIGN AVAILABLE UPON REQUEST

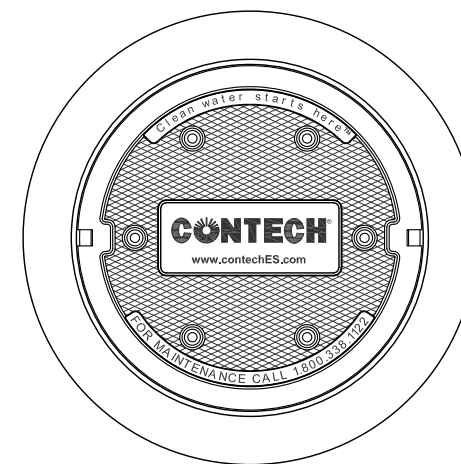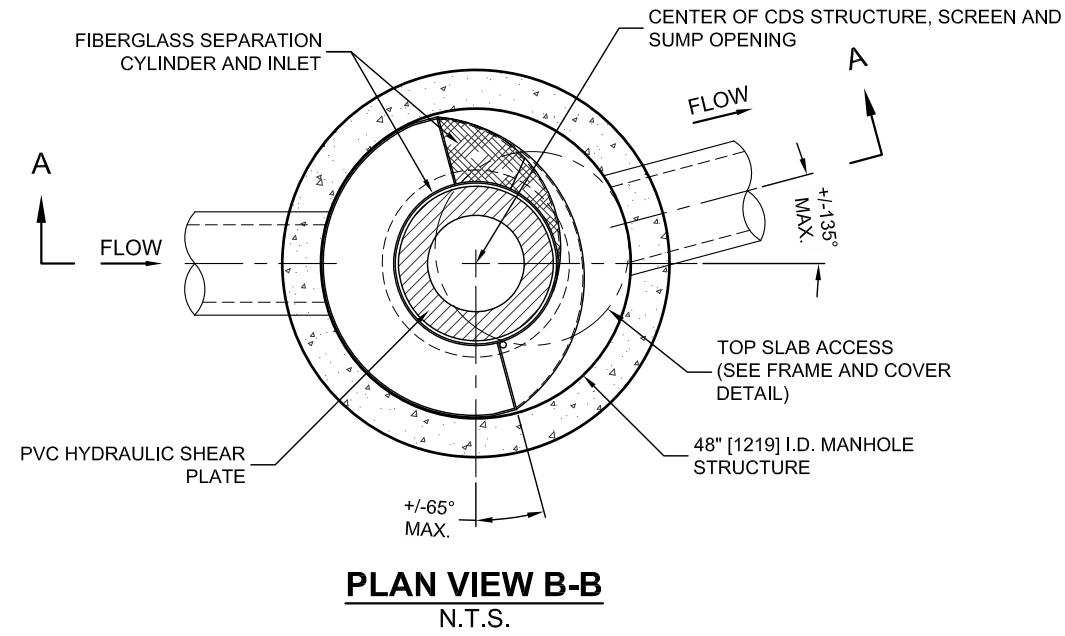

FRAME AND COVER
(DIAMETER VARIES)
N.T.S.

SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID				
WATER QUALITY FLOW RATE (CFS OR L/s)				*
PEAK FLOW RATE (CFS OR L/s)				*
RETURN PERIOD OF PEAK FLOW (YRS)				*
SCREEN APERTURE (2400 OR 4700)				*
PIPE DATA:	I.E.	MATERIAL	DIAMETER	
INLET PIPE 1	*	*	*	
INLET PIPE 2	*	*	*	
OUTLET PIPE	*	*	*	
RIM ELEVATION				*
ANTI-FLOTATION BALLAST	*	*	*	*
NOTES/SPECIAL REQUIREMENTS:				
* PER ENGINEER OF RECORD				

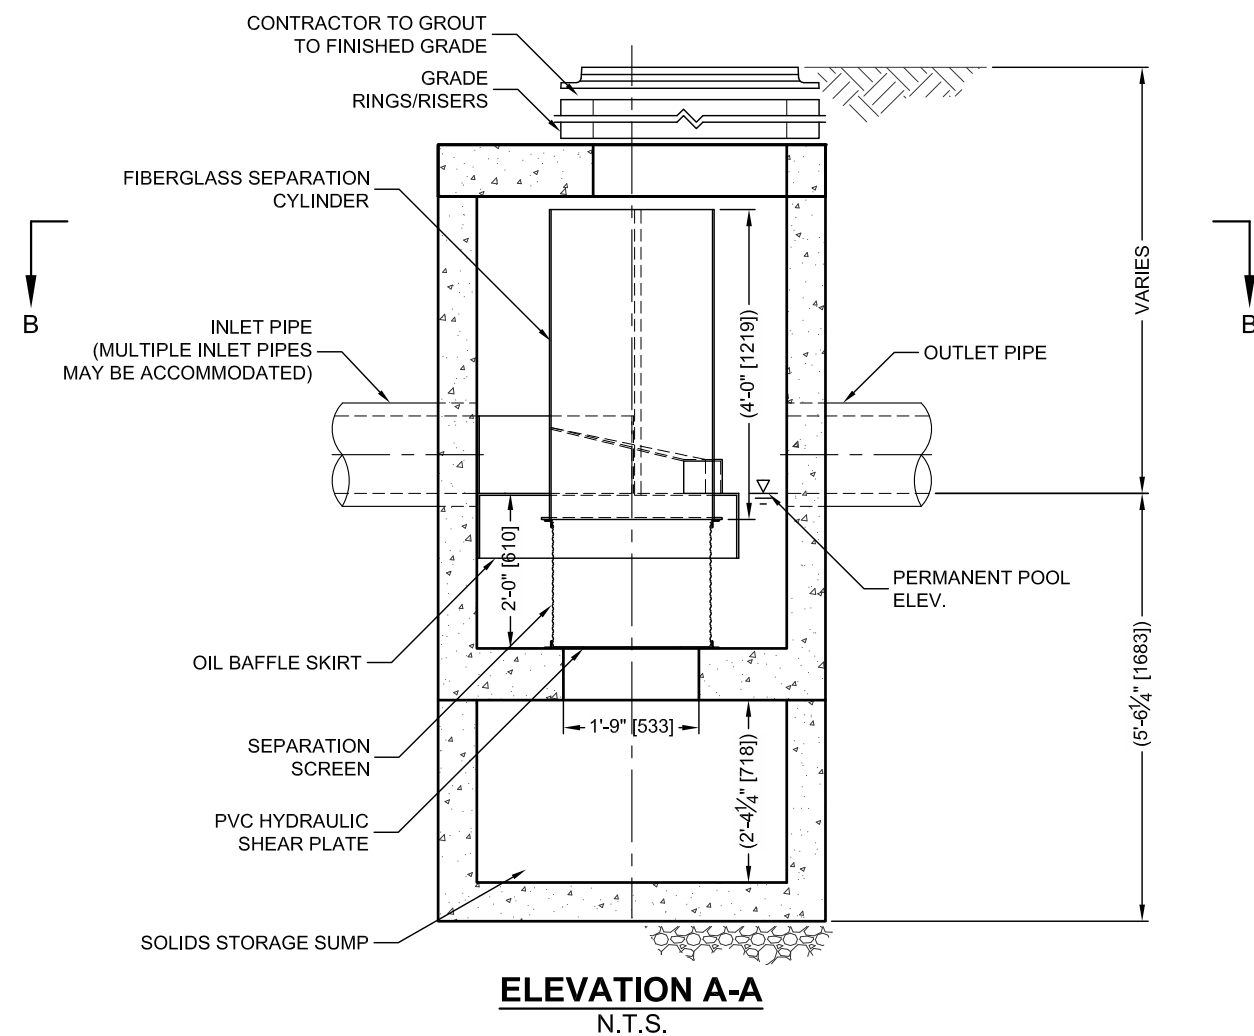

GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH () ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. www.contechES.com
4. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
5. STRUCTURE SHALL MEET AASHTO HS20 AND CASTINGS SHALL MEET HS20 (AASHTO M 306) LOAD RATING, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION.
6. PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS NECESSARY DURING MAINTENANCE CLEANING.

INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE (LIFTING CLUTCHES PROVIDED).
- C. CONTRACTOR TO ADD JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS, AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM. IT IS SUGGESTED THAT ALL JOINTS BELOW PIPE INVERTS ARE GROUTED.

CONTECH
ENGINEERED SOLUTIONS LLC

www.contechES.com
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069
800-338-1122 513-645-7000 513-645-7993 FAX

CDS PMSU2015-4-C
INLINE CDS
STANDARD DETAIL



THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 6,788,848; 6,841,722; 6,911,502; 6,981,783; RELATED FOREIGN PATENTS, OR OTHER PATENT PENDING.



**CDS ESTIMATED NET ANNUAL SOLIDS LOAD REDUCTION
BASED ON THE RATIONAL RAINFALL METHOD
BASED ON A FINE PARTICLE SIZE DISTRIBUTION**



Project Name: 2360 Bristol Circle	Engineer: Husson Engineering + Management
Location: Oakville	Contact: Greg Rapp
OGS #: OGS 102	Report Date: 1-Sep-23

Area	0.67 ha	Rainfall Station #	204
Weighted C	0.9	Particle Size Distribution	FINE
CDS Model	2020	CDS Treatment Capacity	31 l/s


<u>Rainfall Intensity¹</u> (mm/hr)	<u>Percent Rainfall Volume¹</u>	<u>Cumulative Rainfall Volume</u>	<u>Total Flowrate (l/s)</u>	<u>Treated Flowrate (l/s)</u>	<u>Operating Rate (%)</u>	<u>Removal Efficiency (%)</u>	<u>Incremental Removal (%)</u>
0.5	9.4%	9.4%	0.8	0.8	2.7	98.1	9.2
1.0	11.0%	20.4%	1.7	1.7	5.4	97.3	10.7
1.5	10.1%	30.5%	2.5	2.5	8.1	96.5	9.7
2.0	9.6%	40.1%	3.4	3.4	10.8	95.8	9.2
2.5	7.9%	48.0%	4.2	4.2	13.5	95.0	7.5
3.0	6.4%	54.4%	5.0	5.0	16.1	94.2	6.0
3.5	4.4%	58.8%	5.9	5.9	18.8	93.5	4.1
4.0	4.2%	63.0%	6.7	6.7	21.5	92.7	3.9
4.5	3.7%	66.7%	7.5	7.5	24.2	91.9	3.4
5.0	3.3%	70.0%	8.4	8.4	26.9	91.1	3.0
6.0	5.6%	75.6%	10.1	10.1	32.3	89.6	5.0
7.0	4.0%	79.6%	11.7	11.7	37.7	88.1	3.6
8.0	3.5%	83.1%	13.4	13.4	43.0	86.5	3.0
9.0	2.2%	85.3%	15.1	15.1	48.4	85.0	1.9
10.0	1.7%	87.0%	16.8	16.8	53.8	83.4	1.4
15.0	6.3%	93.3%	25.1	25.1	80.7	75.7	4.8
20.0	2.3%	95.6%	33.5	31.2	100.0	65.2	1.5
25.0	1.8%	97.3%	41.9	31.2	100.0	52.2	0.9
30.0	0.8%	98.2%	50.3	31.2	100.0	43.5	0.4
35.0	0.9%	99.0%	58.7	31.2	100.0	37.3	0.3
40.0	0.3%	99.3%	67.1	31.2	100.0	32.6	0.1
45.0	0.5%	99.8%	75.4	31.2	100.0	29.0	0.1
50.0	0.2%	100.0%	83.8	31.2	100.0	26.1	0.0

89.8


Removal Efficiency Adjustment² = 6.5%
Predicted Net Annual Load Removal Efficiency = 83.3%
Predicted % Annual Rainfall Treated = 98.1%

1 - Based on 44 years of hourly rainfall data from Canadian Station 6158733, Toronto ON (Airport)
 2 - Reduction due to use of 60-minute data for a site that has a time of concentration less than 30-minutes.
 3 - CDS Efficiency based on testing conducted at the University of Central Florida
 4 - CDS design flowrate and scaling based on standard manufacturer model & product specifications

C:\USERS\HUDA.ECHELON\VIDEODOCUMENTS\START ITEMS\PMSU SAMPLE DRAWINGS\CDS2020-5-C-DTL.DWG 5/29/2022 11:50 PM

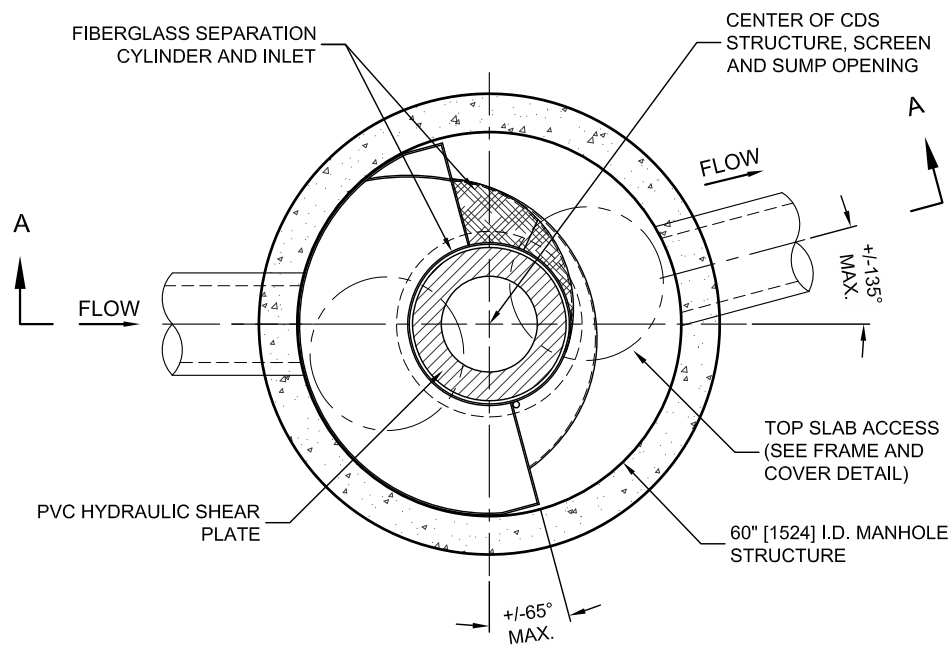

PLAN VIEW B-B
N.T.S.

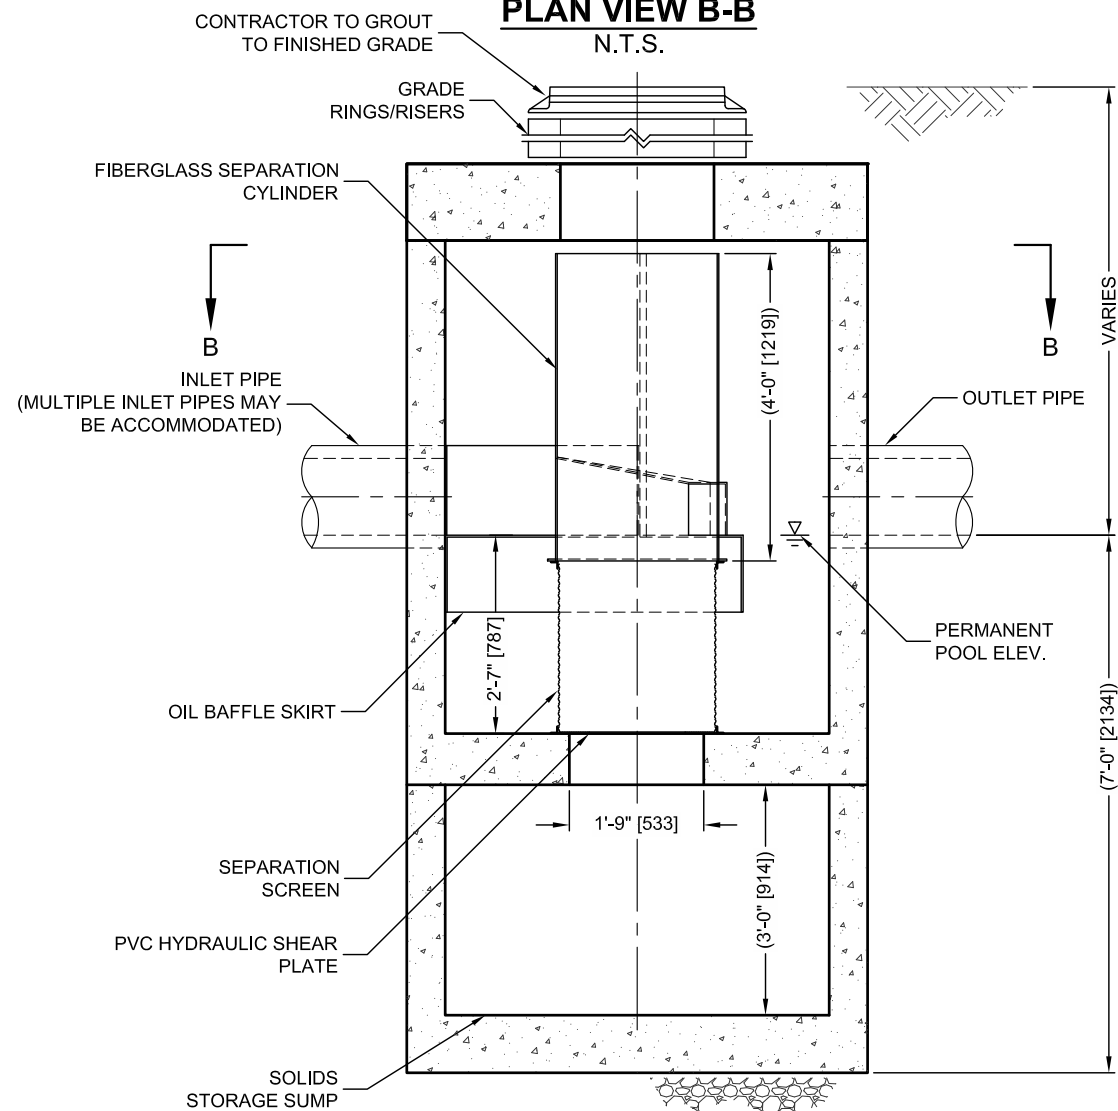

ELEVATION A-A
N.T.S.




THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 6,788,848; 6,841,722; 6,911,502; 6,981,783; RELATED FOREIGN PATENTS, OR OTHER PATENTS PENDING.

CDS PMSU2020-5-C DESIGN NOTES

THE STANDARD CDS PMSU2020-5-C CONFIGURATION IS SHOWN. ALTERNATE CONFIGURATIONS ARE AVAILABLE AND ARE LISTED BELOW. SOME CONFIGURATIONS MAY BE COMBINED TO SUIT SITE REQUIREMENTS.

CONFIGURATION DESCRIPTION

- GRATED INLET ONLY (NO INLET PIPE)
- GRATED INLET WITH INLET PIPE OR PIPES
- CURB INLET ONLY (NO INLET PIPE)
- CURB INLET WITH INLET PIPE OR PIPES
- CUSTOMIZABLE SUMP DEPTH AVAILABLE
- ANTI-FLOTATION DESIGN AVAILABLE UPON REQUEST

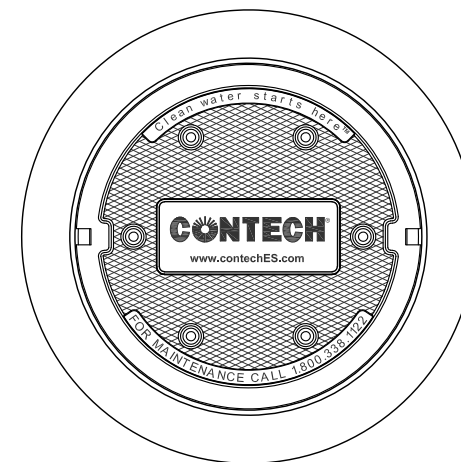

FRAME AND COVER
(DIAMETER VARIES)
N.T.S.

SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID				
WATER QUALITY FLOW RATE (CFS OR L/s)				*
PEAK FLOW RATE (CFS OR L/s)				*
RETURN PERIOD OF PEAK FLOW (YRS)				*
SCREEN APERTURE (2400 OR 4700)				*
PIPE DATA:	I.E.	MATERIAL	DIAMETER	
INLET PIPE 1	*	*	*	
INLET PIPE 2	*	*	*	
OUTLET PIPE	*	*	*	
RIM ELEVATION				*
ANTI-FLOTATION BALLAST	WIDTH	HEIGHT		
	*	*		
NOTES/SPECIAL REQUIREMENTS:				
* PER ENGINEER OF RECORD				

GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH () ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH ENGINEERED SOLUTIONS LLC REPRESENTATIVE. www.contechES.com
4. CDS WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING.
5. STRUCTURE SHALL MEET AASHTO HS20 AND CASTINGS SHALL MEET HS20 (AASHTO M 306) LOAD RATING, ASSUMING GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION.
6. PVC HYDRAULIC SHEAR PLATE IS PLACED ON SHELF AT BOTTOM OF SCREEN CYLINDER. REMOVE AND REPLACE AS NECESSARY DURING MAINTENANCE CLEANING.

INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE CDS MANHOLE STRUCTURE (LIFTING CLUTCHES PROVIDED).
- C. CONTRACTOR TO ADD JOINT SEALANT BETWEEN ALL STRUCTURE SECTIONS, AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH PIPE INVERTS WITH ELEVATIONS SHOWN.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO ASSURE UNIT IS WATER TIGHT, HOLDING WATER TO FLOWLINE INVERT MINIMUM. IT IS SUGGESTED THAT ALL JOINTS BELOW PIPE INVERTS ARE GROUTED.



9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069
800-338-1122 513-645-7000 513-645-7993 FAX

**CDS PMSU2020-5-C
INLINE CDS
STANDARD DETAIL**